

STORMWATER POLLUTION PREVENTION PLAN

FOR

SHEFFIELD GARDENS

NYS Route 17K

**TOWN OF MONTGOMERY
ORANGE COUNTY, NEW YORK**

PREPARED BY



**71 Clinton Street
Montgomery, NY 12549**

**JANUARY 2024
REVISED DECEMBER 2025**

TABLE OF CONTENTS

SECTION	PAGE
1.0 INTRODUCTION	3
1.1 PURPOSE.....	3
1.2 SCOPE.....	3
2.0 PROJECT DESCRIPTION.....	3
3.0 TOPOGRAPHY AND SOILS	4
4.0 METHODOLOGY.....	4
5.0 ARCHEOLOGY.....	5
6.0 STORMWATER MANAGEMENT PLANNING	6
6.1 INITIAL SITE PLANNING	6
6.1.1 EXISTING CONDITIONS	7
6.1.2 PROPOSED CONDITIONS	8
6.2 WATER QUALITY VOLUME.....	13
6.3 RUNOFF REDUCTION VOLUME	14
6.4 APPLICATION OF STANDARD SMP'S FOR THE REVISED WQV	17
6.5 VOLUME AND PEAK RATE CONTROL	17
6.5.1 CHANNEL PROTECTION VOLUME	18
6.5.2 PEAK RATE CONTROL.....	18
6.6 SOIL RESTORATION	20
7.0 EROSION AND SEDIMENT CONTROL MEASURES.....	21
8.0 LONG TERM MAINTENANCE OF WATER QUALITY FEATURES	23
9.0 SUMMARY OF FINDINGS AND CONCLUSIONS.....	24

TABLES

<i>TABLE 1: EXISTING DRAINAGE AREA CHARACTERISTICS</i>	<i>8</i>
<i>TABLE 2: PROPOSED DRAINAGE AREA CHARACTERISTICS.....</i>	<i>13</i>
<i>TABLE 3: REQUIRED WATER QUALITY VOLUMES.....</i>	<i>13</i>
<i>TABLE 4: SPECIFIC REDUCTION FACTOR (S)*</i>	<i>16</i>
<i>TABLE 5: RUNOFF REDUCTION VOLUMES & REVISED WQV.....</i>	<i>17</i>
<i>TABLE 6: WQV PROVIDED IN STANDARD SMP'S.....</i>	<i>17</i>
<i>TABLE 7: CPV EXTENDED DETENTION TIMES.....</i>	<i>18</i>
<i>TABLE 8: SUMMARY OF RESULTS AT THE DESIGN POINTS.....</i>	<i>19</i>
<i>TABLE 9: SOIL RESTORATION REQUIREMENTS</i>	<i>20</i>

APPENDICES

APPENDIX 1: FIGURES

APPENDIX 2: SOILS MAP AND CLASSIFICATIONS

APPENDIX 3: GEOTECHNICAL TEST PIT DATA

APPENDIX 4: CURVE NUMBER CALCULATIONS

APPENDIX 5: TIME OF CONCENTRATION CALCULATIONS

APPENDIX 6: WATER QUALITY VOLUME CALCULATIONS & RUNOFF REDUCTION
VOLUME CALCULATIONS

APPENDIX 7: HYDROGRAPH SUMMARIES & DIAGRAMS

APPENDIX 8: 1 – YEAR DESIGN STORM HYDROGRAPHS

APPENDIX 9: 10 – YEAR DESIGN STORM HYDROGRAPHS

APPENDIX 10: 100 – YEAR DESIGN STORM HYDROGRAPHS

APPENDIX 11: 500 – YEAR DESIGN STORM HYDROGRAPHS

APPENDIX 12: RESERVOIR REPORTS & CPv CALCULATIONS

APPENDIX 13: FOREBAY AND WQv CALCULATIONS

APPENDIX 14: DRAINAGE PIPE CALCULATIONS

APPENDIX 15: CONSTRUCTION SITE INSPECTION FORM, NOTICE OF INTENT & MS4
ACCEPTANCE

APPENDIX 16: CONSTRUCTION WASTE MANAGEMENT & SPILL PREVENTION PLANS

APPENDIX 17: NYSOPRHP LETTER AND PHASE 1 ARCHAEOLOGICAL INVESTIGATION

1.0 INTRODUCTION

Engineering & Surveying Properties, PC (EP) prepared this report summarizing the impact of the proposed development of the property, known as Sheffield Gardens, will have on downstream properties and receiving waters.

1.1 PURPOSE

The purpose of the Stormwater Pollution Prevention Plan (SWPPP) is to:

- a. Maintain existing drainage patterns as much as possible and continue the conveyance of upland watershed runoff;
- b. Mitigate increases in stormwater runoff resulting from the proposed development without adversely affecting downstream conditions;
- c. Mitigate potential stormwater impacts and prevent soil erosion and sedimentation resulting from stormwater runoff.

1.2 SCOPE

The scope of the SWPPP for Sheffield Gardens described herein is as follows:

- a) Describe and estimate existing stormwater runoff conditions;
- b) Describe and estimate proposed stormwater runoff conditions;
- c) Describe and evaluate stormwater management facilities planned as part of the proposed development.

2.0 PROJECT DESCRIPTION

The Sheffield Gardens project site is 52.42± acres in size and is located off NYS Route 17K in the Town of Montgomery in Orange County, New York. Local tax maps identify the Site as Town of Montgomery tax lots 29 – 1 – 5.1, 5.2, 5.3, 5.4, & 5.5. A site location map is included as Figure 1 in Appendix 1.

The proposed action, known as Sheffield Gardens, consists of three residential buildings with a total of 261 apartment units. Access to the site will be from new driveway entrances located on NYS Route 17K. The project proposes 669 parking spaces for apartment residents, employees, and guests.

The project site is a rectangular shaped area of land. The existing site cover consists of mostly high canopy forest.

3.0 TOPOGRAPHY AND SOILS

The existing topography in the Sheffield Gardens project area varies across the site, ranging from approximately 389 feet above mean sea level (AMSL) to 451 feet AMSL. Most of the slopes ($\pm 77\%$) on the project site are gently sloped (0%-15%), and moderate sloped areas (15%-25%) consist of approximately 20.6% of the site. The area of significant slope $>25\%$ consist of approximately 2.4% of the site. The Project Site contains eight different soil groups according to the Soil Survey of Orange County, New York. The on-site soil groups include various series complexes including Canandaigua silt loam (Ca), Erie gravelly silt loam (ErB), Pittsfield gravelly loam (PtB, PtC, & PtD), and Udorthents (UH) soils. These soils are considered to be a part of the "A", "B" & "D" hydrologic soils group. A soil map is included in Appendix 2. Our office conducted exploratory geotechnical testing, areas of Pittsfield gravelly loam (PtB, PtC & PtD) are more consistent with soils which are considered to be classified as hydrologic soil group D. Test pit locations and data are included in Appendix 3.

4.0 METHODOLOGY

The methodology utilized for this analysis is based upon the U.S.D.A. Soil Conservation Service's Technical Release No. 20 and Technical Release No. 55, as utilized by the software entitled Hydraflow Hydrographs.

Hydraflow Hydrographs, developed by Intelisolve of Alpharetta, Georgia, is a Microsoft Windows based program for analyzing the hydrology and hydraulics of stormwater runoff. It utilizes the latest techniques to predict the stormwater flows from any given storm event.

Hydraflow Hydrographs has the capability of computing hydrographs (representing discharge rates characteristic of specific watershed conditions, precipitation, and geologic factors), combining hydrographs, and routing flows through pipes, streams and ponds. A drainage model can consist of four different components - subareas, combinations, reaches and reservoirs.

A subarea consists of a relatively homogeneous area of land, which produces a volume and rate of runoff unique to that watershed. A subarea combination is the hydrologic addition of two subareas in order to determine the peak runoff at a design point. A reach is a channelized conveyance structure which routes the runoff from one

point to another. A reservoir consists of a natural or man-made impoundment which temporarily stores stormwater runoff and that empties in a manner determined by various hydraulic structures located at its outlet.

This Stormwater Pollution Prevention Plan was based upon the New York State Stormwater Management Design Manual published by the New York State Department of Environmental Conservation (NYSDEC). Criteria set forth by this manual, requires analysis and determination of the required Water Quality Volume (WQv), to provide extended detention of the 1-year storm event for Stream Channel Protection (Cpv), to control the peak discharge of the 10-year storm event also known as Overbank Flood Protection Criteria (Qp), and to control the peak discharge and safely pass the 100-year storm event otherwise known as Extreme Flood Control Criteria (Qf).

The Stormwater Pollution Prevention Plan was developed by utilizing the “five-step” process for Stormwater Site Planning and Practice Selection. The five steps consists of site planning, determination of the water quality treatment volume, runoff reduction volumes applied through the use of “green technologies”, application of standard stormwater management practices (SMP’s) for remaining water quality volumes, and application of volume and peak rate control methods as required. Each of the five “steps” is further discussed in detail within this report.

5.0 ARCHEOLOGY

A letter dated March 14, 2023 was received from NYSOPRHP in response to the Notice of Intent for Designation of Lead Agency regarding the Proposed Action from the Town Planning Board. The letter stated “[t]he project is in an archaeologically sensitive area. Therefore, the State Historic Preservation Office/Office of Parks, Recreation and Historic Preservation (SHPO/OPRHP) recommends a Phase IA/IB archaeological survey for components of the project that will involve ground disturbance, unless substantial prior ground disturbance can be documented. A Phase IA/IB survey is designed to determine the presence or absence of archaeological sites or other cultural resources in the project's Area of Potential Effects (APE)”. Based on a letter dated December 4th, 2023 it was determined there was no-impact to cultural resources. Letter is attached in Appendix 17.

Between April 2 and July 19, 2023, TRACKER Archaeology Inc. prepared a Phase 1A literature review & sensitivity analysis and a Phase 1B archaeological field survey for the Project Site. The Area of Potential Effect (APE) consists of approximately 41 acres of the larger 53-acre Project Site and excludes the wetlands.

According to the Phase 1A Analysis, there are two prehistoric sites located within a one-mile radius of the Project area. Furthermore, the APE is located near the Wallkill River and contains level to steeply sloped terrain with well-drained soil. Given these findings, the study area was determined to have an above average potential for the recovery of prehistoric sites such as a procurement/processing site from any of the prehistoric periods.

A historic site file search of a one-mile radius around the study area found two historic sites: (1) the Fowler Site (NYSHPO 7112.000323) a mid-19th century farm occupation with stone well, stone house foundation with mixed 19th-20th century artifacts, located 534 feet from the APE and (2) the Hadden House foundation from the late 18th to late 19th century, with other assorted artifacts. Based on this evidence, the project area was determined to have a higher-than-average potential for the recovery of historic sites.

6.0 STORMWATER MANAGEMENT PLANNING

6.1 INITIAL SITE PLANNING

Development of the proposed site plan within the “site planning” process was an iterative process with different conceptual layouts developed for the project site. During the planning process with the applicant, the current proposed plan was developed after careful consideration of many planning techniques and environmental impacts. The proposed site plan was devised to protect and preserve natural features, maintain natural drainage patterns, and avoid to the greatest extent practical, the disturbance of erodible soils. The site plan with proposed watershed boundaries can be seen as Figure 3 in Appendix 1.

The hydrologic and hydraulic analysis was performed by delineating the tributary watershed to the design point and then dividing these tributary areas into relatively homogeneous subareas. The separation of the watershed into subareas was dictated by watershed conditions, methods of collection, conveyance and points of discharge. Watershed characteristics for each subarea were then

assessed from topographical maps, soil surveys, site investigations and land use maps.

6.1.1 EXISTING CONDITIONS

The existing watershed within the site and areas contributory to the site's discharge location were found to consist of two (2) distinct drainage areas with two (2) distinct design points. A design point represents the point at which stormwater, generated within a watershed, will exit the project site via either sheet flow along a linear boundary or as a point discharge. Figure 2 in Appendix 1 identifies the watershed areas and the corresponding design points. The characteristics of the existing subarea of this watershed is detailed within Table 1 below.

The sub-area was delineated and a contributory area, a curve number (CN) and time of concentration (Tc) was determined for the sub-area. Calculations for the CN's and Tc's are included in Appendices 3 and 4, respectively. It should be noted that the total contributory area includes off-site areas and excludes on site areas not affected by the proposed development and therefore, the total drainage area size will differ from the project lot area.

Existing Drainage Area A (EX-A)

Existing drainage area A is comprised of hydrological soil groups A, B & D soils. Existing drainage area A consists of approximately ± 35.318 acres of both off-site and on-site areas. The drainage area consists of ± 27.370 acres of woods, ± 0.928 acres of lawn, ± 5.905 acres of water and ± 1.115 acres of impervious.

Runoff from this drainage area travels overland via sheet flow and shallow concentrated flow to the adjacent NYSDEC wetland WD-29 and ends at Design Point A (DP-A). Times of concentration for this drainage area is 31.20 minutes.

Existing Drainage Area B (EX-B)

Existing drainage area B is comprised of hydrological soil groups A, B & D soils. Existing drainage area B consists of approximately ± 23.109 acres of both off-site and on-site areas. The drainage area consists of ± 19.049 acres of woods, ± 2.949 acres of lawn, ± 0.000 acres of water and ± 1.111 acres of impervious.

Runoff from this drainage area travels overland via sheet flow and shallow concentrated flow to the adjacent unnamed NYSDEC wetland and ends at Design Point B (DP-B). Times of concentration for this drainage area is 32.40 minutes.

Table 1 below provides a summary of the See Figure 2 in Appendix 1 for the Existing Drainage Map.

TABLE 1: EXISTING DRAINAGE AREA CHARACTERISTICS

DRAINAGE AREA DESIGNATION	DRAINAGE AREA SIZE (Ac.)	CN	Tc (min)
EX-A	35.318	76	31.20
EX-B	23.109	64	32.40
TOTAL:	58.427		

The watershed responses to the 1-, 10-, 100-, and 500-year 24-hour storm events were computed and evaluated at the design point. The peak rates of runoff at each design point are presented in Table 8. Stormwater computations are attached at the end of this report in Appendices 8, 9, 10 and 11.

6.1.2 PROPOSED CONDITIONS

For this analysis, the existing watershed was broken down into a post-development network consisting of four (4) subareas and two (2) stormwater facilities. The subareas under the proposed development are identified in Figure 3 in Appendix 1. The characteristics of each proposed subarea are detailed in Table 2 below. It should be noted that the total

contributory area may include off-site areas where appropriate and therefore, the total drainage area size may differ from the project development area.

Proposed Drainage Area A1-A (PR-A1-A)

Proposed drainage area A1-A is comprised of hydrological soil group D soils. Proposed drainage area A1-A consists of approximately ± 4.969 acres of on-site areas. The drainage area consists of ± 0.006 acres of woods, ± 2.206 acres of lawn, and ± 2.757 acres of impervious.

This drainage area consists of ± 2.757 acres of impervious, ± 2.757 acres of which is considered “new impervious” area and ± 0.000 acres of existing impervious.

Runoff from this drainage area travels overland via sheet flow, shallow concentrated flow and then into the proposed drainage system which runs to bio-retention area A1-A. Times of concentration for this drainage area is 22.20 minutes.

Runoff from this drainage area discharges to Design Point A (DP-A).

Proposed Drainage Area A1-B (PR-A1-B)

Proposed drainage area A1-B is comprised of hydrological soil group D soils. Proposed drainage area A1-B consists of approximately ± 4.432 acres of on-site areas. The drainage area consists of ± 0.000 acres of woods, ± 2.164 acres of lawn, and ± 2.268 acres of impervious.

This drainage area consists of ± 2.268 acres of impervious, ± 2.268 acres of which is considered “new impervious” area and ± 0.000 acres of existing impervious.

Runoff from this drainage area travels overland via sheet flow, shallow concentrated flow and then into the proposed drainage system which runs to bio-retention area A1-B. Times of concentration for this drainage area is 21.60 minutes.

Runoff from this drainage area discharges to Design Point A (DP-A).

Proposed Drainage Area A1-C (PR-A1-C)

Proposed drainage area A1-C is comprised of hydrological soil group D soils. Proposed drainage area A1-C consists of approximately ± 0.667 acres of on-site areas. The drainage area consists of ± 0.000 acres of woods, ± 0.667 acres of lawn, and ± 0.000 acres of impervious.

This drainage area consists of ± 0.000 acres of impervious, ± 0.000 acres of which is considered “new impervious” area and ± 0.000 acres of existing impervious.

Runoff from this drainage area travels overland via sheet flow into the proposed drainage system which runs to detention pond A1. Times of concentration for this drainage area is 3.6 minutes but a minimum of 6 minutes is utilized for calculations.

Runoff from this drainage area discharges to Design Point A (DP-A).

Proposed Drainage Area A2 (PR-A2)

Proposed drainage area A2 is comprised of hydrological soil group A, B, & D soils. Proposed drainage area A2 consists of approximately ± 27.009 acres of both off-site and on-site areas. The drainage area consists of ± 14.890 acres of woods, ± 3.707 acres of lawn, and ± 2.507 acres of impervious.

This drainage area consists of ± 2.507 acres of impervious, ± 1.212 acres of which is considered “new impervious” area and ± 1.295 acres of existing impervious.

Runoff from this drainage area travels overland via sheet flow and shallow concentrated flow to the adjacent NYSDEC wetland WD-29 and ends at Design Point A (DP-A). Times of concentration for this drainage area is 20.40 minutes.

Runoff from this drainage area discharges to Design Point A (DP-A).

Proposed Drainage Area B1-A (PR-B1-A)

Proposed drainage area B1-A is comprised of hydrological soil group A & D soils. Proposed drainage area B1-A consists of approximately ± 4.885 acres of on-site areas. The drainage area consists of ± 0.034 acres of woods, ± 2.304 acres of lawn, and ± 2.547 acres of impervious.

This drainage area consists of ± 2.547 acres of impervious, ± 2.547 acres of which is considered “new impervious” area and ± 0.000 acres of existing impervious.

Runoff from this drainage area travels overland via sheet flow, shallow concentrated flow and then into the proposed drainage system which runs to bio-retention area B1-A. Times of concentration for this drainage area is 22.20 minutes.

Runoff from this drainage area discharges to Design Point B (DP-B).

Proposed Drainage Area B1-B (PR-B1-B)

Proposed drainage area B1-B is comprised of hydrological soil group A & D soils. Proposed drainage area B1-B consists of approximately ± 4.222 acres of on-site areas. The drainage area consists of ± 0.000 acres of woods, ± 2.022 acres of lawn, and ± 2.200 acres of impervious.

This drainage area consists of ± 2.200 acres of impervious, ± 2.200 acres of which is considered “new impervious” area and ± 0.000 acres of existing impervious.

Runoff from this drainage area travels overland via sheet flow, shallow concentrated flow and then into the proposed drainage system which runs to bio-retention area B1-B. Times of concentration for this drainage area is 19.20 minutes.

Runoff from this drainage area discharges to Design Point B (DP-B).

Proposed Drainage Area B1-C (PR-B1-C)

Proposed drainage area B1-C is comprised of hydrological soil group A soils. Proposed drainage area B1-C consists of approximately ± 0.461 acres of on-site areas. The drainage area consists of ± 0.000 acres of woods, ± 0.461 acres of lawn, and ± 0.000 acres of impervious.

This drainage area consists of ± 0.000 acres of impervious, ± 0.000 acres of which is considered “new impervious” area and ± 0.000 acres of existing impervious.

Runoff from this drainage area travels overland via sheet flow into the proposed drainage system which runs to detention pond B1. Times of concentration for this drainage area is 3.6 minutes but a minimum of 6 minutes is utilized for calculations.

Runoff from this drainage area discharges to Design Point B (DP-B).

Proposed Drainage Area B2 (PR-B2)

Proposed drainage area B2 is comprised of hydrological soil group A & D soils. Proposed drainage area B2 consists of approximately ± 11.782 acres of both off-site and on-site areas. The drainage area consists of ± 6.620 acres of woods, ± 3.832 acres of lawn, and ± 1.330 acres of impervious.

This drainage area consists of ± 1.330 acres of impervious, ± 0.390 acres of which is considered “new impervious” area and ± 0.940 acres of existing impervious.

Runoff from this drainage area travels overland via sheet flow and shallow concentrated flow to the adjacent unnamed NYSDEC wetland and ends at Design Point B (DP-B). Times of concentration for this drainage area is 20.40 minutes.

Runoff from this drainage area discharges to Design Point B (DP-B).

TABLE 2: PROPOSED DRAINAGE AREA CHARACTERISTICS

DRAINAGE AREA DESIGNATION	DRAINAGE AREA SIZE (Ac.)	CN	Tc (min)
PR-A1-A	4.969	90	22.20
PR-A1-B	4.432	89	21.60
PR-A1-C	0.667	80	3.60*
PR-A2	27.009	76	20.40
PR-B1-A	4.885	89	22.20
PR-B1-B	4.222	89	19.20
PR-B1-C	0.461	39	3.60*
PR-B2	11.782	61	20.40
TOTAL:	58.427		

*Utilize 6-minute Tc minimum

6.2 WATER QUALITY VOLUME

The second step of the stormwater site planning process is determination of the required water quality treatment volume (WQ_v). WQ_v is calculated using the 90% Rule as defined by NYSDEC Stormwater Management Design Manual. The 90% Rule is defined as:

$$WQ_v = [(P)(R_v)(A)] / 12$$

Where: P is the 90% Rainfall Event Number
 R_v is equal to 0.05 + 0.009*I
 I is the Impervious Cover in percent
 A is the subarea total acreage

The WQ_v was calculated for the design point for which the proposed project will create new impervious coverage. The results of the WQ_v calculations are included in Table 3 below.

TABLE 3: REQUIRED WATER QUALITY VOLUMES

AREA	WQ_v (Ac-ft)
PR-A	0.871
PR-B	0.664

6.3 RUNOFF REDUCTION VOLUME

Step three of the stormwater site planning process is the incorporation of “green infrastructure technologies” and standard SMP’s with runoff reduction volume (RR_v) capacity. The intended result of RR_v , is to treat 100% of the WQ_v and replicate pre-development hydrology, however if unattainable, provide the minimum RR_v required and provide additional treatment for the remaining WQ_v . Each of the following green technologies and standard SMP’s with RR_v capacity were analyzed for implementation along with an explanation of how they are used or unable to be used on this project. The location of the green technologies used can be seen in Figure 4.

Green Technologies

- Conservation of Natural Areas
 - The proposed site is to be fully developed apart from an area of existing wetlands. Therefore, this practice may not be utilized to provide RR_v for the corresponding tributary area.
- Sheet flow to Riparian Buffers / Filter Areas
 - As previously stated this site is proposed to be fully developed and therefore riparian buffers do not exist within the project site.
- Vegetated Open Swales
 - Due to limitations in the size and slope of the site and the use of sub-surface stormwater conveyance, swales are not practicable.
- Tree Planting / Tree Box
 - The site design proposes a landscaping plan. However, the landscaping will be utilized for aesthetic purposes only and will not be designed to incorporate stormwater quality treatment.
- Disconnection of Rooftop runoff
 - Due to a lack of filter strips or grassed areas uphill of the stormwater conveyance paths, the rooftop runoff from the proposed building will be directed to catch basins.

- Stream Daylighting
 - There are no culverted/piped streams on-site therefore this technology is not applicable to this project.
- Rain Gardens
 - Due to the fact that most of the tributary drainage areas consist of areas greater than 1,000 sq.ft., rain gardens could not be utilized as a green technology on this project.
- Green Roof
 - As all the areas of the proposed development, including all new rooftop areas, have been accounted for in other green technologies, the implementation of this practice is not proposed.
- Stormwater Planters
 - Stormwater planters are suitable for small runoff areas such as rooftops or plaza and courtyards. Stormwater planters work very well within urban redevelopment projects with appropriate soils. However, this project is utilizing other technologies for treatment of rooftop runoff; therefore, the green technology of stormwater planters was not implemented.
- Rain Tanks/Cistern
 - Rain Tanks and cisterns are well-suited to treat rooftop runoff, however as previously stated, rooftop runoff is directed towards the proposed drainage system.
- Porous Pavement
 - Porous pavement was not considered as paved areas were already treated under a different runoff reduction practice.
- Soil Restoration
 - Soil restoration measures must be applied to all areas of disturbance that will be re-established as non-impervious cover to recover the original properties and porosity of the soil to the greatest extent practical. Soil restoration techniques and requirements are discussed further in Section 5.6 of this report.

Standard SMP's with RR_v Capacity

- Infiltration Practice
 - Infiltration practices are not being considered due to soil composition and poor infiltration rates on site.
- Bio-Retention
 - The use of four (4) bio-retention facilities are proposed on site to provide RR_v capacity.
- Dry Swale (Open Channel Practice)
 - Dry swales were not utilized for this project as all areas of proposed development have been accounted for in other green technologies.

The RR_v for each of the green technologies used has been calculated for the point of analysis. The total RR_v was calculated and compared to the WQ_v for the design point. The minimum RR_v is based upon the hydrological soil group (HSG) classification within the watershed and is assigned a Specific Reduction Factor (S). The reduction factors for each HSG are shown below in Table 4.

TABLE 4: SPECIFIC REDUCTION FACTOR (S)*

HSG	S
A	0.55
B	0.40
C	0.30
D	0.20

* Watersheds with multiple HSG's utilize a weighted average

RR_{v MIN} was calculated for each watershed in accordance with the following formula:

$$RR_{v \text{ MIN}} = [(P)(0.95)(S)(I)] / 12$$

The total calculated RR_v provided is compared to the RR_{v MIN} to ensure that the green technologies proposed provide the minimum reduction of the WQ_v as required. The RR_{v MIN} and the total RR_v provided along with the revised WQ_v are shown below in Table 5. The revised WQ_v is calculated using the 90% rule as noted in Section 5.2 above, however, the contributory area and impervious area

are reduced through the application of green technologies that have been utilized. The calculations for the required and adjusted water quality volumes along with the runoff reduction volumes calculations are shown in Appendix 6.

TABLE 5: RUNOFF REDUCTION VOLUMES & REVISED WQV

DESIGN POINT	RR_v MIN	Total RR_v (Provided)	Revised WQ_v
PR-A	0.181	0.264	0.289
PR-B	0.180	0.224	0.112

6.4 APPLICATION OF STANDARD SMP'S FOR THE REVISED WQV

The RR_v does reduce the required WQ_v treatment for design point PR-A; however, it does not completely eliminate the need to provide treatment through standard stormwater management practices. Continuing with the stormwater site planning process, step four is to ensure treatment for the remaining WQ_v is provided. The WQ_v provided in each of the standard stormwater management practices throughout the project is provided in Table 6 below.

TABLE 6: WQV PROVIDED IN STANDARD SMP'S

DESIGN POINT	RR_v Provided (ac-ft)	WQ_v Provided (ac-ft)
Forebay A1-A	0.000	1.041
Bio-Retention Basin A1-A	0.132	0.414
Forebay A1-B	0.000	1.154
Bio-Retention Basin A1-B	0.132	0.412
Forebay B1-A	0.000	0.911
Bio-Retention Basin B1-A	0.112	0.348
Forebay B1-B	0.000	0.608
Bio-Retention Basin B1-B	0.112	0.308
TOTAL	0.488	5.196

6.5 VOLUME AND PEAK RATE CONTROL

The fifth and final step of the stormwater site planning process is to apply volume and peak rate control as necessary through the use of standard stormwater management practices. In preparing the SWPPP, it was determined that on-site

stormwater facility (Wet Extended Detention Pond) will be necessary to mitigate the potential increase in peak stormwater runoff rates from the proposed site improvements.

The on-site stormwater management facilities have been designed as Detention Basins (A1 & B1) which are proposed to mitigate any increase in peak runoff from the site improvements tributary to them.

6.5.1 CHANNEL PROTECTION VOLUME

The required volume control consists of Channel Protection Volume (C_{pv}) which is designed to protect downstream channels from erosion. The C_{pv} is achieved through providing extended detention of the 1-year storm event for a period of 24 hours. Ponds that do not meet the 24-hour extended detention period will utilize the minimum 3" orifice as required by the regulations. The C_{pv} detention time is shown in Table 7 below and the calculated results are shown in Appendix 12.

TABLE 7: CPV EXTENDED DETENTION TIMES

FACILITY	C_{pv} ED Time (hrs)
Basin A1	19.40*
Basin B1	7.05*

** FACILITY HAS AN EXTENDED DETENTION TIME LESS THAN 24 HOURS AND WILL UTILIZE A MINIMUM 3" ORIFICE AS REQUIRED.*

6.5.2 PEAK RATE CONTROL

The peak discharge rate is controlled utilizing the storage volume available in the stormwater pond and controlling discharge through an overflow weir. The watershed responses to the 1-, 10-, 100-, and 500- year - 24-hour storm events were computed and evaluated at the aforementioned design point. The peak rates of runoff realized at the design points are presented in Table 8. Stormwater computations are attached at the end of this report.

The total peak runoff rates at the design point for the existing condition as well as the final proposed condition have been calculated and shown below in Table 8. The peak runoff rates have been reduced in the proposed

conditions during the 1-, 10-, 100- and 500-year design storms for all drainage areas on site.

TABLE 8: SUMMARY OF RESULTS AT THE DESIGN POINTS

Criteria		Design Point A	Design Point B
1 – YEAR (Cpv)	Existing (cfs)	15.58	2.54
	Proposed (cfs)	15.32	1.22
	Reduction (cfs)	-0.26	-1.32
	Reduction (%)	-1.67%	-51.97%
10 – YEAR (Qp)	Existing (cfs)	48.98	17.46
	Proposed (cfs)	46.77	9.53
	Reduction (cfs)	-2.21	-7.93
	Reduction (%)	-4.51%	-45.42%
100 – YEAR (Qf)	Existing (cfs)	111.57	52.74
	Proposed (cfs)	104.61	30.65
	Reduction (cfs)	-6.96	-22.09
	Reduction (%)	-6.24%	-41.88%
500 – YEAR	Existing (cfs)	182.01	96.48
	Proposed (cfs)	203.38	64.67
	Reduction (cfs)	+21.37	-31.81
	Reduction (%)	+11.74%	-32.97%

Since the runoff rates have been proven to decrease in the post-development condition, there will be no adverse impact to the downstream receiving waters. Therefore, the SWPPP designed for the Sheffield Gardens project site will accomplish the intent of its design.

The NYSDEC Stormwater Design Manual does not require proposed developments to provide peak rate control for 500-year storms. However at the request of the Town of Montgomery, analysis of the site under a 500-year storm event has been provided. In the event of a storm of this size, runoff will flow via emergency overflow weirs and/or over stormwater basin berms to the on-site wetlands which ultimately discharge to drainage points A and B.

6.6 SOIL RESTORATION

Soil restoration is intended to recover the original properties and porosity of the soil to the greatest extent practicable. Soil restoration measures shall be applied to any disturbed area within the project prior to establishment of permanent vegetation and installation of landscaping. Any proposed impervious areas do not require soil restoration measures. Soil restoration measures such as tilling allows for compacted soil to gather oxygen and create temporary and even permanent air voids and when combined with the incorporation of organic material, greatly improves the soils characteristics to temporarily store water and subsequent runoff reduction through infiltration and evapotranspiration.

Various soil disturbance activities related to construction of land development within various soil types and the associated minimum required soil restoration techniques are shown in Table 9.

TABLE 9: SOIL RESTORATION REQUIREMENTS

Type of Soil Disturbance	Soil Restoration Requirement		Comments / Examples
No Soil Disturbance	Restoration not permitted		Preservation of Natural Features
Minimal Soil Disturbance	Restoration not required		Clearing and Grubbing
Areas where topsoil is stripped only – NO change in grade.	HSG A & B Apply 6" of topsoil	HSG C & D Aerate* and apply 6" of topsoil	Protect Areas from any ongoing construction activities.
Areas of cut or fill	HSG A & B Aerate* and apply 6" of topsoil	HSG C & D Apply full Soil Restoration**	
Heavy traffic areas on site (especially in a zone 5'-25' around buildings, but not within the 5' perimeter around the foundation walls)	Apply full Soil Restoration** (de-compaction and compost enhancement)		

Areas where Runoff Reduction and/or Infiltration Practices are applied.	Restoration not required, but maybe applied to enhance the reduction specified for appropriate practices	Keep construction equipment from crossings these areas. To protect newly installed practice from any ongoing construction activities construct a single phase operation fence area.
Redevelopment projects	Soil restoration is required on redevelopment projects in areas where existing impervious area will be converted to pervious area	

* Aeration includes the use of machines such as tractor-drawn implements with coulters making a narrow slit in the soil, a roller with many spikes making indentations in the soil, or prongs which function like a mini-subsoiler.

** Per "Deep Ripping and De-compaction Guidelines", NYSDEC 2008

7.0 EROSION AND SEDIMENT CONTROL MEASURES

Soil erosion and sediment control measures have been detailed on the plans and outlined herein. The following are general measures that should be implemented:

- a. Damage to surface waters resulting from erosion and sedimentation shall be minimized by stabilizing disturbed areas and by removing sediment from construction site discharges.
- b. Site preparation activities shall be planned to minimize the area and duration of soil disturbance. The plans approved for construction shall contain a detailed "Erosion Control Plan" which depicts the limits of grading along with the required earth cut and fill locations (including stockpile locations if necessary). In addition, any additional site-specific erosion control measures required are shown on the approved plans for construction. The following additional requirements shall be met upon receipt of such waiver:
 - The required site inspections by the qualified inspector shall occur one (1) time every seven (7) days.

- In areas where disturbance has temporarily or permanently ceased, stabilization shall be implemented within seven (7) days from the ceasing of soil disturbance activity.
- c. Permanent traffic corridors shall be established, and “routes of convenience” shall be avoided. Off-site sediment tracking shall be minimized through regularly scheduled sweeping and good housekeeping of construction vehicles.
- d. A qualified professional shall inspect and log the erosion and sediment control measures once every seven days once earth disturbance has commenced and continue until the site has achieved final stabilization in accordance with the requirements. During times of possible inactivity (i.e. winter months), upon the site being temporarily stabilized, the professional shall perform inspections monthly. The professional shall make recommendations to the operator on how to maintain the integrity and function of all temporary erosion control measures throughout the duration of the development process. Any deficiencies in the measures shall be corrected as soon as possible by the operator.
- e. An up-to-date Construction Site Log Book which includes this SWPPP for shall be maintained on site at all times during construction. The Construction Site Log Book shall also include the items found in the most recent version of the New York Standards and Specifications for Erosion and Sediment Control.

In particular, the following measures will be implemented:

- a. Pre-Construction Installation: Prior to any disturbance on site, silt fence shall be installed in accordance with the approved plans in the area of the first phase. Prior to commencement of any subsequent phase, silt fence shall be installed in the proper phase in accordance with the approved plans. Siltation barriers shall be maintained in good condition and reinforced, extended, repaired or replaced as necessary.
- b. Stone Diaphragms: Until such time as final site stabilization is completed, the stone diaphragm shown on the plans at the edge of pavement shall receive

treatment with stone as to effectively trap sediment and minimize its release off-site.

- c. In no case shall erodible materials be stockpiled within 25 feet of any ditch, stream or other surface water body.
- d. Permanent vegetative cover: Immediately following the completion of construction activity in any portion of the site, permanent vegetation shall be established on all exposed soils by properly seeding at a coverage rate as noted on the approved plans and covered with straw. Water shall be applied to newly seeded areas as needed until grass cover is well established.
- e. Washouts shall be immediately repaired, reseeded and protected from further erosion. All accumulated sediment shall be removed and contained in appropriate spoil areas. To effectively control wind erosion, water shall be applied to all exposed soils as necessary.

8.0 LONG TERM MAINTENANCE OF WATER QUALITY FEATURES

Upon completion of the project, the stormwater facilities shall be owned and maintained by the property owner. The property owner shall be responsible for ensuring that the facilities operate and function as designed through proper maintenance as follows.

- a. Regular inspection and maintenance of the proposed facilities are required to ensure their long-term water quality and quantity reduction functions.
- b. All stormwater facilities and roadways with associated infrastructure are proposed to be located within lands to be owned by the property owner.
- c. All side slopes within the stormwater facilities are a minimum of 3:1, to allow for maintenance.
- d. Catch Basins:
 - i. Basins shall be inspected for accumulated sediment and trash every 6 months.
 - ii. Accumulated sediment and trash shall be removed from basins annually, or at more frequent intervals, if needed.
- e. Forebay & Detention Pond

- i. The grass within the pond should be mowed at least 3 times per growing season, limiting the grass to a height of no more than 12 inches.
 - ii. Sediment removal should be done at least every five years.
- f. Bio-Retention Facility
 - i. Sediment removal in the forebay shall occur every five to six years or after 50% of total forebay capacity has been lost.
 - ii. The grass embankments should be mowed at least 3 times per growing season, limiting the grass to a height of no more than 12”.
 - iii. Silt/sediment shall be removed from the filter bed when the accumulation exceeds one inch. When the filtering capacity of the filter diminishes substantially (i.e., when water ponds on the surface of the filter bed for more than 48 hours), the top few inches of discolored material shall be removed and shall be replaced with fresh material. The removed sediments shall be disposed in an acceptable manner.

9.0 SUMMARY OF FINDINGS AND CONCLUSIONS


Based on the analysis of the pre-development and post-development stormwater conditions, and the implementation of stormwater quality and sediment and erosion control measures, the potential stormwater impacts of the Britain Woods project will be mitigated to the greatest extent practical.


- a. Prevent increases in flooding and flood damage through the reduction of the rate of runoff from all areas.
- b. Reduce the erosion potential from the development through the reduction of the rate of runoff from the project site and through the implementation of the soil and erosion control measures outlined on the project plans and as highlighted herein.
- c. Decreases non-point source pollution and water quality degradation through the use of “green technologies”.
- d. Those portions of the site which do not direct runoff into a stormwater management practice, will sheet flow through proposed lawn areas and through existing vegetative cover prior to discharging from the site.


- e. All criteria set forth in the New York State Stormwater Management Design Manual have been met.
- f. Post-development peak discharge rates will be reduced below pre-development peak discharge rates, or their impacts minimized.
- g. Sediment and erosion control measures are designed to minimize erosion loss and downstream sediment deposits.


APPENDIX 1


FIGURES

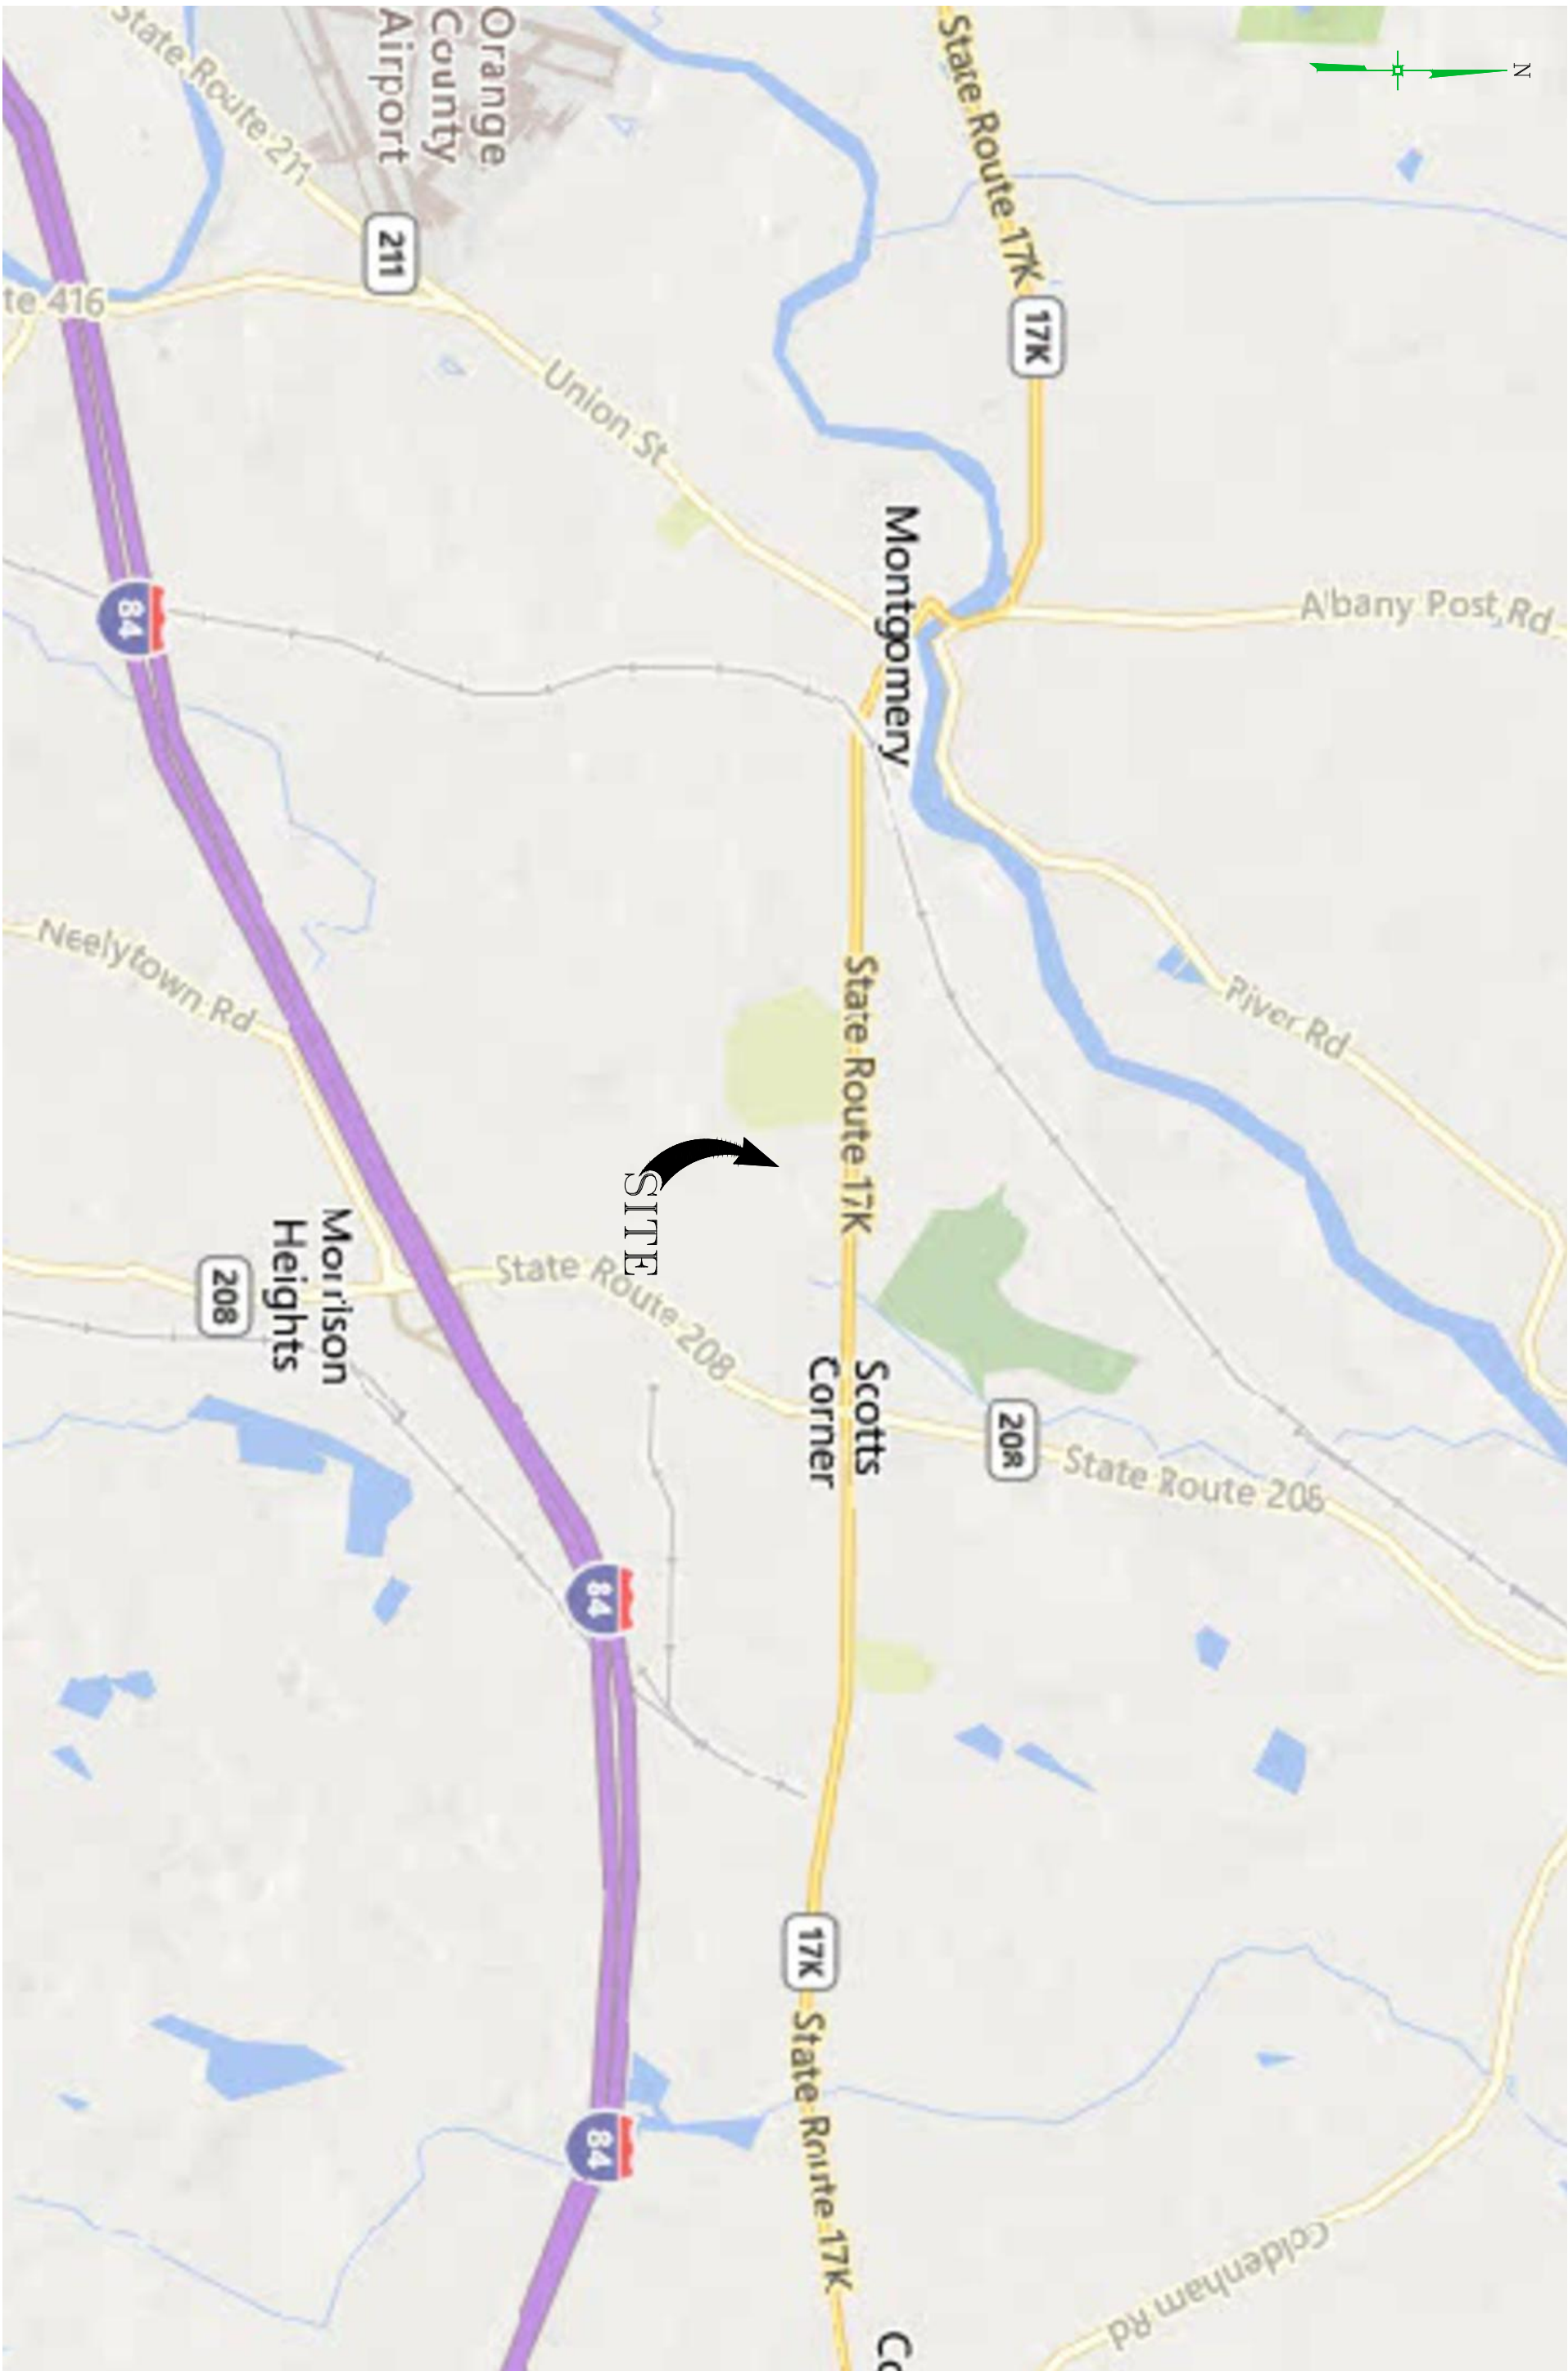


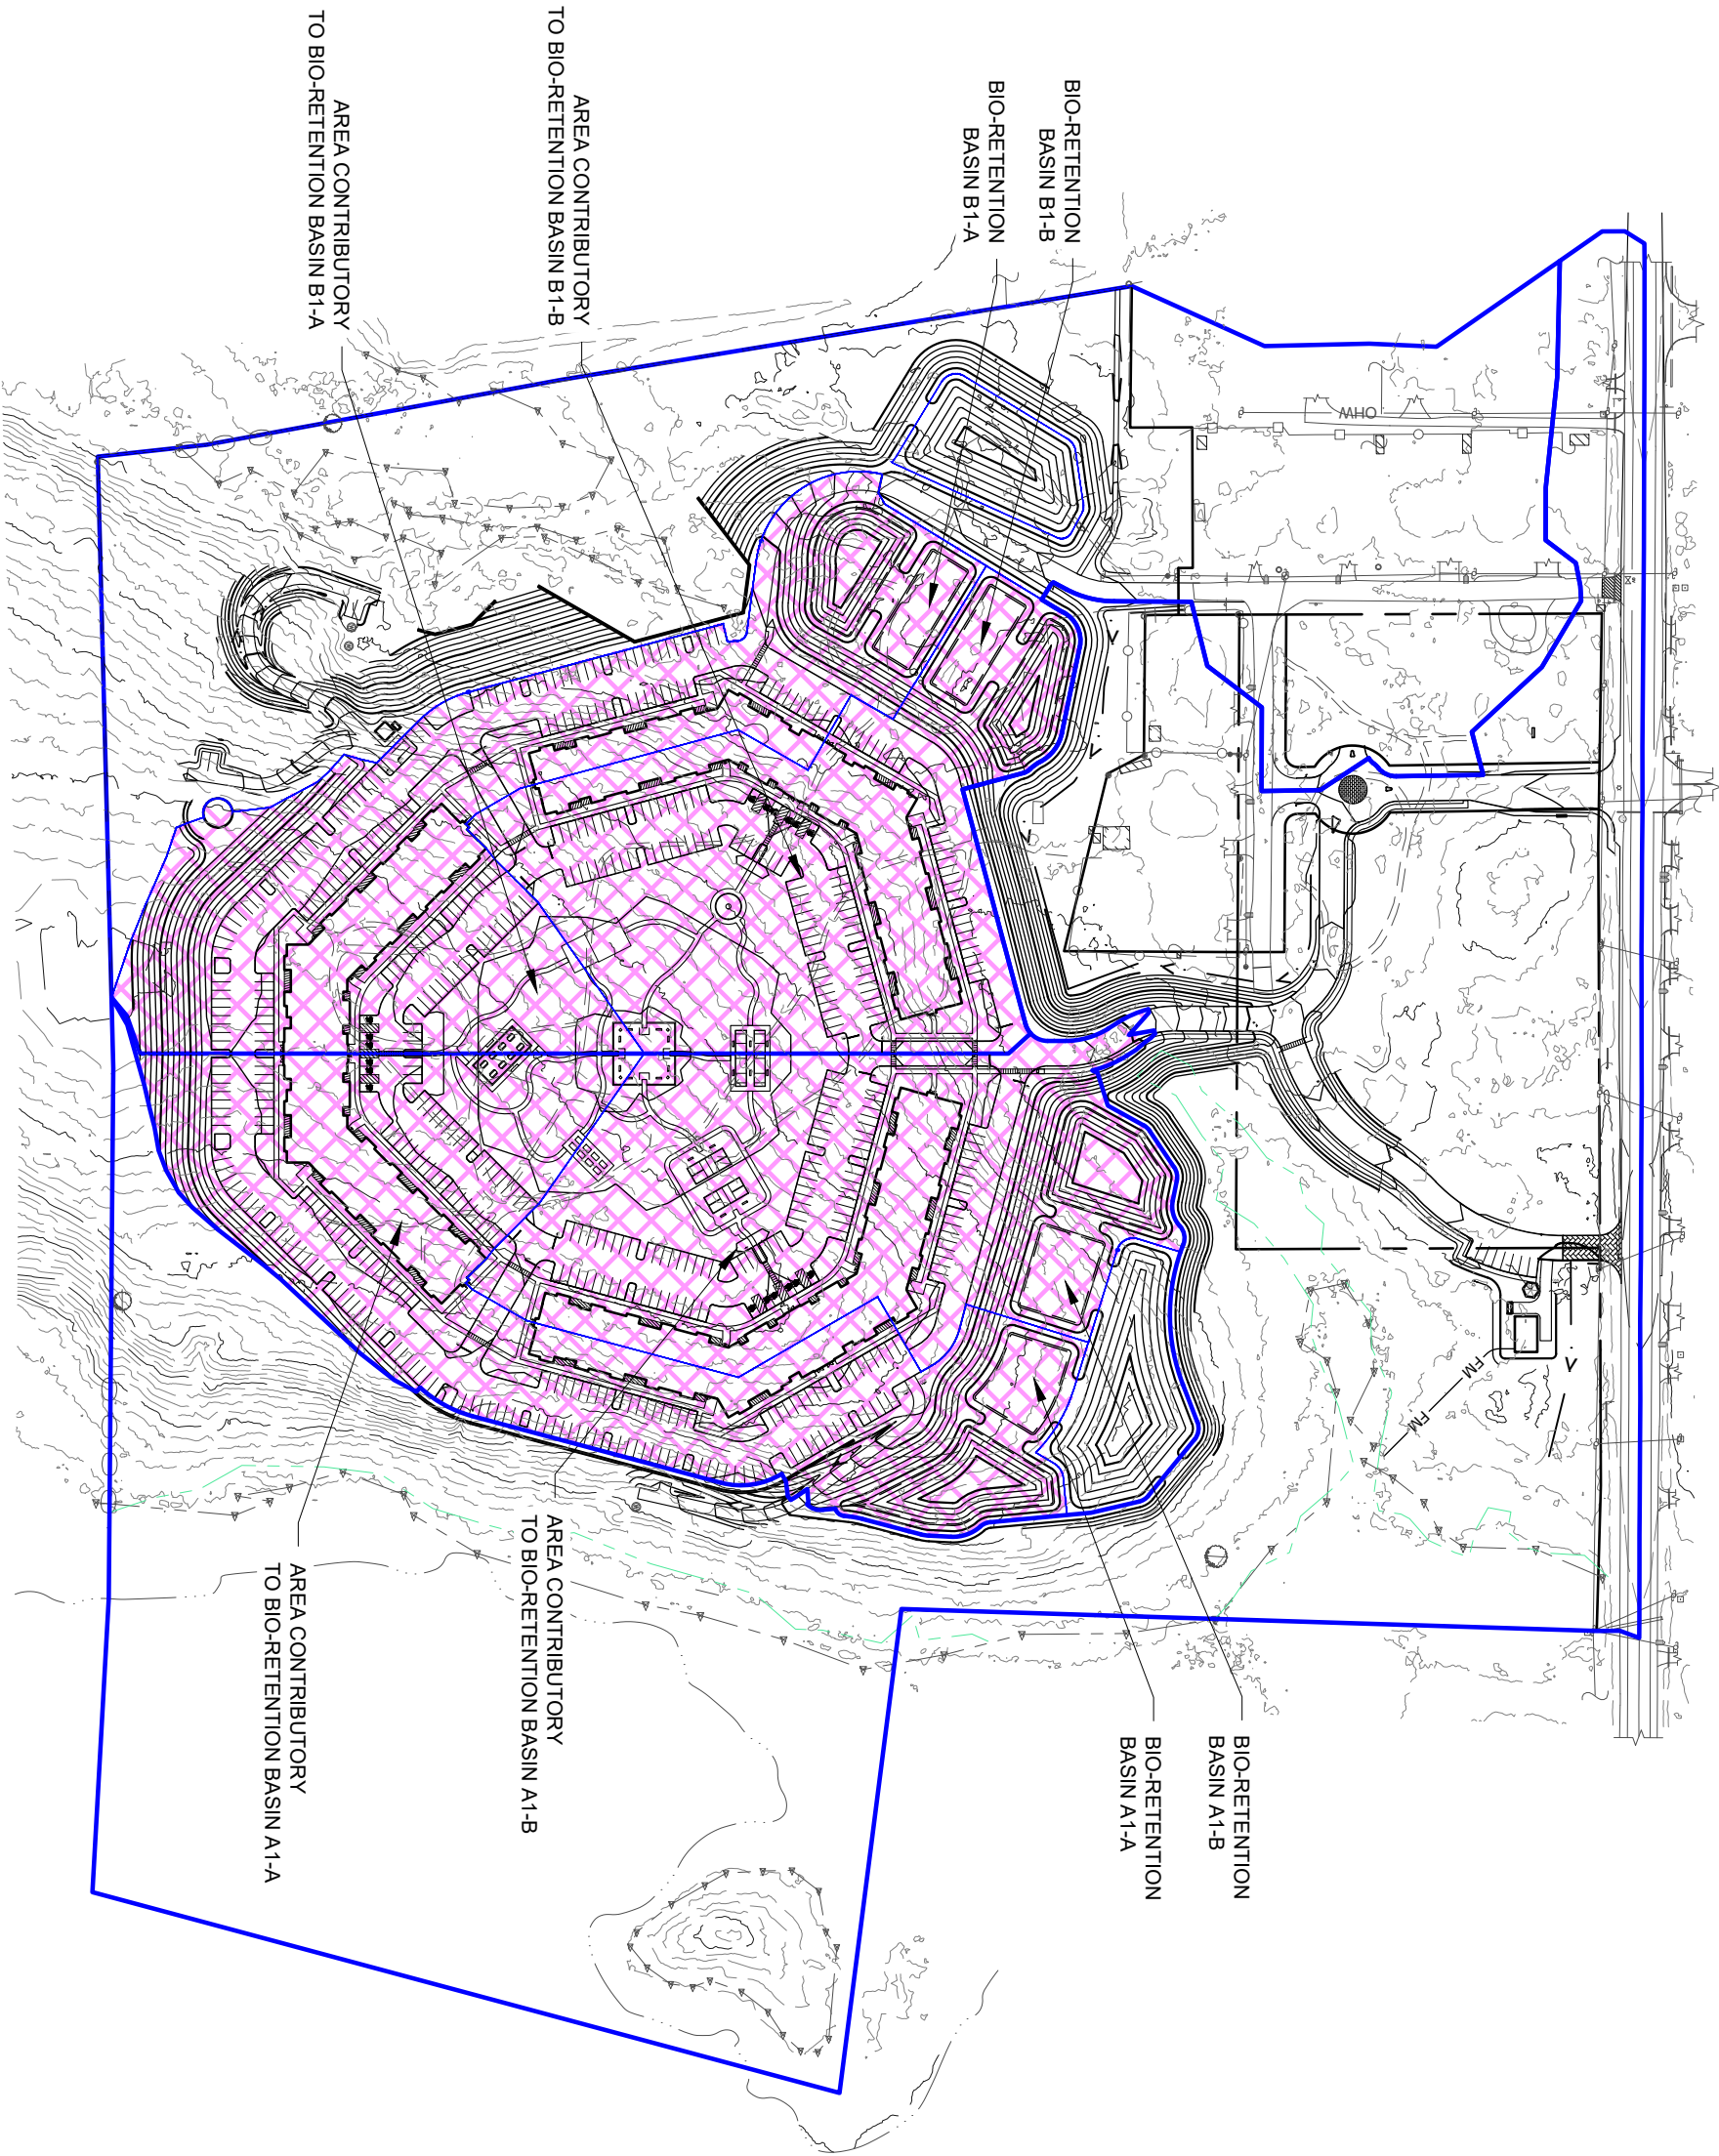
LOCATION MAP	SHEFFIELD GARDENS NYS ROUTE 17K TOWN OF MONTGOMERY ORANGE COUNTY, NEW YORK	DATE: JAN '24 REV DEC '25	JOB # 103.0301	 <div>MONTGOMERY OFFICE 71 CLINTON STREET MONTGOMERY, NY 12549 Ph: (845) 457-7727 WWW.EP-PC.COM</div>
		SCALE: 1" = 2,000'	SHEET # SWM-1	

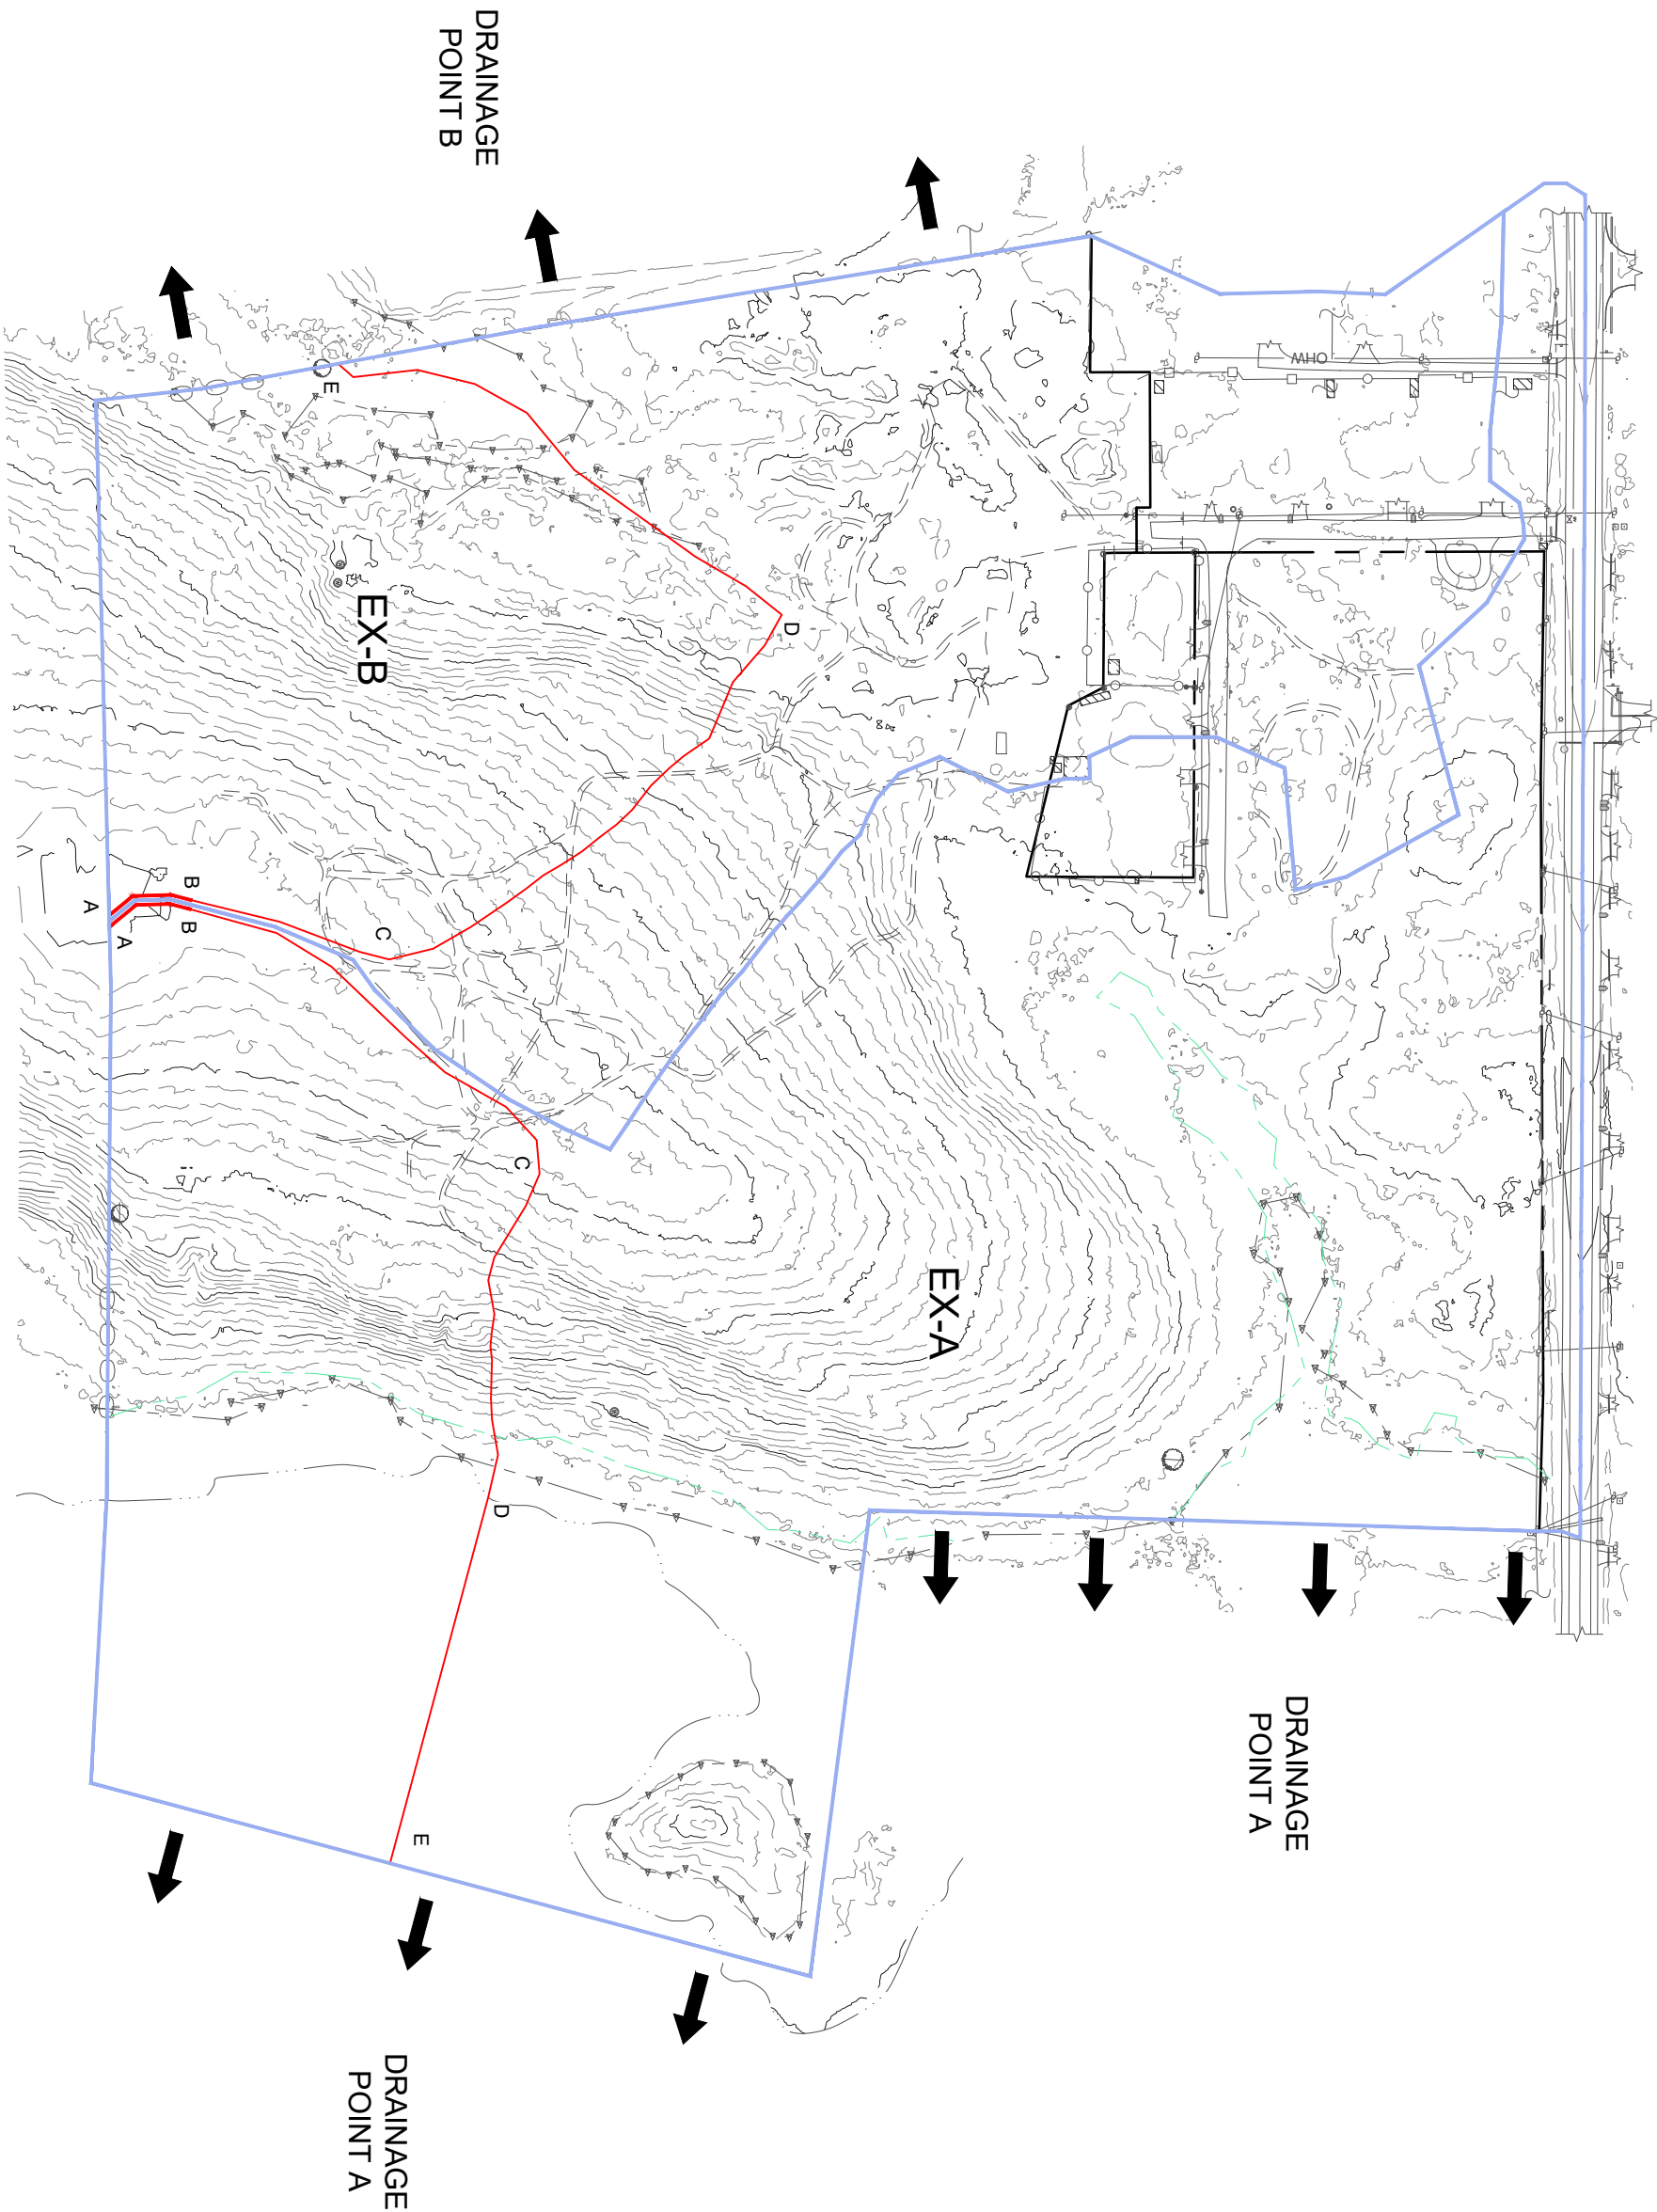

EXISTING DRAINAGE CONDITIONS	SHEFFIELD GARDENS NYS ROUTE 17K TOWN OF MONTGOMERY ORANGE COUNTY, NEW YORK	DATE: JAN '24 REV DEC '25	JOB # 103.0301	 MONTGOMERY OFFICE 71 CLINTON STREET MONTGOMERY, NY 12549 Ph: (845) 457-7727 WWW.EP-PC.COM
		SCALE: 1" = 200'	SHEET # SWM-2	

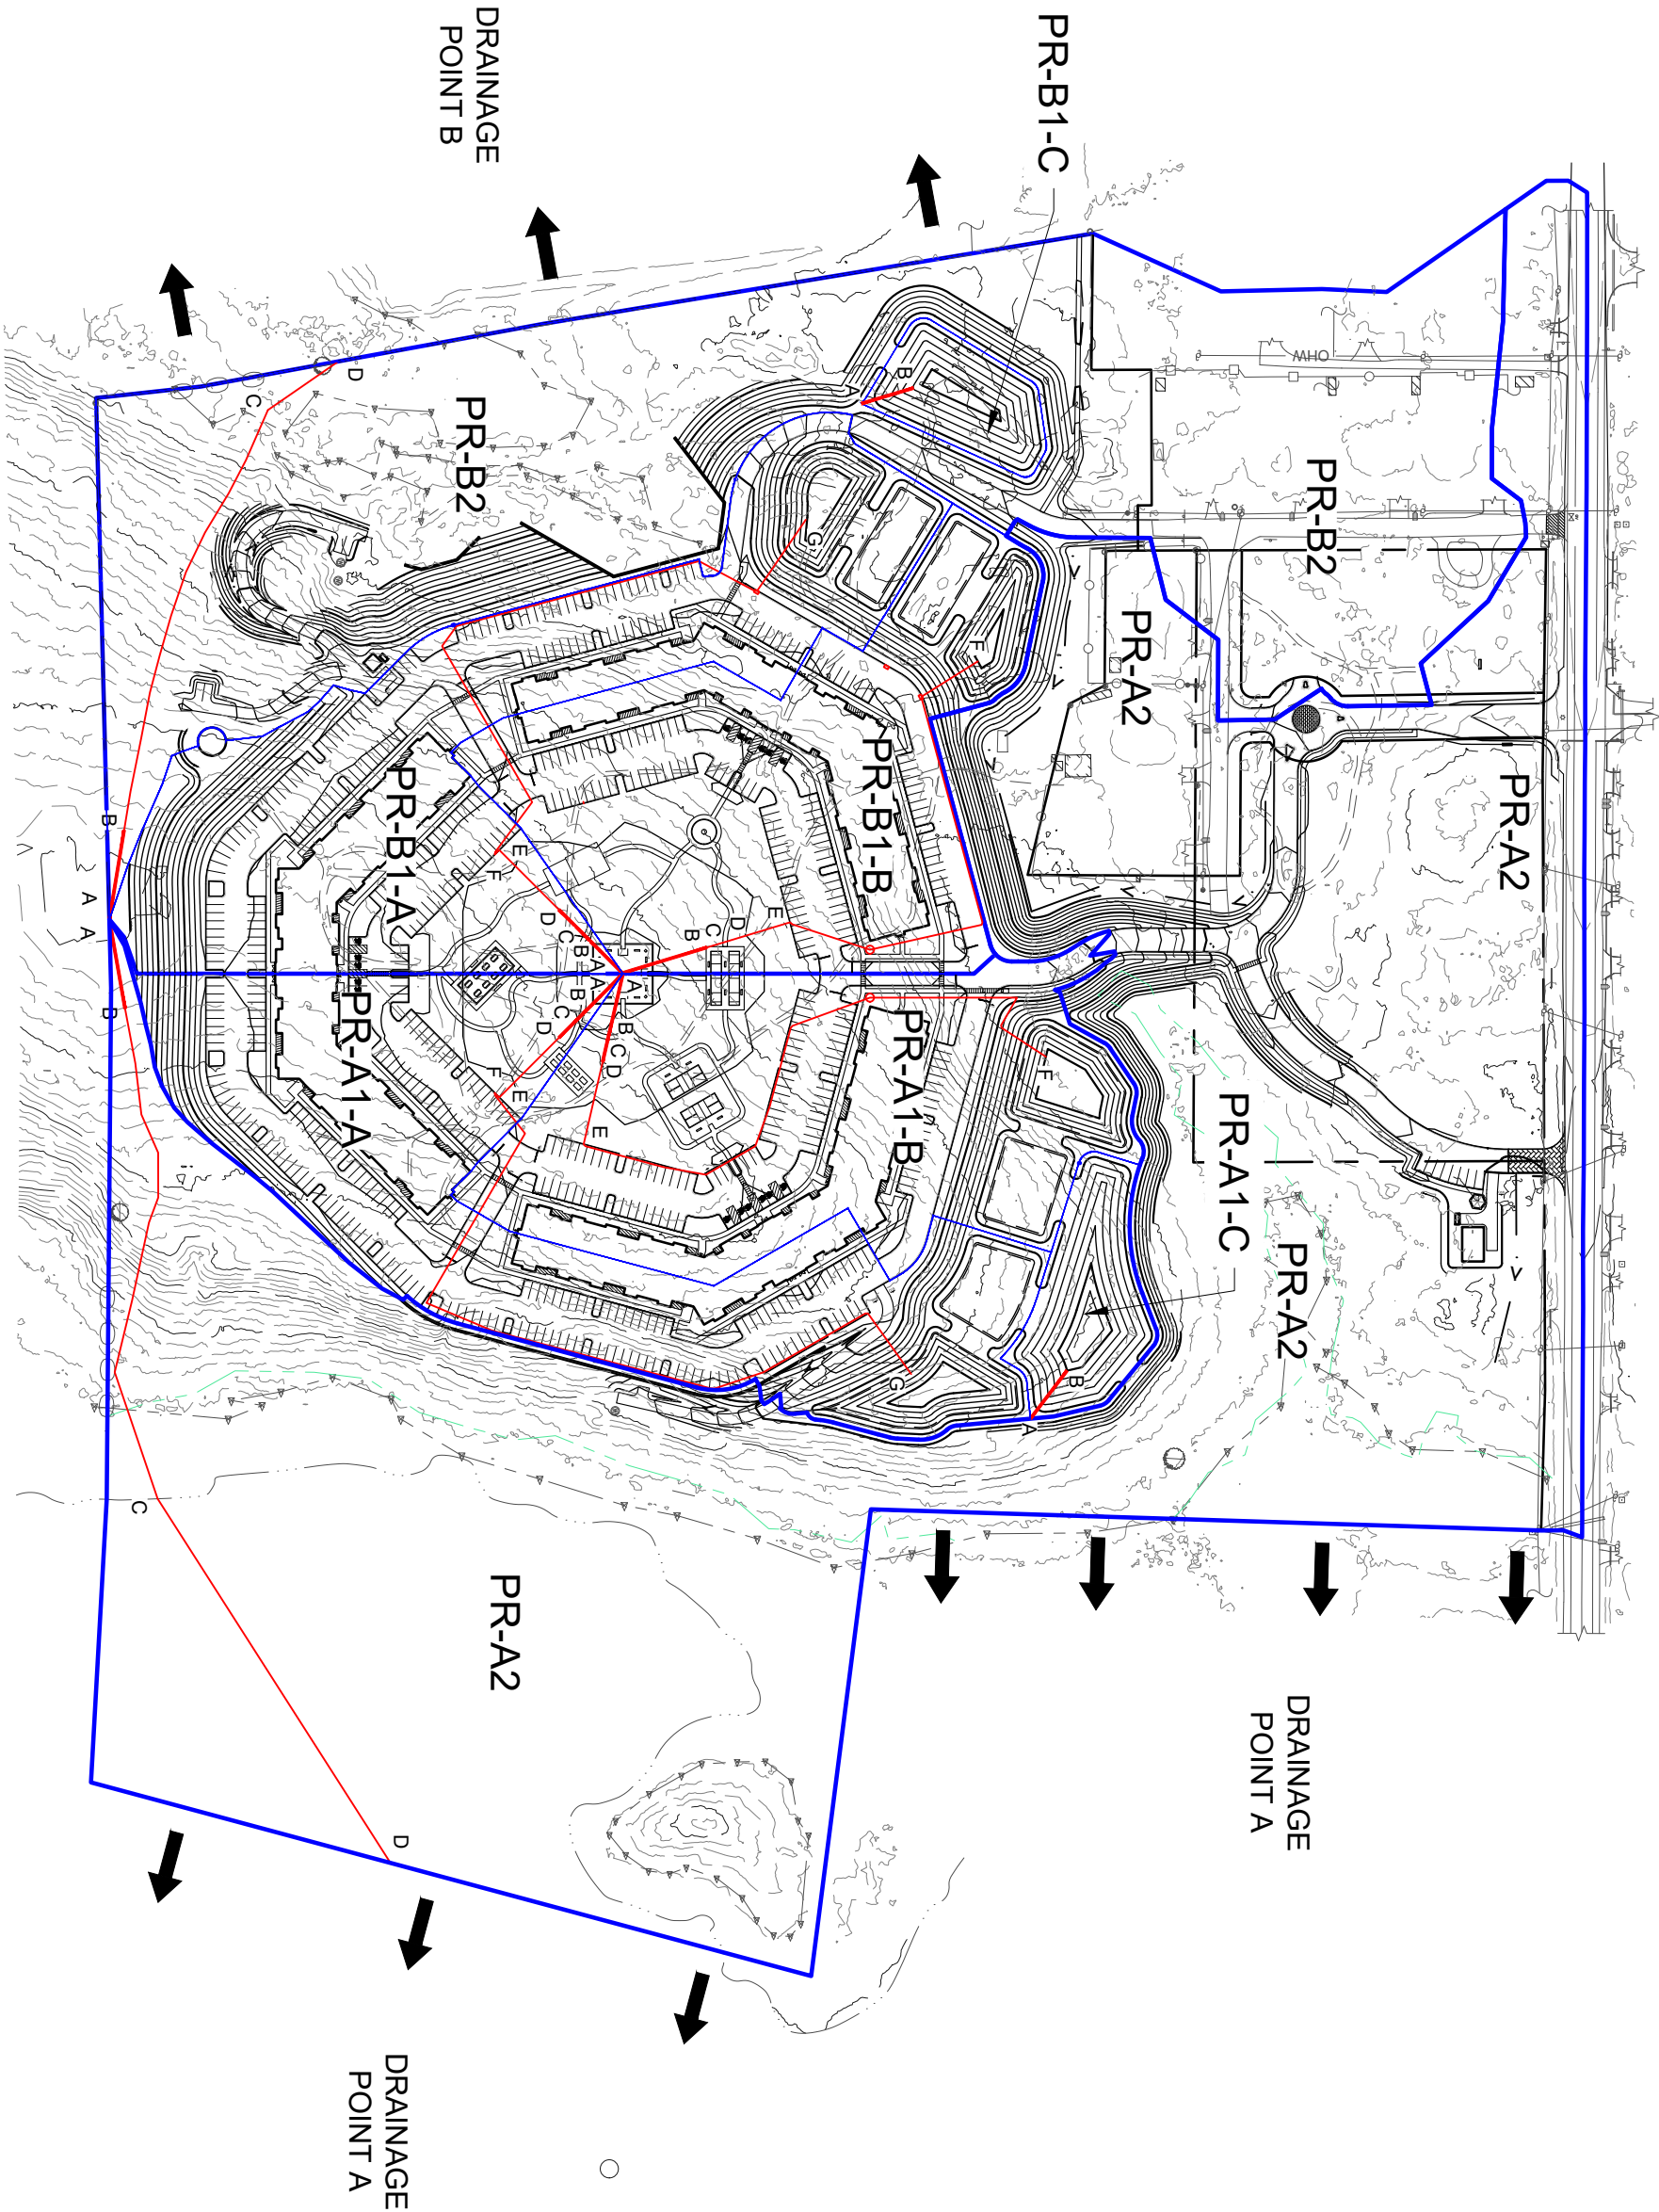

PROPOSED DRAINAGE CONDITIONS	SHEFFIELD GARDENS NYS ROUTE 17K TOWN OF MONTGOMERY ORANGE COUNTY, NEW YORK	DATE: JAN '24 REV DEC '25	JOB # 103.0301	 <div>MONTGOMERY OFFICE 71 CLINTON STREET MONTGOMERY, NY 12549 Ph: (845) 457-7727 WWW.EP-PC.COM</div>
		SCALE: 1" = 200'	SHEET # SWM-3	



GREEN INFRASTRUCTURE

SHEFFIELD GARDENS
NYS ROUTE 17K
TOWN OF MONTGOMERY
ORANGE COUNTY, NEW YORK

DATE: JAN '24
SCALE: 1" = 200'

JOB # 103.0301
SHEET # SWM-4




MONTGOMERY OFFICE
71 CLINTON STREET
MONTGOMERY, NY 12549
Ph: (845) 457-7727
WWW.EP-PC.COM

APPENDIX 2


SOILS MAP AND

CLASSIFICATIONS

Hydrologic Soil Group—Orange County, New York
(SWPPP Soils)

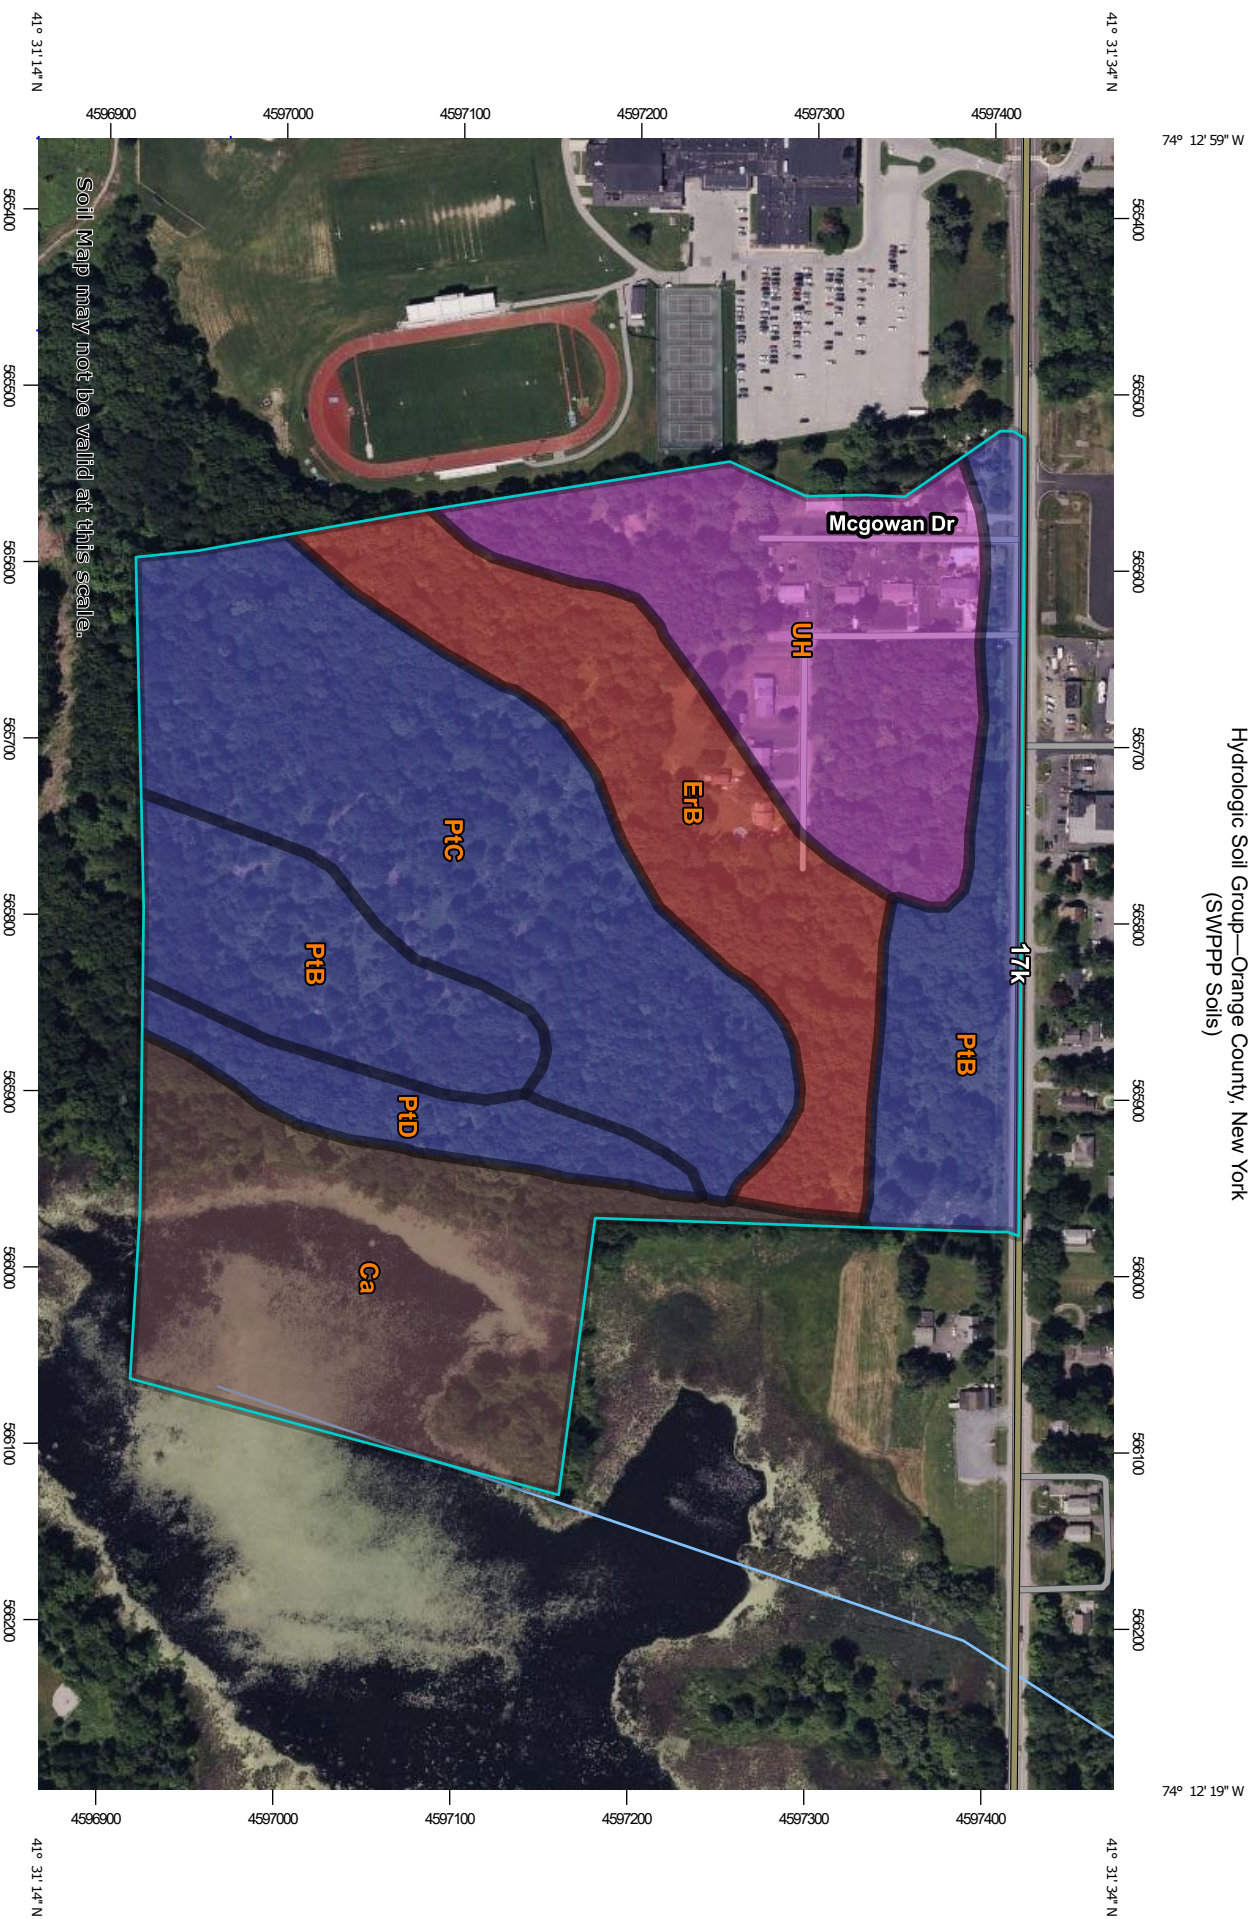

MAP LEGEND

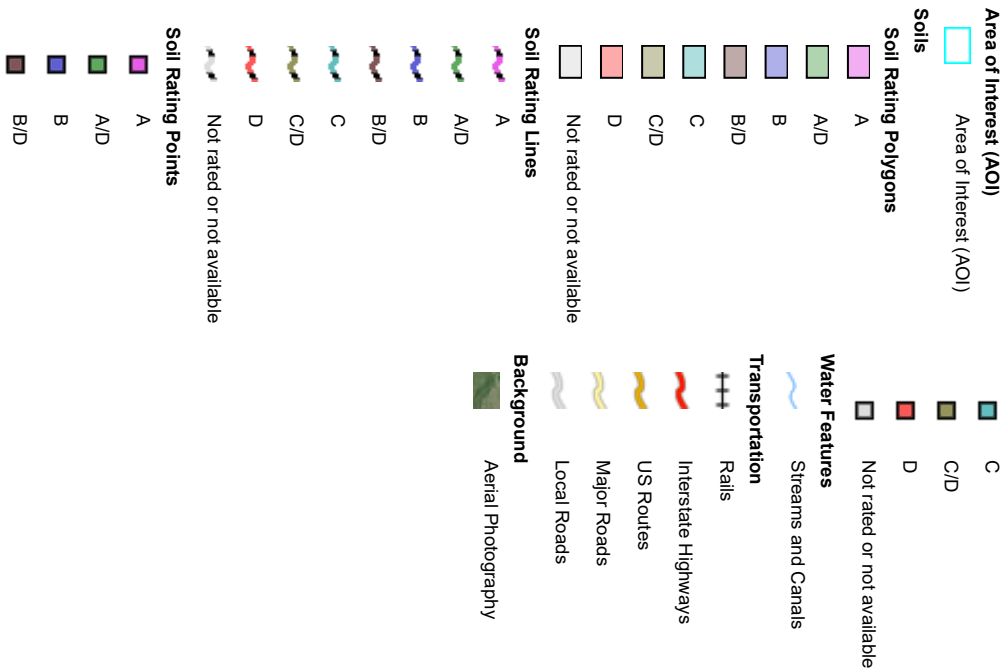

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:15,800.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service

Web Soil Survey URL:

Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: Orange County, New York
Survey Area Data: Version 24, Sep 6, 2023

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: May 31, 2022—Oct 27, 2022

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Hydrologic Soil Group

Map unit symbol	Map unit name	Rating	Acres in AOI	Percent of AOI
Ca	Canandaigua silt loam	B/D	11.5	19.6%
ErB	Erie gravelly silt loam, 3 to 8 percent slopes	D	9.0	15.4%
PtB	Pittsfield gravelly loam, 3 to 8 percent slopes	B	10.5	18.0%
PtC	Pittsfield gravelly loam, 8 to 15 percent slopes	B	14.8	25.3%
PtD	Pittsfield gravelly loam, 15 to 25 percent slopes	B	2.7	4.7%
UH	Udorthents, smoothed	A	9.9	17.0%
Totals for Area of Interest			58.4	100.0%

Description

Hydrologic soil groups are based on estimates of runoff potential. Soils are assigned to one of four groups according to the rate of water infiltration when the soils are not protected by vegetation, are thoroughly wet, and receive precipitation from long-duration storms.

The soils in the United States are assigned to four groups (A, B, C, and D) and three dual classes (A/D, B/D, and C/D). The groups are defined as follows:

Group A. Soils having a high infiltration rate (low runoff potential) when thoroughly wet. These consist mainly of deep, well drained to excessively drained sands or gravelly sands. These soils have a high rate of water transmission.

Group B. Soils having a moderate infiltration rate when thoroughly wet. These consist chiefly of moderately deep or deep, moderately well drained or well drained soils that have moderately fine texture to moderately coarse texture. These soils have a moderate rate of water transmission.

Group C. Soils having a slow infiltration rate when thoroughly wet. These consist chiefly of soils having a layer that impedes the downward movement of water or soils of moderately fine texture or fine texture. These soils have a slow rate of water transmission.

Group D. Soils having a very slow infiltration rate (high runoff potential) when thoroughly wet. These consist chiefly of clays that have a high shrink-swell potential, soils that have a high water table, soils that have a claypan or clay layer at or near the surface, and soils that are shallow over nearly impervious material. These soils have a very slow rate of water transmission.

If a soil is assigned to a dual hydrologic group (A/D, B/D, or C/D), the first letter is for drained areas and the second is for undrained areas. Only the soils that in their natural condition are in group D are assigned to dual classes.

Rating Options

Aggregation Method: Dominant Condition


Component Percent Cutoff: None Specified

Tie-break Rule: Higher

APPENDIX 3

GEOTECHNICAL TEST

PIT DATA

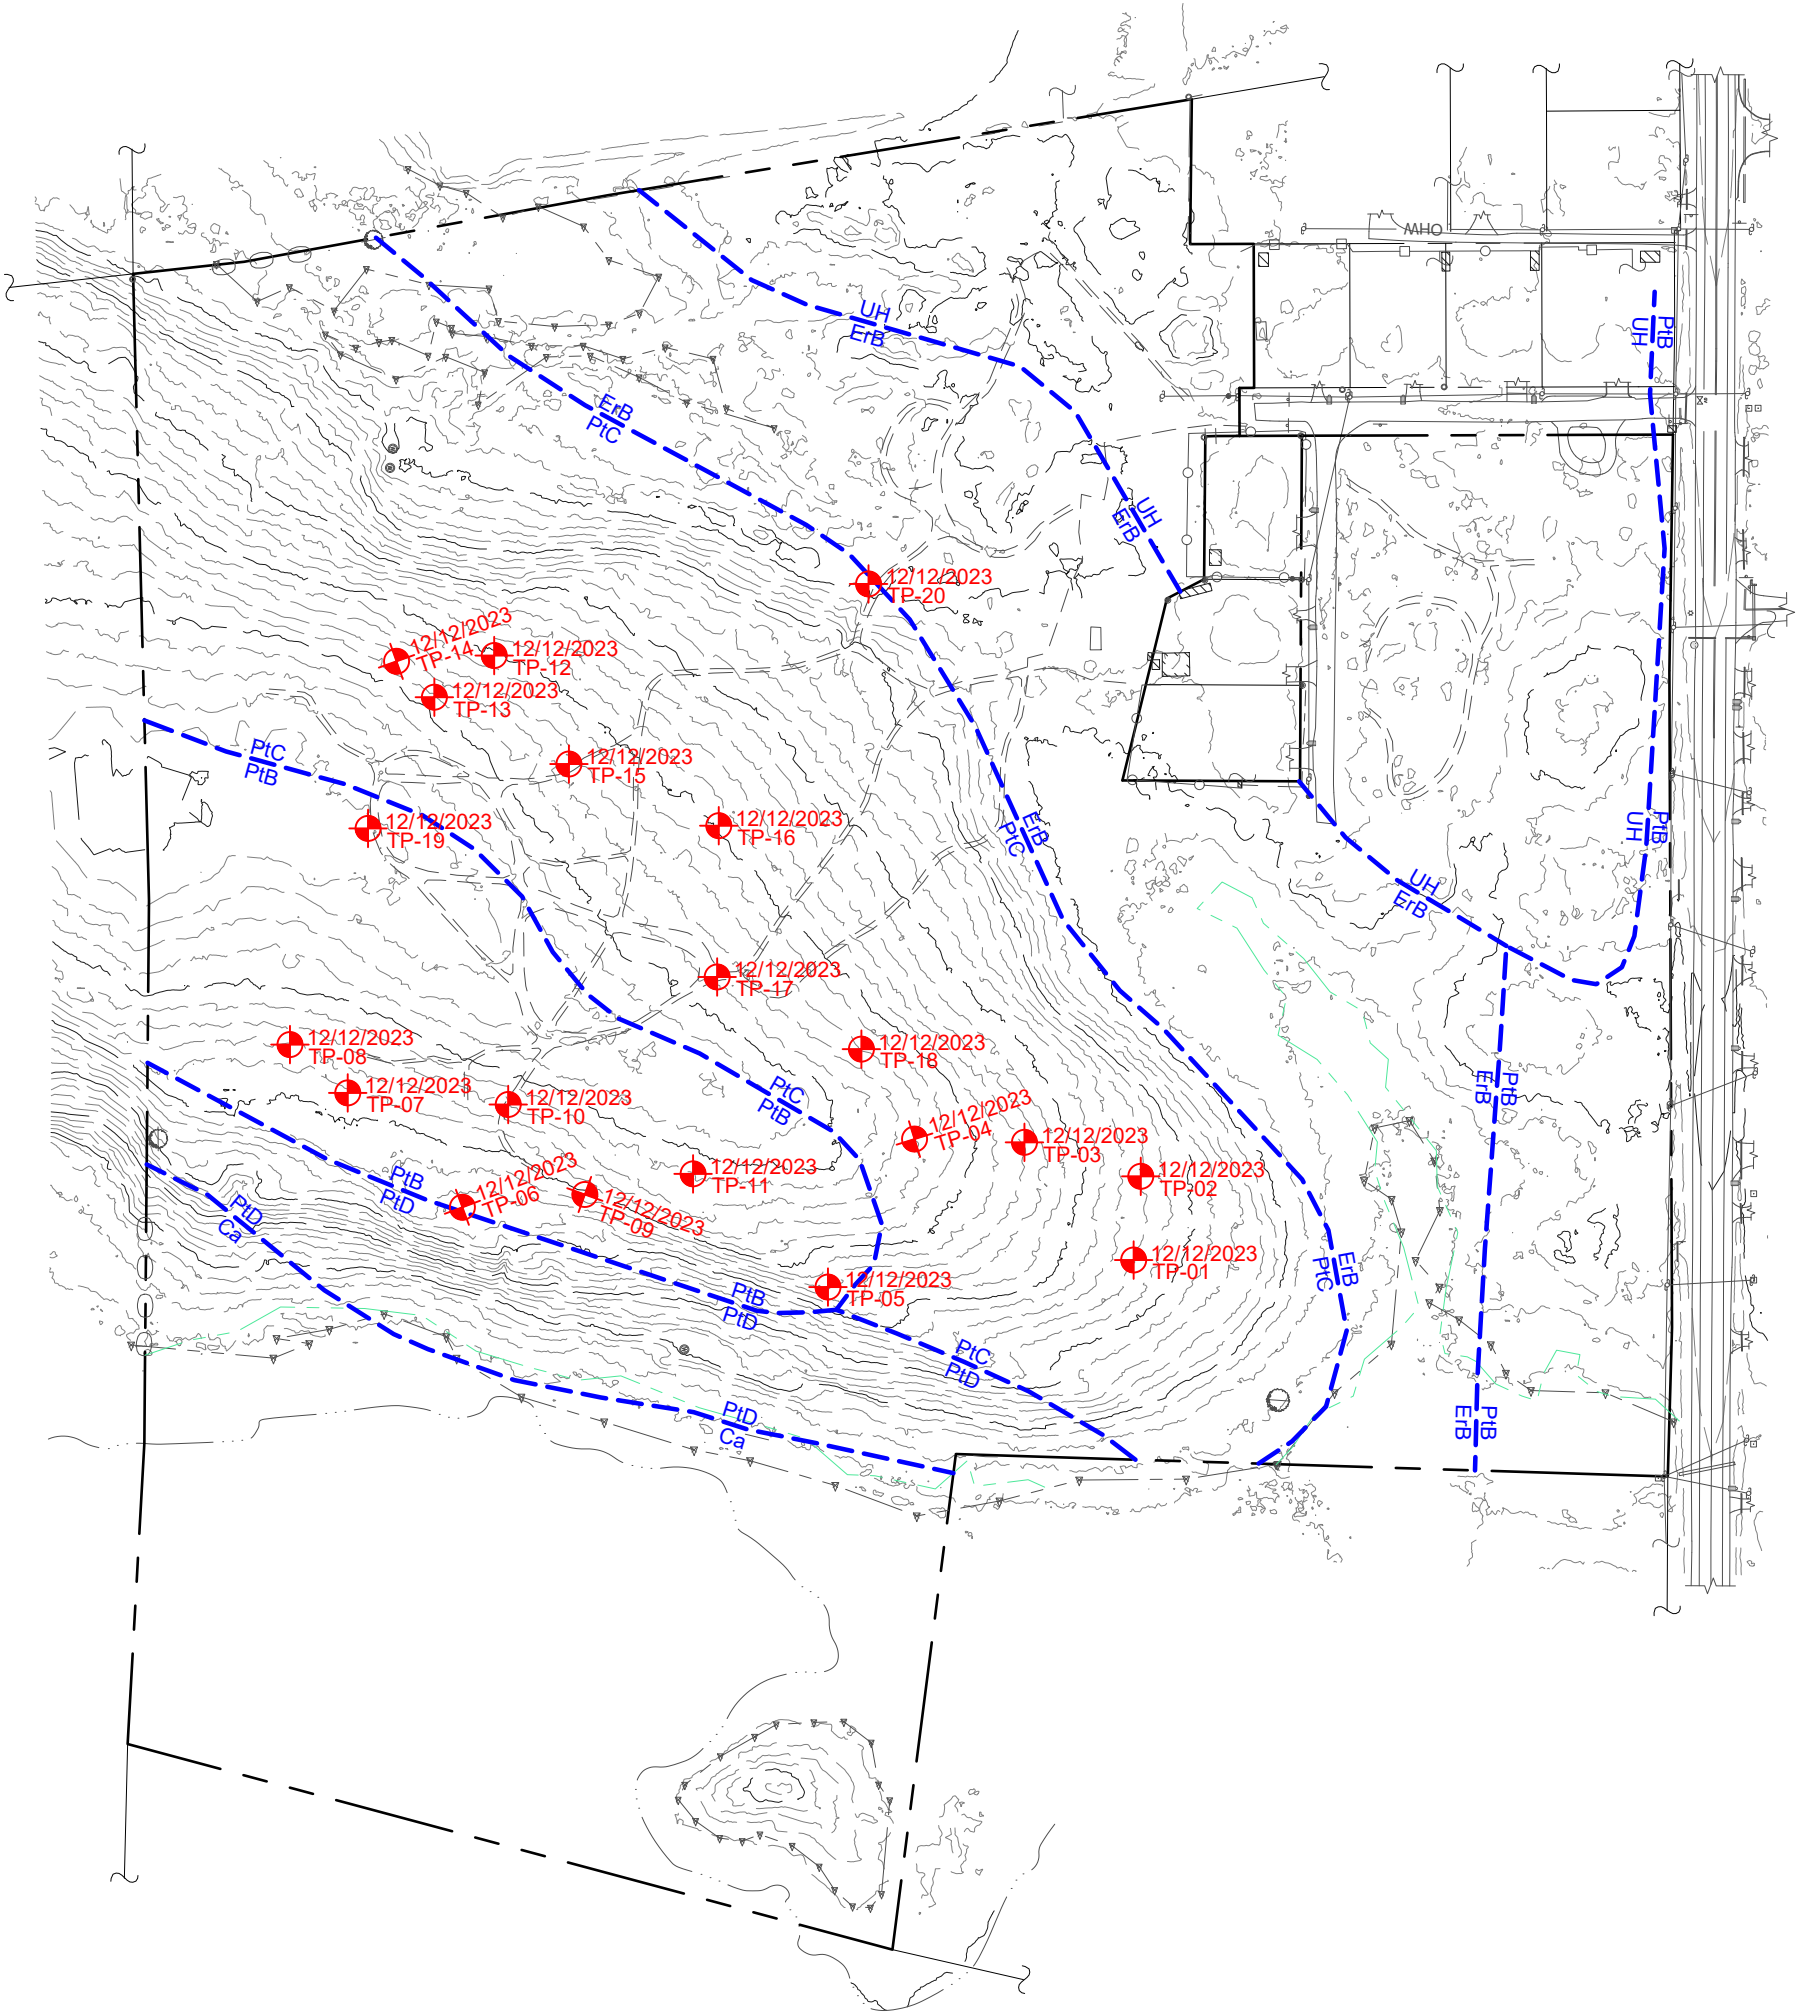

SOIL TYPE	DEPTH TO BEDROCK	DEPTH TO WATER TABLE	EROSION FACTOR Kf	EROSION FACTOR Kw	PERCENT CLAY
Ca CANANDAIGUA SILT LOAM	>200 CM	0 IN	0.49	0.49	22.2%
ErB ERIE GRAVELLY SILT LOAM, 3 TO 8 PERCENT SLOPES	>200 CM	6 - 18 IN	0.32	0.20	22.0%
PiB PITTSFIELD GRAVELLY LOAM, 3 TO 8 PERCENT SLOPES	>200 CM	> 80 IN	0.28	0.17	11.4%
PiC PITTSFIELD GRAVELLY LOAM, 8 TO 15 PERCENT SLOPES	>200 CM	> 80 IN	0.28	0.17	11.3%
PiD PITTSFIELD GRAVELLY LOAM, 15 TO 25 PERCENT SLOPES	>200 CM	> 80 IN	0.28	0.17	11.2%
UH UDORTHENTS, SMOOTHED	>200 CM	36 - 72 IN	0.24	0.15	10.6%

SOIL TESTING LOCATIONS

SHEFFIELD GARDENS
NYS ROUTE 17K
TOWN OF MONTGOMERY
ORANGE COUNTY, NEW YORK

DATE: JAN '24
REV DEC. '25

SCALE: 1" = 200'

JOB # 103.0301

SHEET # GT-1

ENGINEERING & SURVEYING PROPERTIES

Achieving Successful Results with Innovative Designs

MONTGOMERY OFFICE
71 CLINTON STREET
MONTGOMERY, NY 12549
Ph: (845) 457-7727
WWW.EP-PC.COM

DEEP TEST PIT SOIL RESULTS

WO. NO. 103.0301	DATE 12/13/23	REVISED	SHEET 1	OF 4
----------------------------	-------------------------	---------	-------------------	----------------

PROJECT TITLE
Sheffield Gardens

LOCATION
NYS Route 17K, Montgomery, NY

CALCULATED BY
AK

APPROVED BY
RW

REF DRAWING(S)
Test Pit Locations 12-12-2023

Deep Test #	Depth	Soil Description
1 ~11:40am	0ft - 0.5ft 0.5ft - 3ft 3ft - 11ft 11ft - 14ft Seepage	Topsoil Tan Silty Clay Loam Brown Silty Clay Loam Brown Hard Silty Clay Loam Seepage found at 7ft
2 ~11:40am	0ft - 0.5ft 0.5ft - 5ft 5ft - 7ft Seepage	Topsoil Tan Silty Clay Loam Brown Hard Silty Clay Loam Seepage found at 5ft, large mottling at 5.5ft
3 ~11:40am	0ft - 0.5ft 0.5ft - 4ft Seepage	Topsoil Tan Silty Clay Loam Seepage found at 1.5ft and below
4 ~12:00pm	0ft - 0.5ft 0.5ft - 3ft 3ft - 9.5ft Seepage	Topsoil Tan Silty Clay Loam Brown Hard Silty Clay Loam Seepage found at 2ft, 3ft, and 6ft
5 ~12:20pm	0ft - 1ft 1ft - 2ft 2ft - 4.5ft Seepage	Topsoil Tan Silty Clay Loam Brown Hard Silty Clay Loam Seepage found at 2ft
6 ~12:40pm	0ft - 0.5ft 0.5ft - 2ft 2ft - 4.5ft Seepage	Topsoil Tan Silty Clay Loam Brown Hard Silty Clay Loam Seepage found at 1ft and below

Comments: Rocks 1 - 12" diameter commonly observed in hard clay layer.

No bedrock found. Mottling commonly found inside brown hard clay when broken. Clay would become harder with depth

Hardness of clay occasionally prevented from going deeper. Isolated G.W. seepage found in hard clay layer

DEEP TEST PIT SOIL RESULTS

WO. NO. 103.0301	DATE 12/13/23	REVISED	SHEET 2	OF 4
----------------------------	-------------------------	---------	-------------------	----------------

PROJECT TITLE
Sheffield Gardens

LOCATION
NYS Route 17K, Montgomery, NY

CALCULATED BY
AK

APPROVED BY
RW

REF DRAWING(S)
Test Pit Locations 12-12-2023

Deep Test #	Depth	Soil Description
7 ~1:10pm	0ft - 1ft 1ft - 3ft 3ft - 9.5ft Seepage	Topsoil Tan Silty Clay Loam Brown Hard Silty Clay Loam Groundwater found between 1ft - 5ft, mottling @ 3ft
8 ~1:55pm	0ft - 1ft 1ft - 4ft 4ft - 11ft Seepage	Topsoil Tan Silty Clay Loam Brown Hard Silty Clay Loam Groundwater found between 1ft - 4ft, mottling @ 4ft
9 ~2:25pm	0ft - 1ft 1ft - 4ft 4ft - 6.5ft Seepage	Topsoil Tan Silty Clay Loam Brown Hard Silty Clay Loam Groundwater found between 1ft - 4ft
10 ~3:00pm	0ft - 1ft 1ft - 3ft 3ft - 8ft 8ft - 11ft Seepage	Topsoil Tan Silty Clay Loam Brown Silty Clay Loam Brown Hard Silty Clay Loam Groundwater found between 1ft - 8ft
11 ~3:50pm	0ft - 1ft 1ft - 5ft 5ft - 13 Seepage	Topsoil Tan Silty Clay Loam Brown Hard Silty Clay Loam Groundwater seepage found between 1ft - 5ft

Comments: Rocks 1 - 12" diameter commonly observed in hard clay layer.

No bedrock found. Mottling commonly found inside brown hard clay when broken. Clay would become harder with depth

Hardness of clay occasionally prevented from going deeper. Isolated G.W. seepage found in hard clay layer

DEEP TEST PIT SOIL RESULTS

WO. NO. 103.0301	DATE 12/14/23	REVISED	SHEET 3	OF 4
----------------------------	-------------------------	---------	-------------------	----------------

PROJECT TITLE
Sheffield Gardens

LOCATION
NYS Route 17K, Montgomery, NY

CALCULATED BY
AK

APPROVED BY
RW

REF DRAWING(S)
Test Pit Locations 12-12-2023

Deep Test #	Depth	Soil Description
12 ~8:15am	0ft - 0.5ft 0.5ft - 3ft 3ft - 5ft Seepage	Topsoil Tan Silty Clay Loam Brown Hard Silty Clay Loam Seepage found between 0.5ft - 3ft
13 ~8:25am	0ft - 1ft 1ft - 3ft 3ft - 4.5ft Seepage	Topsoil Tan Silty Clay Loam Brown Hard Silty Clay Loam Seepage found between 1ft - 3ft
14 ~9:00am	0ft - 1ft 1ft - 3ft 3ft - 10.5ft 10.5ft - 11.5ft Seepage	Topsoil Tan Silty Clay Loam Brown Hard Silty Clay Loam Brown-Grey Hard Silty Clay Loam Seepage found between 1ft - 11.5ft
15 ~9:45am	0ft - 1ft 1ft - 3ft 3ft - 10.5ft Seepage	Topsoil Tan Silty Clay Loam Brown Hard Silty Clay Loam Seepage found between 1ft -7ft, mottling found at 7ft
16 ~10:15am	0ft - 1ft 1ft - 3ft 3ft - 4.5ft Seepage	Topsoil Tan Silty Clay Loam Brown Hard Silty Clay Loam Seepage seepage found 1ft - 4.5ft
17 ~11:15am	0ft - 1ft 1ft - 2.5ft 2.5ft - 12ft 12ft - 13ft Seepage	Topsoil Tan Silty Clay Loam Brown Hard Silty Clay Loam Brown-Grey Hard Silty Clay Loam Seepage found between 1ft - 7ft

Comments: Rocks 1 - 12" diameter commonly observed in hard clay layer.

No bedrock found. Mottling commonly found inside brown hard clay when broken. Clay would become harder with depth

Hardness of clay occasionally prevented from going deeper. Isolated G.W. seepage found in hard clay layer

DEEP TEST PIT SOIL RESULTS

WO. NO. 103.0301	DATE 12/14/23	REVISED	SHEET 4	OF 4
----------------------------	-------------------------	---------	-------------------	----------------

PROJECT TITLE
Sheffield Gardens

LOCATION
NYS Route 17K, Montgomery, NY

CALCULATED BY
AK

APPROVED BY
RW

REF DRAWING(S)
Test Pit Locations 12-12-2023

Deep Test #	Depth	Soil Description
18 ~11:40am	0ft - 1ft	Topsoil
	1ft - 4ft	Tan Silty Clay Loam
	4ft - 10.5ft	Brown Hard Silty Clay Loam
	Seepage	Seepage found between 1ft - 7ft
19 ~12:20pm	0ft - 1ft	Topsoil
	1ft - 3ft	Tan Silty Clay Loam
	3ft - 8ft	Brown Hard Silty Clay Loam
	Seepage	Seepage found between 1ft - 3ft
20 ~12:45pm	0ft - 1ft	Topsoil
	1ft - 3ft	Tan Silty Clay Loam
	3ft - 6ft	Brown Hard Silty Clay Loam
	Seepage	Seepage found between 1ft - 3ft

Comments: Rocks 1 - 12" diameter commonly observed in hard clay layer.

No bedrock found. Mottling commonly found inside brown hard clay when broken. Clay would become harder with depth

Hardness of clay occasionally prevented from going deeper. Isolated G.W. seepage found in hard clay layer

APPENDIX 4

CURVE NUMBER

CALCULATIONS



CURVE NUMBER (CN) WORKSHEET

WO. NO. 103.0301	DATE Jan '24	REVISED Dec '25	SHEET 1	OF 10
----------------------------	------------------------	---------------------------	-------------------	-----------------

PROJECT TITLE Sheffield Gardens		LOCATION Town of Montgomery	
CALCULATED BY ZS	APPROVED BY RW	REF DRAWING(S)	

1. Runoff curve number (CN)

Existing

Proposed

Subarea: **EX-A**

Soil Name & Hydrologic Group	Cover Description (cover type, treatment & conditions)	CN	Area (acres)	Product of CN x Area
	Impervious	98	1.115	109.27
A	Grass - Good Condition	39	0.233	9.09
B	Grass - Good Condition	61	0.394	24.03
D	Grass - Good Condition	80	0.301	24.08
A	Woods - Good Condition	30	2.111	63.33
B	Woods - Good Condition	55	3.154	173.47
D	Woods - Good Condition	77	22.105	1,702.09
	Water	98	5.905	578.69
TOTAL =			35.32	2684.046

$$\text{CN (weighted)} = \frac{\text{total product}}{\text{total area}} = \frac{2684.046}{35.318}$$

$$\text{CN (weighted)} = 75.997 \quad \text{Use CN} = \mathbf{76}$$

2. Runoff

$$S = 3.16$$

Frequency yr
Rainfall, P in
Runoff, Q in

Storm #1	Storm #2	Storm #3

(Use P and CN with table 2-1, fig 2-1, or eqns. 2-3 and 2-4)

CURVE NUMBER (CN) WORKSHEET

WO. NO.
103.0301

DATE
Jan '24

REVISED
Dec '25

SHEET
2

OF
10

PROJECT TITLE
Sheffield Gardens

LOCATION
Town of Montgomery

CALCULATED BY ZS	APPROVED BY RW
----------------------------	--------------------------

REF DRAWING(S)

1. Runoff curve number (CN)

Existing

Proposed

Subarea: **EX-B**

Soil Name & Hydrologic Group	Cover Description (cover type, treatment & conditions)	CN	Area (acres)	Product of CN x Area
	Impervious	98	1.111	108.88
A	Grass - Good Condition	39	2.488	97.03
B	Grass - Good Condition	61	0.000	
D	Grass - Good Condition	80	0.461	36.88
A	Woods - Good Condition	30	5.012	150.36
B	Woods - Good Condition	55	0.000	
D	Woods - Good Condition	77	14.037	1,080.85
	Water	98	0.00	
		TOTAL =	23.11	1473.999

$$\text{CN (weighted)} = \frac{\text{total product}}{\text{total area}} = \frac{1473.999}{23.109}$$

CN (weighted) = 63.785 Use CN= **64**

2. Runoff

$$S = 5.63$$

Frequency	yr
Rainfall, P	in
Runoff, Q	in

<i>Storm #1</i>	<i>Storm #2</i>	<i>Storm #3</i>

(Use P and CN with table 2-1, fig 2-1, or eqns. 2-3 and 2-4)



CURVE NUMBER (CN) WORKSHEET

WO. NO. 103.0301	DATE Jan '24	REVISED Dec '25	SHEET 3	OF 10
----------------------------	------------------------	---------------------------	-------------------	-----------------

PROJECT TITLE Sheffield Gardens	LOCATION Town of Montgomery
CALCULATED BY ZS	APPROVED BY RW
REF DRAWING(S)	

1. Runoff curve number (CN)

Existing Proposed Subarea: **PR-A1-A**

Soil Name & Hydrologic Group	Cover Description (cover type, treatment & conditions)	CN	Area (acres)	Product of CN x Area
	Impervious	98	2.757	270.19
A	Grass - Good Condition	39	0.000	
B	Grass - Good Condition	61	0.000	
D	Grass - Good Condition	80	2.206	176.48
A	Woods - Good Condition	30	0.000	
B	Woods - Good Condition	55	0.000	
D	Woods - Good Condition	77	0.006	0.46
	Water	98	0.000	
TOTAL =			4.97	447.128

$$\text{CN (weighted)} = \frac{\text{total product}}{\text{total area}} = \frac{447.128}{4.969}$$

$$\text{CN (weighted)} = 89.983 \quad \text{Use CN} = \mathbf{90}$$

2. Runoff

$$S = 1.11$$

Frequency yr
Rainfall, P in
Runoff, Q in

Storm #1	Storm #2	Storm #3

(Use P and CN with table 2-1, fig 2-1, or eqns. 2-3 and 2-4)

CURVE NUMBER (CN) WORKSHEET

WO. NO.
103.0301

DATE
Jan '24

REVISED
Dec '25

SHEET
4

OF
10

PROJECT TITLE	Sheffield Gardens
---------------	-------------------

LOCATION
Town of Montgomery

CALCULATED BY ZS	APPROVED BY RW
----------------------------	--------------------------

REF DRAWING(S)

1. Runoff curve number (CN)

Existing **Proposed** Subarea: **PR-A1-B**

Soil Name & Hydrologic Group	Cover Description (cover type, treatment & conditions)	CN	Area (acres)	Product of CN x Area
	Impervious	98	2.268	222.26
A	Grass - Good Condition	39	0.000	
B	Grass - Good Condition	61	0.000	
D	Grass - Good Condition	80	2.164	173.12
A	Woods - Good Condition	30	0.000	
B	Woods - Good Condition	55	0.000	
D	Woods - Good Condition	77	0.000	
	Water	98	0.000	
		TOTAL =	4.43	395.384

$$\text{CN (weighted)} = \frac{\text{total product}}{\text{total area}} = \frac{395.384}{4.432}$$

CN (weighted) = 89.211 Use CN= **89**

2. Runoff

$$S = 1.24$$

Frequency	yr
Rainfall, P	in
Runoff, Q	in

<i>Storm #1</i>	<i>Storm #2</i>	<i>Storm #3</i>

(Use P and CN with table 2-1, fig 2-1, or eqns. 2-3 and 2-4)

CURVE NUMBER (CN) WORKSHEET

WO. NO.
103.0301

DATE
Jan '24

REVISED
Dec '25

SHEET
5

OF
10

PROJECT TITLE	Sheffield Gardens
---------------	-------------------

LOCATION
Town of Montgomery

CALCULATED BY ZS	APPROVED BY RW
----------------------------	--------------------------

REF DRAWING(S)

1. Runoff curve number (CN)

Existing	Proposed	Subarea:	PR-A1-C
----------	-----------------	----------	----------------

Soil Name & Hydrologic Group	Cover Description (cover type, treatment & conditions)	CN	Area (acres)	Product of CN x Area
	Impervious	98	0.000	
A	Grass - Good Condition	39	0.000	
B	Grass - Good Condition	61	0.000	
D	Grass - Good Condition	80	0.667	53.36
A	Woods - Good Condition	30	0.000	
B	Woods - Good Condition	55	0.000	
D	Woods - Good Condition	77	0.000	
	Water	98	0.000	
		TOTAL =	0.67	53.36

$$\text{CN (weighted)} = \frac{\text{total product}}{\text{total area}} = \frac{53.36}{0.667}$$

CN (weighted) = 80.000 Use CN= **80**

2. Runoff

S = 2.50

Frequency	yr
Rainfall, P	in
Runoff, Q	in

<i>Storm #1</i>	<i>Storm #2</i>	<i>Storm #3</i>

(Use P and CN with table 2-1, fig 2-1, or eqns. 2-3 and 2-4)

CURVE NUMBER (CN) WORKSHEET

WO. NO.
103.0301

DATE
Jan '24

REVISED
Dec '25

SHEET
6

OF
10

PROJECT TITLE	Sheffield Gardens
---------------	-------------------

LOCATION
Town of Montgomery

CALCULATED BY ZS	APPROVED BY RW
----------------------------	--------------------------

REF DRAWING(S)

1. Runoff curve number (CN)

Existing	Proposed	Subarea:	PR-A2
----------	----------	----------	--------------

Soil Name & Hydrologic Group	Cover Description (cover type, treatment & conditions)	CN	Area (acres)	Product of CN x Area
	Impervious	98	2.507	245.69
A	Grass - Good Condition	39	1.062	41.42
B	Grass - Good Condition	61	0.609	37.15
D	Grass - Good Condition	80	2.036	162.88
A	Woods - Good Condition	30	2.216	66.48
B	Woods - Good Condition	55	2.590	142.45
D	Woods - Good Condition	77	10.084	776.47
	Water	98	5.905	578.69
		TOTAL =	27.01	2051.221

$$\text{CN (weighted)} = \frac{\text{total product}}{\text{total area}} = \frac{2051.221}{27.009}$$

CN (weighted) = 75.946 Use CN= **76**

2. Runoff

S = 3.16

Frequency	yr
Rainfall, P	in
Runoff, Q	in

<i>Storm #1</i>	<i>Storm #2</i>	<i>Storm #3</i>

(Use P and CN with table 2-1, fig 2-1, or eqns. 2-3 and 2-4)



CURVE NUMBER (CN) WORKSHEET

WO. NO. 103.0301	DATE Jan '24	REVISED Dec '25	SHEET 7	OF 10
----------------------------	------------------------	---------------------------	-------------------	-----------------

PROJECT TITLE Sheffield Gardens	LOCATION Town of Montgomery
CALCULATED BY ZS	APPROVED BY RW
REF DRAWING(S)	

1. Runoff curve number (CN)

Existing Proposed Subarea: **PR-B1-A**

Soil Name & Hydrologic Group	Cover Description (cover type, treatment & conditions)	CN	Area (acres)	Product of CN x Area
	Impervious	98	2.547	249.61
A	Grass - Good Condition	39	0.053	2.07
B	Grass - Good Condition	61	0.000	
D	Grass - Good Condition	80	2.251	180.08
A	Woods - Good Condition	30	0.000	
B	Woods - Good Condition	55	0.000	
D	Woods - Good Condition	77	0.034	2.62
	Water	98	0.000	
		TOTAL =	4.89	434.371

$$\text{CN (weighted)} = \frac{\text{total product}}{\text{total area}} = \frac{434.371}{4.885}$$

$\text{CN (weighted)} = 88.919$

 Use CN= **89**

2. Runoff

S = 1.24

Frequency yr
 Rainfall, P in
 Runoff, Q in

Storm #1	Storm #2	Storm #3

(Use P and CN with table 2-1, fig 2-1, or eqns. 2-3 and 2-4)



CURVE NUMBER (CN) WORKSHEET

WO. NO. 103.0301	DATE Jan '24	REVISED Dec '25	SHEET 8	OF 10
----------------------------	------------------------	---------------------------	-------------------	-----------------

PROJECT TITLE Sheffield Gardens		LOCATION Town of Montgomery	
CALCULATED BY ZS	APPROVED BY RW	REF DRAWING(S)	

1. Runoff curve number (CN)

Existing Proposed Subarea: **PR-B1-B**

Soil Name & Hydrologic Group	Cover Description (cover type, treatment & conditions)	CN	Area (acres)	Product of CN x Area
	Impervious	98	2.200	215.60
A	Grass - Good Condition	39	0.061	2.38
B	Grass - Good Condition	61	0.000	
D	Grass - Good Condition	80	1.961	156.88
A	Woods - Good Condition	30	0.000	
B	Woods - Good Condition	55	0.000	
D	Woods - Good Condition	77	0.000	
	Water	98	0.000	
		TOTAL =	4.22	374.859

$$\text{CN (weighted)} = \frac{\text{total product}}{\text{total area}} = \frac{374.859}{4.222}$$

CN (weighted) = **88.787** Use CN= **89**

2. Runoff

S = 1.24

Frequency yr
 Rainfall, P in
 Runoff, Q in

Storm #1	Storm #2	Storm #3

(Use P and CN with table 2-1, fig 2-1, or eqns. 2-3 and 2-4)

CURVE NUMBER (CN) WORKSHEET

WO. NO.
103.0301

DATE
Jan '24

REVISED
Dec '25

SHEET
9

OF
10

PROJECT TITLE
Sheffield Gardens

LOCATION
Town of Montgomery

CALCULATED BY ZS	APPROVED BY RW
----------------------------	--------------------------

REF DRAWING(S)

1. Runoff curve number (CN)

Existing	Proposed	Subarea:	PR-B1-C
----------	----------	----------	----------------

Soil Name & Hydrologic Group	Cover Description (cover type, treatment & conditions)	CN	Area (acres)	Product of CN x Area
	Impervious	98	0.000	
A	Grass - Good Condition	39	0.461	17.98
B	Grass - Good Condition	61	0.000	
D	Grass - Good Condition	80	0.000	
A	Woods - Good Condition	30	0.000	
B	Woods - Good Condition	55	0.000	
D	Woods - Good Condition	77	0.000	
	Water	98	0.000	
		TOTAL =	0.46	17.979

$$\text{CN (weighted)} = \frac{\text{total product}}{\text{total area}} = \frac{17.979}{0.461}$$

CN (weighted) = 39.000 Use CN= **39**

2. Runoff

S = 15.64

Frequency	yr
Rainfall, P	in
Runoff, Q	in

<i>Storm #1</i>	<i>Storm #2</i>	<i>Storm #3</i>

(Use P and CN with table 2-1, fig 2-1, or eqns. 2-3 and 2-4)



CURVE NUMBER (CN) WORKSHEET

WO. NO. 103.0301	DATE Jan '24	REVISED Dec '25	SHEET 10	OF 10
----------------------------	------------------------	---------------------------	--------------------	-----------------

PROJECT TITLE Sheffield Gardens	LOCATION Town of Montgomery
CALCULATED BY ZS	APPROVED BY RW
REF DRAWING(S)	

1. Runoff curve number (CN)

Existing Proposed Subarea: **PR-B2**

Soil Name & Hydrologic Group	Cover Description (cover type, treatment & conditions)	CN	Area (acres)	Product of CN x Area
	Impervious	98	1.330	130.34
A	Grass - Good Condition	39	2.728	106.39
B	Grass - Good Condition	61	0.000	
D	Grass - Good Condition	80	1.104	88.32
A	Woods - Good Condition	30	2.563	76.89
B	Woods - Good Condition	55	0.000	
D	Woods - Good Condition	77	4.057	312.39
	Water	98	0.000	
		TOTAL =	11.78	714.331

$$\text{CN (weighted)} = \frac{\text{total product}}{\text{total area}} = \frac{714.331}{11.782}$$

$\text{CN (weighted)} = 60.629$

 Use CN= **61**

2. Runoff

S = 6.39

Frequency yr
 Rainfall, P in
 Runoff, Q in

Storm #1	Storm #2	Storm #3

(Use P and CN with table 2-1, fig 2-1, or eqns. 2-3 and 2-4)

APPENDIX 5

TIME OF CONCENTRATION

CALCULATIONS

TIME OF CONCENTRATION (T_c) WORKSHEET

WO. NO. 103.0301	DATE Jan '24	REVISED Dec '25	SHEET 1	OF 10
----------------------------	------------------------	---------------------------	-------------------	-----------------

PROJECT TITLE Sheffield Gardens		LOCATION Town of Montgomery		
CALCULATED BY ZS	APPROVED BY RW	REF DRAWING(S)		

Existing
 Proposed
 Area: **EX-A**

1. Sheet Flow

Surface Description (table 3-1)
 Manning's roughness coeff., 'n' (table 3-1)
 Flow length, L (total L ≤ 300 ft)
 Two-year 24-hour rainfall, P₂
 Land Slope, s

$$T_t = \frac{0.007 (nL)^{0.8}}{P_2^{0.5} s^{0.4}}$$

Segment
ID

ft
in
ft/ft
hr

A-B				
Woods: L				
0.40				
100				
3.50				
0.018				
0.357				0.357

2. Shallow Concentrated Flow

Surface description (paved or unpaved)
 Flow length, L
 Watercourse slope, s
 Average velocity, V (figure 3-1)

$$T_t = \frac{L}{3600 V}$$

Segment
ID

ft
ft/ft
ft/s
hr

B-C	C-D	D-E		
Unpaved	Unpaved	Unpaved		
506.6	375.0	419.7		
0.016	0.135	0.010		
2.028	5.928	1.613		
0.069	0.018	0.072		0.159

3. Channel Flow

Cross sectional flow area, a
 Wetted perimeter, p_w
 Hydraulic radius, r = a/p_w
 Channel slope, s
 Manning's roughness coefficient, n

$$V = \frac{1.49 r^{2/3} s^{1/2}}{n}$$

Flow Length, L

$$T_t = \frac{L}{3600 V}$$

Segment
ID

ft²
ft
ft
ft/ft
ft/s
ft
hr

Total T_c For Watershed or Subarea (Add Steps 6, 11, and 19) hr =

0.52

min =

31.20

TIME OF CONCENTRATION (T_c) WORKSHEET

WO. NO. 103.0301	DATE Jan '24	REVISED Dec '25	SHEET 2	OF 10
----------------------------	------------------------	---------------------------	-------------------	-----------------

PROJECT TITLE

Sheffield Gardens

LOCATION

Town of Montgomery

CALCULATED BY
ZS

APPROVED BY
RW

REF DRAWING(S)

Existing

Proposed

Area:

EX-B

1. Sheet Flow

Surface Description (table 3-1)

Manning's roughness coeff., 'n' (table 3-1)

Flow length, L (total L ≤ 300 ft)

Two-year 24-hour rainfall, P₂

Land Slope, s

$$T_t = \frac{0.007 (nL)^{0.8}}{P_2^{0.5} s^{0.4}}$$

Segment
ID

A-B

Woods: L

0.40

ft

100

in

3.50

ft/ft

0.018

hr

0.357

0.357

2. Shallow Concentrated Flow

Surface description (paved or unpaved)

Flow length, L

Watercourse slope, s

Average velocity, V (figure 3-1)

$$T_t = \frac{L}{3600 V}$$

Segment
ID

B-C

C-D

D-E

Unpaved

Unpaved

Unpaved

ft

228.7

597.0

588.1

ft/ft

0.013

0.082

0.009

ft/s

1.840

4.628

1.488

hr

0.035

0.036

0.110

0.180

3. Channel Flow

Cross sectional flow area, a

Wetted perimeter, p_w

Hydraulic radius, r = a/p_w

Channel slope, s

Manning's roughness coefficient, n

$$V = \frac{1.49 r^{2/3} s^{1/2}}{n}$$

Flow Length, L

$$T_t = \frac{L}{3600 V}$$

Segment
ID

ft²

ft

ft

ft/ft

ft/s

ft

hr

Total T_c For Watershed or Subarea (Add Steps 6, 11, and 19) hr =

0.54

min =

32.40

TIME OF CONCENTRATION (T_c) WORKSHEET

WO. NO. 103.0301	DATE Jan '24	REVISED Dec '25	SHEET 3	OF 10
----------------------------	------------------------	---------------------------	-------------------	-----------------

PROJECT TITLE Sheffield Gardens		LOCATION Town of Montgomery	
CALCULATED BY ZS	APPROVED BY RW	REF DRAWING(S)	

Existing Proposed Area: PR-A1-A

1. Sheet Flow

Surface Description (table 3-1)
Manning's roughness coeff., 'n' (table 3-1)
Flow length, L (total L ≤ 300 ft)
Two-year 24-hour rainfall, P₂
Land Slope, s

$$T_t = \frac{0.007 (nL)^{0.8}}{P_2^{0.5} s^{0.4}}$$

Segment
ID

A-B	B-C	C-D		
Grass: D	Paved	Grass: D		
0.24	0.01	0.24		
59	12	29		
3.50	3.50	3.50		
0.020	0.020	0.020		
0.149	0.004	0.084		0.237

2. Shallow Concentrated Flow

Surface description (paved or unpaved)
Flow length, L
Watercourse slope, s
Average velocity, V (figure 3-1)

$$T_t = \frac{L}{3600 V}$$

Segment
ID

D-E	E-F			
Unpaved	Paved			
93.0	7.6			
0.020	0.020			
2.282	2.875			
0.011	0.001			0.012

3. Channel Flow

Cross sectional flow area, a
Wetted perimeter, p_w
Hydraulic radius, r = a/p_w
Channel slope, s
Manning's roughness coefficient, n

$$V = \frac{1.49 r^{2/3} s^{1/2}}{n}$$

Flow Length, L

$$T_t = \frac{L}{3600 V}$$

Segment
ID

F-G				
1.23				
3.93				
0.31				
0.010				
0.035				
1.960				
879.0				
0.125				0.125

Total T_c For Watershed or Subarea (Add Steps 6, 11, and 19) hr =

0.37

min =

22.20

TIME OF CONCENTRATION (T_c) WORKSHEET

WO. NO. 103.0301	DATE Jan '24	REVISED Dec '25	SHEET 4	OF 10
----------------------------	------------------------	---------------------------	-------------------	-----------------

PROJECT TITLE Sheffield Gardens		LOCATION Town of Montgomery		
CALCULATED BY ZS	APPROVED BY RW	REF DRAWING(S)		

Existing Proposed Area: **PR-A1-B**

1. Sheet Flow

Surface Description (table 3-1)
Manning's roughness coeff., 'n' (table 3-1)
Flow length, L (total L ≤ 300 ft)
Two-year 24-hour rainfall, P₂
Land Slope, s

$$T_t = \frac{0.007 (nL)^{0.8}}{P_2^{0.5} s^{0.4}}$$

Segment
ID

A-B	B-C	C-D		
Grass: D	Paved	Grass: D		
0.24	0.01	0.24		
71	4	25		
3.50	3.50	3.50		
0.020	0.020	0.020		
0.173	0.001	0.075		0.249

2. Shallow Concentrated Flow

Surface description (paved or unpaved)
Flow length, L
Watercourse slope, s
Average velocity, V (figure 3-1)

$$T_t = \frac{L}{3600 V}$$

Segment
ID

D-E				
Unpaved				
93.0				
0.020				
2.282				
0.011				0.011

3. Channel Flow

Cross sectional flow area, a
Wetted perimeter, p_w
Hydraulic radius, r = a/p_w
Channel slope, s
Manning's roughness coefficient, n

$$V = \frac{1.49 r^{2/3} s^{1/2}}{n}$$

Flow Length, L

$$T_t = \frac{L}{3600 V}$$

Segment
ID

D-E				
1.23				
3.93				
0.31				
0.010				
0.035				
1.960				
706.0				
0.100				0.100

Total T_c For Watershed or Subarea (Add Steps 6, 11, and 19) hr =

0.36

min =

21.60

TIME OF CONCENTRATION (T_c) WORKSHEET

WO. NO. 103.0301	DATE Jan '24	REVISED Dec '25	SHEET 5	OF 10
----------------------------	------------------------	---------------------------	-------------------	-----------------

PROJECT TITLE Sheffield Gardens		LOCATION Town of Montgomery	
CALCULATED BY ZS	APPROVED BY RW	REF DRAWING(S)	

Existing Proposed Area: **PR-A1-B**

1. Sheet Flow

Surface Description (table 3-1)
Manning's roughness coeff., 'n' (table 3-1)
Flow length, L (total L ≤ 300 ft)
Two-year 24-hour rainfall, P₂
Land Slope, s

$$T_t = \frac{0.007 (nL)^{0.8}}{P_2^{0.5} s^{0.4}}$$

Segment
ID

A-B					
Grass: D					
0.24					
67					
3.50					
0.250					
0.060					0.060

2. Shallow Concentrated Flow

Surface description (paved or unpaved)
Flow length, L
Watercourse slope, s
Average velocity, V (figure 3-1)

$$T_t = \frac{L}{3600 V}$$

Segment
ID

					0.000

3. Channel Flow

Cross sectional flow area, a
Wetted perimeter, p_w
Hydraulic radius, r = a/p_w
Channel slope, s
Manning's roughness coefficient, n

$$V = \frac{1.49 r^{2/3} s^{1/2}}{n}$$

Flow Length, L

$$T_t = \frac{L}{3600 V}$$

Segment
ID

ft ²					
ft					
ft					
ft/ft					
ft/s					
ft					
hr					

Total T_c For Watershed or Subarea (Add Steps 6, 11, and 19) hr =

0.06

min =

3.60

Use a minimum of 6 minutes.

TIME OF CONCENTRATION (T_c) WORKSHEET

WO. NO. 103.0301	DATE Jan '24	REVISED Dec '25	SHEET 6	OF 10
----------------------------	------------------------	---------------------------	-------------------	-----------------

PROJECT TITLE Sheffield Gardens		LOCATION Town of Montgomery	
CALCULATED BY ZS	APPROVED BY RW	REF DRAWING(S)	

Existing Proposed Area: **PR-A2**

1. Sheet Flow

Surface Description (table 3-1)
Manning's roughness coeff., 'n' (table 3-1)
Flow length, L (total L ≤ 300 ft)
Two-year 24-hour rainfall, P₂
Land Slope, s

$$T_t = \frac{0.007 (nL)^{0.8}}{P_2^{0.5} s^{0.4}}$$

Segment
ID

ft
in
ft/ft
hr

A-B					
Woods: L					
0.40					
100					
3.50					
0.053					
0.232					0.232

2. Shallow Concentrated Flow

Surface description (paved or unpaved)
Flow length, L
Watercourse slope, s
Average velocity, V (figure 3-1)

$$T_t = \frac{L}{3600 V}$$

Segment
ID

ft
ft/ft
ft/s
hr

B-C	C-D				
Unpaved	Unpaved				
561.7	478.1				
0.099	0.010				
5.077	1.613				
0.031	0.082				0.113

3. Channel Flow

Cross sectional flow area, a
Wetted perimeter, p_w
Hydraulic radius, r = a/p_w
Channel slope, s
Manning's roughness coefficient, n

$$V = \frac{1.49 r^{2/3} s^{1/2}}{n}$$

Flow Length, L

$$T_t = \frac{L}{3600 V}$$

Segment
ID

ft²
ft
ft
ft/ft
ft/s
ft
hr

Total T_c For Watershed or Subarea (Add Steps 6, 11, and 19) hr =

0.34

min =

20.40

TIME OF CONCENTRATION (T_c) WORKSHEET

WO. NO. 103.0301	DATE Jan '24	REVISED Dec '25	SHEET 7	OF 10
----------------------------	------------------------	---------------------------	-------------------	-----------------

PROJECT TITLE Sheffield Gardens		LOCATION Town of Montgomery		
CALCULATED BY ZS	APPROVED BY RW	REF DRAWING(S)		

Existing Proposed Area: **PR-B1-A**

1. Sheet Flow

Surface Description (table 3-1)
Manning's roughness coeff., 'n' (table 3-1)
Flow length, L (total L ≤ 300 ft)
Two-year 24-hour rainfall, P₂
Land Slope, s

$$T_t = \frac{0.007 (nL)^{0.8}}{P_2^{0.5} s^{0.4}}$$

Segment
ID

A-B	B-C	C-D		
Grass: D	Paved	Grass: D		
0.24	0.01	0.24		
57	5	38		
3.50	3.50	3.50		
0.020	0.020	0.020		
0.145	0.002	0.105		0.252

2. Shallow Concentrated Flow

Surface description (paved or unpaved)
Flow length, L
Watercourse slope, s
Average velocity, V (figure 3-1)

$$T_t = \frac{L}{3600 V}$$

Segment
ID

B-C	C-D			
Unpaved	Paved			
93.0	10.5			
0.020	0.020			
2.282	2.875			
0.011	0.001			0.012

3. Channel Flow

Cross sectional flow area, a
Wetted perimeter, p_w
Hydraulic radius, r = a/p_w
Channel slope, s
Manning's roughness coefficient, n

$$V = \frac{1.49 r^{2/3} s^{1/2}}{n}$$

Flow Length, L

$$T_t = \frac{L}{3600 V}$$

Segment
ID

E-F				
1.23				
3.93				
0.31				
0.010				
0.035				
1.960				
740.0				
0.105				0.105

Total T_c For Watershed or Subarea (Add Steps 6, 11, and 19) hr =

0.37

min =

22.20

TIME OF CONCENTRATION (T_c) WORKSHEET

WO. NO. 103.0301	DATE Jan '24	REVISED Dec '25	SHEET 8	OF 10
----------------------------	------------------------	---------------------------	-------------------	-----------------

PROJECT TITLE Sheffield Gardens		LOCATION Town of Montgomery	
CALCULATED BY ZS	APPROVED BY RW	REF DRAWING(S)	

Existing Proposed Area: **PR-B1-B**

1. Sheet Flow

Surface Description (table 3-1)
Manning's roughness coeff., 'n' (table 3-1)
Flow length, L (total L ≤ 300 ft)
Two-year 24-hour rainfall, P₂
Land Slope, s

$$T_t = \frac{0.007 (nL)^{0.8}}{P_2^{0.5} s^{0.4}}$$

Segment
ID

A-B				
Grass: D				
0.24				
100				
3.50				
0.020				
0.227				0.227

2. Shallow Concentrated Flow

Surface description (paved or unpaved)
Flow length, L
Watercourse slope, s
Average velocity, V (figure 3-1)

$$T_t = \frac{L}{3600 V}$$

Segment
ID

B-C	C-D	D-E		
Unpaved	Paved	Paved		
19.0	5.0	76.0		
0.020	0.020	0.020		
2.282	2.875	2.875		
0.002	0.000	0.007		0.010

3. Channel Flow

Cross sectional flow area, a
Wetted perimeter, p_w
Hydraulic radius, r = a/p_w
Channel slope, s
Manning's roughness coefficient, n

$$V = \frac{1.49 r^{2/3} s^{1/2}}{n}$$

Flow Length, L

$$T_t = \frac{L}{3600 V}$$

Segment
ID

E-F				
1.23				
3.93				
0.31				
0.010				
0.035				
1.960				
552.0				
0.078				0.078

Total T_c For Watershed or Subarea (Add Steps 6, 11, and 19) hr =

0.32

min =

19.20

TIME OF CONCENTRATION (T_c) WORKSHEET

WO. NO. 103.0301	DATE Jan '24	REVISED Dec '25	SHEET 9	OF 10
----------------------------	------------------------	---------------------------	-------------------	-----------------

PROJECT TITLE Sheffield Gardens		LOCATION Town of Montgomery	
CALCULATED BY ZS	APPROVED BY RW	REF DRAWING(S)	

Existing Proposed Area: **PR-B1-B**

1. Sheet Flow

Surface Description (table 3-1)
Manning's roughness coeff., 'n' (table 3-1)
Flow length, L (total L ≤ 300 ft)
Two-year 24-hour rainfall, P₂
Land Slope, s

$$T_t = \frac{0.007 (nL)^{0.8}}{P_2^{0.5} s^{0.4}}$$

Segment
ID

A-B					
Grass: D					
0.24					
60					
3.50					
0.250					
0.055					0.055

2. Shallow Concentrated Flow

Surface description (paved or unpaved)
Flow length, L
Watercourse slope, s
Average velocity, V (figure 3-1)

$$T_t = \frac{L}{3600 V}$$

Segment
ID

					0.000

3. Channel Flow

Cross sectional flow area, a
Wetted perimeter, p_w
Hydraulic radius, r = a/p_w
Channel slope, s
Manning's roughness coefficient, n

$$V = \frac{1.49 r^{2/3} s^{1/2}}{n}$$

Flow Length, L

$$T_t = \frac{L}{3600 V}$$

Segment
ID

ft ²					
ft					
ft					
ft/ft					
ft/s					
ft					
hr					

Total T_c For Watershed or Subarea (Add Steps 6, 11, and 19) hr =

0.06

Use a minimum of 6 minutes.

min =

3.60

TIME OF CONCENTRATION (T_c) WORKSHEET

WO. NO. 103.0301	DATE Jan '24	REVISED Dec '25	SHEET 10	OF 10
----------------------------	------------------------	---------------------------	--------------------	-----------------

PROJECT TITLE Sheffield Gardens		LOCATION Town of Montgomery	
CALCULATED BY ZS	APPROVED BY RW	REF DRAWING(S)	

Existing Proposed Area: **PR-B3**

1. Sheet Flow

Surface Description (table 3-1)
Manning's roughness coeff., 'n' (table 3-1)
Flow length, L (total L ≤ 300 ft)
Two-year 24-hour rainfall, P₂
Land Slope, s

$$T_t = \frac{0.007 (nL)^{0.8}}{P_2^{0.5} s^{0.4}}$$

Segment
ID

A-B					
Woods: L					
0.40					
ft	100				
in	3.50				
ft/ft	0.027				
hr	0.303				0.303

2. Shallow Concentrated Flow

Surface description (paved or unpaved)
Flow length, L
Watercourse slope, s
Average velocity, V (figure 3-1)

$$T_t = \frac{L}{3600 V}$$

Segment
ID

B-C	C-D				
Unpaved	Unpaved				
ft	495.3	94.8			
ft/ft	0.108	0.029			
ft/s	5.298	2.748			
hr	0.026	0.010			0.036

3. Channel Flow

Cross sectional flow area, a
Wetted perimeter, p_w
Hydraulic radius, r = a/p_w
Channel slope, s
Manning's roughness coefficient, n

$$V = \frac{1.49 r^{2/3} s^{1/2}}{n}$$

Flow Length, L

$$T_t = \frac{L}{3600 V}$$

Segment
ID

ft ²					
ft					
ft					
ft/ft					
ft/s					
ft					
hr					

Total T_c For Watershed or Subarea (Add Steps 6, 11, and 19) hr =

0.34

min =

20.40


APPENDIX 6

WATER QUALITY VOLUME

CALCULATIONS & RUNOFF

REDUCTION VOLUME

CALCULATIONS

				WATER QUALITY VOLUME (WQ _v) CALCULATION SHEET				
				WO. NO. 103.0301	DATE Jan '24	REVISED Dec '25	SHEET 1	OF 2
PROJECT TITLE Sheffield Gardens				LOCATION Town of Montgomery				
CALCULATED BY ZS		APPROVED BY RW		Stormwater Management Design Point Designation PR-A				
$WQ_v = (P * R_v * A) / (12)$								
Drainage Area			90% Rainfall Event # (P)	Total Drainage Area (A)	Total Impervious Area (I)	R _v (0.05 + 0.009*I%)	WQ _v Required (Ac-ft)	WQ _v Required (ft ³)
PR-A			1.40	37.077	6.237	0.201	0.871	37,940.8
HSG	Area (Ac.)	%	S	Minimum RR_v = (P * 0.95 * S * I) / (12)				
A	4.149	11%	0.55	P = 1.40				
B	4.315	12%	0.40	S = 0.26				
C	0.000	0%	0.30	I = 6.24				
D	28.613	77%	0.20	RR_v MIN	0.181	Ac-ft		
Green Technology			Implemented ?		Drainage Area Reduction	Contributing Drainage Area Reduction	Total Drainage Area Reduction	Total Impervious Area Reduction
			Yes	No				
Area Reduction Practices								
Conservation of Natural Areas			<input type="checkbox"/>	<input checked="" type="checkbox"/>	-	-	-	-
Sheet Flow to Riparian Buffers or Filter Strips			<input type="checkbox"/>	<input checked="" type="checkbox"/>	-	-	-	-
Tree Planting / Tree Box			<input type="checkbox"/>	<input checked="" type="checkbox"/>	-	-	-	-
Subtotals							0.00	0.00
Revised WQ_v after Area Deductions			P	A	I	R_v	WQ_v	RR_v AREA
			1.40	37.08	6.24	0.201	0.871	0.000
Disconnection of Rooftop Runoff			Impervious Area Reduction:			0.00 Acres		
Revised WQ_v after Impervious Disconnect			P	A	I	R_v	WQ_v	RR_v IMP
			1.40	37.08	6.24	0.201	0.871	0.000
Source Control WQ_v Treatment Practices			Yes	No	WQ_v	RR_v SC*	(A) Reduction	(I) Reduction
Vegetated Open Swales			<input type="checkbox"/>	<input checked="" type="checkbox"/>	-	-	-	-
Rain Garden			<input type="checkbox"/>	<input checked="" type="checkbox"/>	-	-	-	-
Green Roof			<input type="checkbox"/>	<input checked="" type="checkbox"/>	-	-	-	-
Stormwater Planters			<input type="checkbox"/>	<input checked="" type="checkbox"/>	-	-	-	-
Rain Tanks / Cisterns			<input type="checkbox"/>	<input checked="" type="checkbox"/>	-	-	-	-
Porous Pavement			<input type="checkbox"/>	<input checked="" type="checkbox"/>	-	-	-	-
Standard SMP's with RR_v Capacity								
Infiltration			<input type="checkbox"/>	<input checked="" type="checkbox"/>	-	-	-	-
Bio-Retention			<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.582	0.264	9.40	5.03
Dry Swale (Open Channel)			<input type="checkbox"/>	<input checked="" type="checkbox"/>	-	-	-	-
Subtotals					0.582	0.264	9.40	5.03
Is The Total RR _v (RR _v AREA + RR _v IMP + RR _v SC)			0.264	≥ RR_v MIN ?		0.181	YES	
WQ_v Required by Standard Practices			P	A	I	R_v	WQ_v (Ac-ft)	WQ_v (ft³)
			1.40	27.68	1.21	0.089	0.289	12,575.9

* For Source Control (if used) RR_v calculations see attached Green Technology RR_v Calculation Sheets

RUNOFF REDUCTION VOLUME (RRv) CALCULATION SHEET

WO. NO. 103.0301	DATE Jan '24	REVISED Dec '25	SHEET 2	OF 2
----------------------------	------------------------	---------------------------	-------------------	----------------

PROJECT TITLE
Sheffield Gardens

LOCATION
Town of Montgomery

CALCULATED BY
ZS

APPROVED BY
RW

Stormwater Management Design Point Designation
PR-A

BIO-RETENTION

Requirement Checks

Yes

No

Notes:

Runoff enters as sheet flow or through a dissipator

☐
☒

Plunge pool forebay provided for pretreatment

Pretreatment provided

☒
☐

Design Complies with Required Elements of Practice

☒
☐

Infiltration designed to exfiltrate through bottom of practice only?

☐
☒

Underdrains are provided for filtration bioretention.

Drainage Area (Ac.) 9.401

Impervious Area (Ac.) 5.025

Rainfall Event # (P) 1.40

Rv 0.531

WQV_{REQ'D} 0.582

A_f (ft²) 11,970.0 Surface area of filter bed

d_t (ft) 2.5 depth of filter bed

k (ft/day) 1.0 coefficient of permability of filter media

h_f (ft) 0.50 average height of water above filter bed

t_f (days) 2.00 design filter bed drain time

V_f (ft³) 28,728.0 Design volume of filter (WQ_v Provided)

V_f > WQV_{REQ'D} **YES**

HSG Soil Classification D

RRv Reduction Allowance

Infiltration Bioretention F-4 100%

Filtration Bioretention F-5 40%*

RRv 0.264


*For practices with underdrains that require sizing the surface area of the filter bed using Darcy's Law, the designer can elect to oversize the surface area of the filter bed to provide additional storage volume and receive additional RRv credit up to 100% of the WQv required.

WQv Req.= 25372.14

WQv Prov. = 28,728.00

Increase Factor = 28,058.40/26016.79 = 1.132

Revised RRv Allowance = 1.078 * 40% = 45.29%

				WATER QUALITY VOLUME (WQ _v) CALCULATION SHEET				
				WO. NO. 1146.01	DATE Jan '24	REVISED Dec '25	SHEET 1	OF 2
PROJECT TITLE Sheffield Gardens				LOCATION Town of Montgomery				
CALCULATED BY ZS		APPROVED BY RW		Stormwater Management Design Point Designation PR-B				
$WQ_v = (P * R_v * A) / (12)$								
Drainage Area			90% Rainfall Event # (P)	Total Drainage Area (A)	Total Impervious Area (I)	R _v (0.05 + 0.009*I%)	WQ _v Required (Ac-ft)	WQ _v Required (ft ³)
PR-B			1.40	21.349	5.137	0.267	0.664	28,923.8
HSG	Area (Ac.)	%	S	Minimum RR_v = (P * 0.95 * S * I) / (12)				
A	7.048	33%	0.55	P = 1.40				
B	0.002	0%	0.40	S = 0.32				
C	0.000	0%	0.30	I = 5.14				
D	14.299	67%	0.20	RR_v MIN	0.180	Ac-ft		
Green Technology			Implemented ?		Drainage Area Reduction	Contributing Drainage Area Reduction	Total Drainage Area Reduction	Total Impervious Area Reduction
			Yes	No				
Area Reduction Practices								
Conservation of Natural Areas			<input type="checkbox"/>	<input checked="" type="checkbox"/>	-	-	-	-
Sheet Flow to Riparian Buffers or Filter Strips			<input type="checkbox"/>	<input checked="" type="checkbox"/>	-	-	-	-
Tree Planting / Tree Box			<input type="checkbox"/>	<input checked="" type="checkbox"/>	-	-	-	-
Subtotals							0.00	0.00
Revised WQ_v after Area Deductions			P	A	I	R_v	WQ_v	RR_v AREA
			1.40	21.35	5.14	0.267	0.664	0.000
Disconnection of Rooftop Runoff			Impervious Area Reduction:			0.00 Acres		
Revised WQ_v after Impervious Disconnect			P	A	I	R_v	WQ_v	RR_v IMP
			1.40	21.35	5.14	0.267	0.664	0.000
Source Control WQ _v Treatment Practices			Yes	No	WQ_v	RR_v SC*	(A) Reduction	(I) Reduction
Vegetated Open Swales			<input type="checkbox"/>	<input checked="" type="checkbox"/>	-	-	-	-
Rain Garden			<input type="checkbox"/>	<input checked="" type="checkbox"/>	-	-	-	-
Green Roof			<input type="checkbox"/>	<input checked="" type="checkbox"/>	-	-	-	-
Stormwater Planters			<input type="checkbox"/>	<input checked="" type="checkbox"/>	-	-	-	-
Rain Tanks / Cisterns			<input type="checkbox"/>	<input checked="" type="checkbox"/>	-	-	-	-
Porous Pavement			<input type="checkbox"/>	<input checked="" type="checkbox"/>	-	-	-	-
Standard SMP's with RR_v Capacity								
Infiltration			<input type="checkbox"/>	<input checked="" type="checkbox"/>	-	-	-	-
Bio-Retention			<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.552	0.224	9.11	4.75
Dry Swale (Open Channel)			<input type="checkbox"/>	<input checked="" type="checkbox"/>	-	-	-	-
Subtotals					0.552	0.224	9.11	4.75
Is The Total RR _v (RR _v AREA + RR _v IMP + RR _v SC)			0.224	≥ RR_v MIN ?		0.180	YES	
WQ_v Required by Standard Practices			P	A	I	R_v	WQ_v (Ac-ft)	WQ_v (ft³)
			1.40	12.24	0.39	0.079	0.112	4,894.5

* For Source Control (if used) RR_v calculations see attached Green Technology RR_v Calculation Sheets

RUNOFF REDUCTION VOLUME (RRv) CALCULATION SHEET

WO. NO. 1146.01	DATE Jan '24	REVISED Dec '25	SHEET 2	OF 2
---------------------------	------------------------	---------------------------	-------------------	----------------

PROJECT TITLE Sheffield Gardens		LOCATION Town of Montgomery
CALCULATED BY ZS	APPROVED BY RW	Stormwater Management Design Point Designation PR-B

BIO-RETENTION

Requirement Checks

Yes

No

Notes:

Runoff enters as sheet flow or through a dissipator	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Plunge pool forebay provided for pretreatment
Pretreatment provided	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
Design Complies with Required Elements of Practice	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
Infiltration designed to exfiltrate through bottom of practice only?	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Underdrains are provided for filtration bioretention.

Drainage Area (Ac.)	9.107	
Impervious Area (Ac.)	4.747	
Rainfall Event # (P)	1.40	
Rv	0.519	
WQV _{REQ'D}	0.552	
A _f (ft ²)	10,176.0	Surface area of filter bed
d _t (ft)	2.5	depth of filter bed
k (ft/day)	1.0	coefficient of permability of filter media
h _f (ft)	0.50	average height of water above filter bed
t _f (days)	2.00	design filter bed drain time
V _f (ft ³)	24,422.4	Design volume of filter (WQ _v Provided)
V _f > WQV _{REQ'D}	YES	
HSG Soil Classification	D	

RRv Reduction Allowance

Infiltration Bioretention F-4	100%
Filtration Bioretention F-5	40%*

*For practices with underdrains that require sizing the surface area of the filter bed using Darcy's Law, the designer can elect to oversize the surface area of the filter bed to provide additional storage volume and receive additional RRv credit up to 100% of the WQv required.

RRv	0.224
-----	-------

WQv Req.= 24025.92 WQv Prov. = 24,422.40
 Increase Factor = 28,058.40/26016.79 = 1.017
 Revised RRv Allowance = 1.078 * 40% = 40.66%

APPENDIX 7

HYDROGRAPH SUMMARIES &

DIAGRAMS

Extreme Precipitation Tables

Northeast Regional Climate Center

Data represents point estimates calculated from partial duration series. All precipitation amounts are displayed in inches.

Smoothing
State
Location
Latitude
Longitude
Elevation
Date/Time

Yes
New York
New York, United States
41.523 degrees North
74.211 degrees West
120 feet
Wed Dec 06 2023 08:27:24 GMT-0500 (Eastern Standard Time)




Extreme Precipitation Estimates

	5min	10min	15min	30min	60min	120min	1hr	2hr	3hr	6hr	12hr	24hr	48hr		1day	2day	4day	7day	10day	
1yr	0.32	0.50	0.62	0.81	1.01	1.26	0.87	1.18	1.44	1.76	2.15	2.62	3.03	1yr	2.32	2.91	3.37	4.01	4.66	1yr
2yr	0.39	0.60	0.74	0.98	1.23	1.53	1.06	1.42	1.75	2.14	2.61	3.17	3.61	2yr	2.80	3.47	3.98	4.68	5.33	2yr
5yr	0.45	0.71	0.89	1.19	1.52	1.91	1.31	1.76	2.20	2.70	3.28	3.96	4.56	5yr	3.50	4.38	5.01	5.76	6.53	5yr
10yr	0.51	0.80	1.01	1.38	1.79	2.27	1.54	2.06	2.61	3.21	3.89	4.69	5.44	10yr	4.15	5.23	5.97	6.75	7.62	10yr
25yr	0.59	0.95	1.20	1.67	2.22	2.84	1.92	2.55	3.29	4.04	4.90	5.87	6.88	25yr	5.19	6.61	7.53	8.32	9.36	25yr
50yr	0.67	1.08	1.39	1.95	2.62	3.37	2.26	3.00	3.91	4.81	5.82	6.96	8.22	50yr	6.16	7.90	8.99	9.75	10.94	50yr
100yr	0.77	1.24	1.60	2.27	3.09	4.01	2.67	3.52	4.66	5.74	6.93	8.25	9.83	100yr	7.30	9.45	10.73	11.44	12.80	100yr
200yr	0.87	1.42	1.84	2.64	3.65	4.77	3.15	4.15	5.55	6.83	8.24	9.80	11.76	200yr	8.67	11.30	12.83	13.43	14.98	200yr
500yr	1.04	1.72	2.24	3.26	4.56	5.99	3.94	5.15	6.99	8.61	10.38	12.30	14.91	500yr	10.89	14.34	16.25	16.61	18.47	500yr

Lower Confidence Limits

	5min	10min	15min	30min	60min	120min	1hr	2hr	3hr	6hr	12hr	24hr	48hr		1day	2day	4day	7day	10day	
1yr	0.29	0.45	0.55	0.74	0.91	1.08	0.79	1.05	1.23	1.54	1.98	2.21	2.47	1yr	1.96	2.38	3.00	3.63	3.93	1yr
2yr	0.37	0.58	0.71	0.96	1.18	1.41	1.02	1.38	1.60	2.05	2.56	3.05	3.48	2yr	2.70	3.35	3.83	4.51	5.15	2yr
5yr	0.42	0.64	0.80	1.10	1.39	1.64	1.20	1.60	1.86	2.38	2.99	3.60	4.13	5yr	3.19	3.97	4.56	5.25	6.00	5yr
10yr	0.46	0.71	0.88	1.22	1.58	1.83	1.36	1.79	2.08	2.67	3.36	4.07	4.70	10yr	3.61	4.52	5.21	5.88	6.73	10yr
25yr	0.52	0.80	0.99	1.42	1.87	2.11	1.61	2.06	2.40	3.09	3.89	4.80	5.57	25yr	4.25	5.35	6.18	6.86	7.91	25yr
50yr	0.58	0.88	1.10	1.58	2.12	2.35	1.83	2.29	2.68	3.47	4.37	5.43	6.35	50yr	4.80	6.10	7.08	7.72	8.97	50yr
100yr	0.65	0.98	1.22	1.77	2.42	2.62	2.09	2.56	3.01	3.90	4.92	6.14	7.25	100yr	5.43	6.97	8.12	8.82	10.20	100yr
200yr	0.72	1.09	1.38	2.00	2.79	2.91	2.40	2.85	3.36	4.41	5.53	6.90	8.29	200yr	6.11	7.97	9.33	10.02	11.63	200yr
500yr	0.85	1.26	1.62	2.36	3.36	3.37	2.90	3.30	3.91	5.18	6.50	8.06	9.93	500yr	7.14	9.55	11.24	11.89	13.93	500yr

Upper Confidence Limits

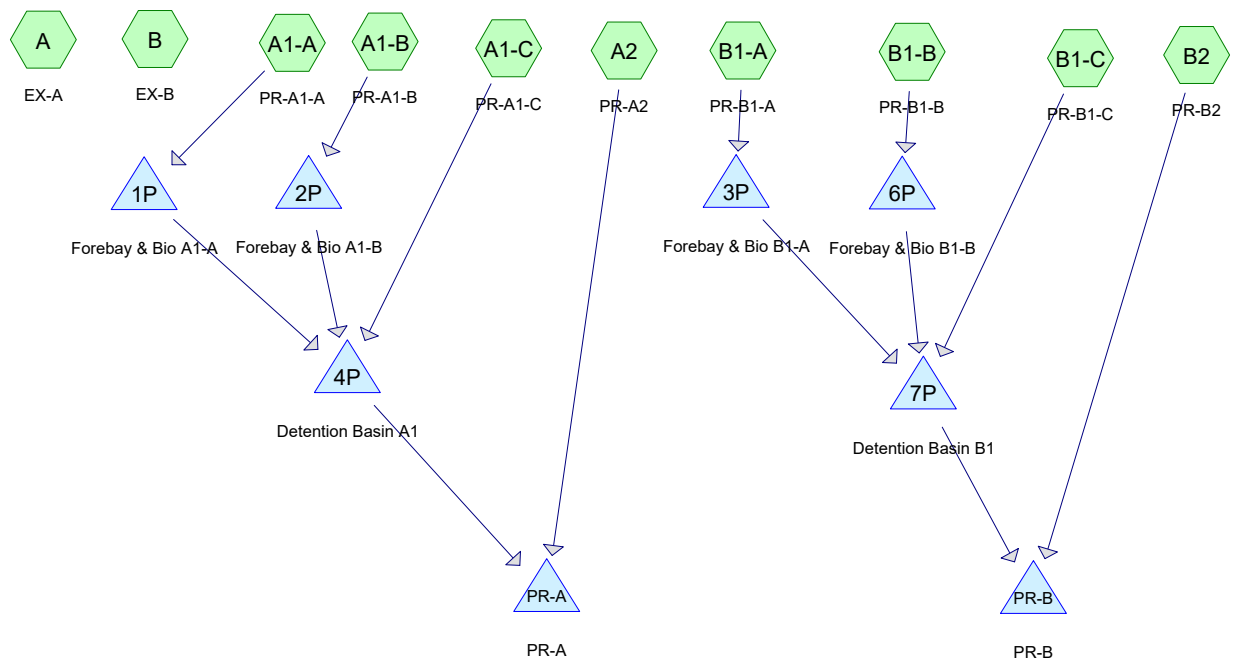

Routing Diagram for 103.0301 - Hydrographs

Prepared by Engineering Surveying Properties, Printed 12/8/2025
HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Multi-Event Tables

Printed 12/8/2025

Page 1

Events for Subcatchment A: EX-A

Event	Rainfall (inches)	Runoff (cfs)	Volume (acre-feet)	Depth (inches)
1-yr	2.62	15.58	2.261	0.77
10-yr	4.69	48.98	6.718	2.28
100-yr	8.25	111.57	15.852	5.39
500-yr	12.30	182.01	27.027	9.18

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Multi-Event Tables

Printed 12/8/2025

Page 2

Events for Subcatchment A1-A: PR-A1-A

Event	Rainfall (inches)	Runoff (cfs)	Volume (acre-feet)	Depth (inches)
1-yr	2.62	6.21	0.678	1.64
10-yr	4.69	12.66	1.482	3.58
100-yr	8.25	22.90	2.920	7.05
500-yr	12.30	33.81	4.580	11.06

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Multi-Event Tables

Printed 12/8/2025

Page 3

Events for Subcatchment A1-B: PR-A1-B

Event	Rainfall (inches)	Runoff (cfs)	Volume (acre-feet)	Depth (inches)
1-yr	2.62	5.36	0.576	1.56
10-yr	4.69	11.19	1.284	3.48
100-yr	8.25	20.50	2.560	6.93
500-yr	12.30	30.39	4.037	10.93

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Multi-Event Tables

Printed 12/8/2025

Page 4

Events for Subcatchment A1-C: PR-A1-C

Event	Rainfall (inches)	Runoff (cfs)	Volume (acre-feet)	Depth (inches)
1-yr	2.62	0.85	0.054	0.97
10-yr	4.69	2.20	0.146	2.62
100-yr	8.25	4.46	0.326	5.86
500-yr	12.30	6.82	0.541	9.74

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Multi-Event Tables

Printed 12/8/2025

Page 5

Events for Subcatchment A2: PR-A2

Event	Rainfall (inches)	Runoff (cfs)	Volume (acre-feet)	Depth (inches)
1-yr	2.62	14.91	1.729	0.77
10-yr	4.69	46.20	5.137	2.28
100-yr	8.25	103.89	12.122	5.39
500-yr	12.30	168.02	20.669	9.18

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Multi-Event Tables

Printed 12/8/2025

Page 6

Events for Subcatchment B: EX-B

Event	Rainfall (inches)	Runoff (cfs)	Volume (acre-feet)	Depth (inches)
1-yr	2.62	2.54	0.605	0.31
10-yr	4.69	17.46	2.663	1.38
100-yr	8.25	52.74	7.668	3.98
500-yr	12.30	96.48	14.315	7.43

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Multi-Event Tables

Printed 12/8/2025

Page 7

Events for Subcatchment B1-A: PR-B1-A

Event	Rainfall (inches)	Runoff (cfs)	Volume (acre-feet)	Depth (inches)
1-yr	2.62	5.82	0.635	1.56
10-yr	4.69	12.16	1.415	3.48
100-yr	8.25	22.28	2.822	6.93
500-yr	12.30	33.05	4.450	10.93

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Multi-Event Tables

Printed 12/8/2025

Page 8

Events for Subcatchment B1-B: PR-B1-B

Event	Rainfall (inches)	Runoff (cfs)	Volume (acre-feet)	Depth (inches)
1-yr	2.62	0.01	0.005	0.09
10-yr	4.69	0.25	0.039	0.78
100-yr	8.25	1.20	0.145	2.84
500-yr	12.30	2.51	0.299	5.87

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Multi-Event Tables

Printed 12/8/2025

Page 9

Events for Subcatchment B1-C: PR-B1-C

Event	Rainfall (inches)	Runoff (cfs)	Volume (acre-feet)	Depth (inches)
1-yr	2.62	0.00	0.000	0.00
10-yr	4.69	0.01	0.005	0.14
100-yr	8.25	0.41	0.049	1.26
500-yr	12.30	1.49	0.130	3.39

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Multi-Event Tables

Printed 12/8/2025

Page 10

Events for Subcatchment B2: PR-B2

Event	Rainfall (inches)	Runoff (cfs)	Volume (acre-feet)	Depth (inches)
1-yr	2.62	0.86	0.228	0.23
10-yr	4.69	9.10	1.165	1.19
100-yr	8.25	30.10	3.570	3.64
500-yr	12.30	56.59	6.848	6.98

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Multi-Event Tables

Printed 12/8/2025

Page 11

Events for Pond 1P: Forebay & Bio A1-A

Event	Inflow (cfs)	Primary (cfs)	Elevation (feet)	Storage (cubic-feet)
1-yr	6.21	5.75	408.62	68,576
10-yr	12.66	12.09	408.70	70,010
100-yr	22.90	22.25	409.00	75,659
500-yr	33.81	26.06	409.40	83,225

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Multi-Event Tables

Printed 12/8/2025

Page 12

Events for Pond 2P: Forebay & Bio A1-B

Event	Inflow (cfs)	Primary (cfs)	Elevation (feet)	Storage (cubic-feet)
1-yr	5.36	4.88	408.61	74,349
10-yr	11.19	10.58	408.68	75,787
100-yr	20.50	19.78	409.00	82,211
500-yr	30.39	21.67	409.40	90,637

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Multi-Event Tables

Printed 12/8/2025

Page 13

Events for Pond 3P: Forebay & Bio B1-A

Event	Inflow (cfs)	Primary (cfs)	Elevation (feet)	Storage (cubic-feet)
1-yr	5.82	4.70	408.72	61,882
10-yr	12.16	10.57	408.88	64,578
100-yr	22.28	14.85	409.39	73,813
500-yr	33.05	38.57	428.93	85,810

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Multi-Event Tables

Printed 12/8/2025

Page 14

Events for Pond 4P: Detention Basin A1

Event	Inflow (cfs)	Primary (cfs)	Elevation (feet)	Storage (cubic-feet)
1-yr	10.87	0.58	404.55	56,133
10-yr	23.33	0.74	408.23	111,560
100-yr	43.47	16.90	409.00	127,540
500-yr	49.78	47.53	409.39	136,327

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Multi-Event Tables

Printed 12/8/2025

Page 15

Events for Pond 6P: Forebay & Bio B1-B

Event	Inflow (cfs)	Primary (cfs)	Elevation (feet)	Storage (cubic-feet)
1-yr	0.01	0.00	408.50	43,154
10-yr	0.25	0.13	408.52	43,421
100-yr	1.20	0.83	408.57	44,137
500-yr	2.51	1.95	408.65	45,305

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Multi-Event Tables

Printed 12/8/2025

Page 16

Events for Pond 7P: Detention Basin B1

Event	Inflow (cfs)	Primary (cfs)	Elevation (feet)	Storage (cubic-feet)
1-yr	4.70	0.45	404.19	15,118
10-yr	10.64	0.60	407.04	39,262
100-yr	15.58	8.76	408.32	54,682
500-yr	41.12	23.73	408.63	59,000

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Multi-Event Tables

Printed 12/8/2025

Page 17

Events for Pond PR-A: PR-A

Event	Inflow (cfs)	Primary (cfs)	Elevation (feet)	Storage (acre-feet)
1-yr	15.32	15.32	0.00	0.000
10-yr	46.77	46.77	0.00	0.000
100-yr	104.61	104.61	0.00	0.000
500-yr	203.38	203.38	0.00	0.000

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Multi-Event Tables

Printed 12/8/2025

Page 18

Events for Pond PR-B: PR-B

Event	Inflow (cfs)	Primary (cfs)	Elevation (feet)	Storage (acre-feet)
1-yr	1.22	1.22	0.00	0.000
10-yr	9.53	9.53	0.00	0.000
100-yr	30.65	30.65	0.00	0.000
500-yr	64.67	64.67	0.00	0.000

APPENDIX 8

1-YEAR DESIGN STORM

HYDROGRAPHS

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"

Printed 12/8/2025

Page 1

Time span=0.00-48.00 hrs, dt=0.01 hrs, 4801 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

SubcatchmentA: EX-A	Runoff Area=35.318 ac 19.88% Impervious Runoff Depth=0.77" Tc=31.2 min CN=76 Runoff=15.58 cfs 2.261 af
SubcatchmentA1-A: PR-A1-A	Runoff Area=4.969 ac 55.48% Impervious Runoff Depth=1.64" Tc=22.2 min CN=90 Runoff=6.21 cfs 0.678 af
SubcatchmentA1-B: PR-A1-B	Runoff Area=4.432 ac 51.17% Impervious Runoff Depth=1.56" Tc=21.6 min CN=89 Runoff=5.36 cfs 0.576 af
SubcatchmentA1-C: PR-A1-C	Runoff Area=0.667 ac 0.00% Impervious Runoff Depth=0.97" Tc=6.0 min CN=80 Runoff=0.85 cfs 0.054 af
SubcatchmentA2: PR-A2	Runoff Area=27.009 ac 31.15% Impervious Runoff Depth=0.77" Tc=20.4 min CN=76 Runoff=14.91 cfs 1.729 af
SubcatchmentB: EX-B	Runoff Area=23.109 ac 4.81% Impervious Runoff Depth=0.31" Tc=32.4 min CN=64 Runoff=2.54 cfs 0.605 af
SubcatchmentB1-A: PR-B1-A	Runoff Area=4.885 ac 52.14% Impervious Runoff Depth=1.56" Tc=22.2 min CN=89 Runoff=5.82 cfs 0.635 af
SubcatchmentB1-B: PR-B1-B	Runoff Area=0.610 ac 25.08% Impervious Runoff Depth=0.09" Tc=19.2 min CN=54 Runoff=0.01 cfs 0.005 af
SubcatchmentB1-C: PR-B1-C	Runoff Area=0.461 ac 0.00% Impervious Runoff Depth=0.00" Tc=6.0 min CN=39 Runoff=0.00 cfs 0.000 af
SubcatchmentB2: PR-B2	Runoff Area=11.782 ac 11.29% Impervious Runoff Depth=0.23" Tc=20.4 min CN=61 Runoff=0.86 cfs 0.228 af
Pond 1P: Forebay & Bio A1-A	Peak Elev=408.62' Storage=68,576 cf Inflow=6.21 cfs 0.678 af Outflow=5.75 cfs 0.678 af
Pond 2P: Forebay & Bio A1-B	Peak Elev=408.61' Storage=74,349 cf Inflow=5.36 cfs 0.576 af Outflow=4.88 cfs 0.576 af
Pond 3P: Forebay & Bio B1-A	Peak Elev=408.72' Storage=61,882 cf Inflow=5.82 cfs 0.635 af Outflow=4.70 cfs 0.635 af
Pond 4P: Detention Basin A1	Peak Elev=404.55' Storage=56,133 cf Inflow=10.87 cfs 1.309 af Outflow=0.58 cfs 1.305 af
Pond 6P: Forebay & Bio B1-B	Peak Elev=408.50' Storage=43,154 cf Inflow=0.01 cfs 0.005 af Outflow=0.00 cfs 0.005 af
Pond 7P: Detention Basin B1	Peak Elev=404.19' Storage=15,118 cf Inflow=4.70 cfs 0.640 af Outflow=0.45 cfs 0.639 af

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 2

Pond PR-A: PR-A

Inflow=15.32 cfs 3.035 af
Primary=15.32 cfs 3.035 af

Pond PR-B: PR-B

Inflow=1.22 cfs 0.867 af
Primary=1.22 cfs 0.867 af

Total Runoff Area = 113.242 ac Runoff Volume = 6.772 af Average Runoff Depth = 0.72"
77.40% Pervious = 87.644 ac 22.60% Impervious = 25.598 ac

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"

Printed 12/8/2025

Page 3

Subcatchment A: EX-A

Hydrograph

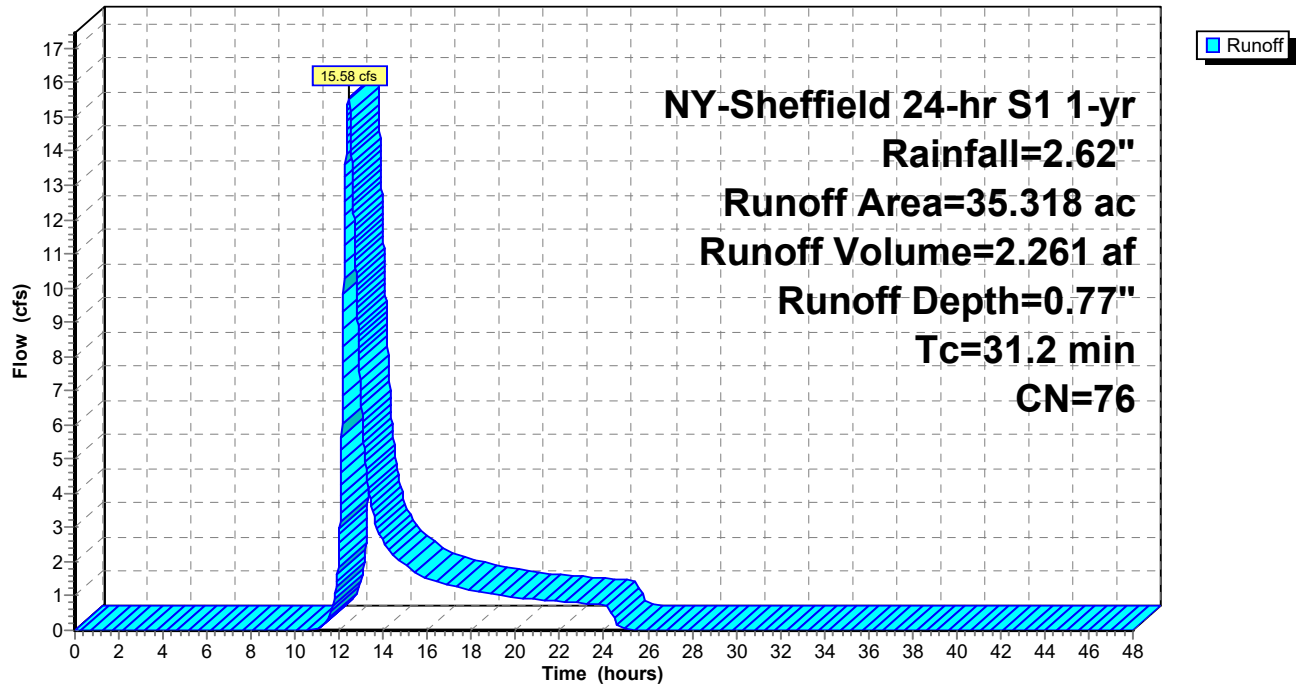

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"

Printed 12/8/2025

Page 4

Subcatchment A1-A: PR-A1-A

Hydrograph

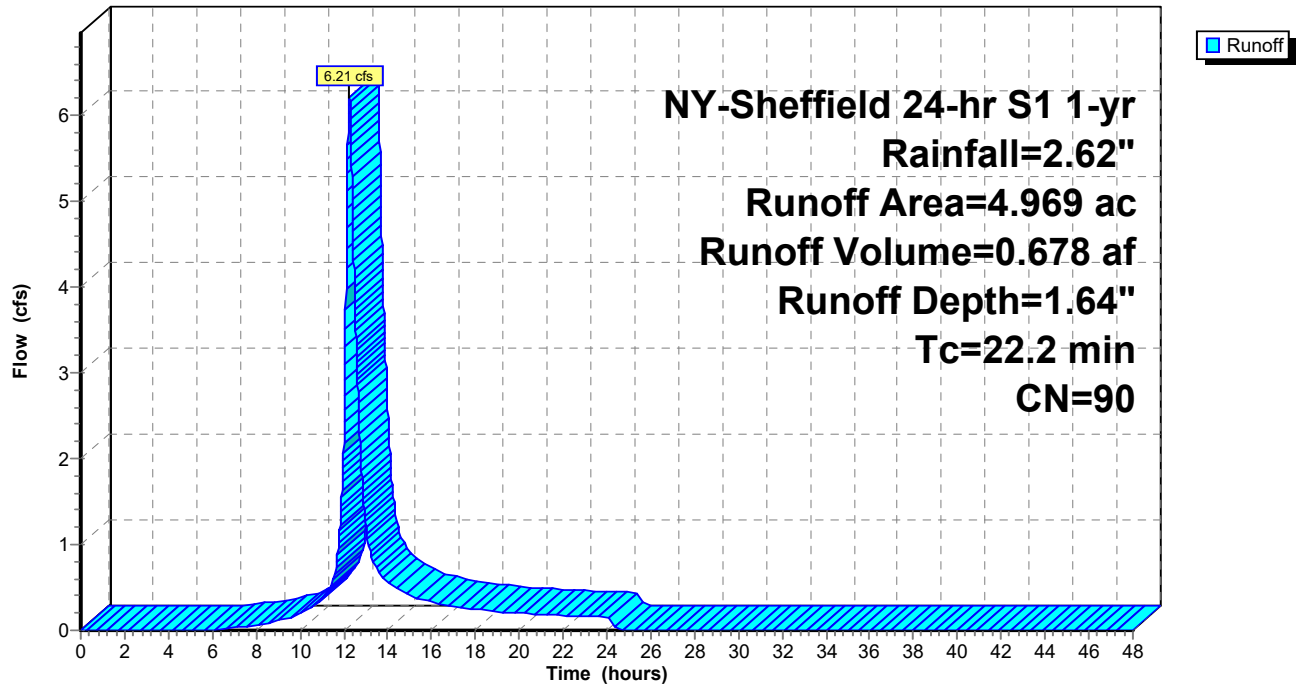

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"

Printed 12/8/2025

Page 5

Subcatchment A1-B: PR-A1-B

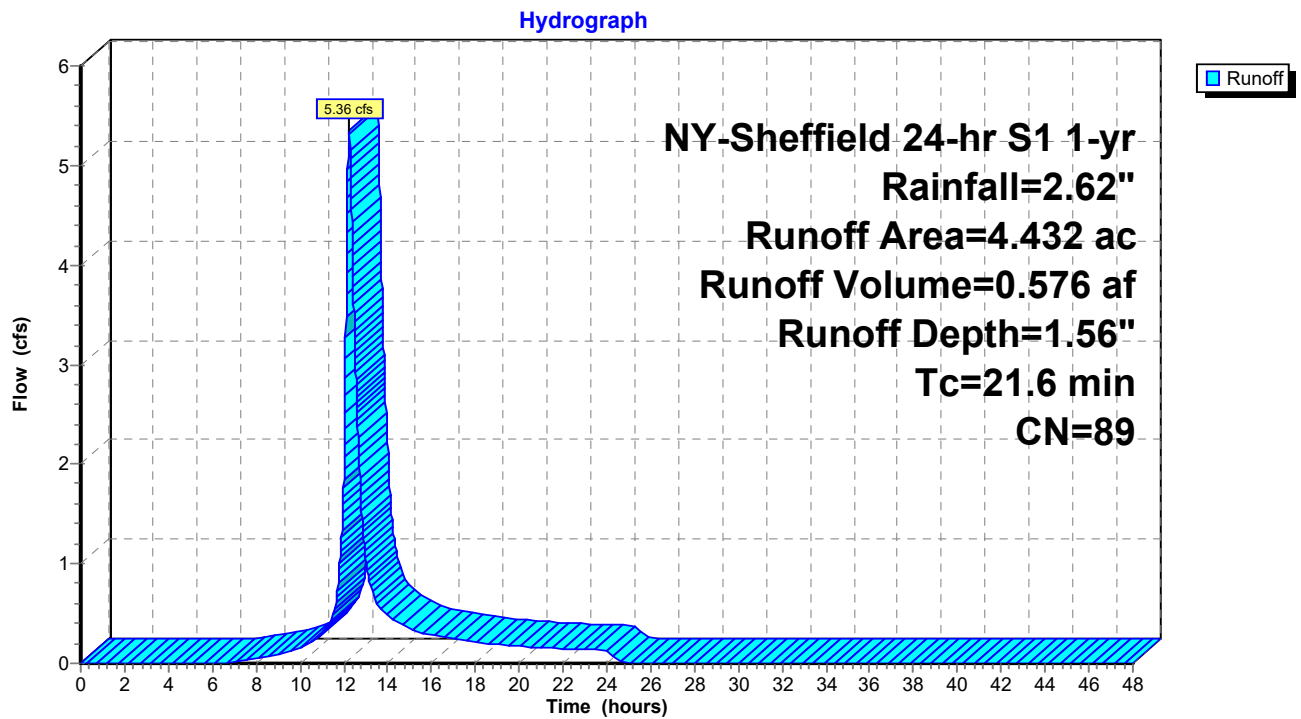

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"

Printed 12/8/2025

Page 6

Subcatchment A1-C: PR-A1-C

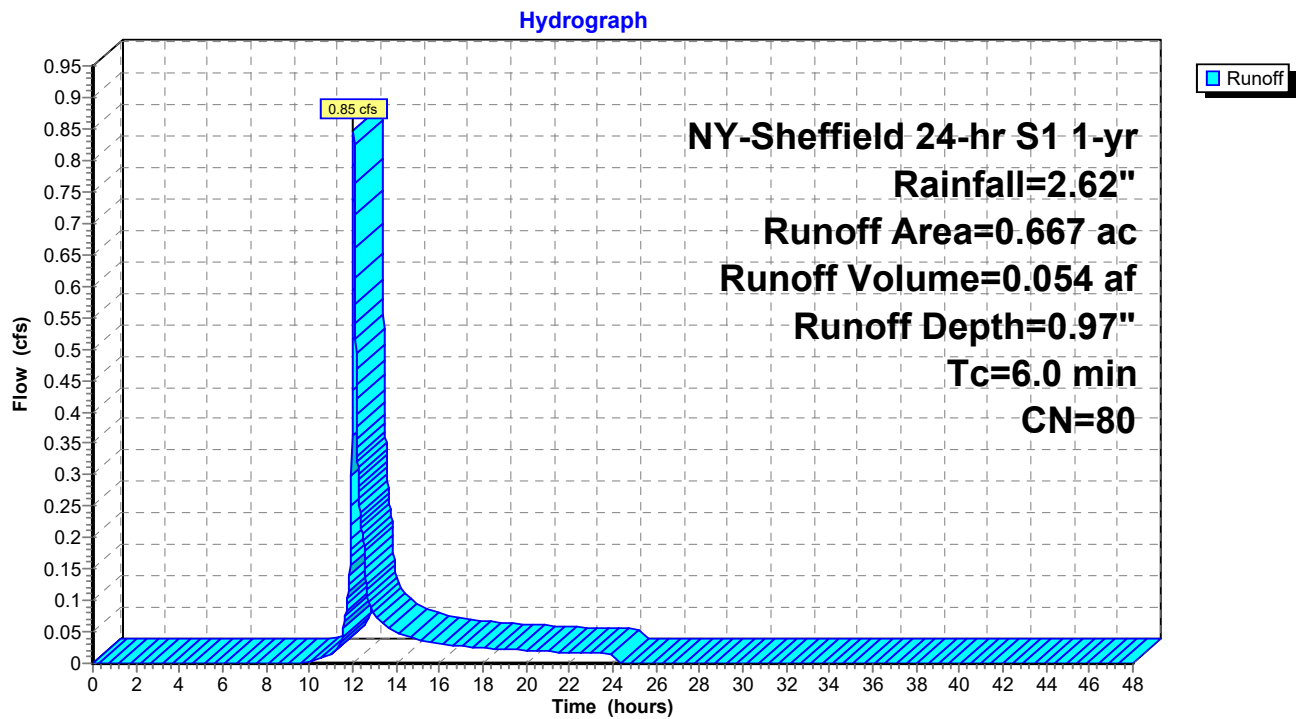

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"

Printed 12/8/2025

Page 7

Subcatchment A2: PR-A2

Hydrograph

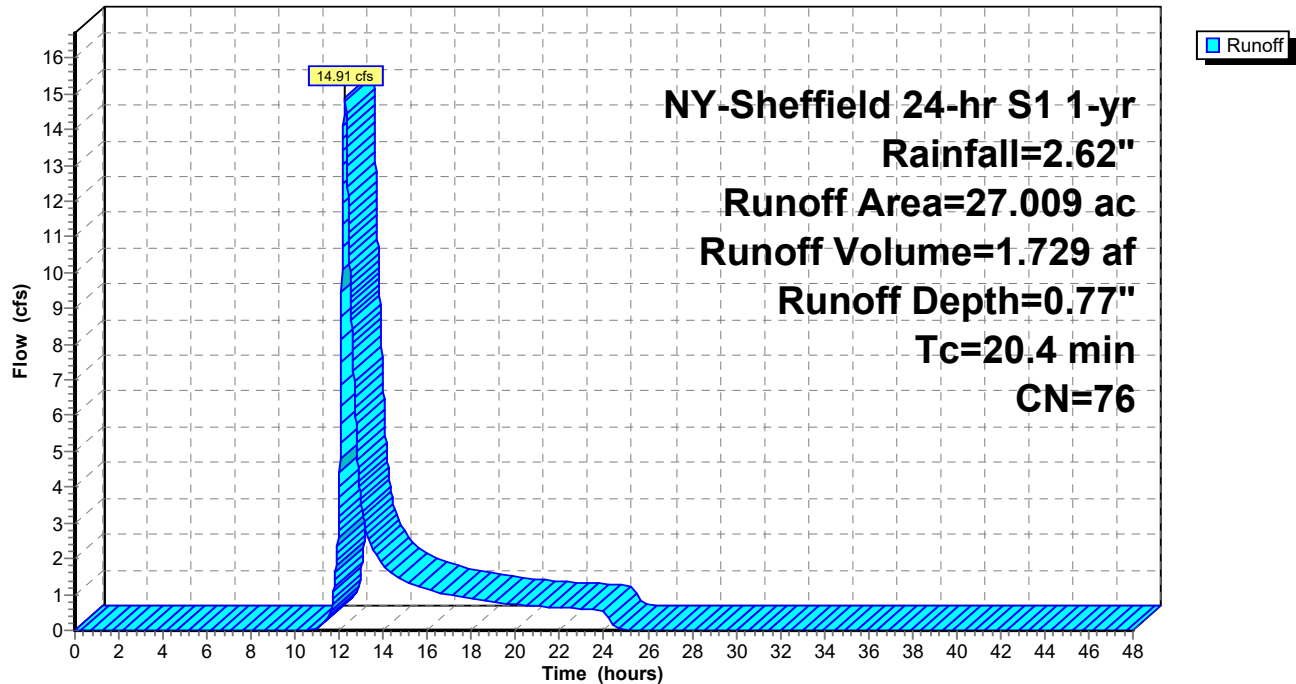

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"

Printed 12/8/2025

Page 8

Subcatchment B: EX-B

Hydrograph

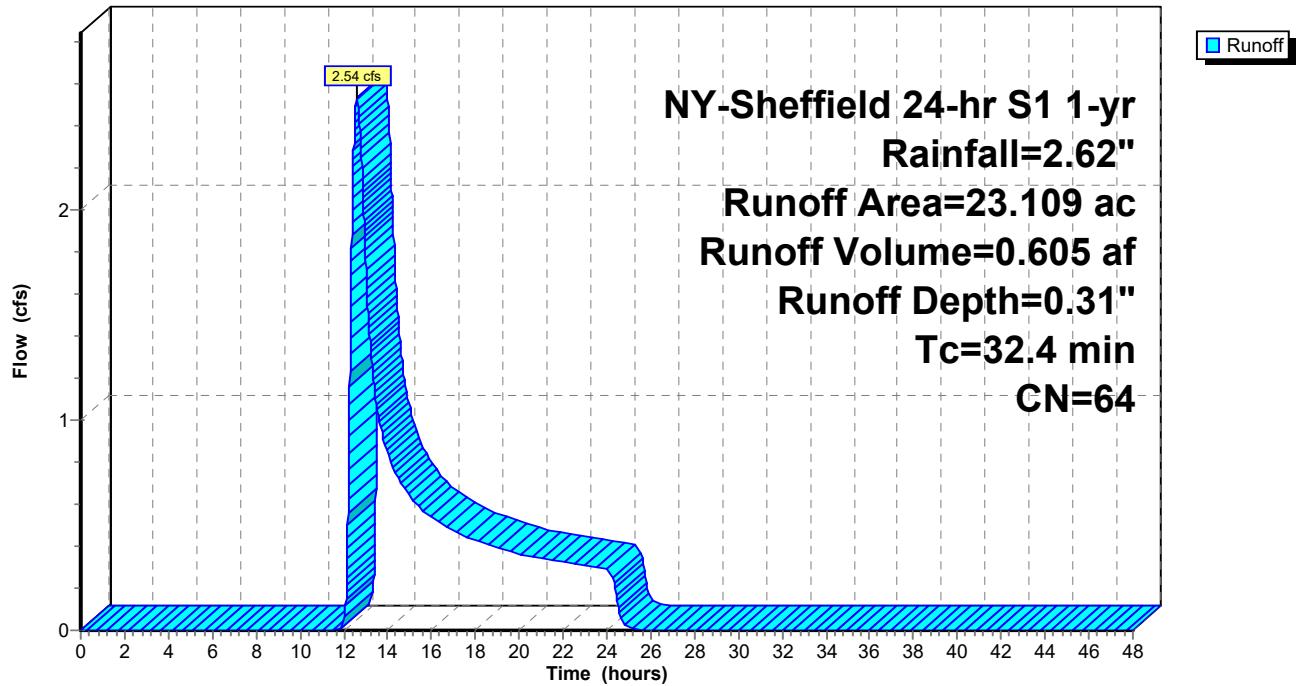

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"

Printed 12/8/2025

Page 9

Subcatchment B1-A: PR-B1-A

Hydrograph

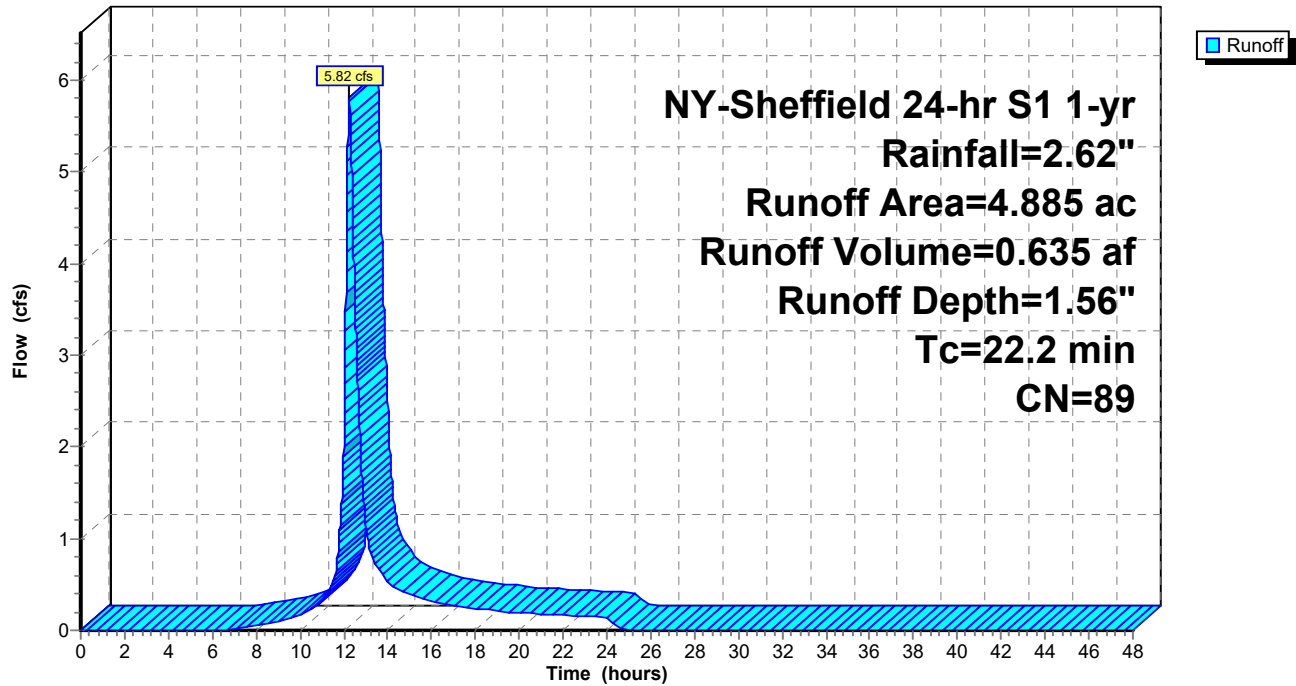

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"

Printed 12/8/2025

Page 10

Subcatchment B1-B: PR-B1-B

Hydrograph

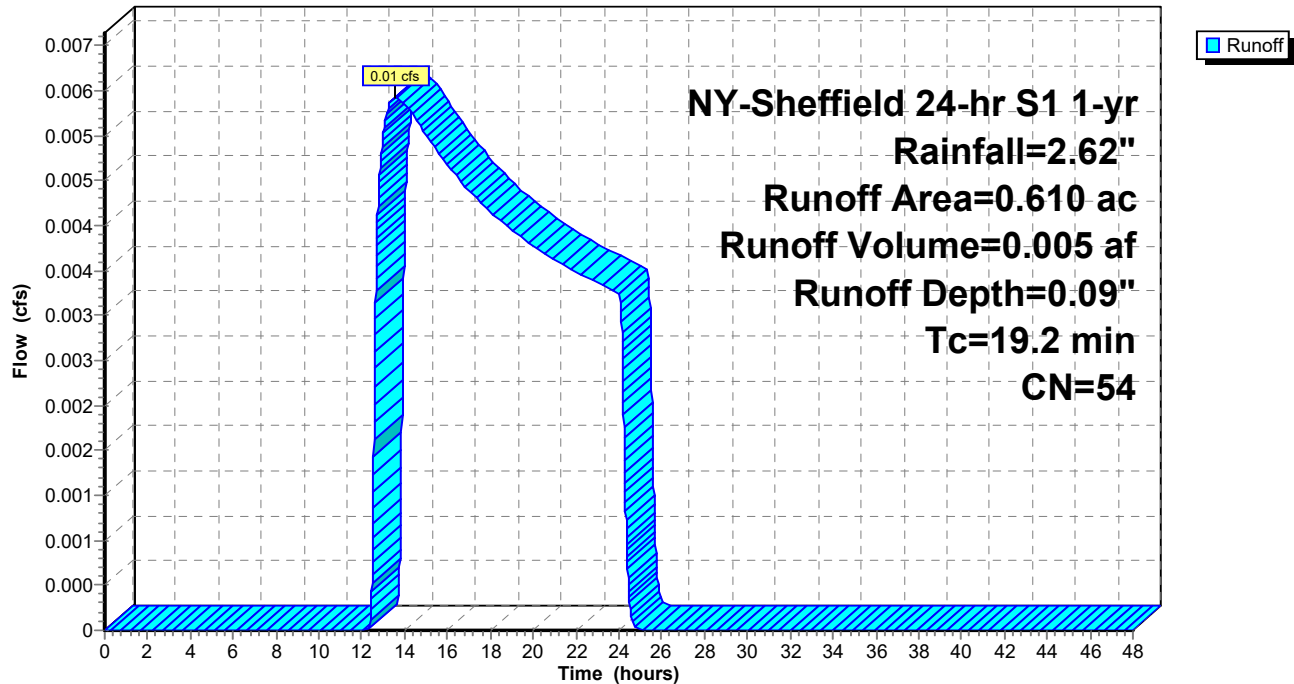

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"

Printed 12/8/2025

Page 11

Subcatchment B1-C: PR-B1-C

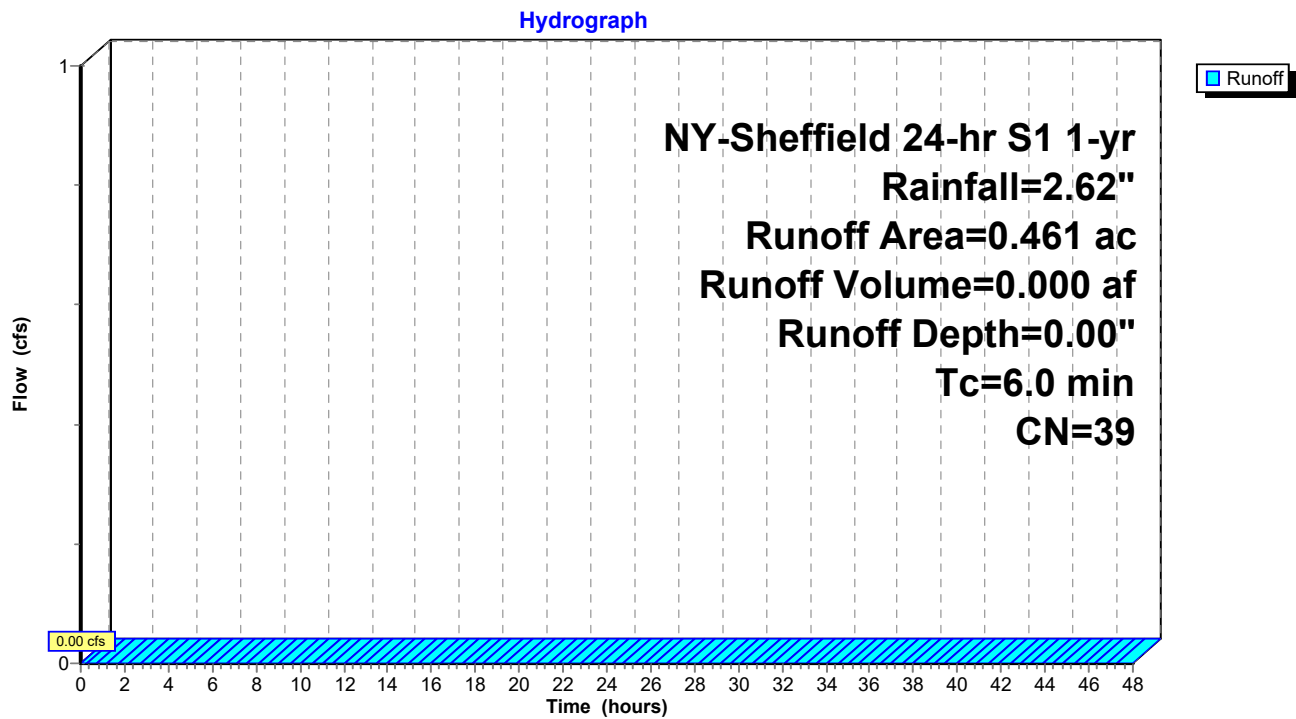

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"

Printed 12/8/2025

Page 12

Subcatchment B2: PR-B2

Hydrograph

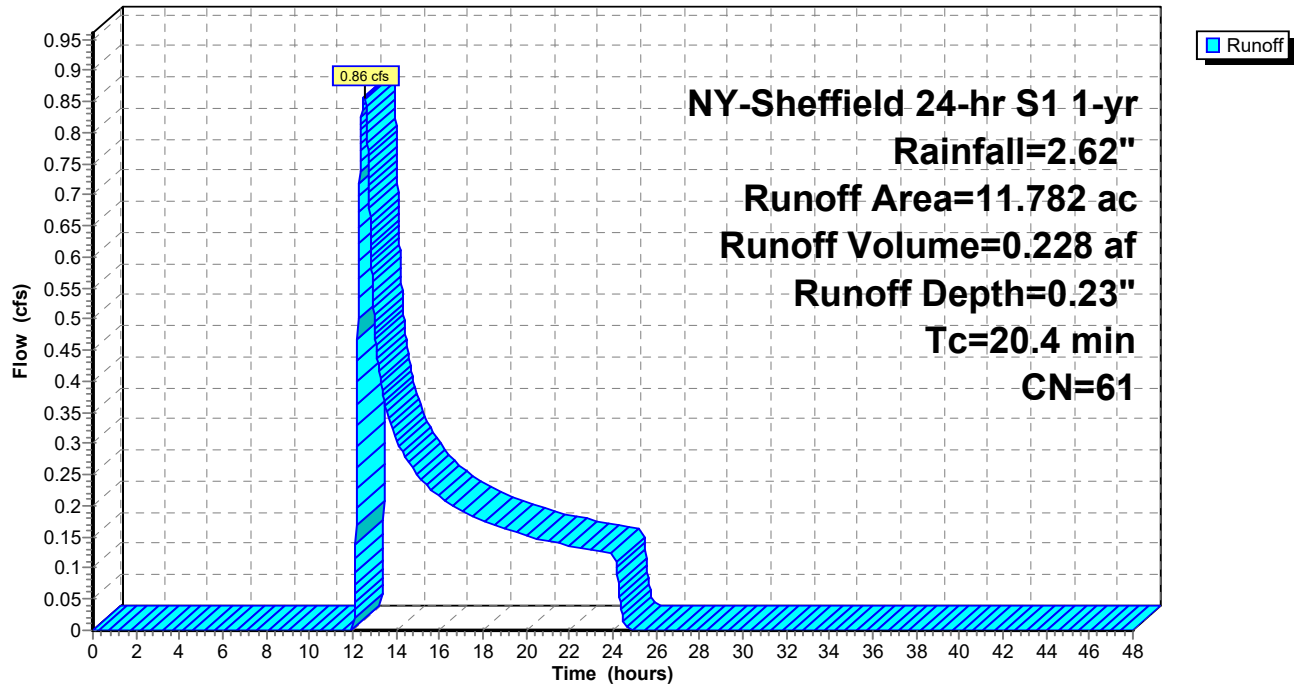

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"

Printed 12/8/2025

Page 13

Pond 1P: Forebay & Bio A1-A

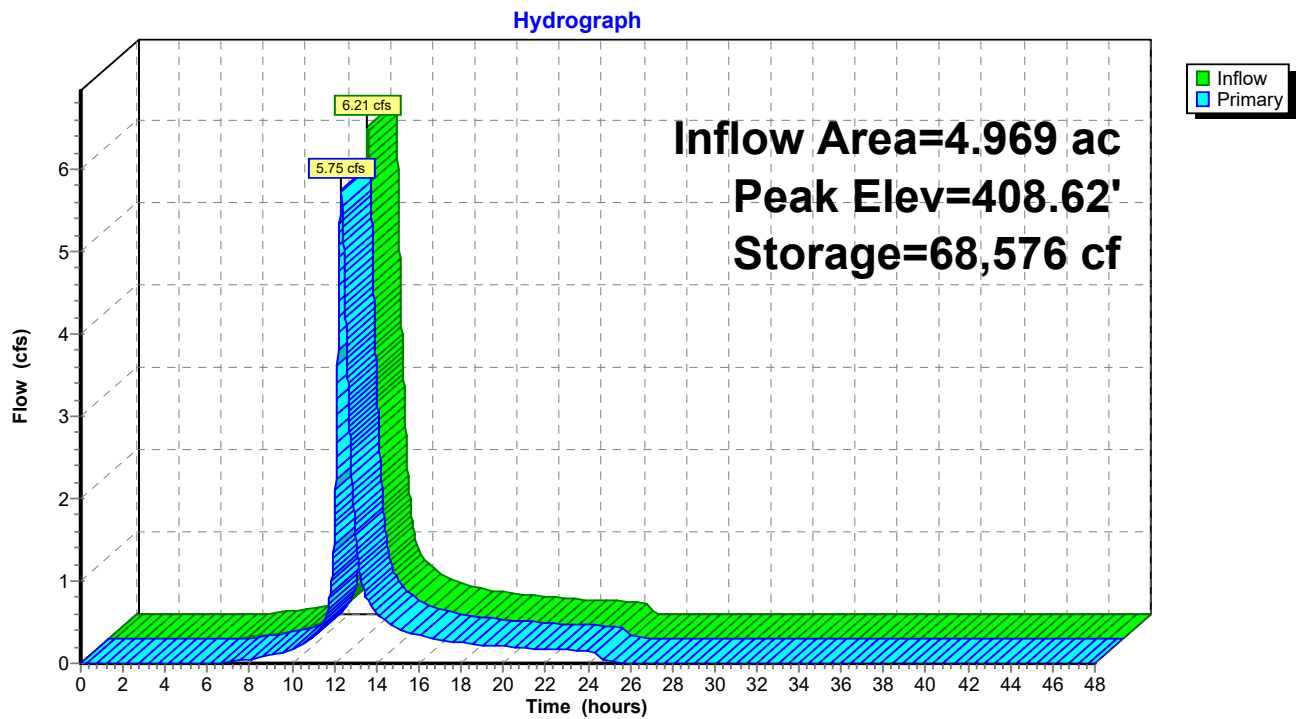

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"

Printed 12/8/2025

Page 14

Pond 2P: Forebay & Bio A1-B

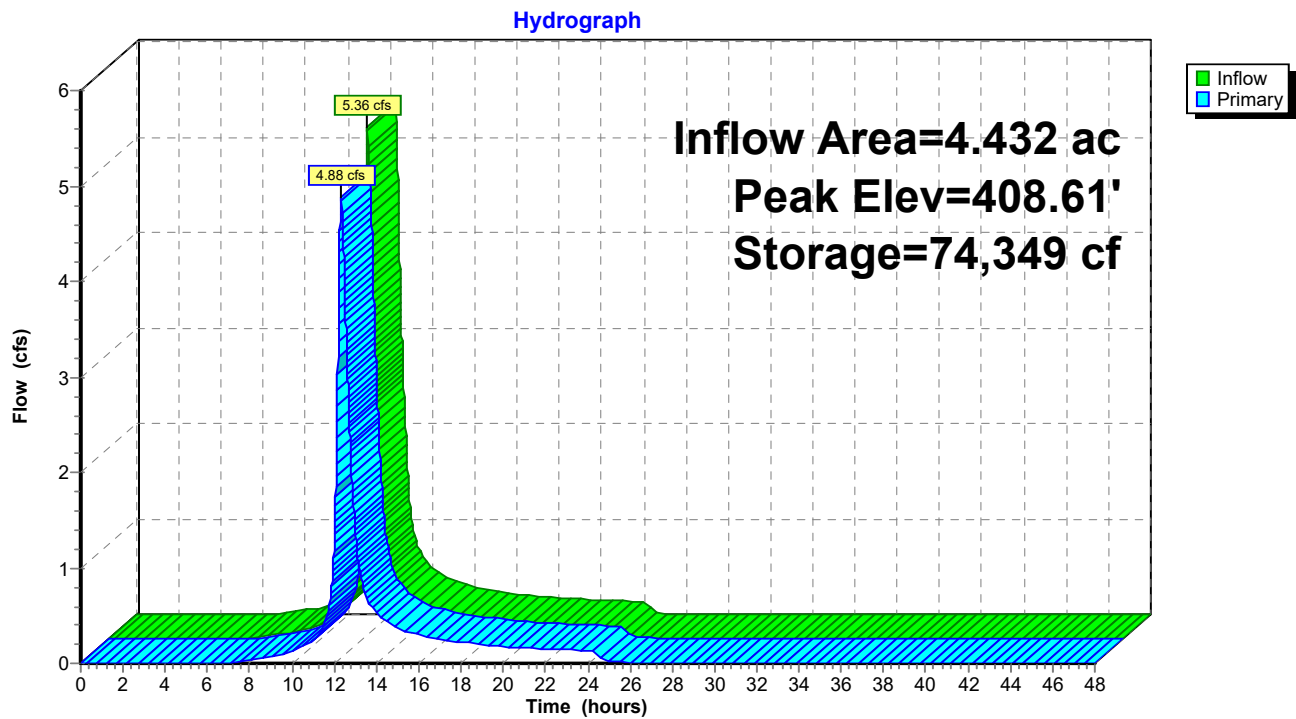

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"

Printed 12/8/2025

Page 15

Pond 3P: Forebay & Bio B1-A

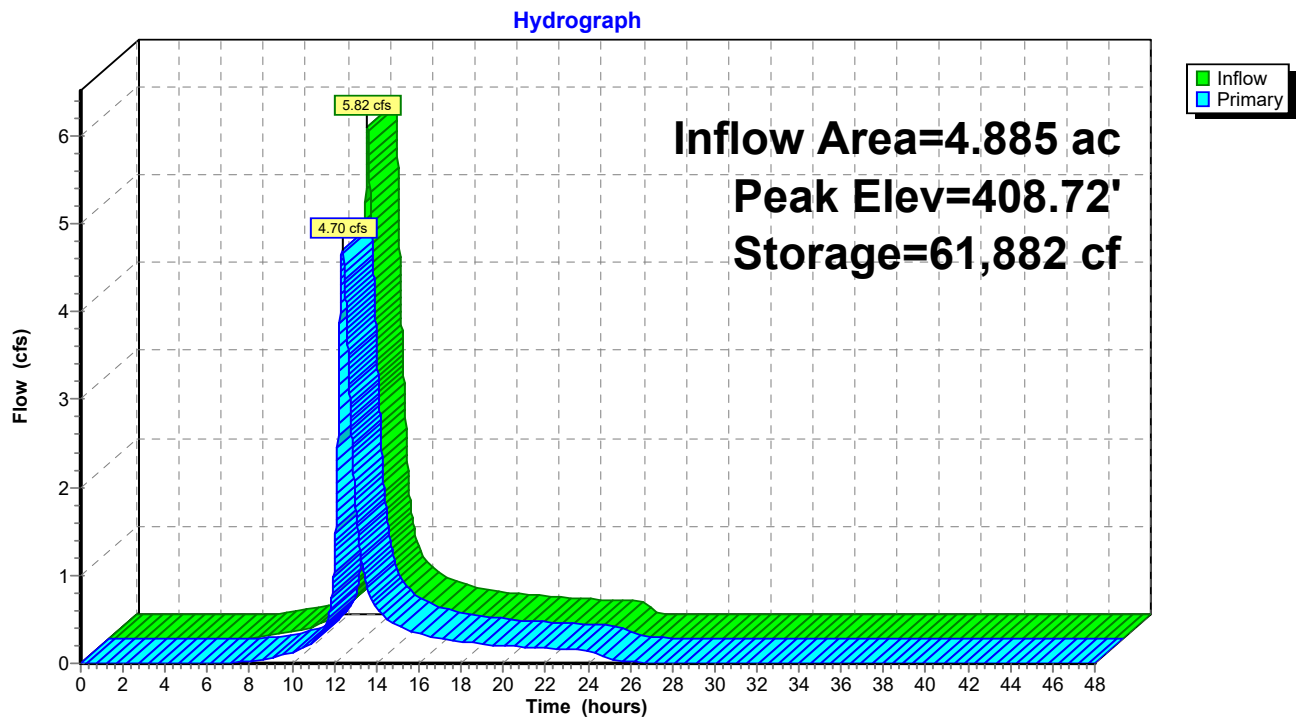

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"

Printed 12/8/2025

Page 16

Pond 4P: Detention Basin A1

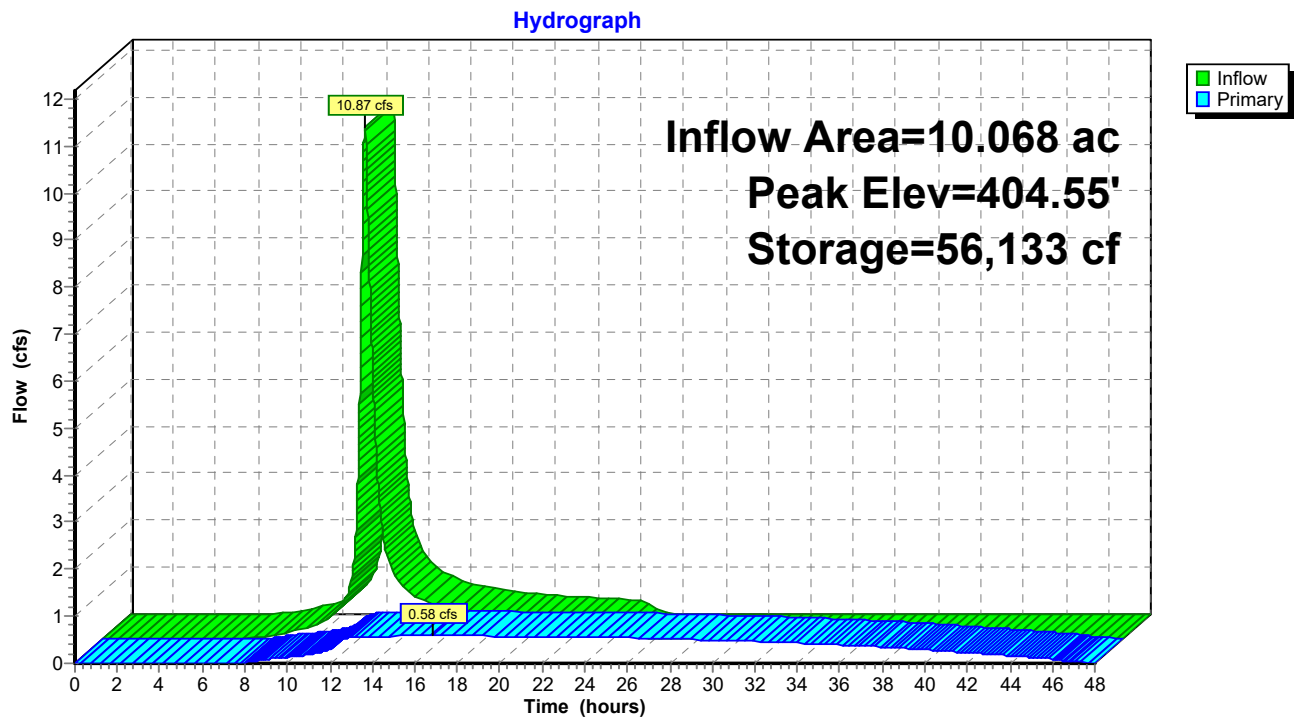

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"

Printed 12/8/2025

Page 17

Pond 6P: Forebay & Bio B1-B

Hydrograph

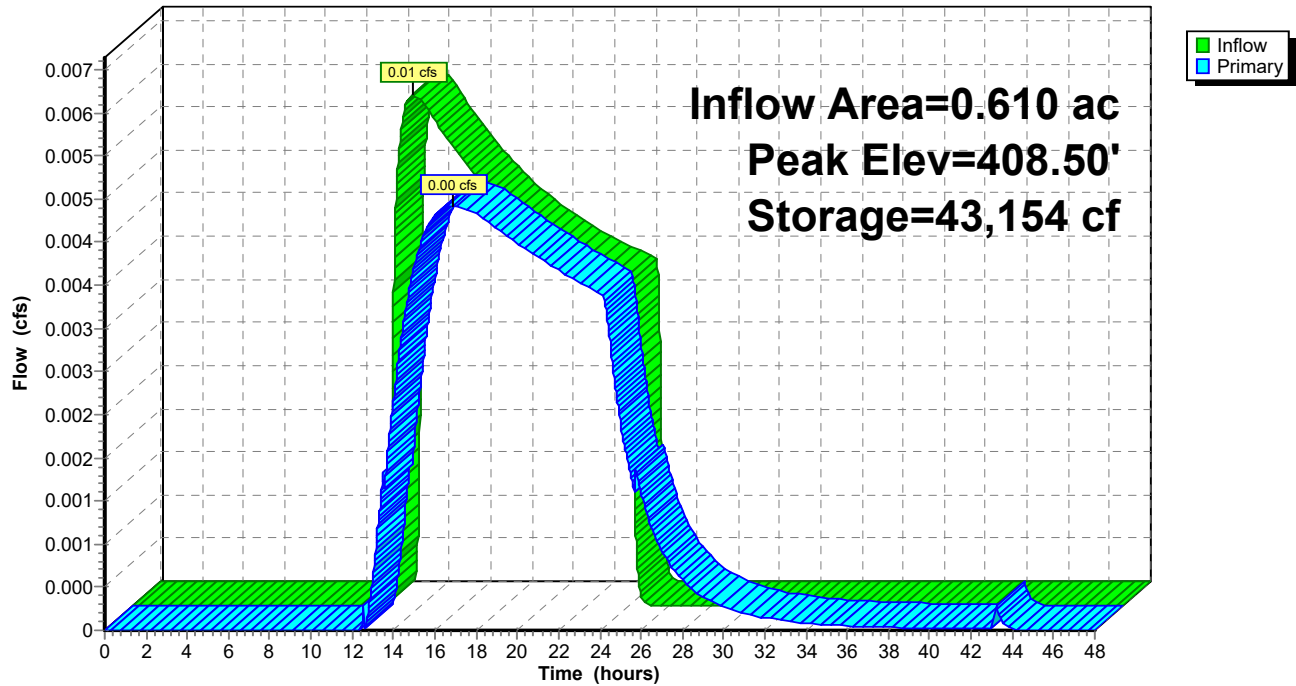

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"

Printed 12/8/2025

Page 18

Pond 7P: Detention Basin B1

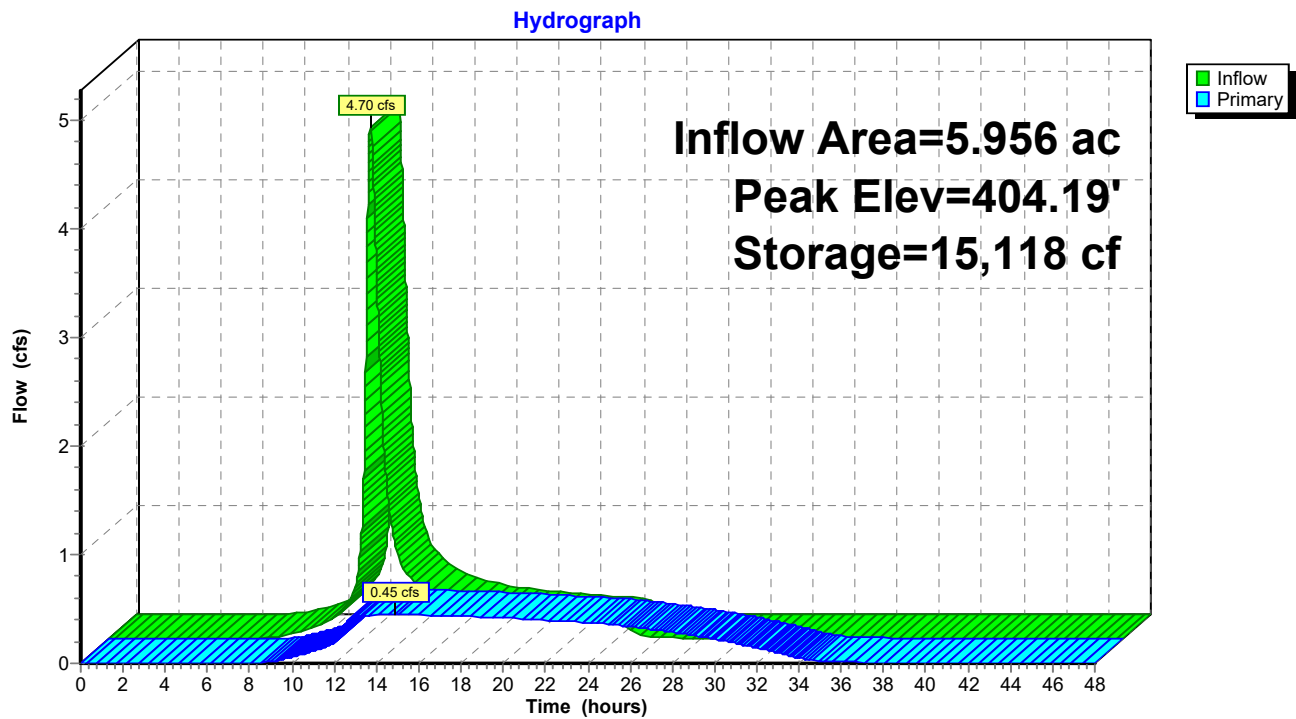

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"

Printed 12/8/2025

Page 19

Pond PR-A: PR-A

Hydrograph

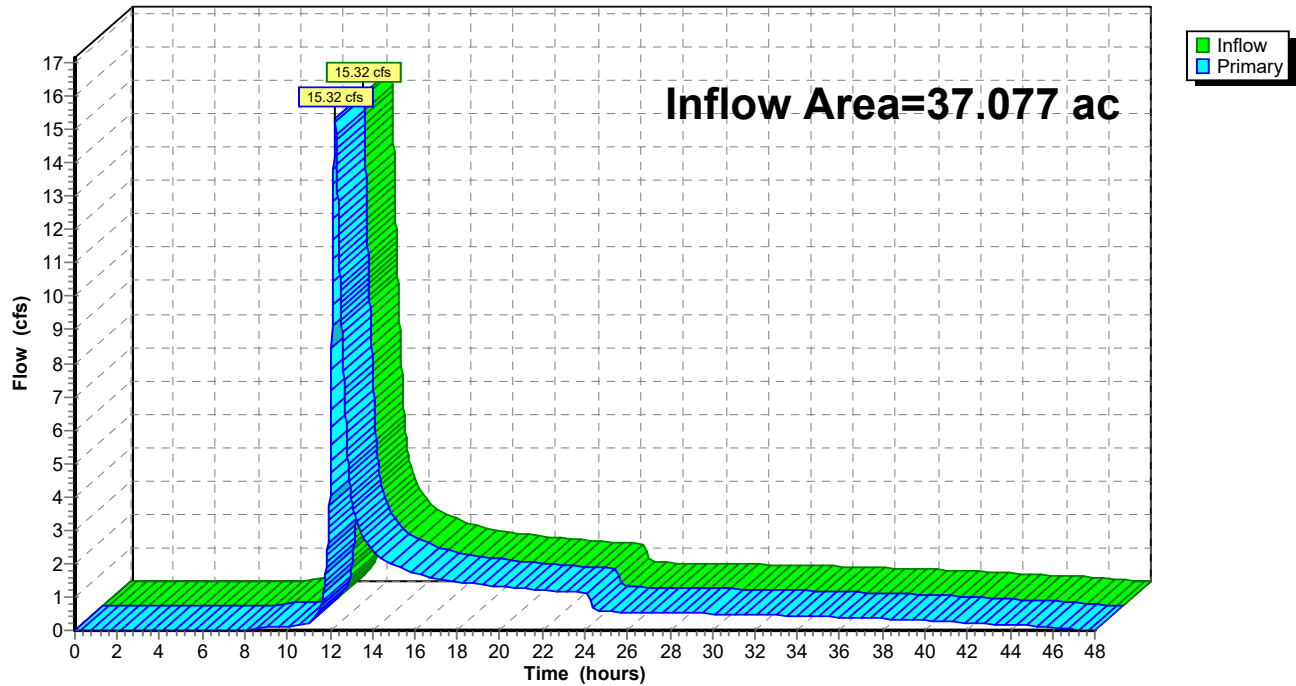

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"

Printed 12/8/2025

Page 20

Pond PR-B: PR-B

Hydrograph

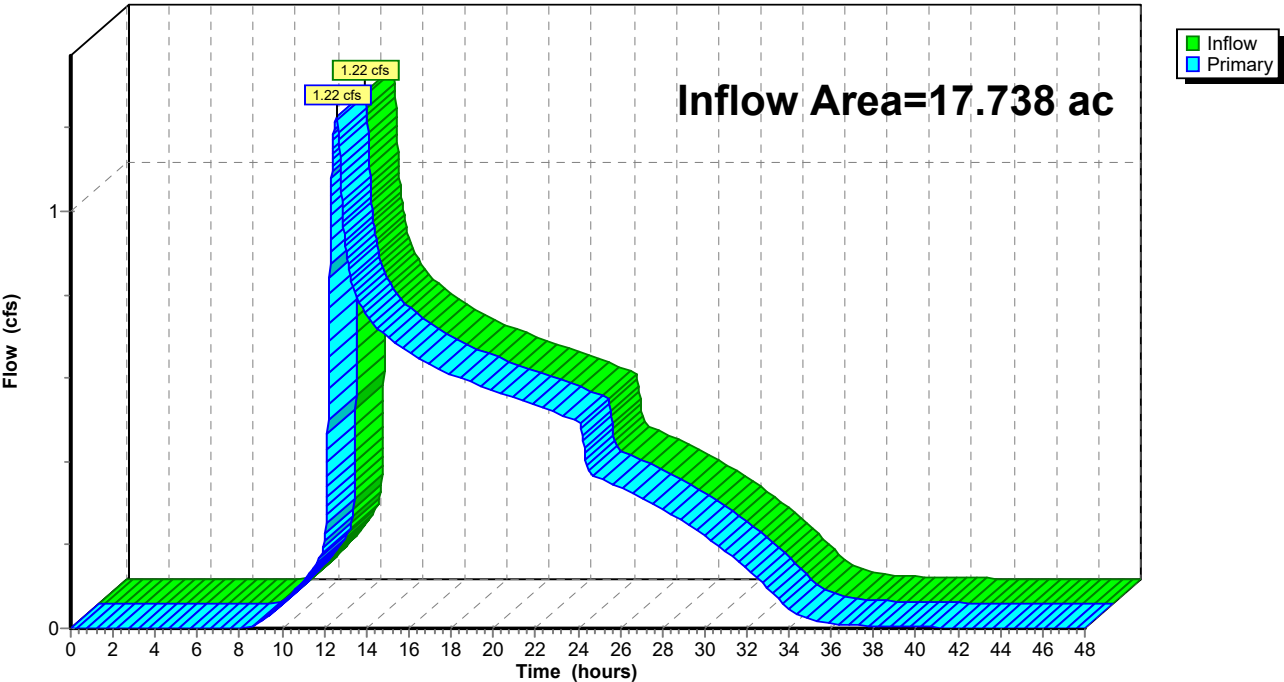

APPENDIX 9

10-YEAR DESIGN STORM

HYDROGRAPHS

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 1

Time span=0.00-48.00 hrs, dt=0.01 hrs, 4801 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

SubcatchmentA: EX-A	Runoff Area=35.318 ac 19.88% Impervious Runoff Depth=2.28" Tc=31.2 min CN=76 Runoff=48.98 cfs 6.718 af
SubcatchmentA1-A: PR-A1-A	Runoff Area=4.969 ac 55.48% Impervious Runoff Depth=3.58" Tc=22.2 min CN=90 Runoff=12.66 cfs 1.482 af
SubcatchmentA1-B: PR-A1-B	Runoff Area=4.432 ac 51.17% Impervious Runoff Depth=3.48" Tc=21.6 min CN=89 Runoff=11.19 cfs 1.284 af
SubcatchmentA1-C: PR-A1-C	Runoff Area=0.667 ac 0.00% Impervious Runoff Depth=2.62" Tc=6.0 min CN=80 Runoff=2.20 cfs 0.146 af
SubcatchmentA2: PR-A2	Runoff Area=27.009 ac 31.15% Impervious Runoff Depth=2.28" Tc=20.4 min CN=76 Runoff=46.20 cfs 5.137 af
SubcatchmentB: EX-B	Runoff Area=23.109 ac 4.81% Impervious Runoff Depth=1.38" Tc=32.4 min CN=64 Runoff=17.46 cfs 2.663 af
SubcatchmentB1-A: PR-B1-A	Runoff Area=4.885 ac 52.14% Impervious Runoff Depth=3.48" Tc=22.2 min CN=89 Runoff=12.16 cfs 1.415 af
SubcatchmentB1-B: PR-B1-B	Runoff Area=0.610 ac 25.08% Impervious Runoff Depth=0.78" Tc=19.2 min CN=54 Runoff=0.25 cfs 0.039 af
SubcatchmentB1-C: PR-B1-C	Runoff Area=0.461 ac 0.00% Impervious Runoff Depth=0.14" Tc=6.0 min CN=39 Runoff=0.01 cfs 0.005 af
SubcatchmentB2: PR-B2	Runoff Area=11.782 ac 11.29% Impervious Runoff Depth=1.19" Tc=20.4 min CN=61 Runoff=9.10 cfs 1.165 af
Pond 1P: Forebay & Bio A1-A	Peak Elev=408.70' Storage=70,010 cf Inflow=12.66 cfs 1.482 af Outflow=12.09 cfs 1.482 af
Pond 2P: Forebay & Bio A1-B	Peak Elev=408.68' Storage=75,787 cf Inflow=11.19 cfs 1.284 af Outflow=10.58 cfs 1.284 af
Pond 3P: Forebay & Bio B1-A	Peak Elev=408.88' Storage=64,578 cf Inflow=12.16 cfs 1.415 af Outflow=10.57 cfs 1.415 af
Pond 4P: Detention Basin A1	Peak Elev=408.23' Storage=111,560 cf Inflow=23.33 cfs 2.911 af Outflow=0.74 cfs 2.162 af
Pond 6P: Forebay & Bio B1-B	Peak Elev=408.52' Storage=43,421 cf Inflow=0.25 cfs 0.039 af Outflow=0.13 cfs 0.039 af
Pond 7P: Detention Basin B1	Peak Elev=407.04' Storage=39,262 cf Inflow=10.64 cfs 1.460 af Outflow=0.60 cfs 1.450 af

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 2

Pond PR-A: PR-A

Inflow=46.77 cfs 7.299 af
Primary=46.77 cfs 7.299 af

Pond PR-B: PR-B

Inflow=9.53 cfs 2.615 af
Primary=9.53 cfs 2.615 af

Total Runoff Area = 113.242 ac Runoff Volume = 20.054 af Average Runoff Depth = 2.13"
77.40% Pervious = 87.644 ac 22.60% Impervious = 25.598 ac

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Printed 12/8/2025

Page 3

Subcatchment A: EX-A

Hydrograph

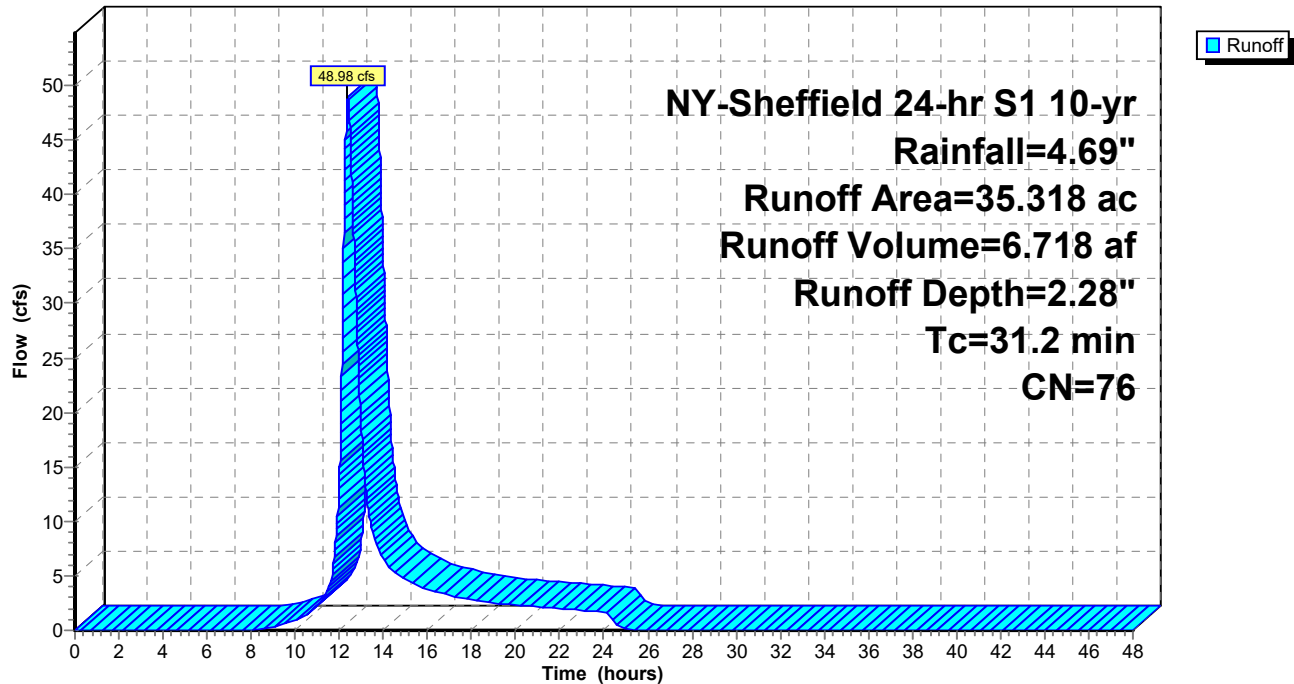

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Printed 12/8/2025

Page 4

Subcatchment A1-A: PR-A1-A

Hydrograph

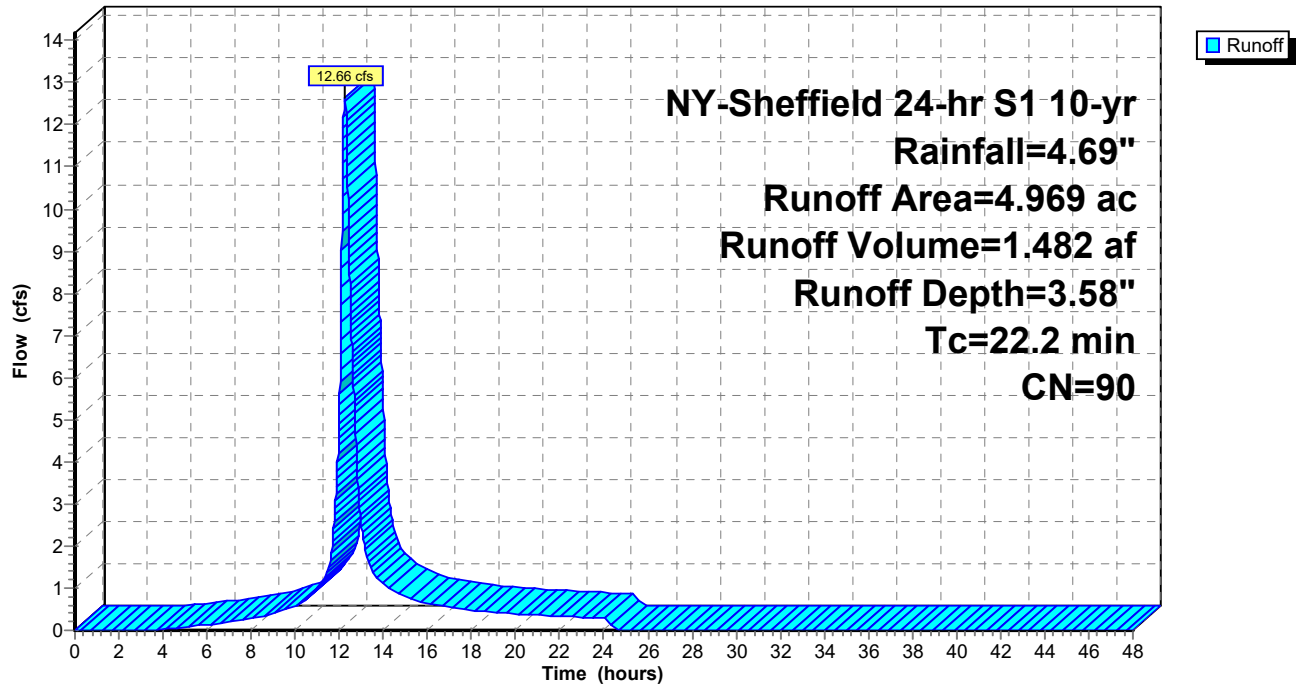

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Printed 12/8/2025

Page 5

Subcatchment A1-B: PR-A1-B

Hydrograph

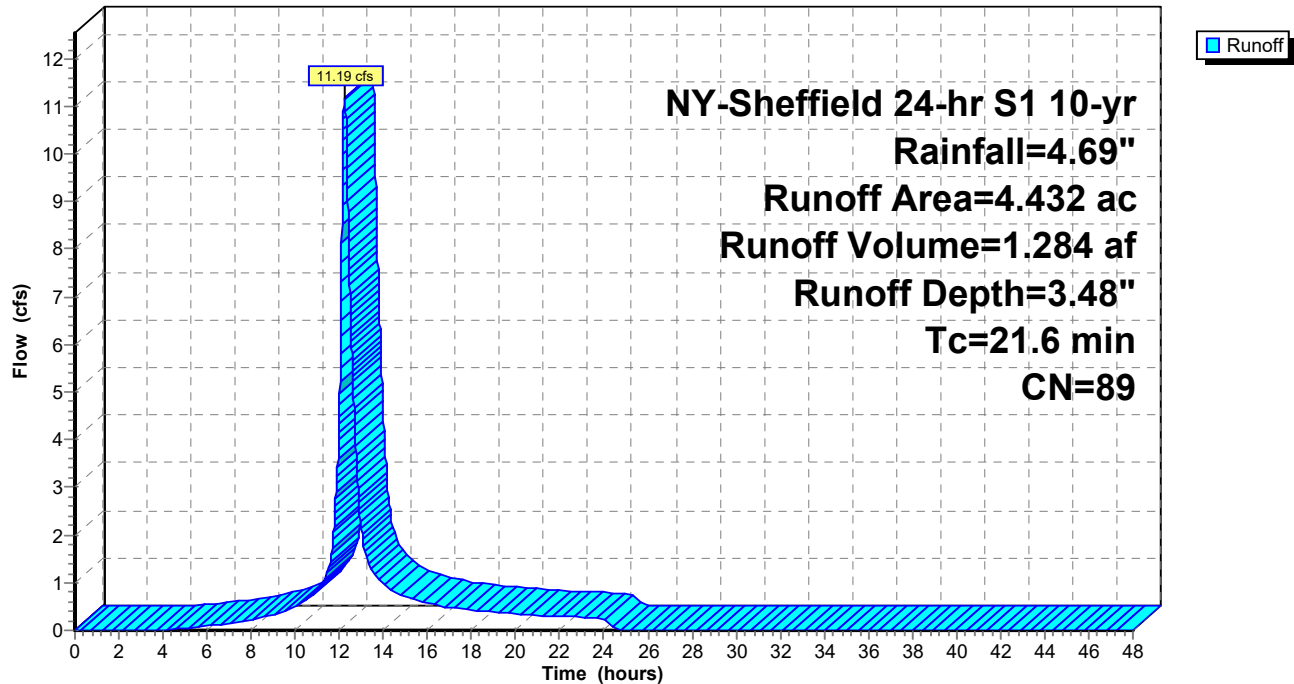

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Printed 12/8/2025

Page 6

Subcatchment A1-C: PR-A1-C

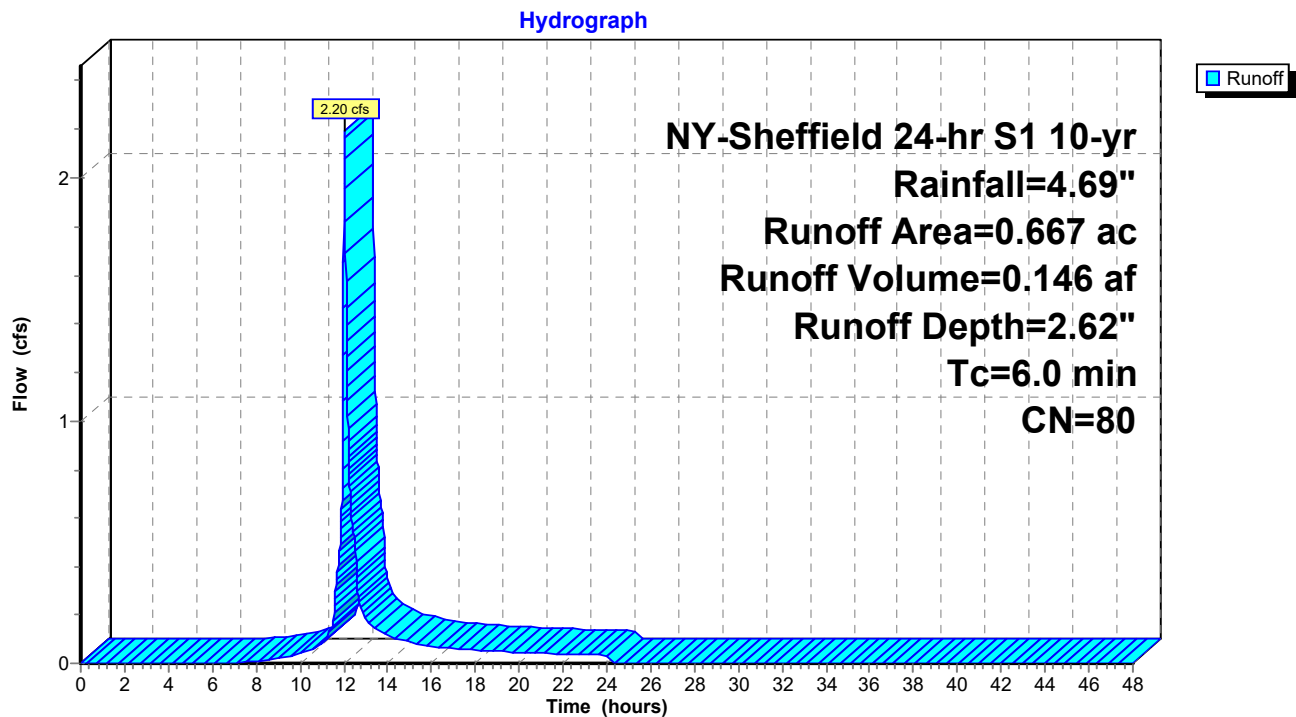

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Printed 12/8/2025

Page 7

Subcatchment A2: PR-A2

Hydrograph

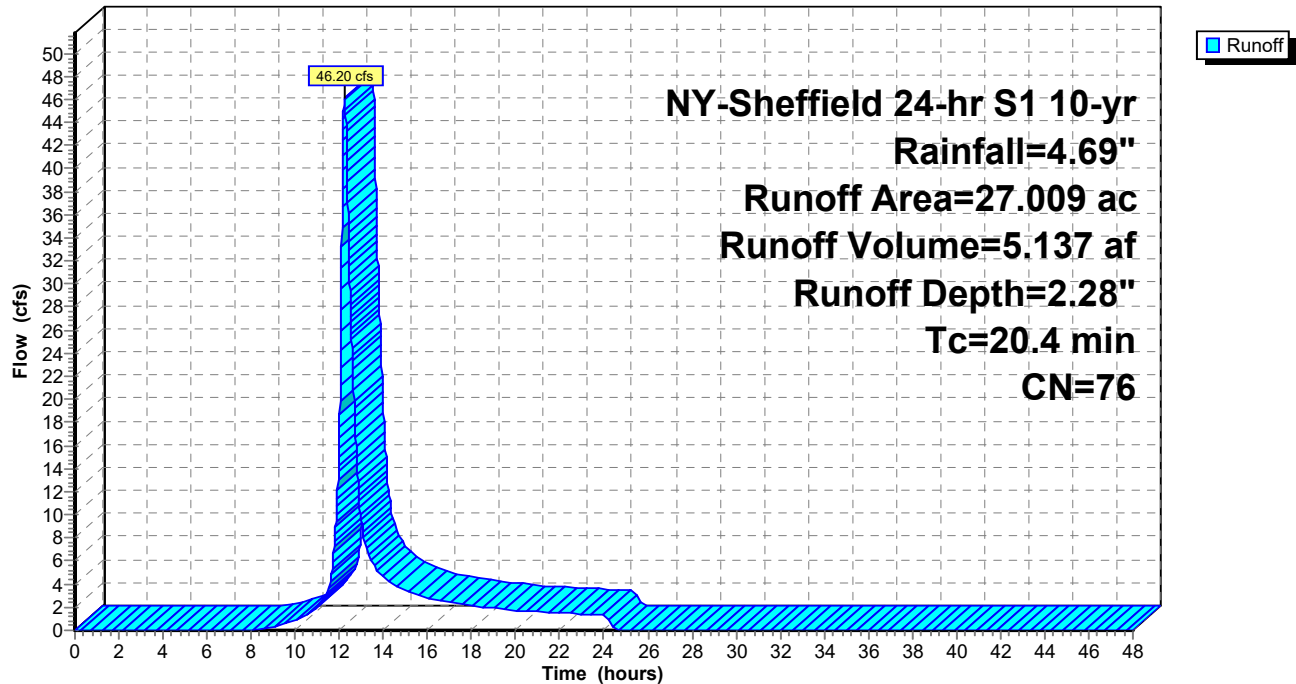

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Printed 12/8/2025

Page 8

Subcatchment B: EX-B

Hydrograph

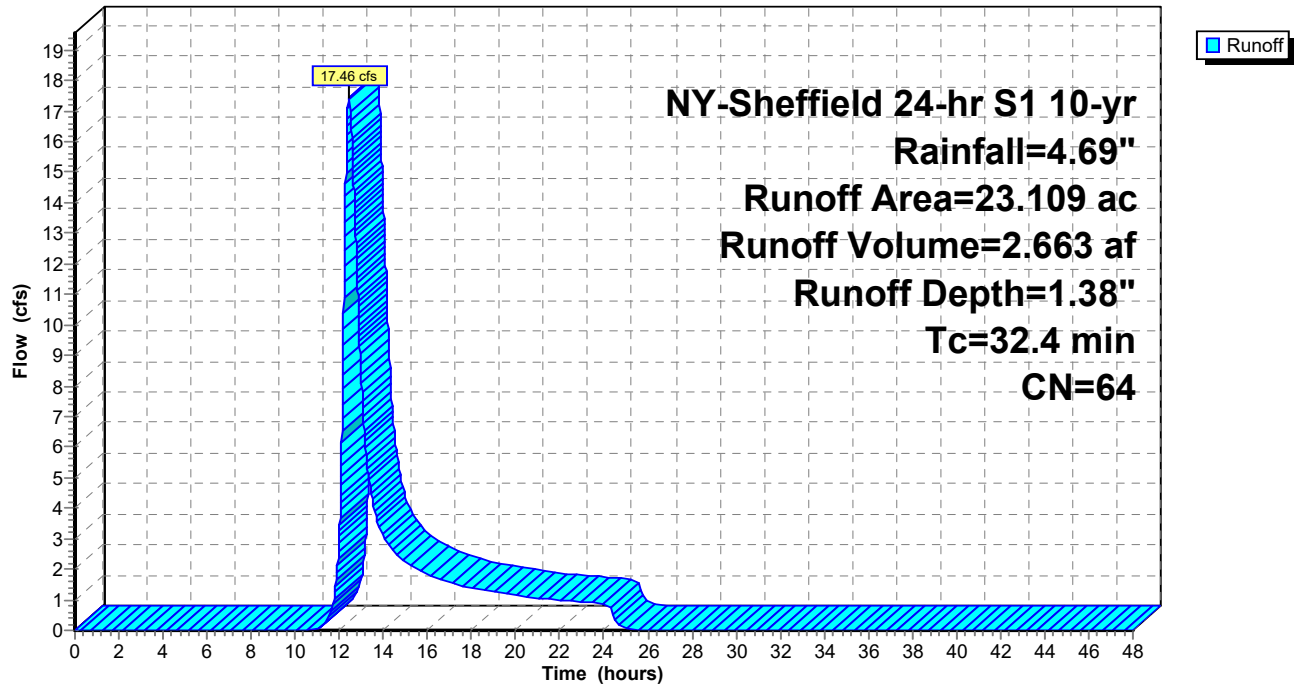

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Printed 12/8/2025

Page 9

Subcatchment B1-A: PR-B1-A

Hydrograph

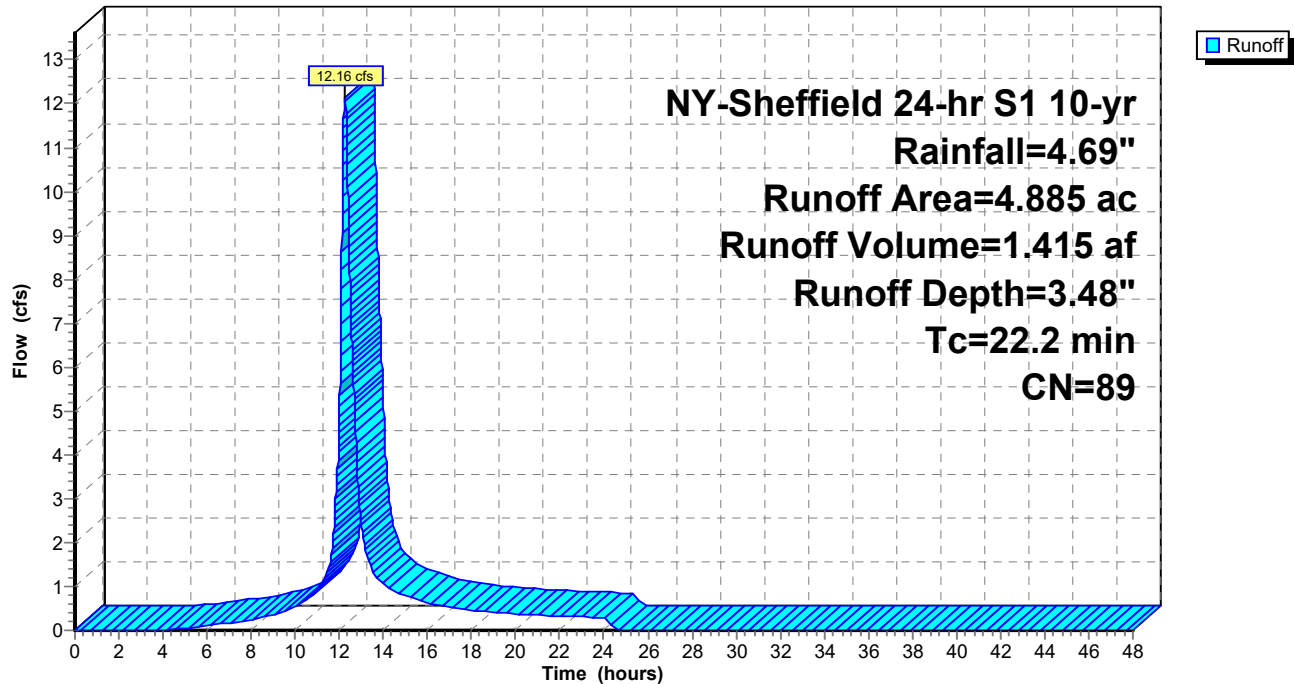

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Printed 12/8/2025

Page 10

Subcatchment B1-B: PR-B1-B

Hydrograph

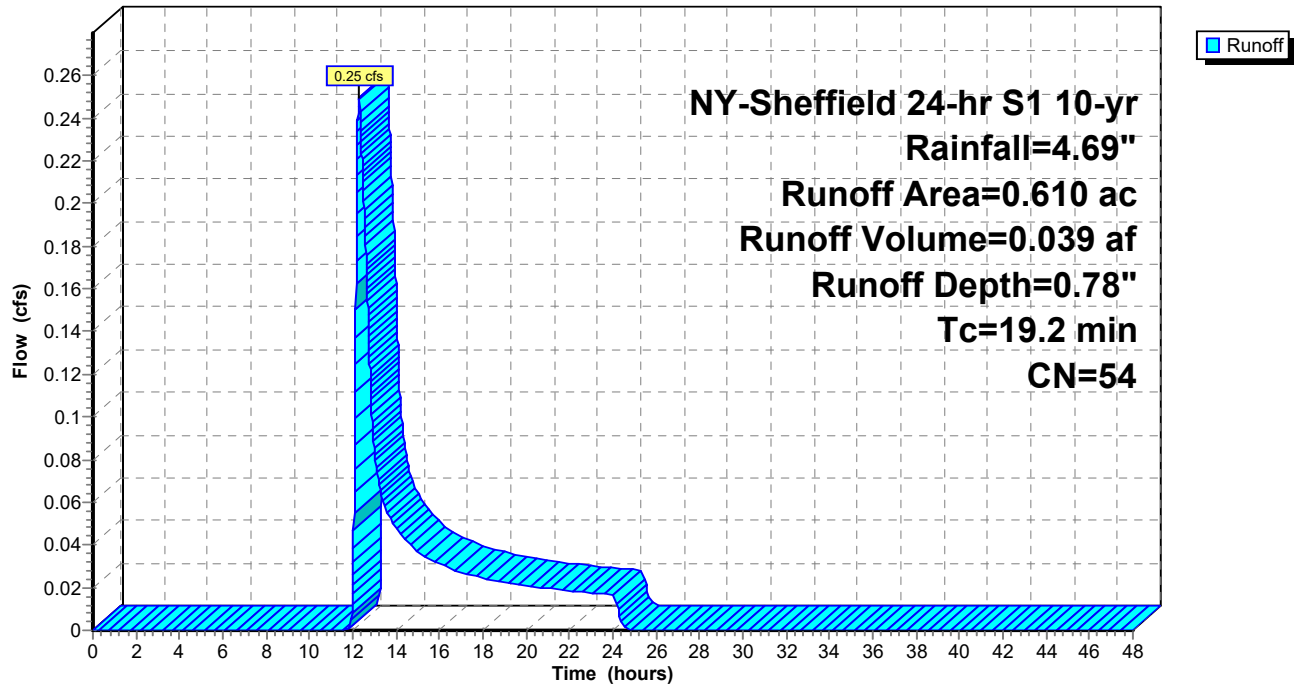

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Printed 12/8/2025

Page 11

Subcatchment B1-C: PR-B1-C

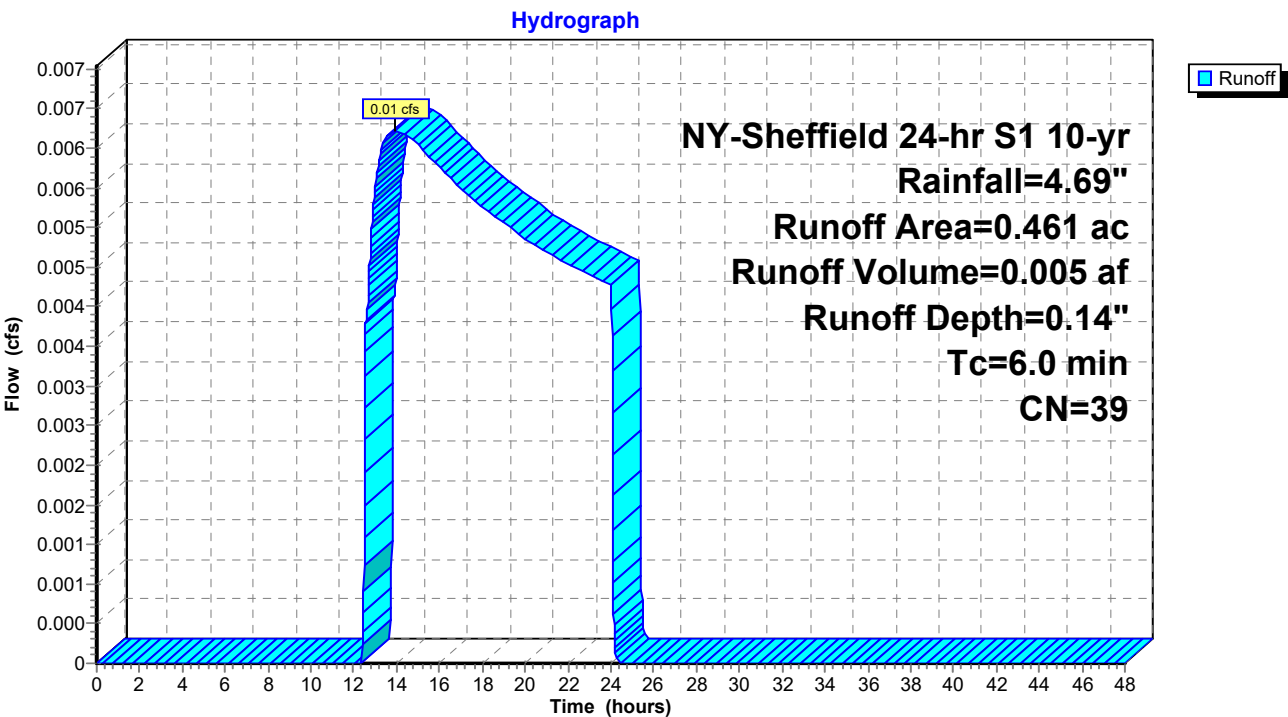

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Printed 12/8/2025

Page 12

Subcatchment B2: PR-B2

Hydrograph

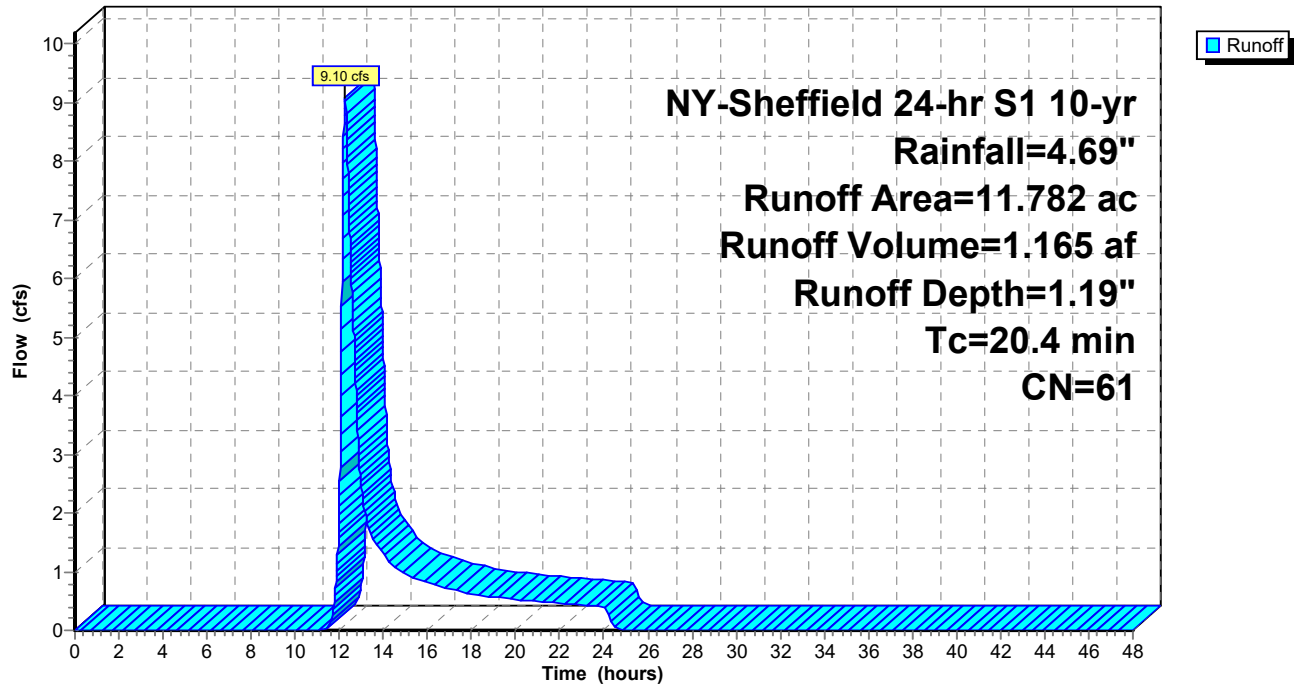

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Printed 12/8/2025

Page 13

Pond 1P: Forebay & Bio A1-A

Hydrograph

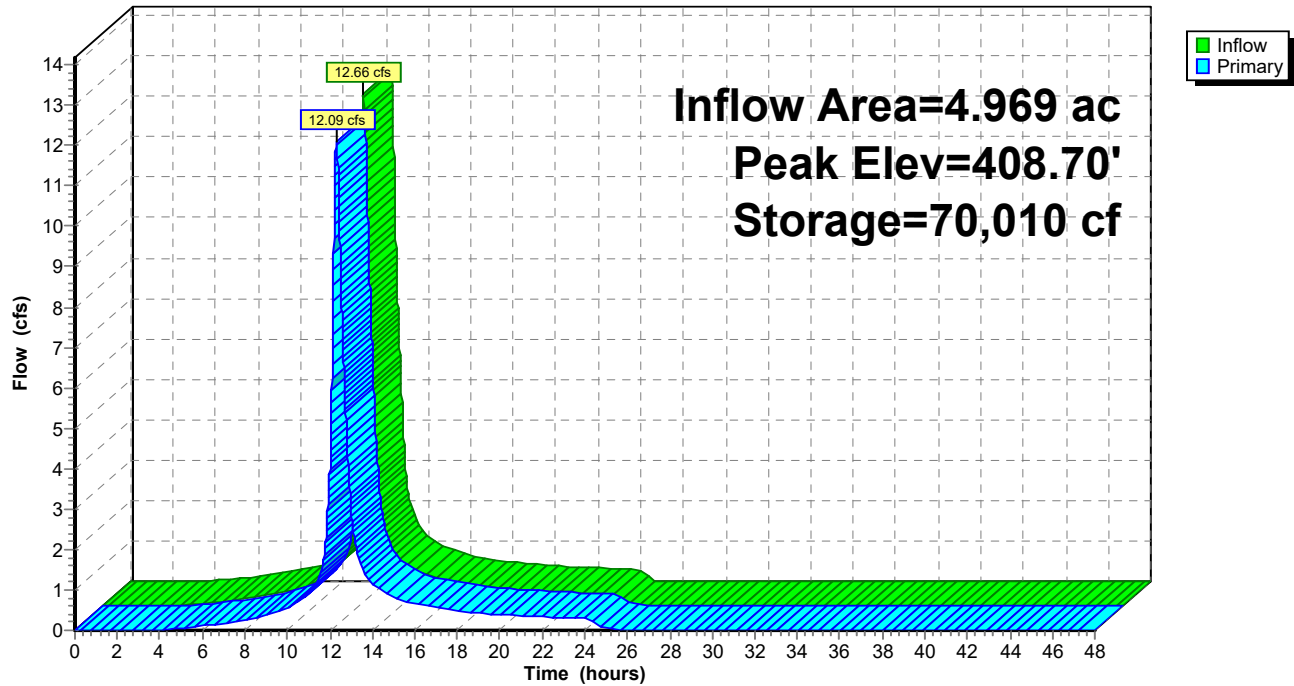

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Printed 12/8/2025

Page 14

Pond 2P: Forebay & Bio A1-B

Hydrograph

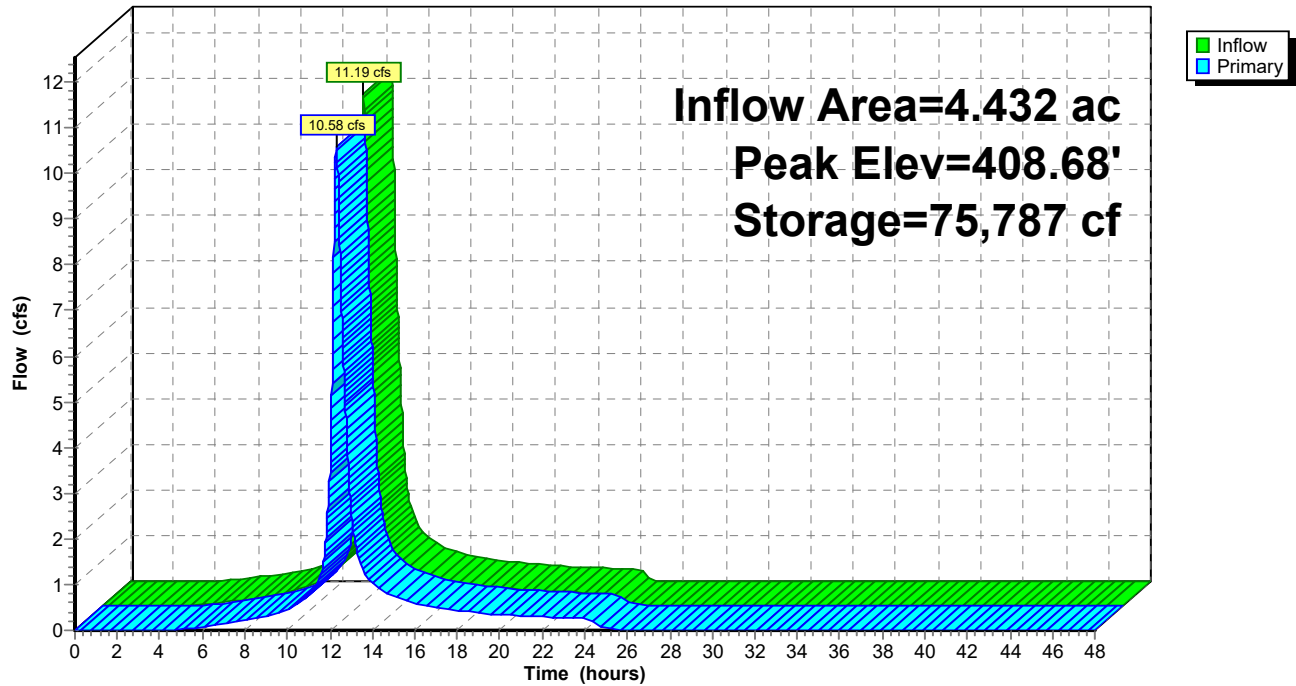

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Printed 12/8/2025

Page 15

Pond 3P: Forebay & Bio B1-A

Hydrograph

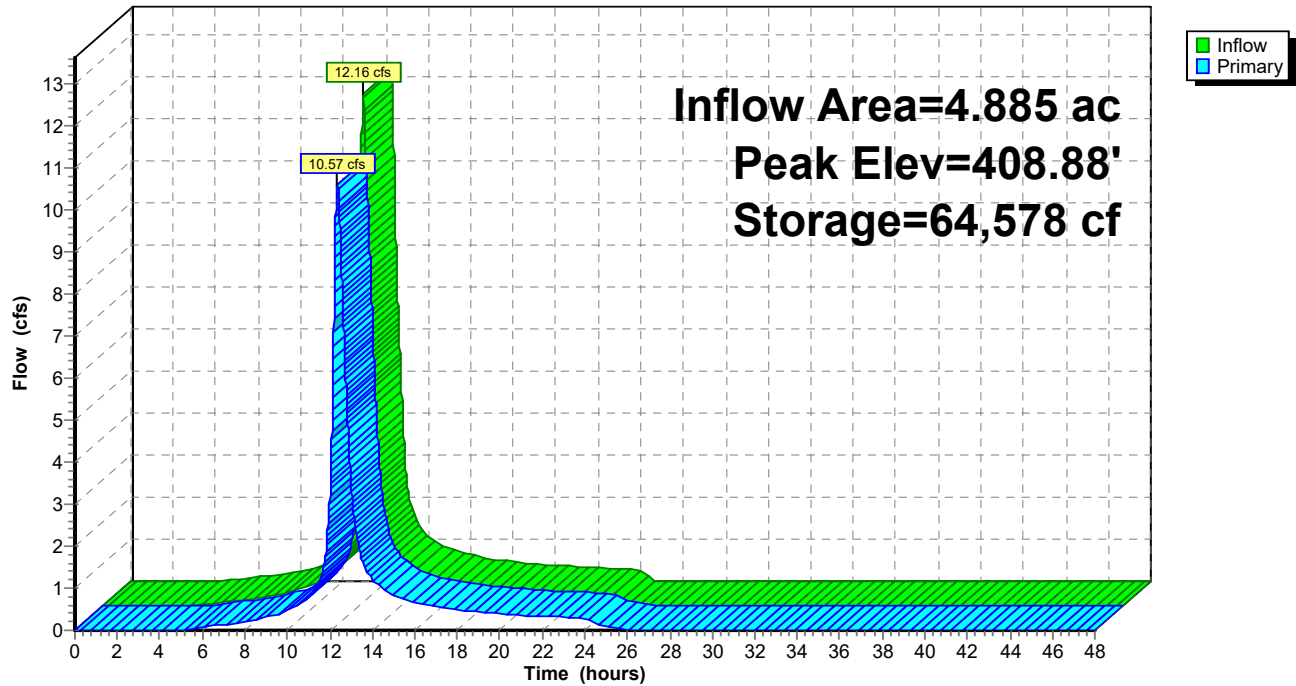

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Printed 12/8/2025

Page 16

Pond 4P: Detention Basin A1

Hydrograph

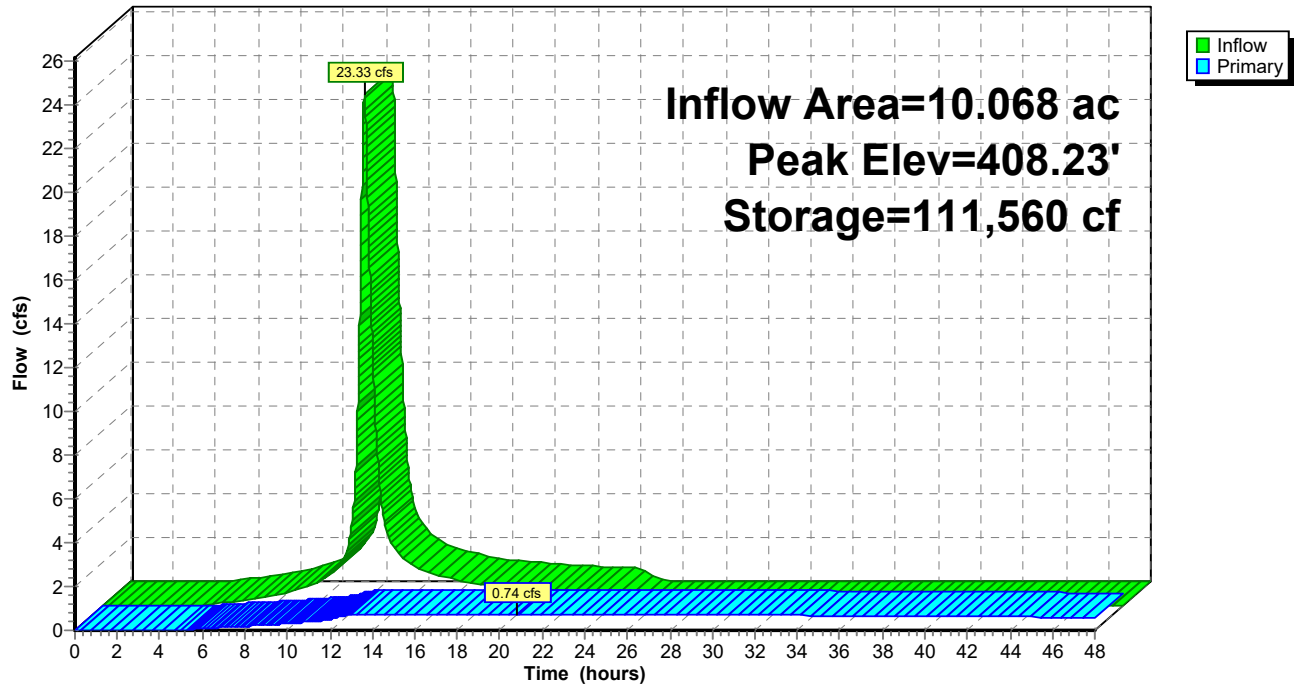

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Printed 12/8/2025

Page 17

Pond 6P: Forebay & Bio B1-B

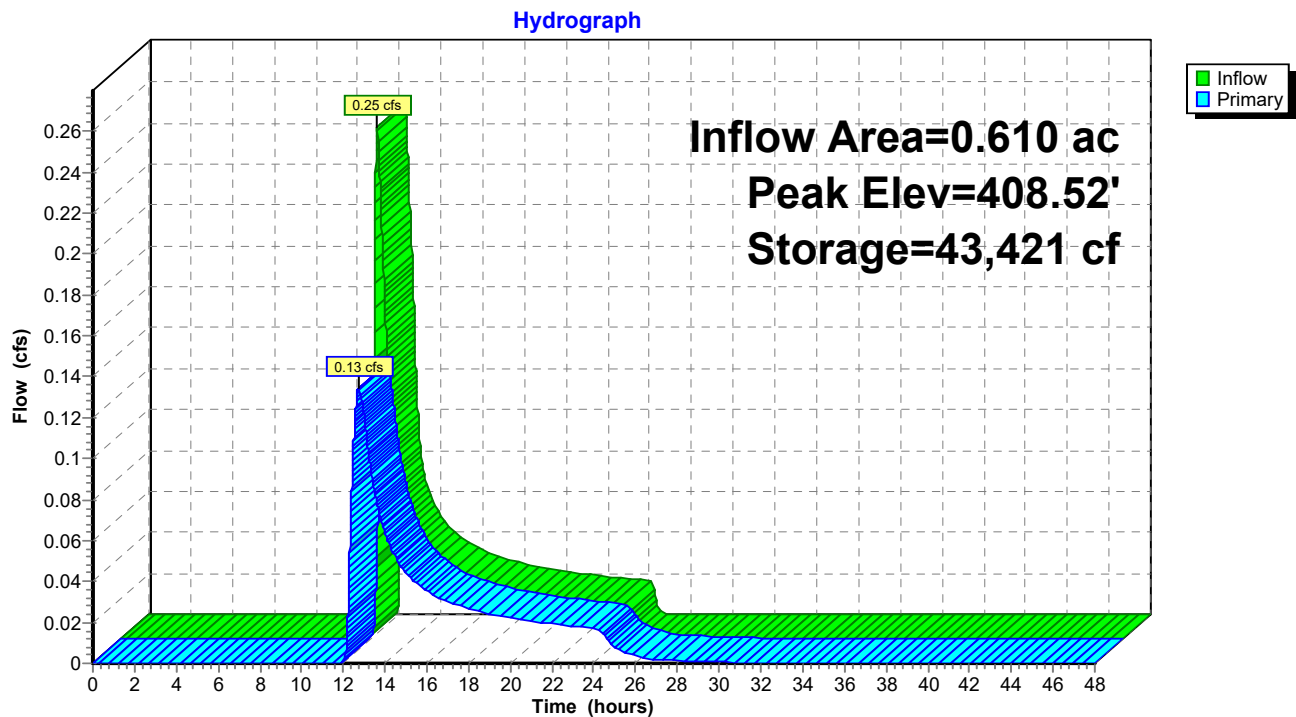

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Printed 12/8/2025

Page 18

Pond 7P: Detention Basin B1

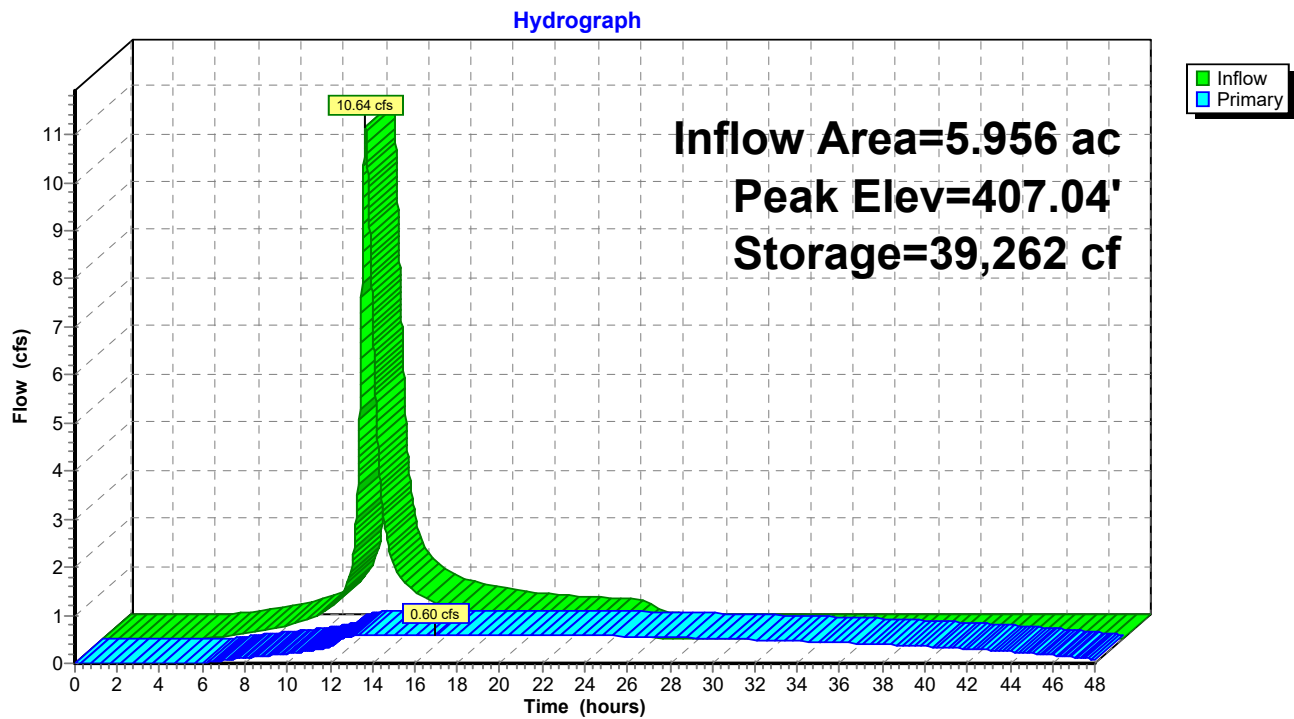

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Printed 12/8/2025

Page 19

Pond PR-A: PR-A

Hydrograph

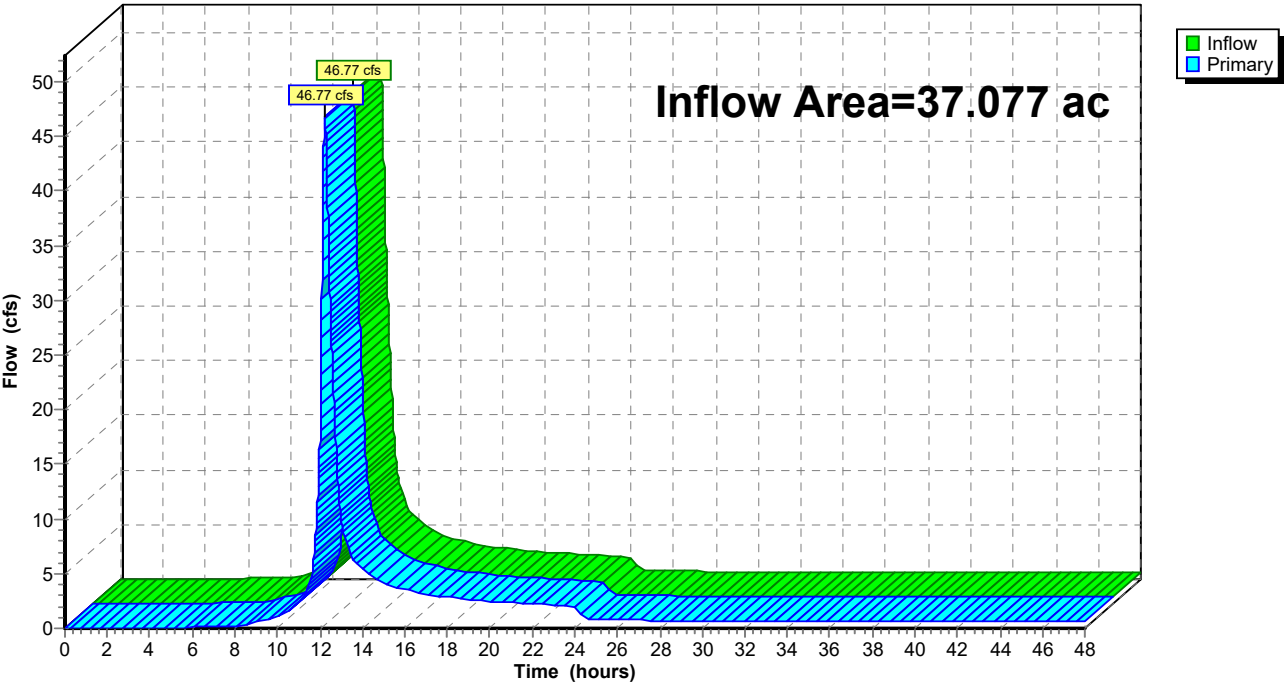

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Printed 12/8/2025

Page 20

Pond PR-B: PR-B

Hydrograph

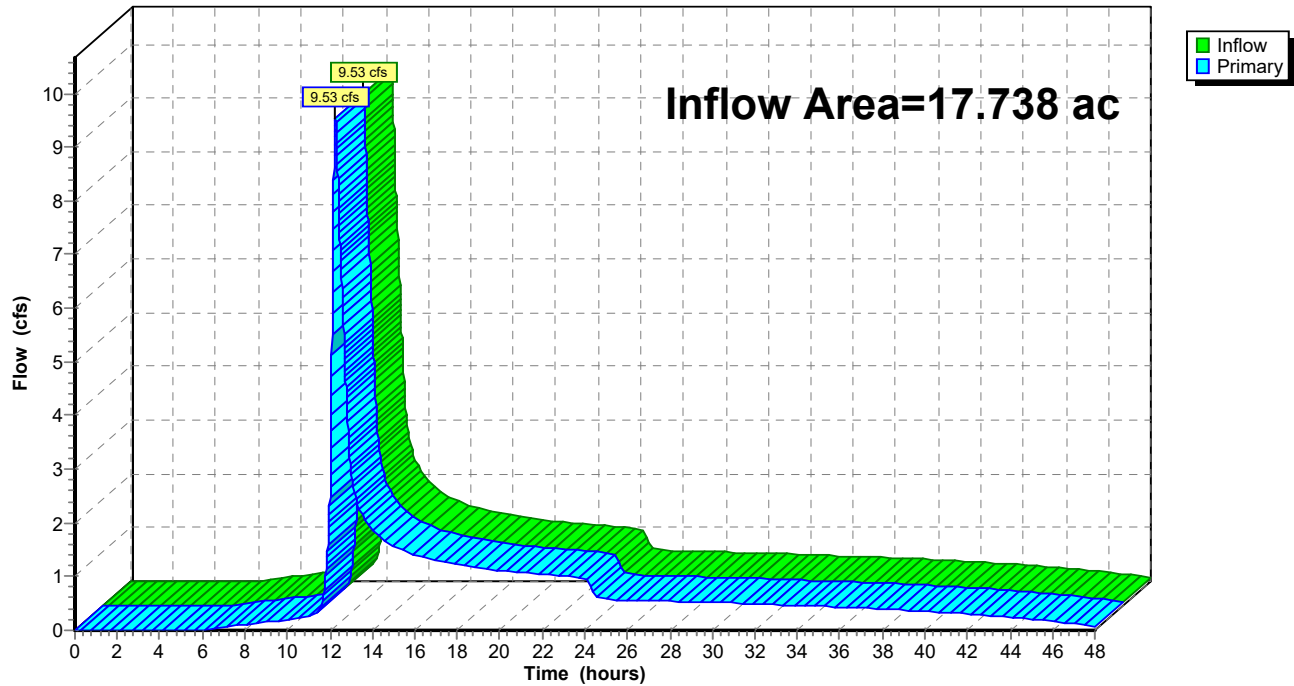

APPENDIX 10

100-YEAR DESIGN STORM

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 1

Time span=0.00-48.00 hrs, dt=0.01 hrs, 4801 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

SubcatchmentA: EX-A	Runoff Area=35.318 ac 19.88% Impervious Runoff Depth=5.39" Tc=31.2 min CN=76 Runoff=111.57 cfs 15.852 af
SubcatchmentA1-A: PR-A1-A	Runoff Area=4.969 ac 55.48% Impervious Runoff Depth=7.05" Tc=22.2 min CN=90 Runoff=22.90 cfs 2.920 af
SubcatchmentA1-B: PR-A1-B	Runoff Area=4.432 ac 51.17% Impervious Runoff Depth=6.93" Tc=21.6 min CN=89 Runoff=20.50 cfs 2.560 af
SubcatchmentA1-C: PR-A1-C	Runoff Area=0.667 ac 0.00% Impervious Runoff Depth=5.86" Tc=6.0 min CN=80 Runoff=4.46 cfs 0.326 af
SubcatchmentA2: PR-A2	Runoff Area=27.009 ac 31.15% Impervious Runoff Depth=5.39" Tc=20.4 min CN=76 Runoff=103.89 cfs 12.122 af
SubcatchmentB: EX-B	Runoff Area=23.109 ac 4.81% Impervious Runoff Depth=3.98" Tc=32.4 min CN=64 Runoff=52.74 cfs 7.668 af
SubcatchmentB1-A: PR-B1-A	Runoff Area=4.885 ac 52.14% Impervious Runoff Depth=6.93" Tc=22.2 min CN=89 Runoff=22.28 cfs 2.822 af
SubcatchmentB1-B: PR-B1-B	Runoff Area=0.610 ac 25.08% Impervious Runoff Depth=2.84" Tc=19.2 min CN=54 Runoff=1.20 cfs 0.145 af
SubcatchmentB1-C: PR-B1-C	Runoff Area=0.461 ac 0.00% Impervious Runoff Depth=1.26" Tc=6.0 min CN=39 Runoff=0.41 cfs 0.049 af
SubcatchmentB2: PR-B2	Runoff Area=11.782 ac 11.29% Impervious Runoff Depth=3.64" Tc=20.4 min CN=61 Runoff=30.10 cfs 3.570 af
Pond 1P: Forebay & Bio A1-A	Peak Elev=409.00' Storage=75,659 cf Inflow=22.90 cfs 2.920 af Outflow=22.25 cfs 2.920 af
Pond 2P: Forebay & Bio A1-B	Peak Elev=409.00' Storage=82,211 cf Inflow=20.50 cfs 2.560 af Outflow=19.78 cfs 2.560 af
Pond 3P: Forebay & Bio B1-A	Peak Elev=409.39' Storage=73,813 cf Inflow=22.28 cfs 2.822 af Outflow=14.85 cfs 2.822 af
Pond 4P: Detention Basin A1	Peak Elev=409.00' Storage=127,540 cf Inflow=43.47 cfs 5.806 af Outflow=16.90 cfs 4.909 af
Pond 6P: Forebay & Bio B1-B	Peak Elev=408.57' Storage=44,137 cf Inflow=1.20 cfs 0.145 af Outflow=0.83 cfs 0.145 af
Pond 7P: Detention Basin B1	Peak Elev=408.32' Storage=54,682 cf Inflow=15.58 cfs 3.015 af Outflow=8.76 cfs 2.868 af

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 2

Pond PR-A: PR-A

Inflow=104.61 cfs 17.031 af
Primary=104.61 cfs 17.031 af

Pond PR-B: PR-B

Inflow=30.65 cfs 6.438 af
Primary=30.65 cfs 6.438 af

Total Runoff Area = 113.242 ac Runoff Volume = 48.033 af Average Runoff Depth = 5.09"
77.40% Pervious = 87.644 ac 22.60% Impervious = 25.598 ac

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"

Printed 12/8/2025

Page 3

Subcatchment A: EX-A

Hydrograph

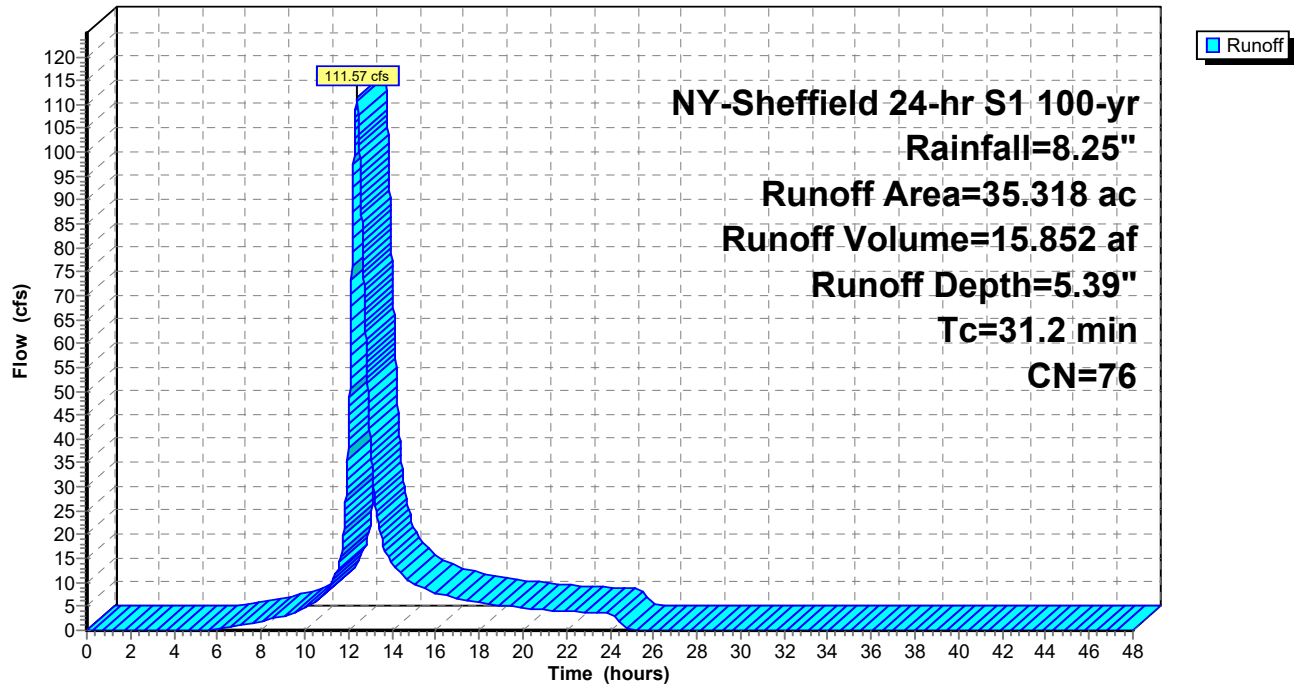

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"

Printed 12/8/2025

Page 4

Subcatchment A1-A: PR-A1-A

Hydrograph

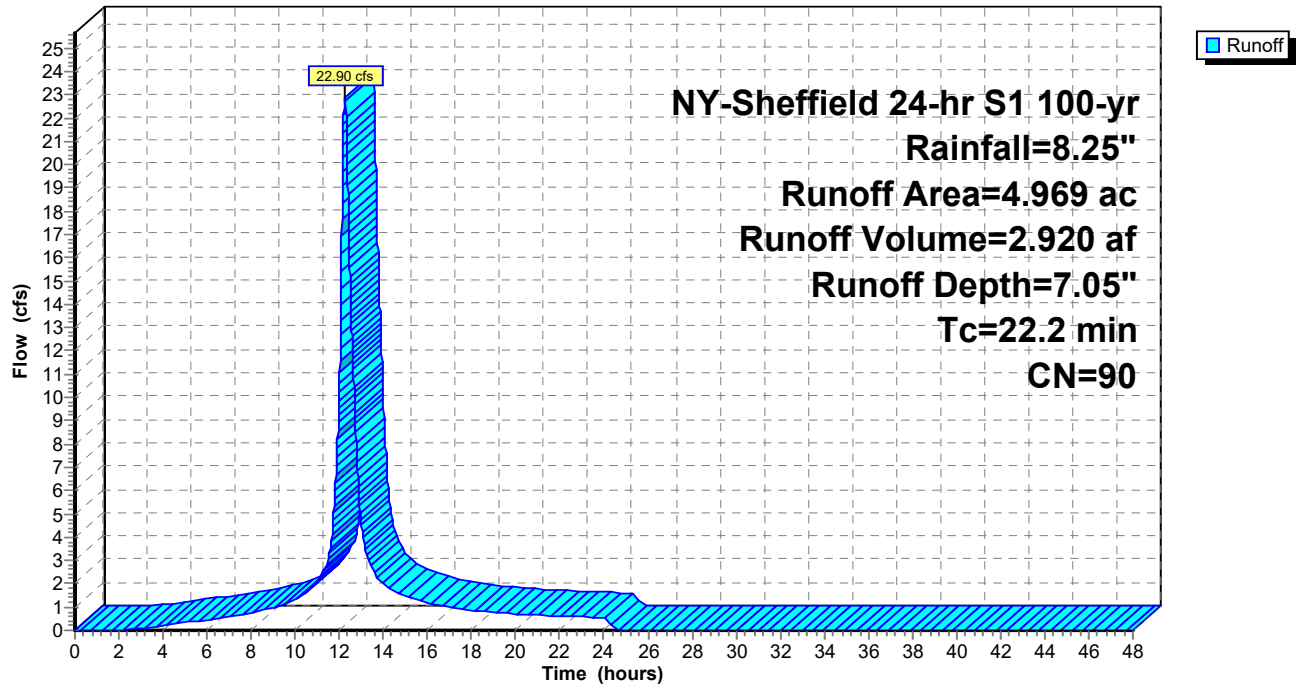

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"

Printed 12/8/2025

Page 5

Subcatchment A1-B: PR-A1-B

Hydrograph

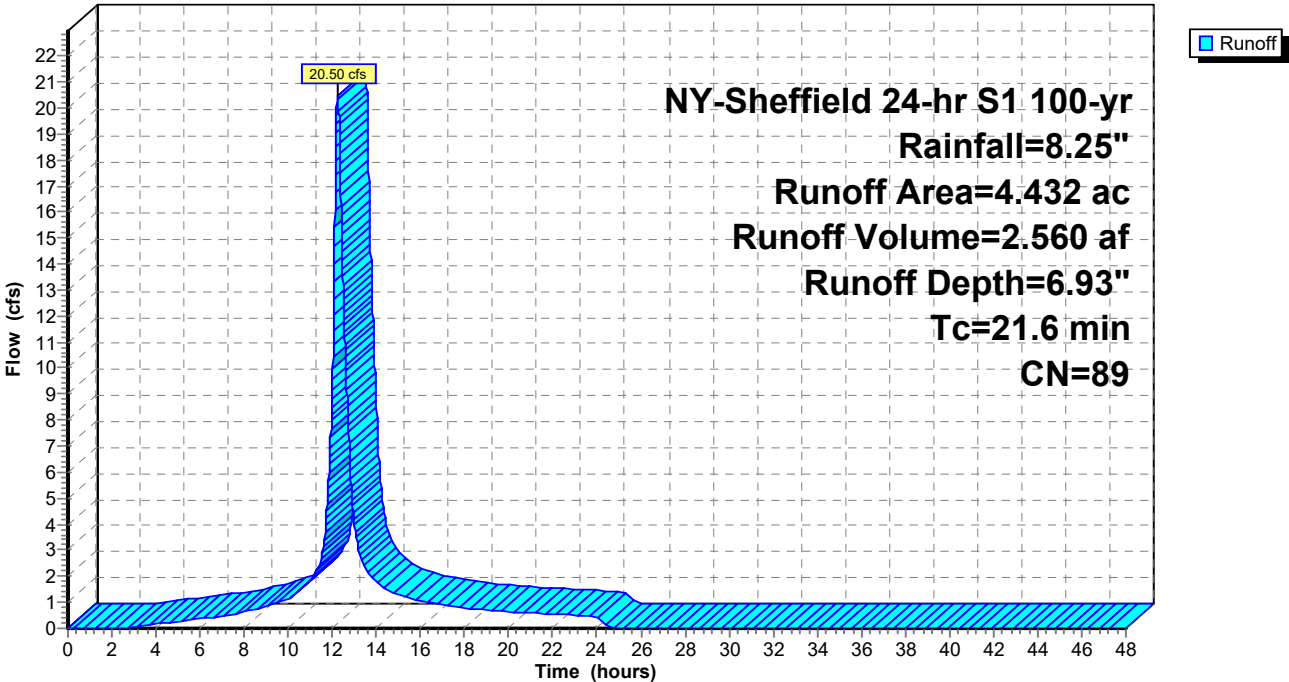

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"

Printed 12/8/2025

Page 6

Subcatchment A1-C: PR-A1-C

Hydrograph

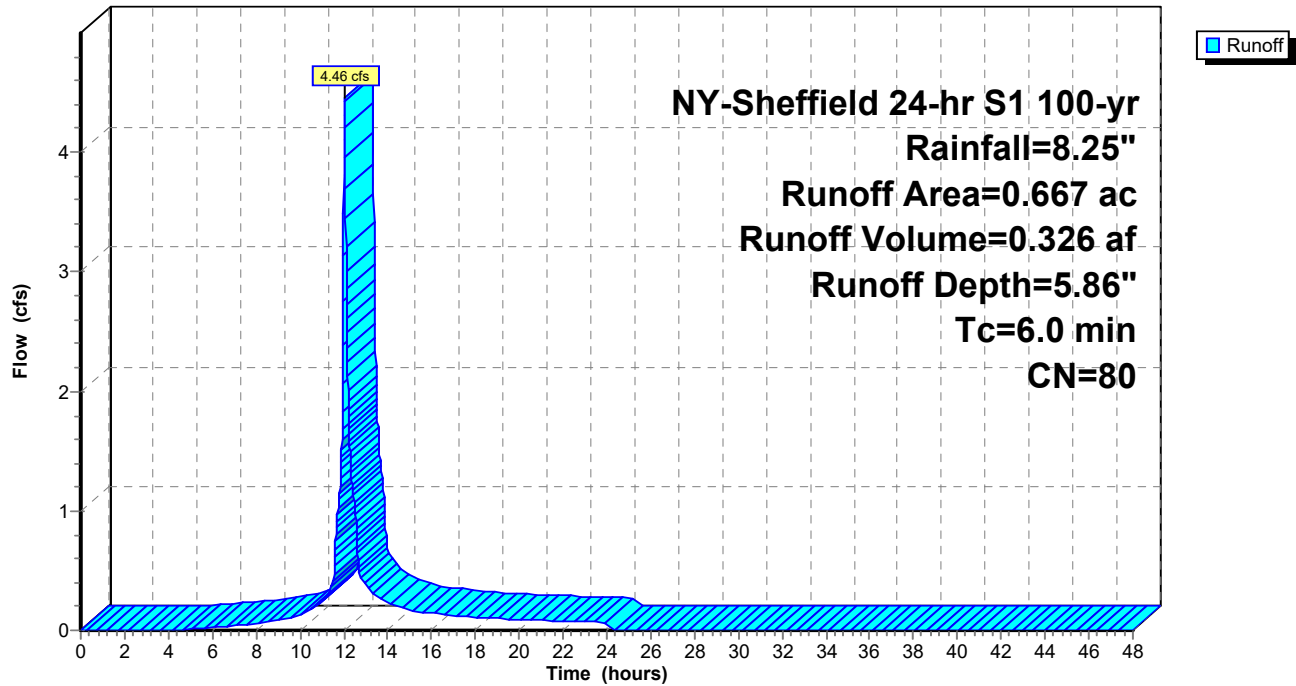

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"

Printed 12/8/2025

Page 7

Subcatchment A2: PR-A2

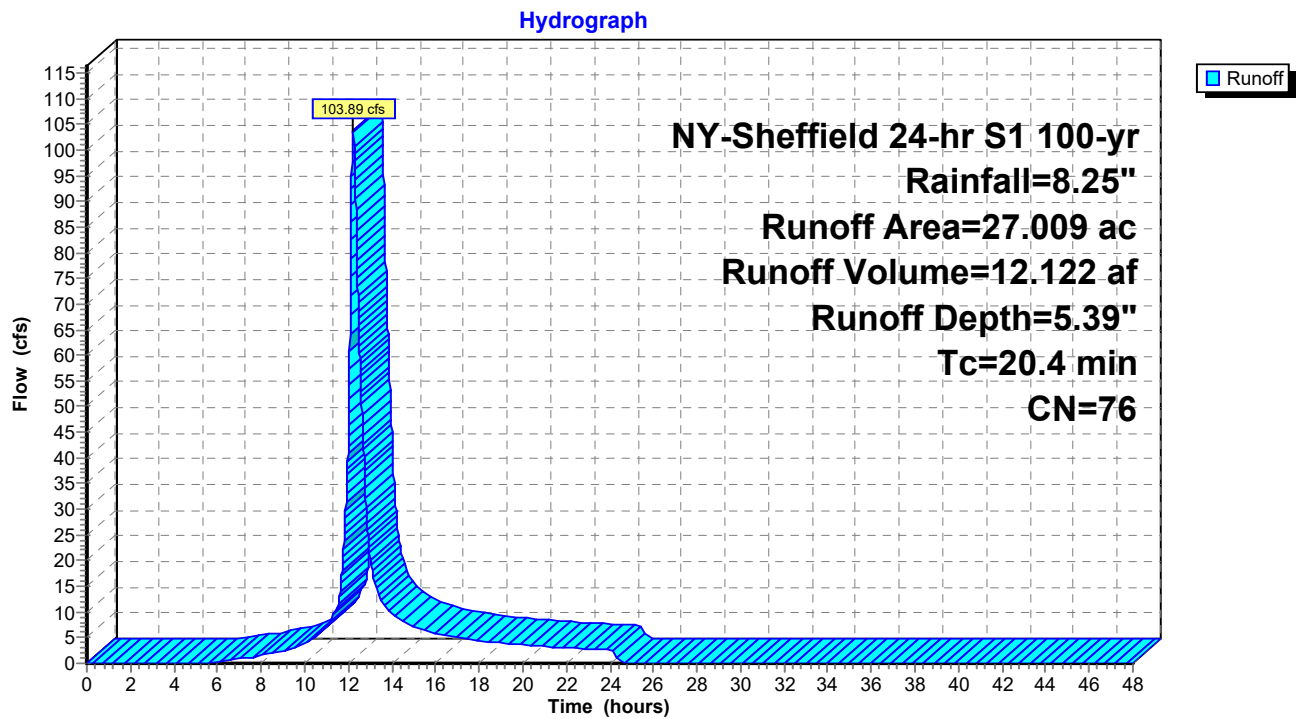

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"

Printed 12/8/2025

Page 8

Subcatchment B: EX-B

Hydrograph

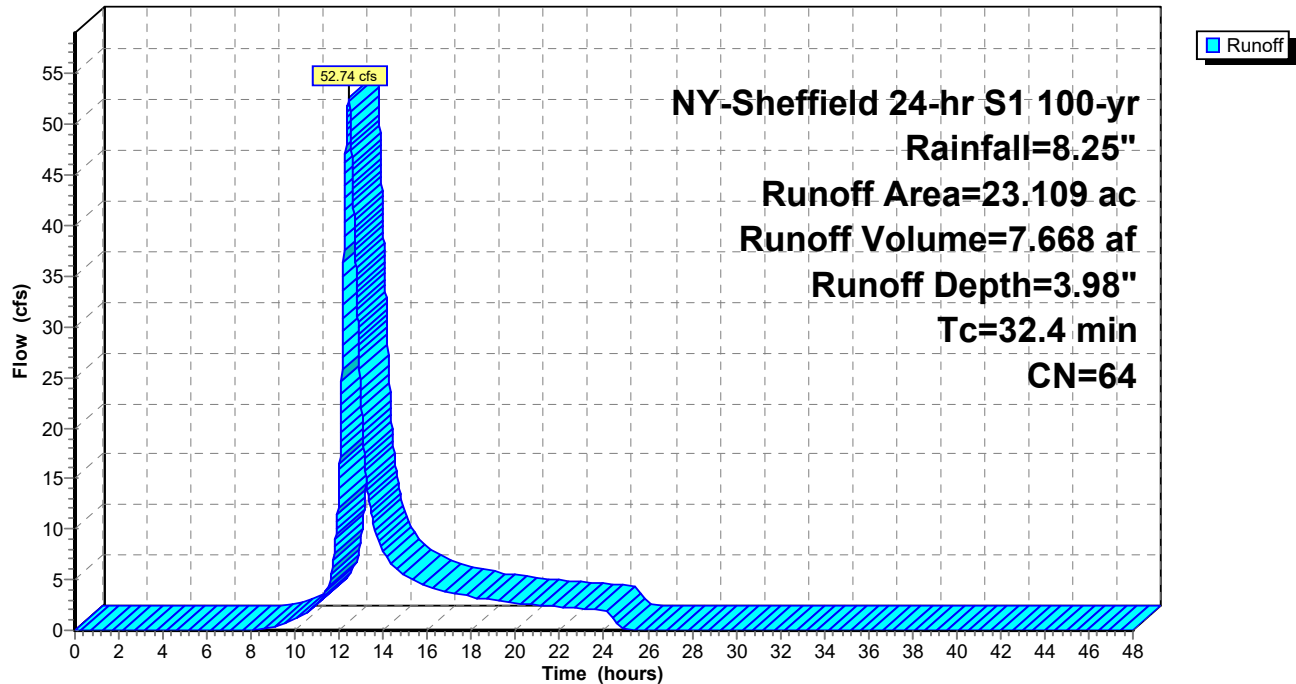

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"

Printed 12/8/2025

Page 9

Subcatchment B1-A: PR-B1-A

Hydrograph

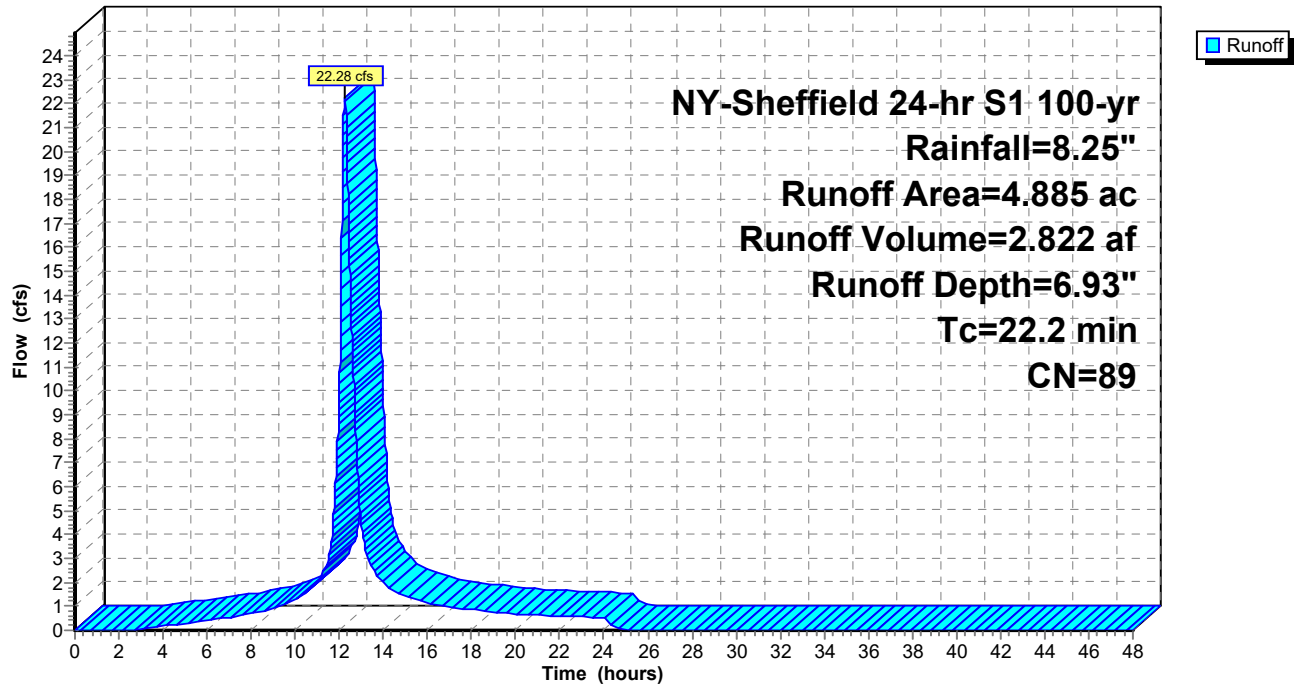

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"

Printed 12/8/2025

Page 10

Subcatchment B1-B: PR-B1-B

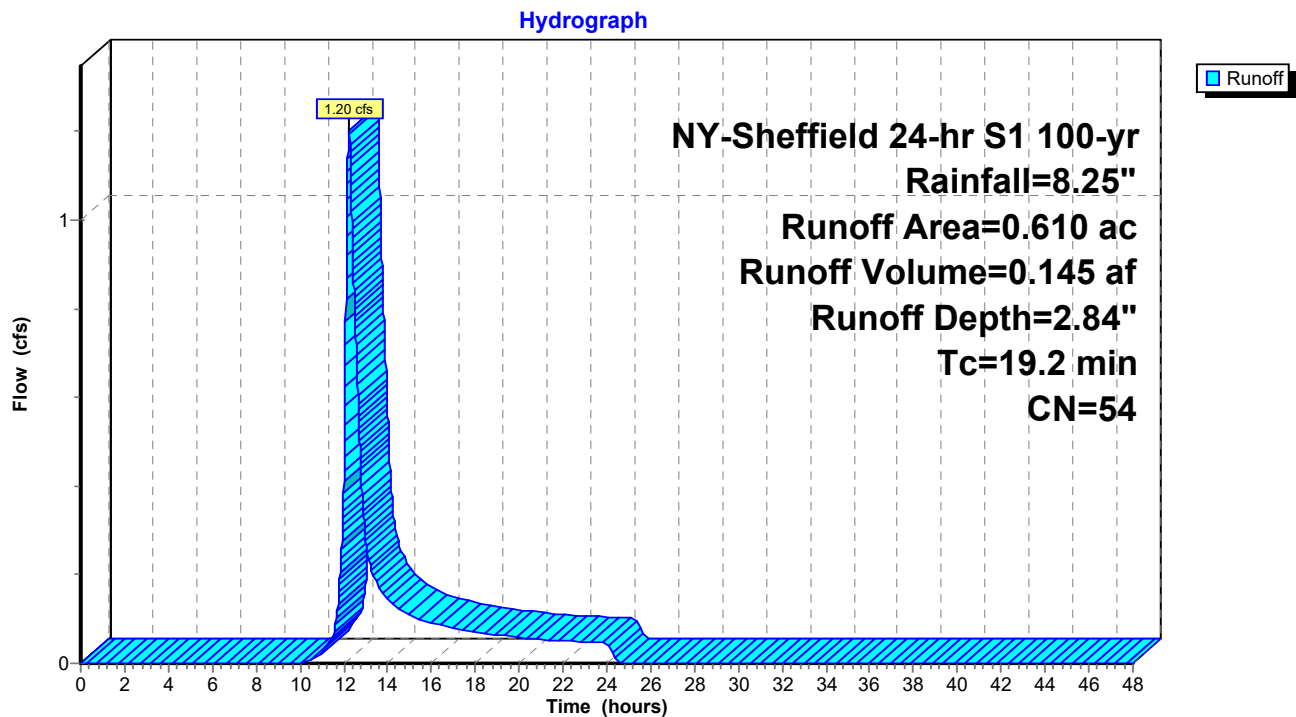

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"

Printed 12/8/2025

Page 11

Subcatchment B1-C: PR-B1-C

Hydrograph

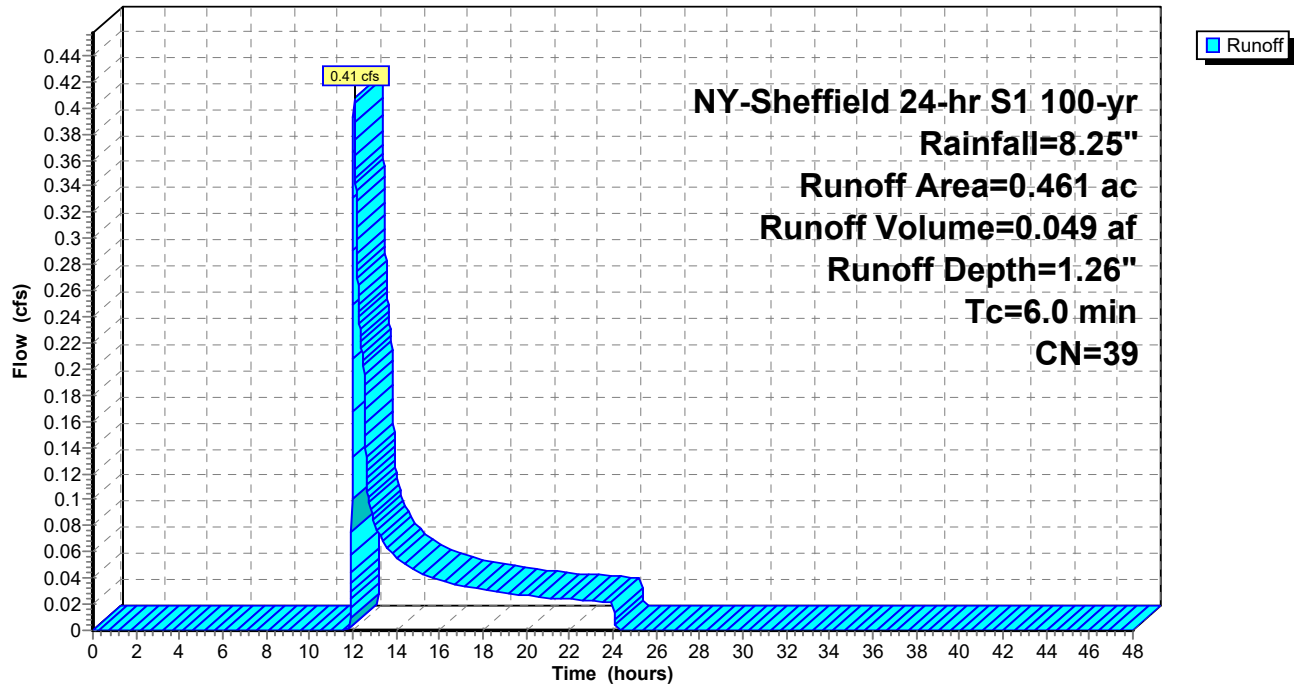

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"

Printed 12/8/2025

Page 12

Subcatchment B2: PR-B2

Hydrograph

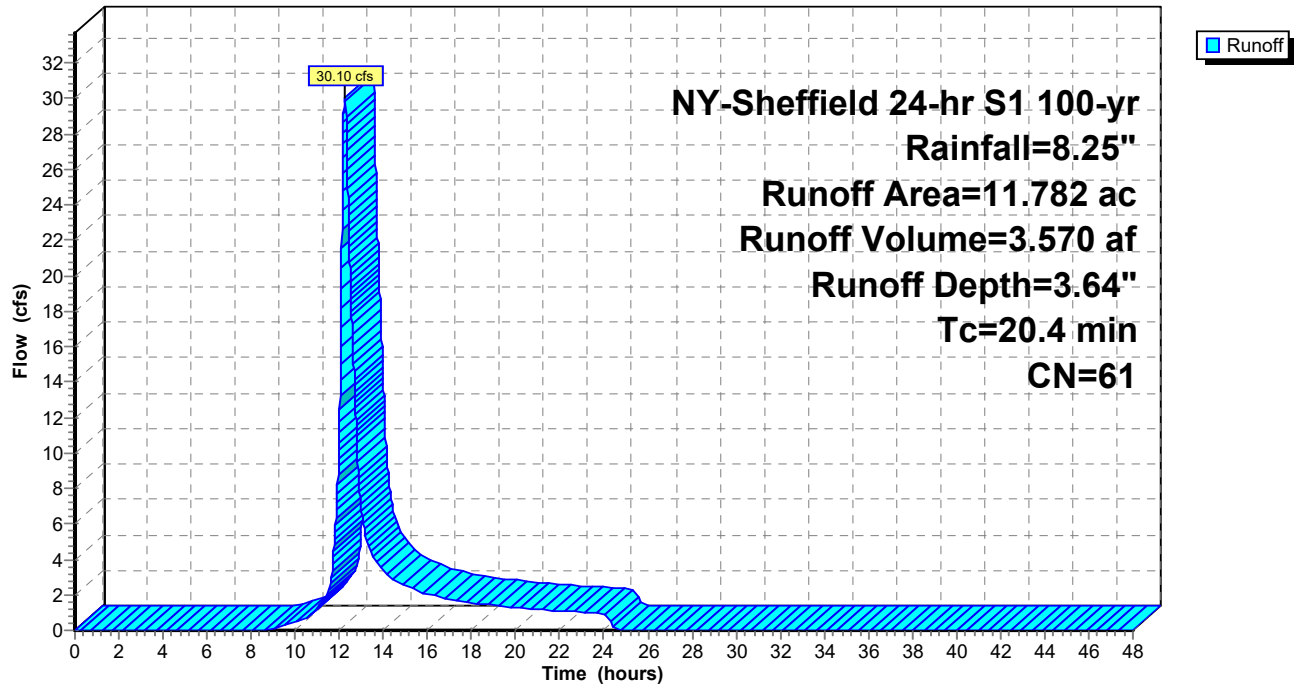

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"

Printed 12/8/2025

Page 13

Pond 1P: Forebay & Bio A1-A

Hydrograph

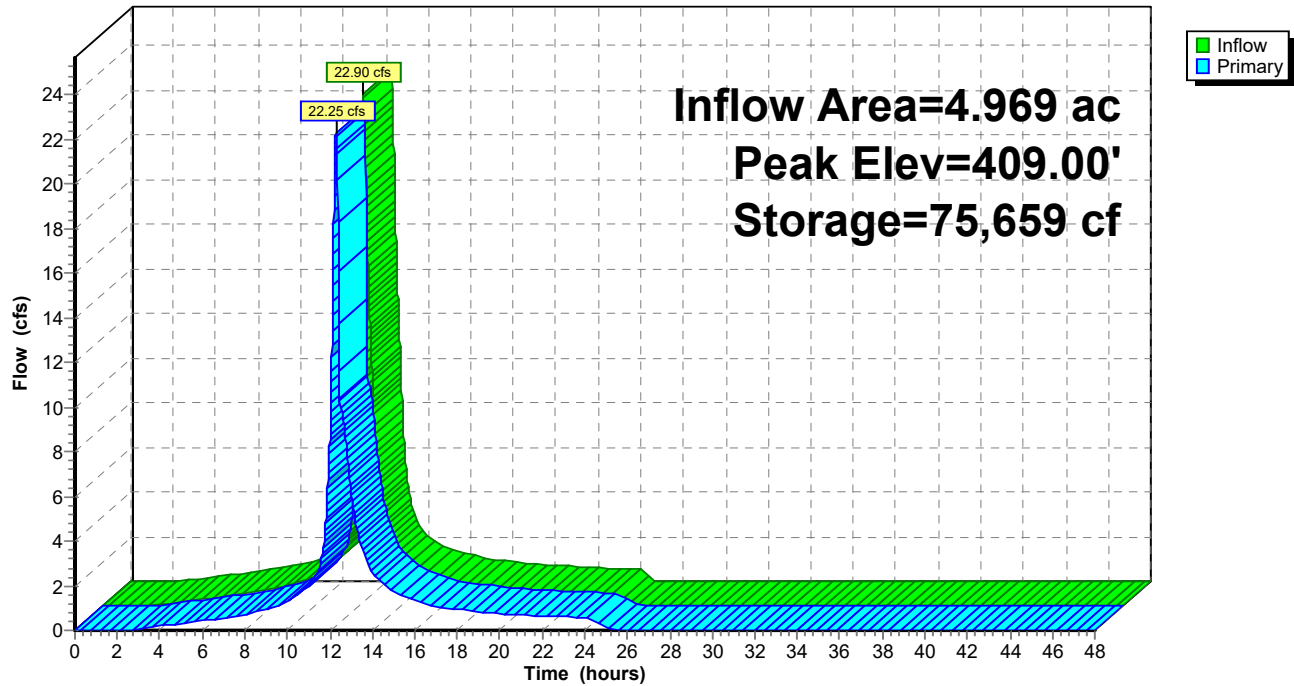

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"

Printed 12/8/2025

Page 14

Pond 2P: Forebay & Bio A1-B

Hydrograph

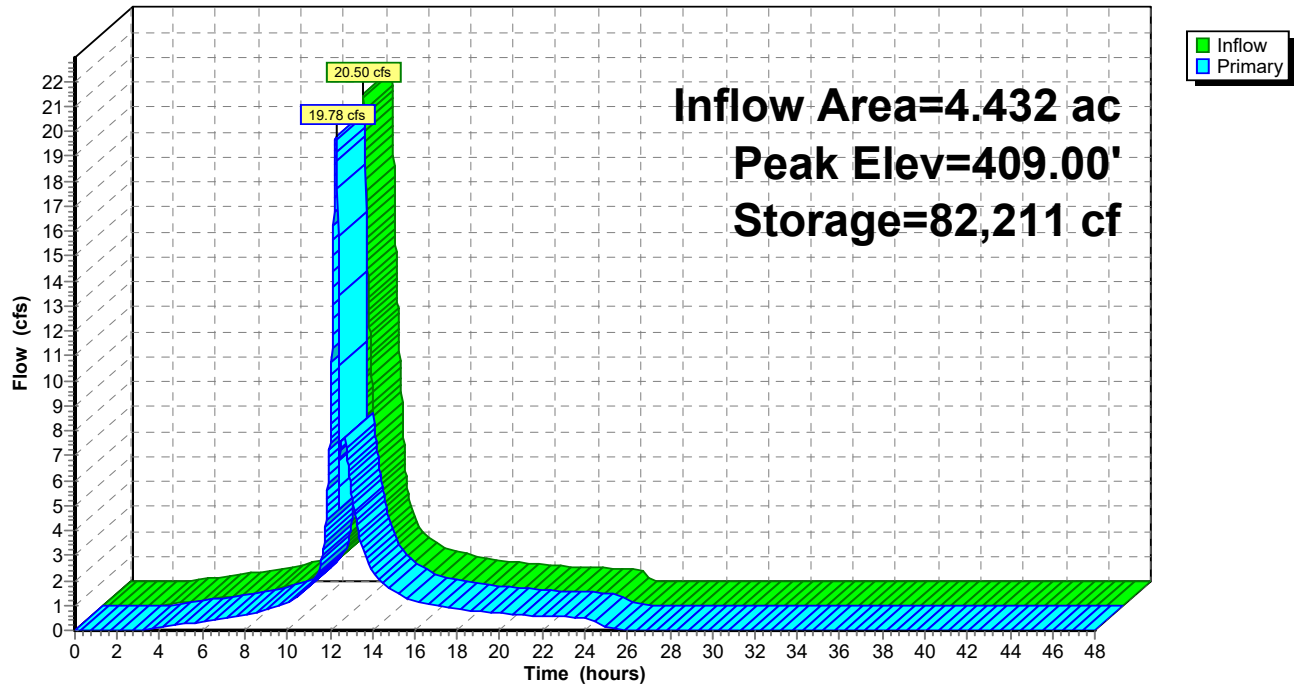

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"

Printed 12/8/2025

Page 15

Pond 3P: Forebay & Bio B1-A

Hydrograph

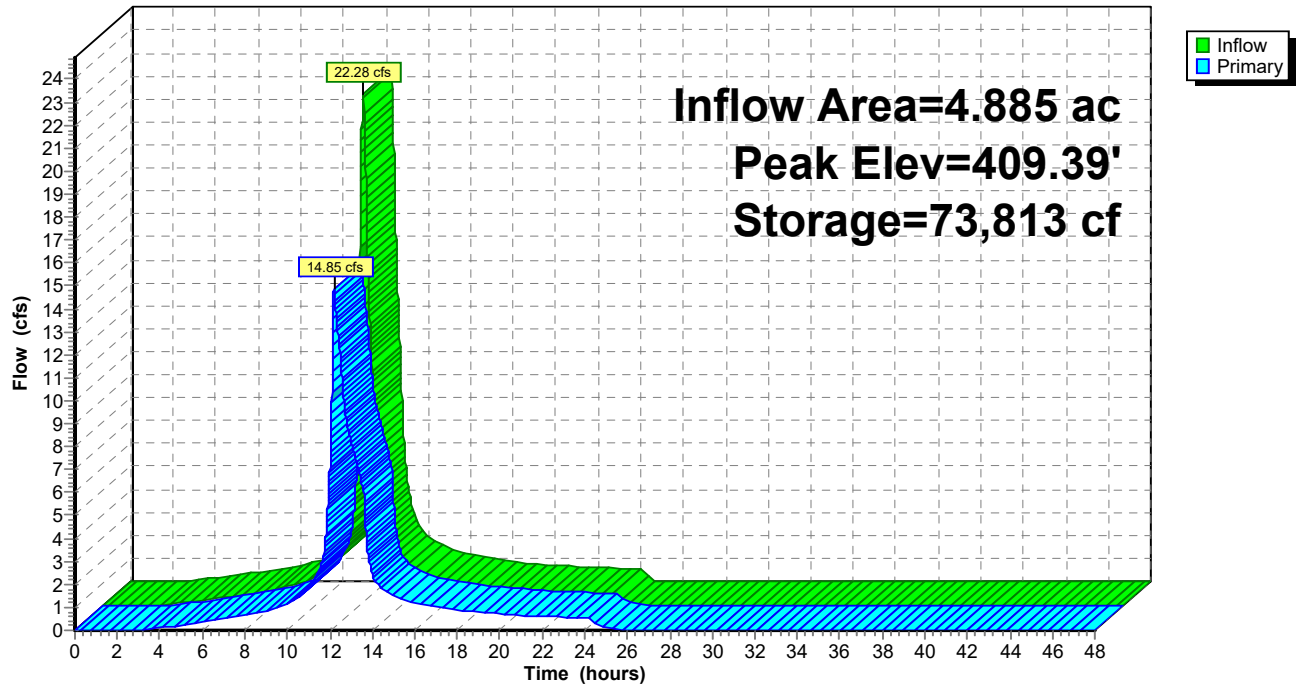

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"

Printed 12/8/2025

Page 16

Pond 4P: Detention Basin A1

Hydrograph

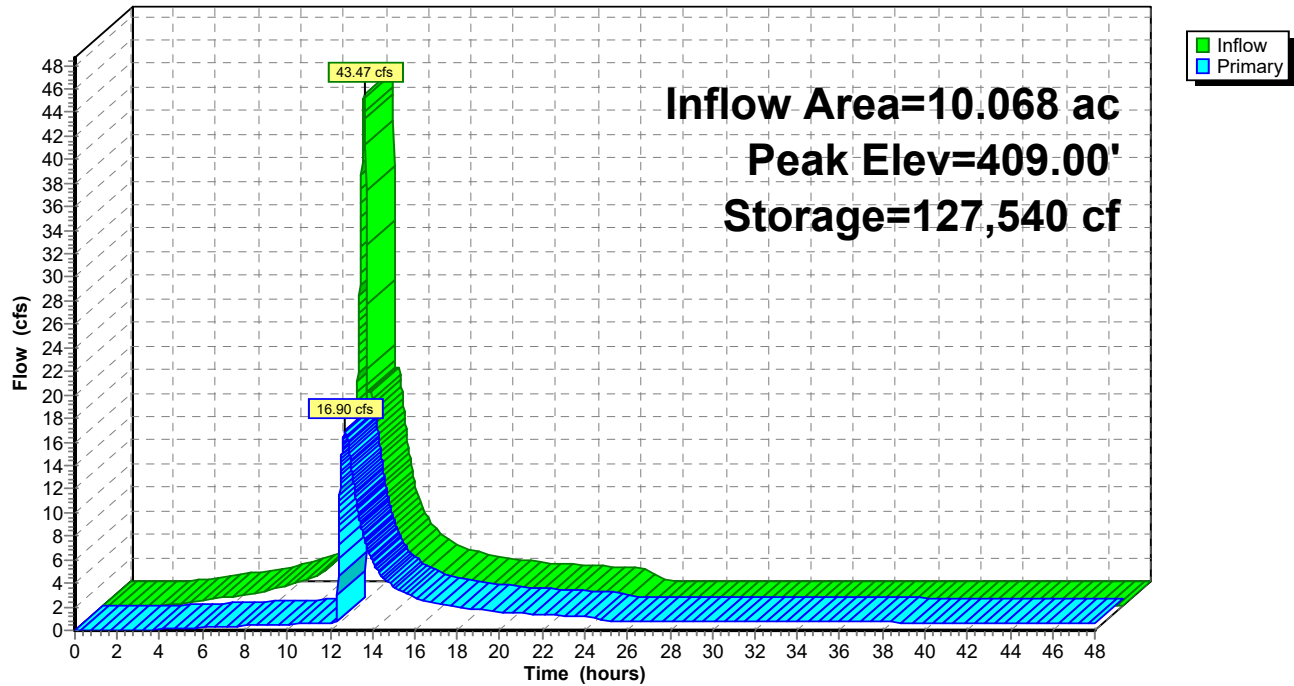

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"

Printed 12/8/2025

Page 17

Pond 6P: Forebay & Bio B1-B

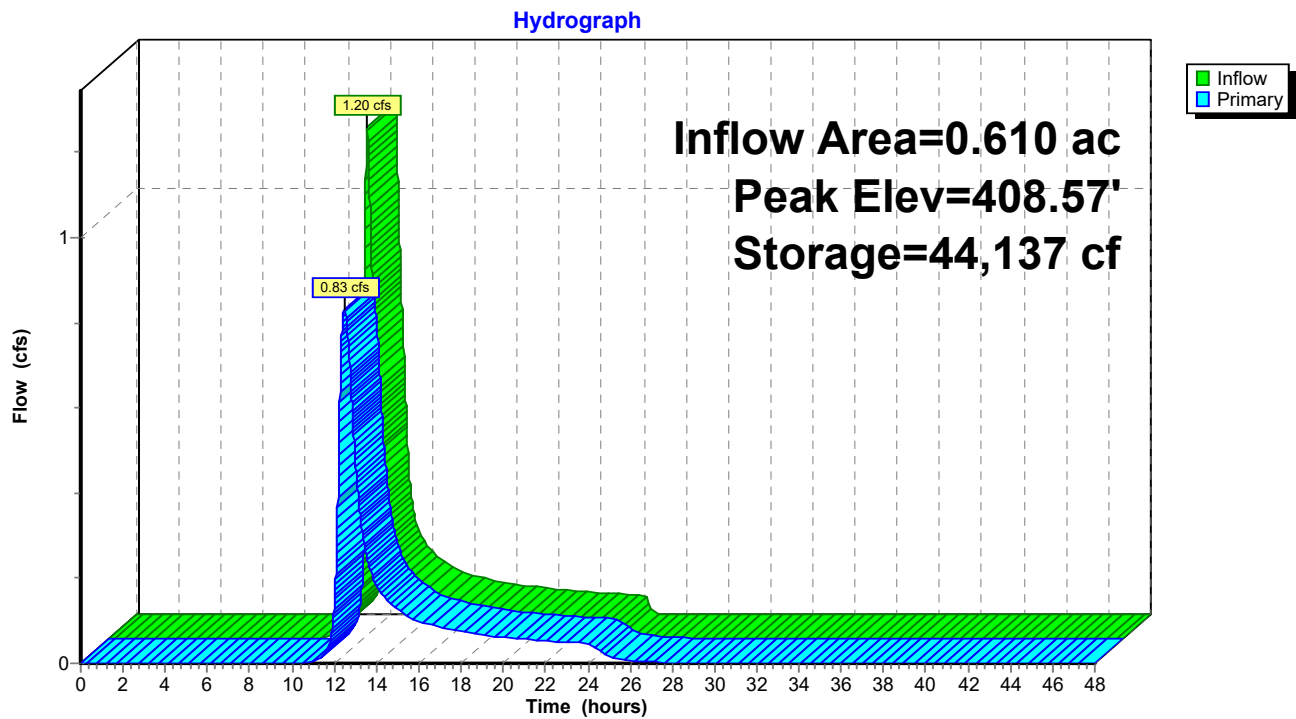

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"

Printed 12/8/2025

Page 18

Pond 7P: Detention Basin B1

Hydrograph

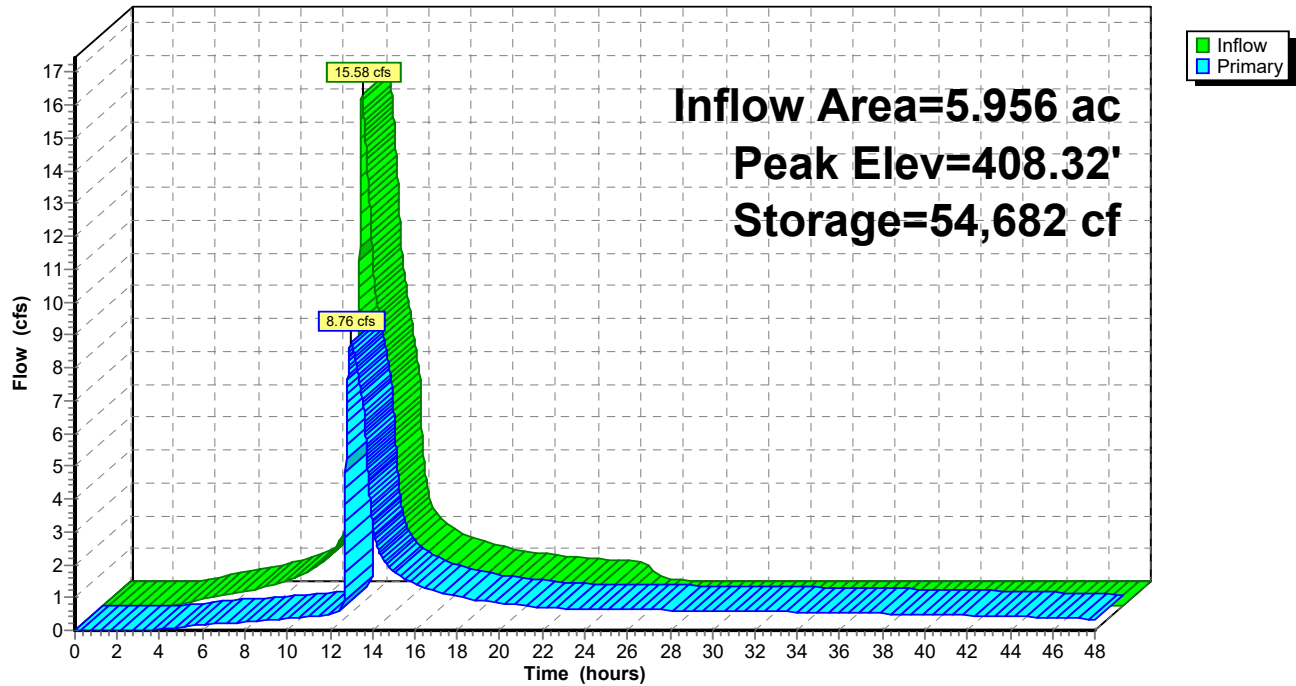

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"

Printed 12/8/2025

Page 19

Pond PR-A: PR-A

Hydrograph

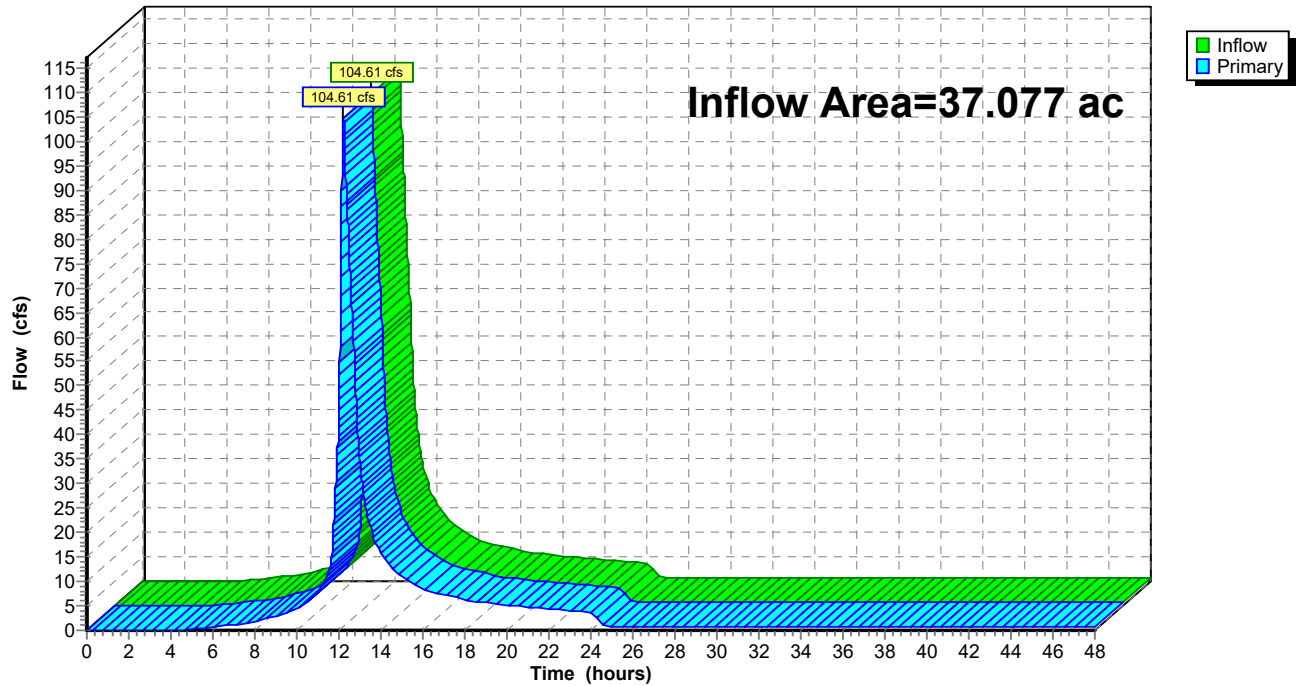

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"

Printed 12/8/2025

Page 20

Pond PR-B: PR-B

Hydrograph

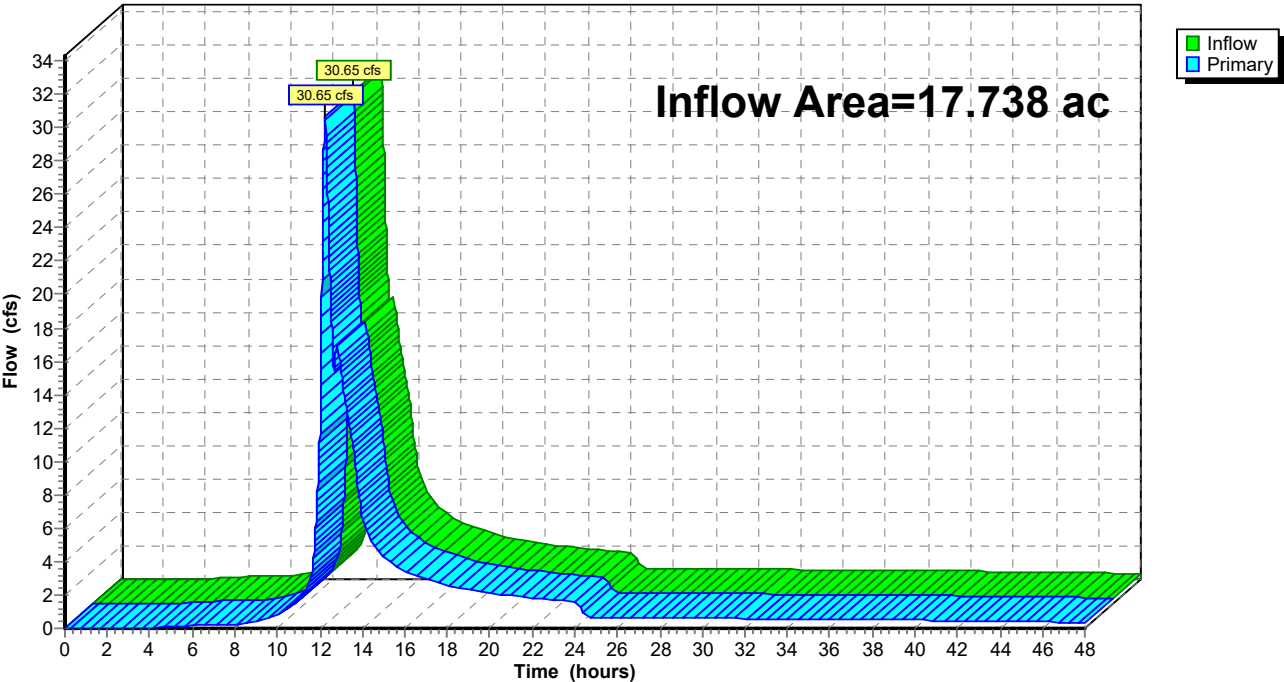

APPENDIX 11

500-YEAR DESIGN STORM

HYDROGRAPHS

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 1

Time span=0.00-48.00 hrs, dt=0.01 hrs, 4801 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

SubcatchmentA: EX-A	Runoff Area=35.318 ac 19.88% Impervious Runoff Depth=9.18" Tc=31.2 min CN=76 Runoff=182.01 cfs 27.027 af
SubcatchmentA1-A: PR-A1-A	Runoff Area=4.969 ac 55.48% Impervious Runoff Depth=11.06" Tc=22.2 min CN=90 Runoff=33.81 cfs 4.580 af
SubcatchmentA1-B: PR-A1-B	Runoff Area=4.432 ac 51.17% Impervious Runoff Depth=10.93" Tc=21.6 min CN=89 Runoff=30.39 cfs 4.037 af
SubcatchmentA1-C: PR-A1-C	Runoff Area=0.667 ac 0.00% Impervious Runoff Depth=9.74" Tc=6.0 min CN=80 Runoff=6.82 cfs 0.541 af
SubcatchmentA2: PR-A2	Runoff Area=27.009 ac 31.15% Impervious Runoff Depth=9.18" Tc=20.4 min CN=76 Runoff=168.02 cfs 20.669 af
SubcatchmentB: EX-B	Runoff Area=23.109 ac 4.81% Impervious Runoff Depth=7.43" Tc=32.4 min CN=64 Runoff=96.48 cfs 14.315 af
SubcatchmentB1-A: PR-B1-A	Runoff Area=4.885 ac 52.14% Impervious Runoff Depth=10.93" Tc=22.2 min CN=89 Runoff=33.05 cfs 4.450 af
SubcatchmentB1-B: PR-B1-B	Runoff Area=0.610 ac 25.08% Impervious Runoff Depth=5.87" Tc=19.2 min CN=54 Runoff=2.51 cfs 0.299 af
SubcatchmentB1-C: PR-B1-C	Runoff Area=0.461 ac 0.00% Impervious Runoff Depth=3.39" Tc=6.0 min CN=39 Runoff=1.49 cfs 0.130 af
SubcatchmentB2: PR-B2	Runoff Area=11.782 ac 11.29% Impervious Runoff Depth=6.98" Tc=20.4 min CN=61 Runoff=56.59 cfs 6.848 af
Pond 1P: Forebay & Bio A1-A	Peak Elev=409.40' Storage=83,225 cf Inflow=33.81 cfs 4.580 af Outflow=26.06 cfs 4.580 af
Pond 2P: Forebay & Bio A1-B	Peak Elev=409.40' Storage=90,637 cf Inflow=30.39 cfs 4.037 af Outflow=21.67 cfs 4.037 af
Pond 3P: Forebay & Bio B1-A	Peak Elev=428.93' Storage=85,810 cf Inflow=33.05 cfs 4.450 af Outflow=38.57 cfs 4.450 af
Pond 4P: Detention Basin A1	Peak Elev=409.39' Storage=136,327 cf Inflow=49.78 cfs 9.159 af Outflow=47.53 cfs 8.242 af
Pond 6P: Forebay & Bio B1-B	Peak Elev=408.65' Storage=45,305 cf Inflow=2.51 cfs 0.299 af Outflow=1.95 cfs 0.299 af
Pond 7P: Detention Basin B1	Peak Elev=408.63' Storage=59,000 cf Inflow=41.12 cfs 4.879 af Outflow=23.73 cfs 4.723 af

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 2

Pond PR-A: PR-A

Inflow=203.38 cfs 28.911 af
Primary=203.38 cfs 28.911 af

Pond PR-B: PR-B

Inflow=64.67 cfs 11.572 af
Primary=64.67 cfs 11.572 af

Total Runoff Area = 113.242 ac Runoff Volume = 82.897 af Average Runoff Depth = 8.78"
77.40% Pervious = 87.644 ac 22.60% Impervious = 25.598 ac

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Printed 12/8/2025

Page 3

Subcatchment A: EX-A

Hydrograph

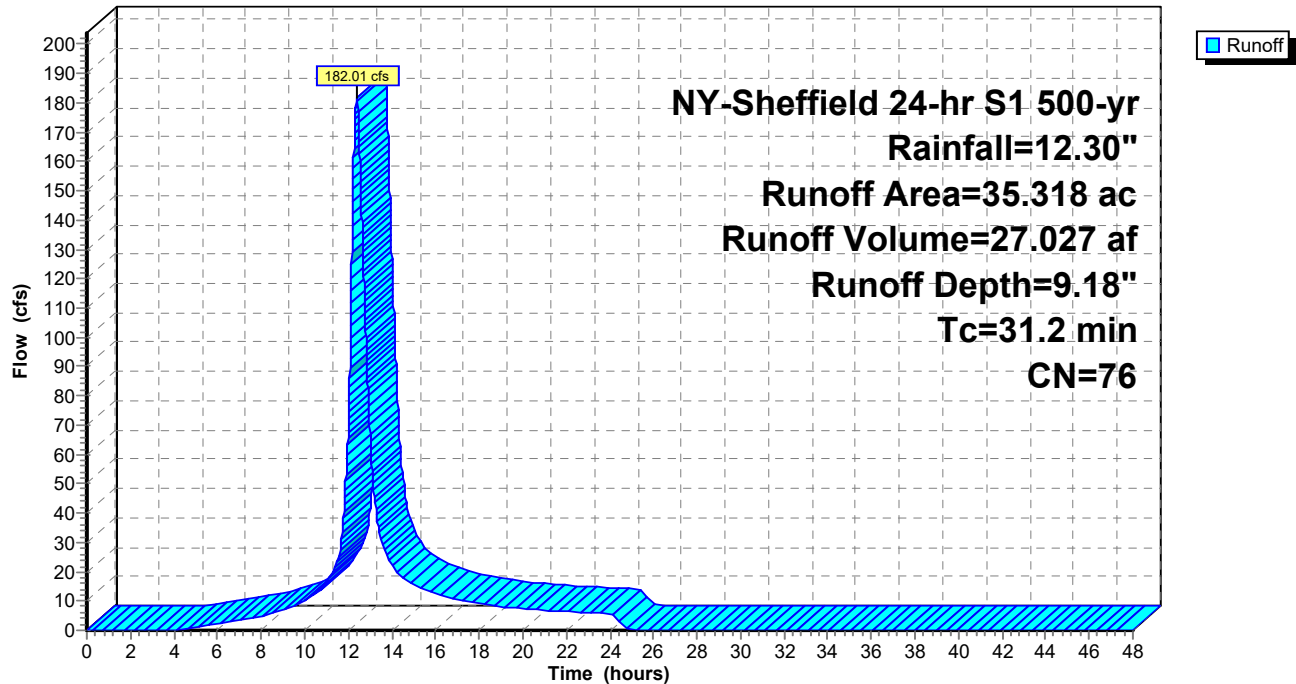

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Printed 12/8/2025

Page 4

Subcatchment A1-A: PR-A1-A

Hydrograph

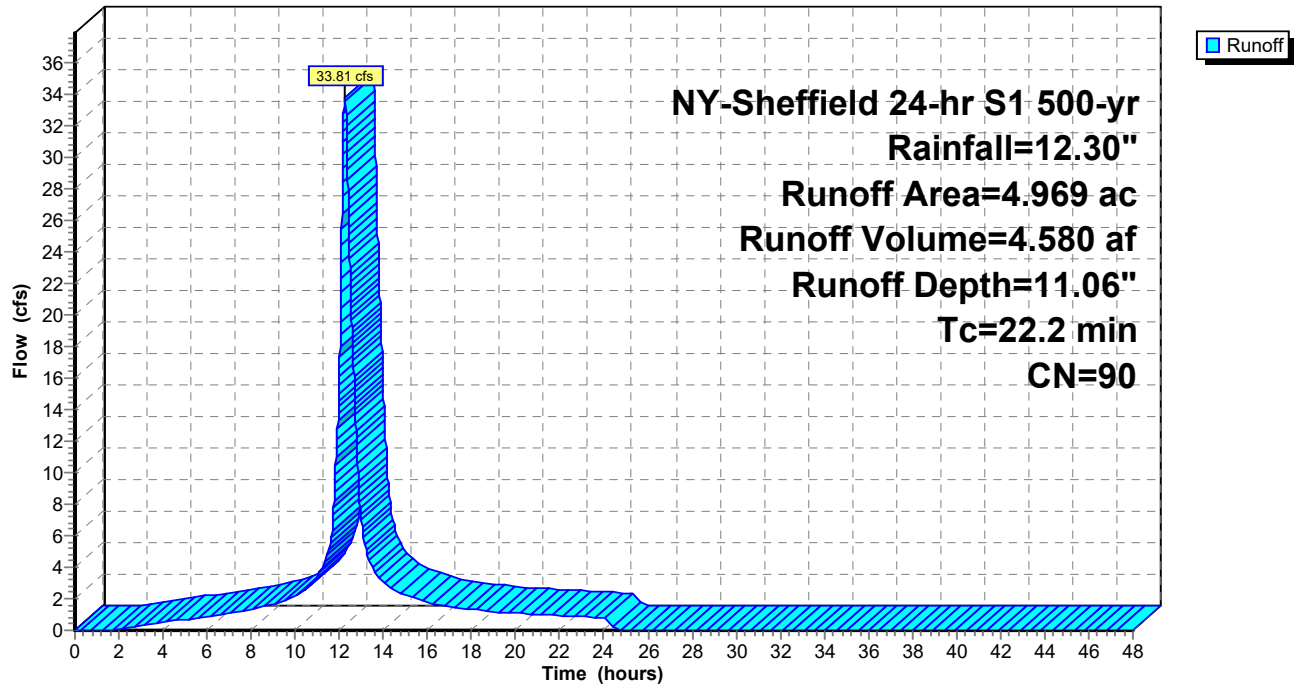

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Printed 12/8/2025

Page 5

Subcatchment A1-B: PR-A1-B

Hydrograph

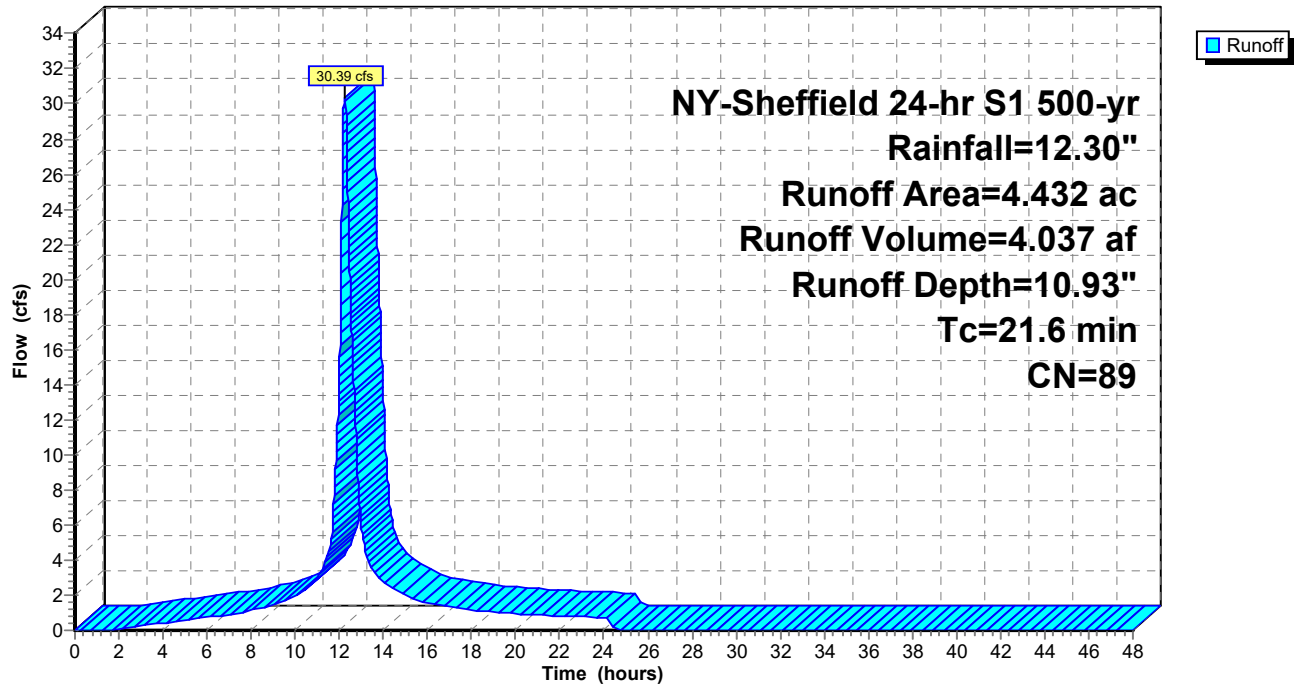

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Printed 12/8/2025

Page 6

Subcatchment A1-C: PR-A1-C

Hydrograph

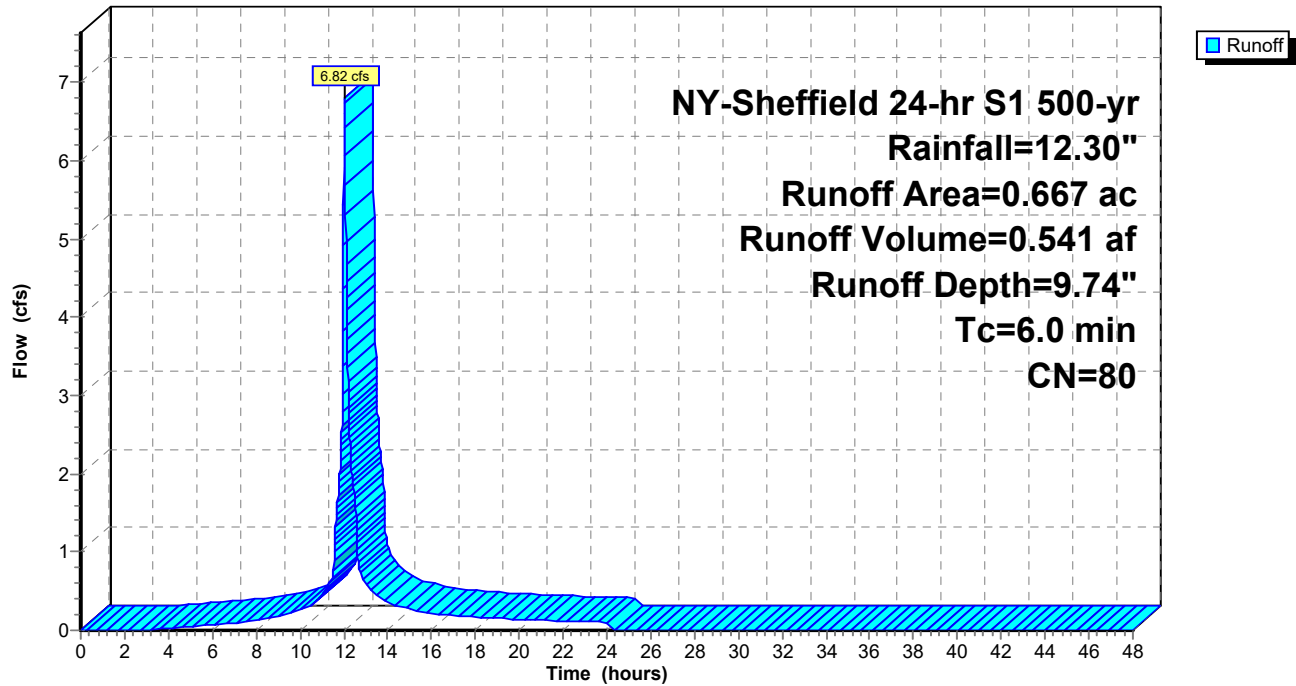

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Printed 12/8/2025

Page 7

Subcatchment A2: PR-A2

Hydrograph

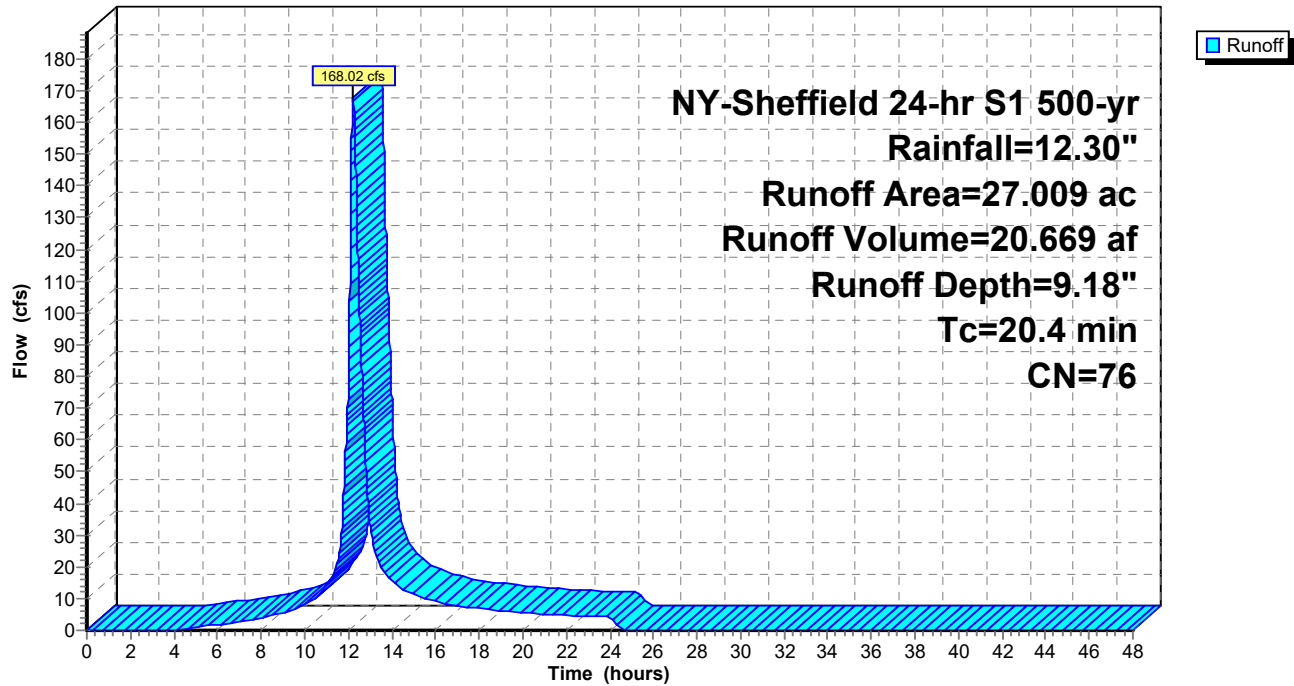

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Printed 12/8/2025

Page 8

Subcatchment B: EX-B

Hydrograph

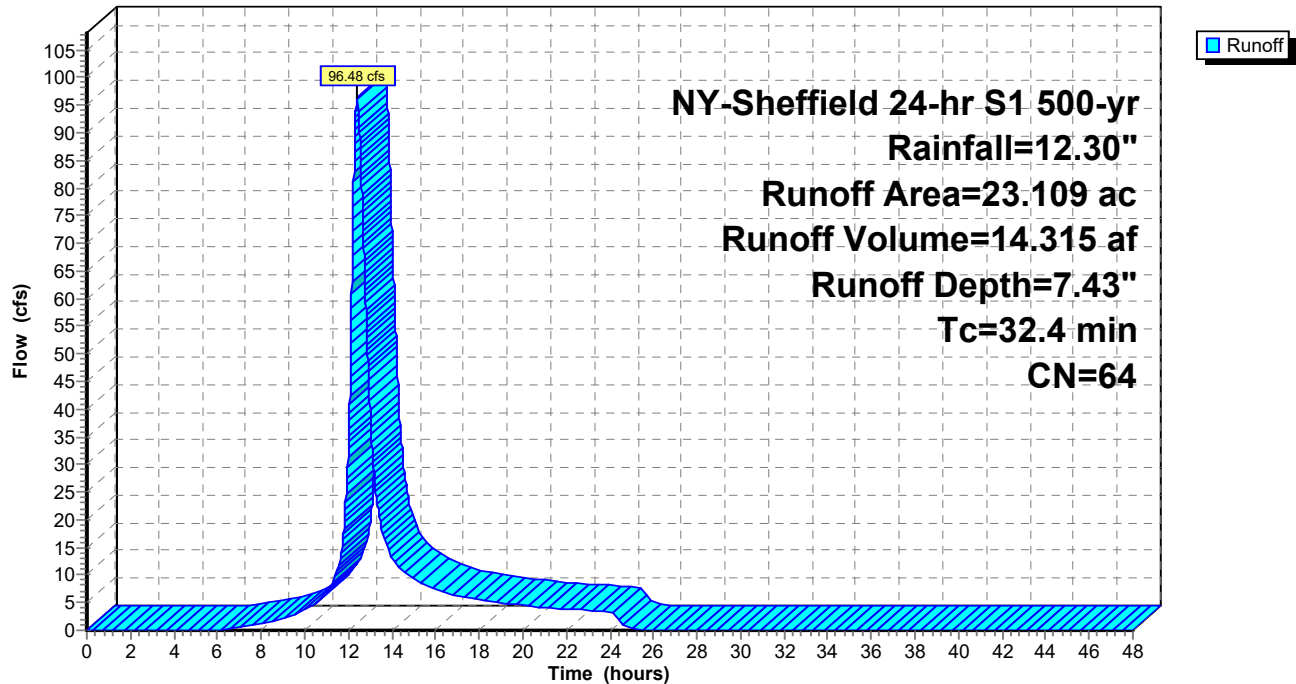

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Printed 12/8/2025

Page 9

Subcatchment B1-A: PR-B1-A

Hydrograph

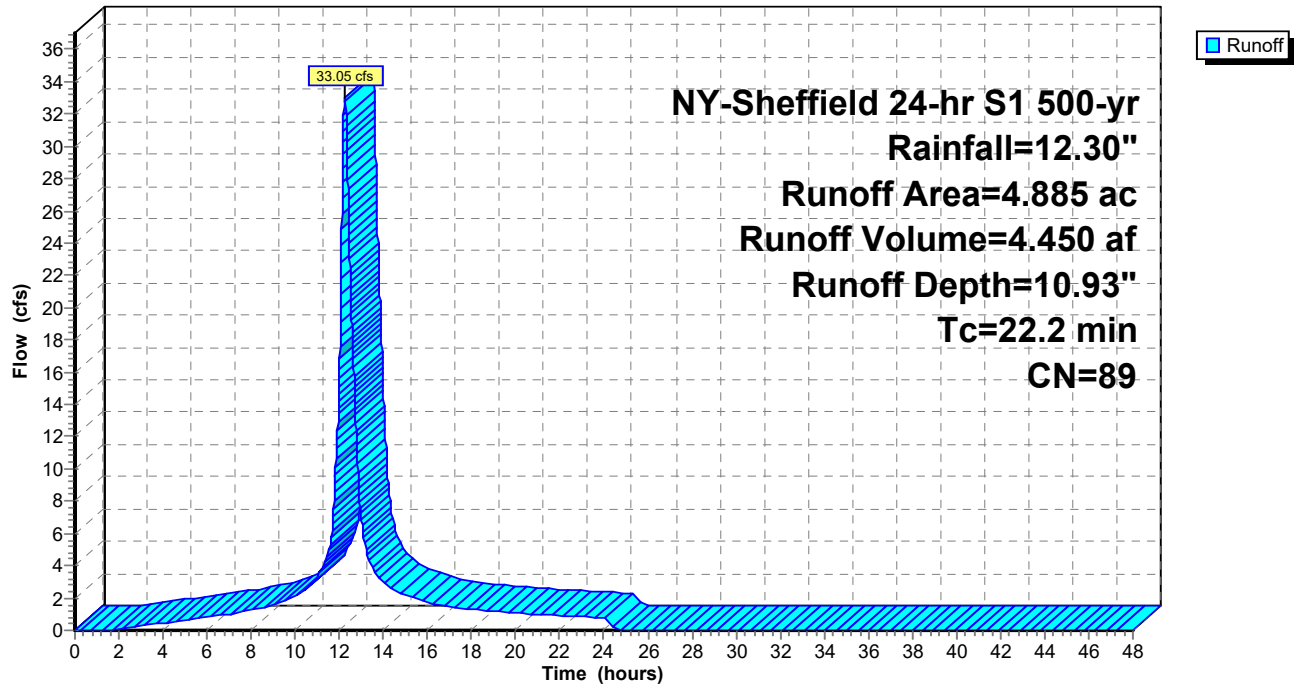

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Printed 12/8/2025

Page 10

Subcatchment B1-B: PR-B1-B

Hydrograph

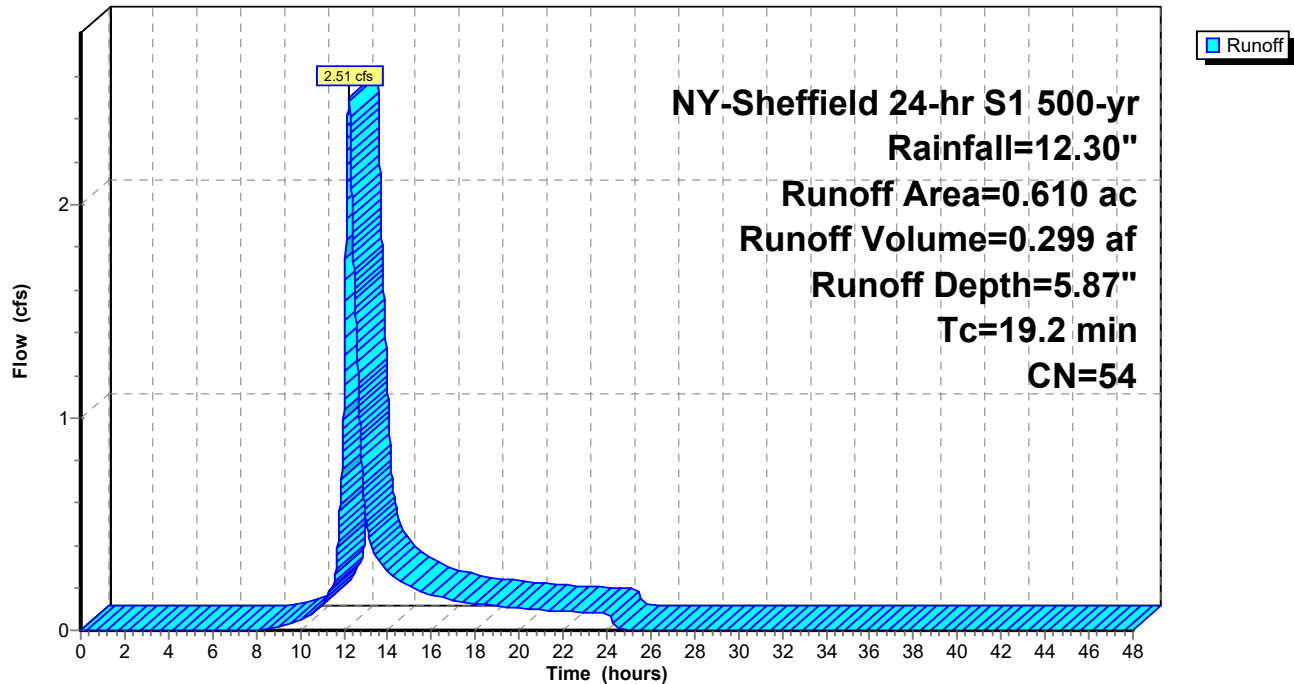

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Printed 12/8/2025

Page 11

Subcatchment B1-C: PR-B1-C

Hydrograph

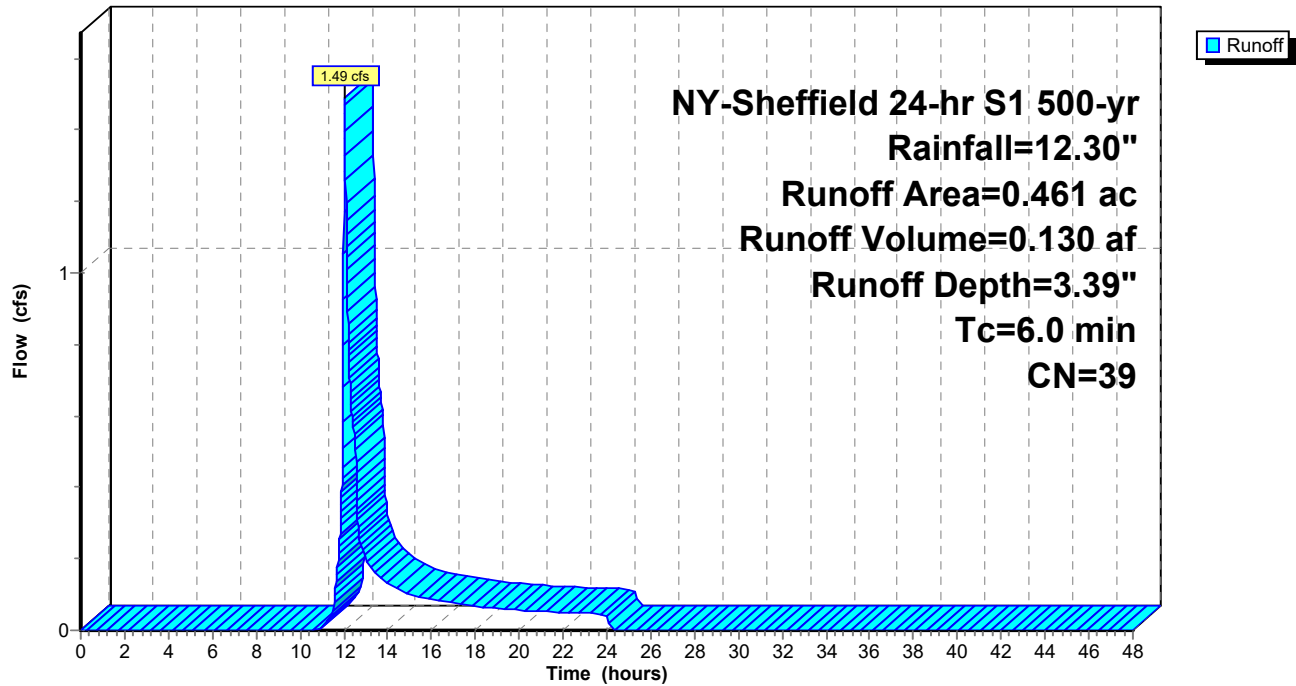

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Printed 12/8/2025

Page 12

Subcatchment B2: PR-B2

Hydrograph

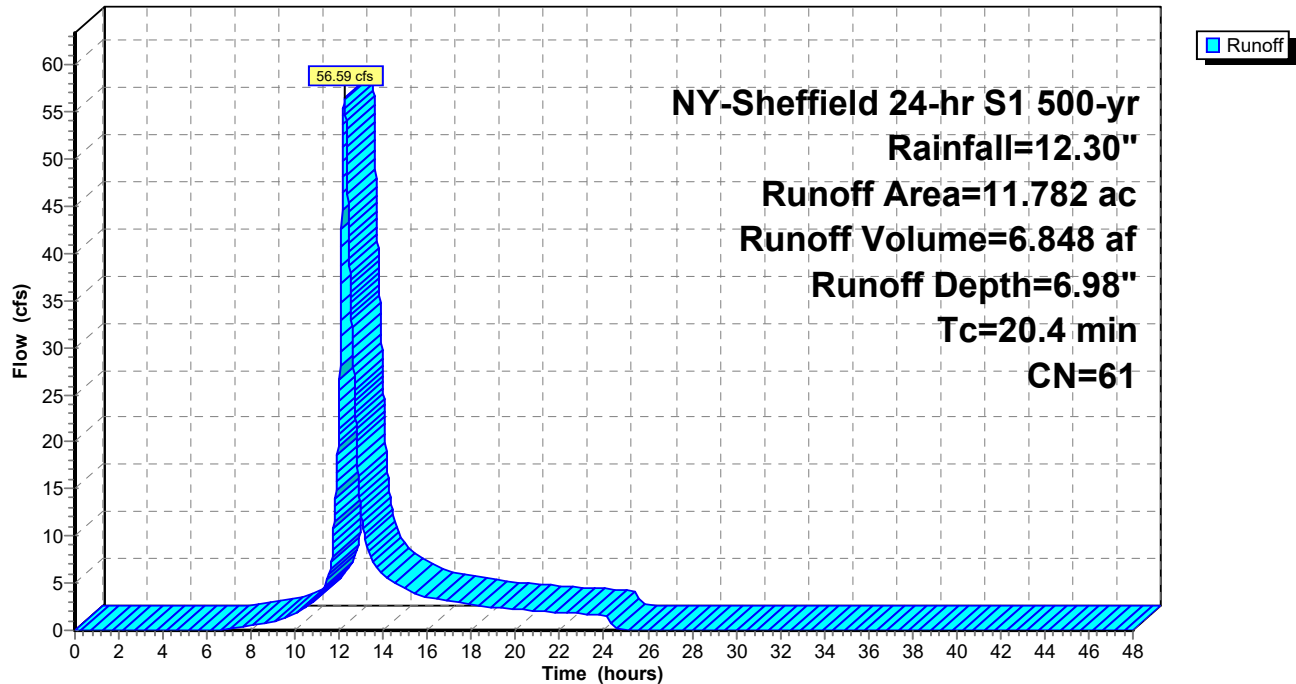

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Printed 12/8/2025

Page 13

Pond 1P: Forebay & Bio A1-A

Hydrograph

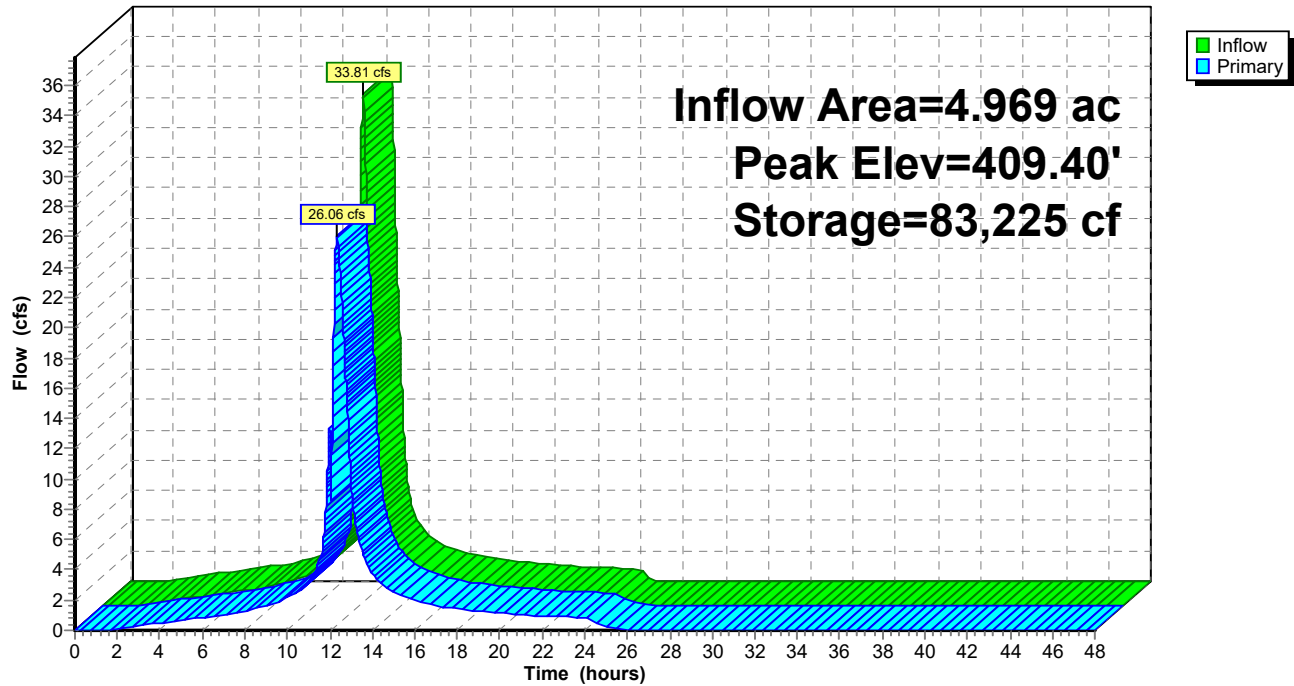

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Printed 12/8/2025

Page 14

Pond 2P: Forebay & Bio A1-B

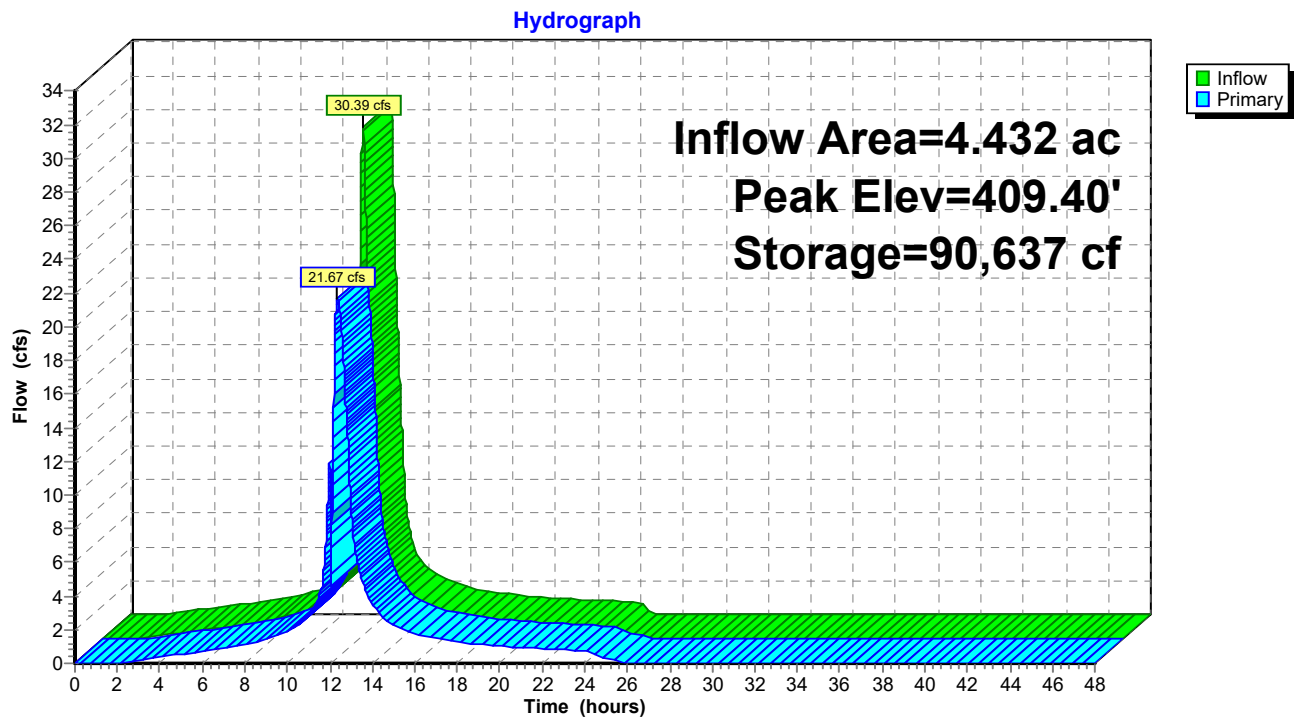

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Printed 12/8/2025

Page 15

Pond 3P: Forebay & Bio B1-A

Hydrograph

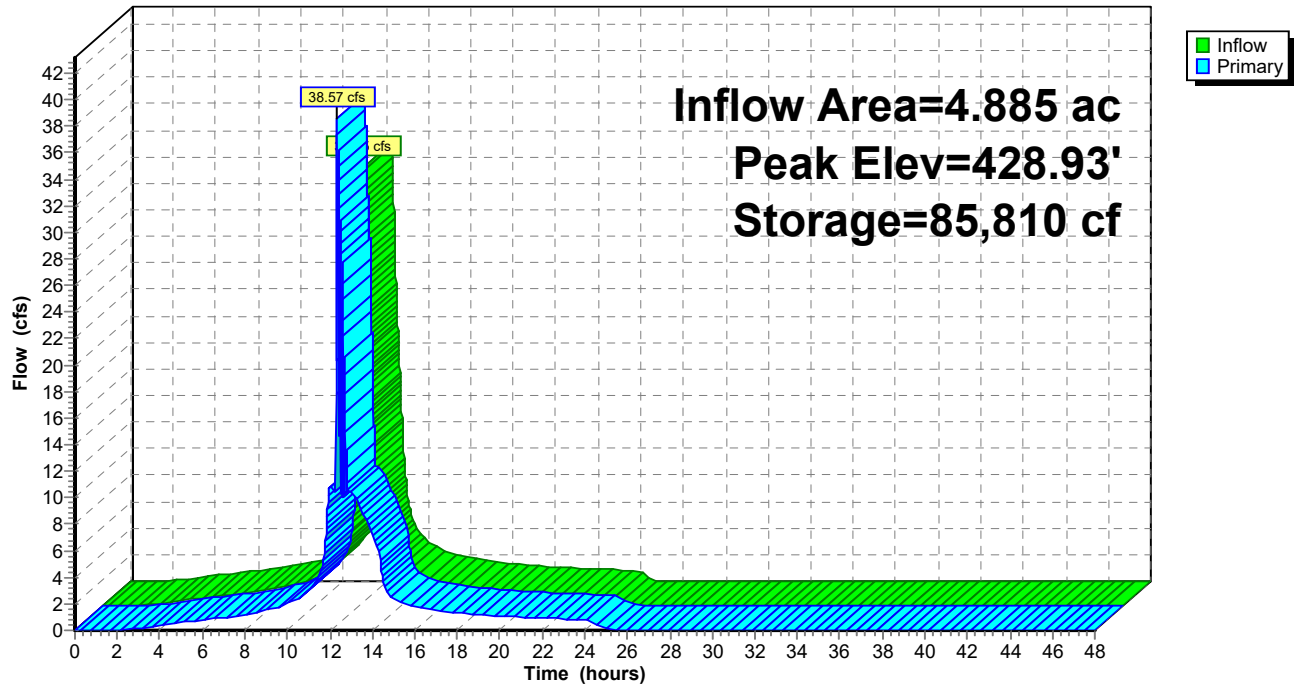

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Printed 12/8/2025

Page 16

Pond 4P: Detention Basin A1

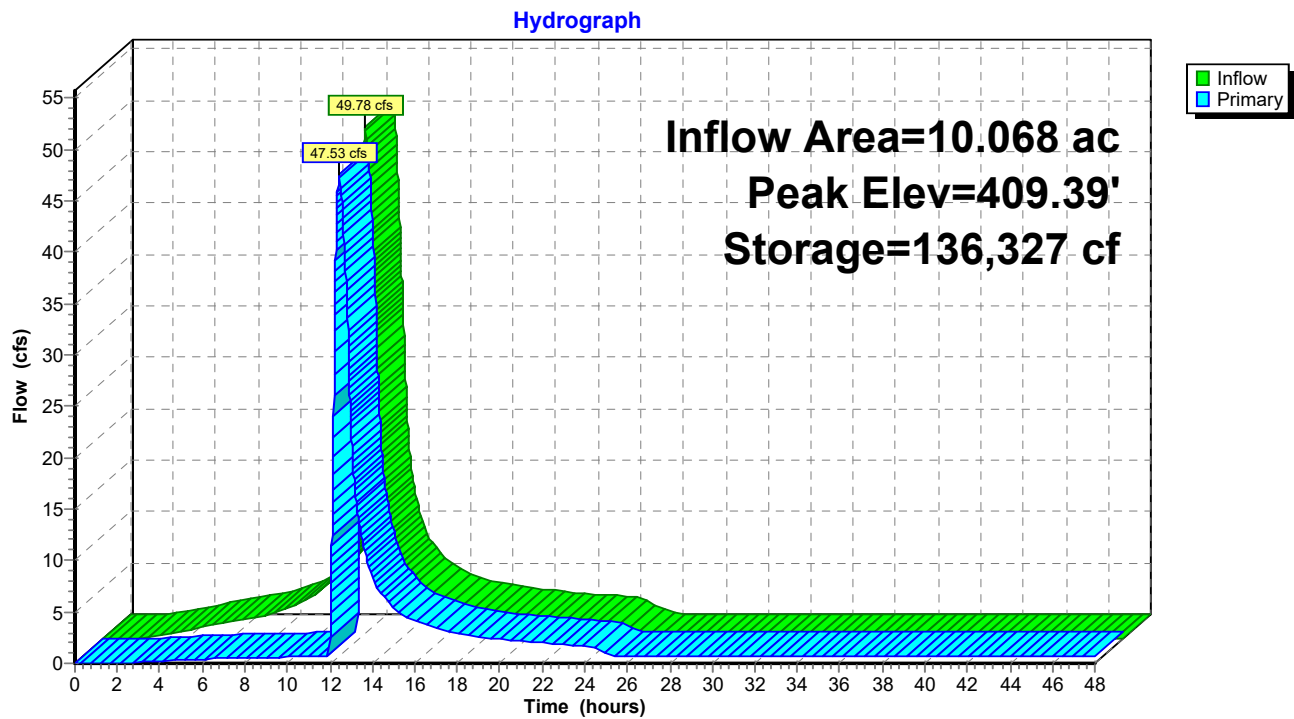

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Printed 12/8/2025

Page 17

Pond 6P: Forebay & Bio B1-B

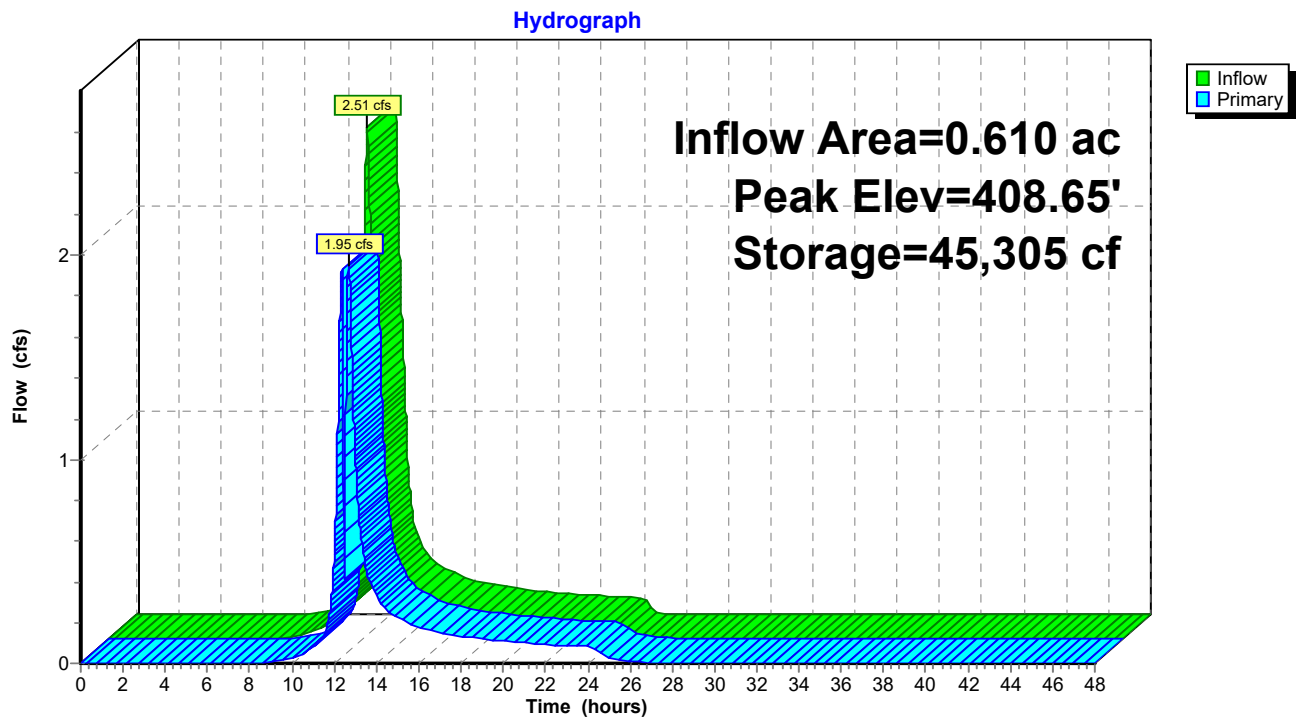

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Printed 12/8/2025

Page 18

Pond 7P: Detention Basin B1

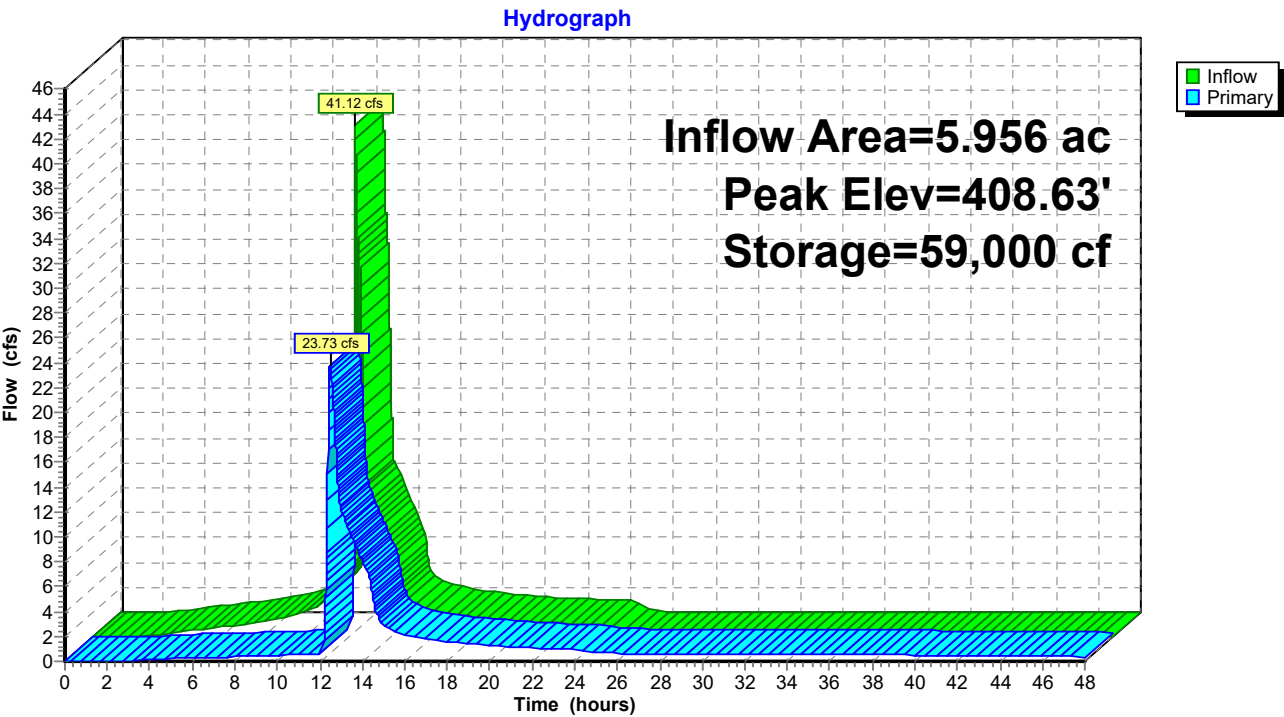

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Printed 12/8/2025

Page 19

Pond PR-A: PR-A

Hydrograph

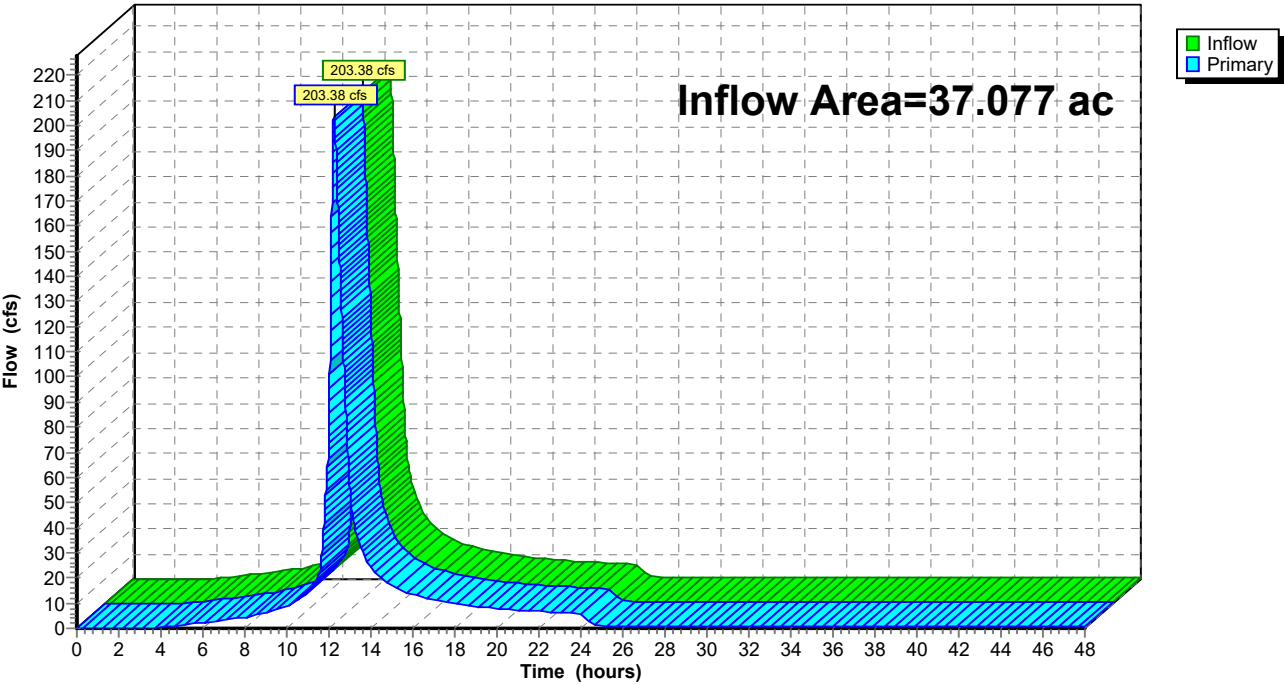

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC


NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Printed 12/8/2025

Page 20

Pond PR-B: PR-B

Hydrograph

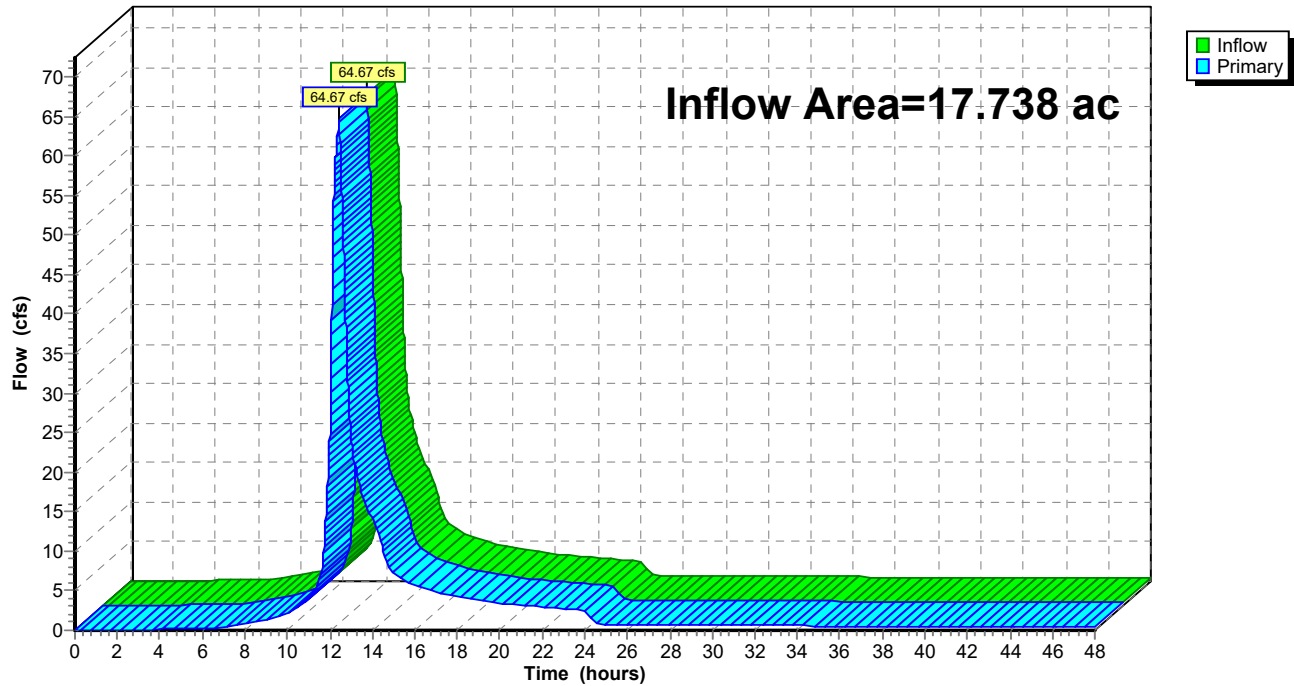

APPENDIX 12

RESERVOIR REPORTS & CPV

CALCULATIONS

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 1

Summary for Pond 1P: Forebay & Bio A1-A

Inflow Area = 4.969 ac, 55.48% Impervious, Inflow Depth = 1.64" for 1-yr event
 Inflow = 6.21 cfs @ 12.26 hrs, Volume= 0.678 af
 Outflow = 5.75 cfs @ 12.33 hrs, Volume= 0.678 af, Atten= 7%, Lag= 4.3 min
 Primary = 5.75 cfs @ 12.33 hrs, Volume= 0.678 af
 Routed to Pond 4P : Detention Basin A1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
 Automatic Starting Elev= 408.50' Surf.Area= 18,385 sf Storage= 66,328 cf
 Peak Elev= 408.62' @ 12.33 hrs Surf.Area= 18,472 sf Storage= 68,576 cf (2,247 cf above start)

Plug-Flow detention time= (not calculated: initial storage exceeds outflow)

Center-of-Mass det. time= 13.0 min (854.7 - 841.7)

Volume	Invert	Avail.Storage	Storage Description	
#1	400.00'	94,716 cf	Custom Stage Data (Conic) Listed below (Recalc)	
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
400.00	2,093	0	0	2,093
402.00	3,854	5,858	5,858	3,895
404.00	5,993	9,769	15,627	6,090
406.00	8,501	14,421	30,048	8,669
407.50	16,634	18,513	48,561	16,824
408.00	18,030	8,664	57,225	18,239
410.00	19,471	37,492	94,716	19,977

Device	Routing	Invert	Outlet Devices									
#1	Primary	408.50'	50.0' long + 4.0 ' SideZ x 31.0' breadth Broad-Crested Rectangular Weir									
			Head (feet)	0.20	0.40	0.60	0.80	1.00	1.20	1.40	1.60	
			Coef. (English)	2.68	2.70	2.70	2.64	2.63	2.64	2.64	2.63	

Primary OutFlow Max=5.75 cfs @ 12.33 hrs HW=408.62' TW=402.01' (Dynamic Tailwater)

↑1=Broad-Crested Rectangular Weir (Weir Controls 5.75 cfs @ 0.93 fps)

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"


Printed 12/8/2025

Page 2

Pond 1P: Forebay & Bio A1-A

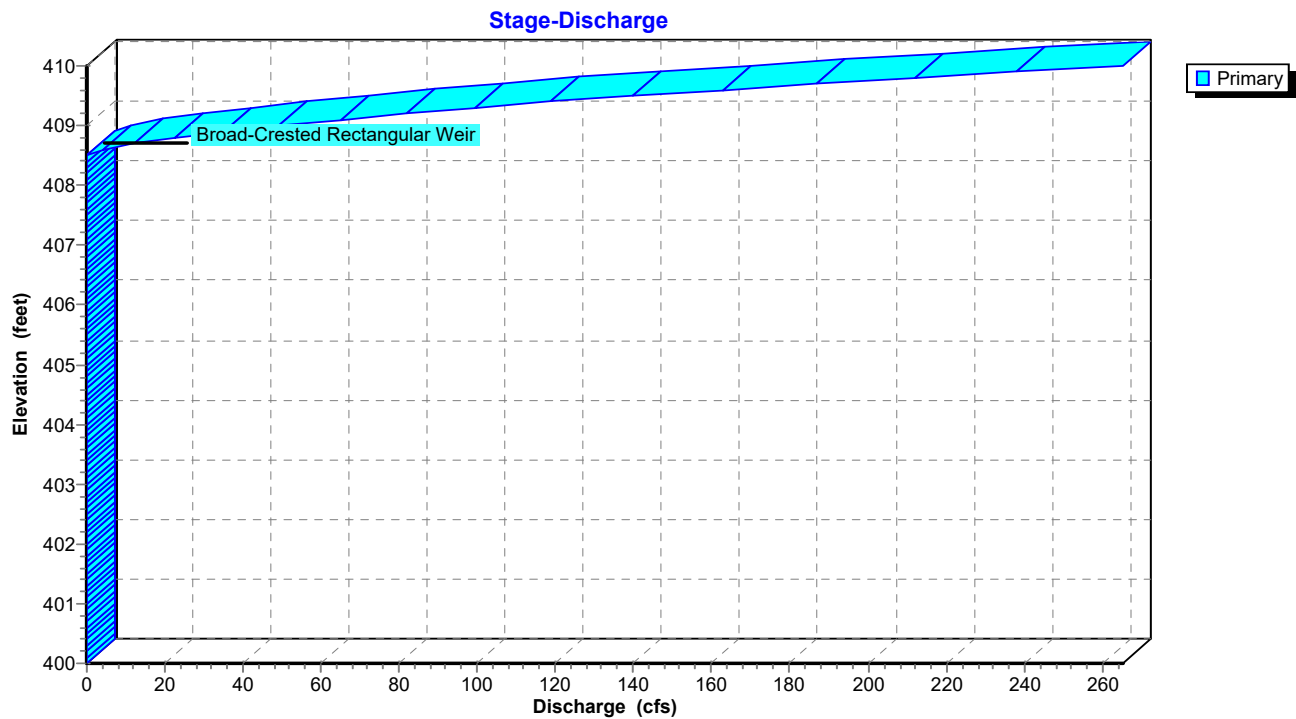

Pond 1P: Forebay & Bio A1-A

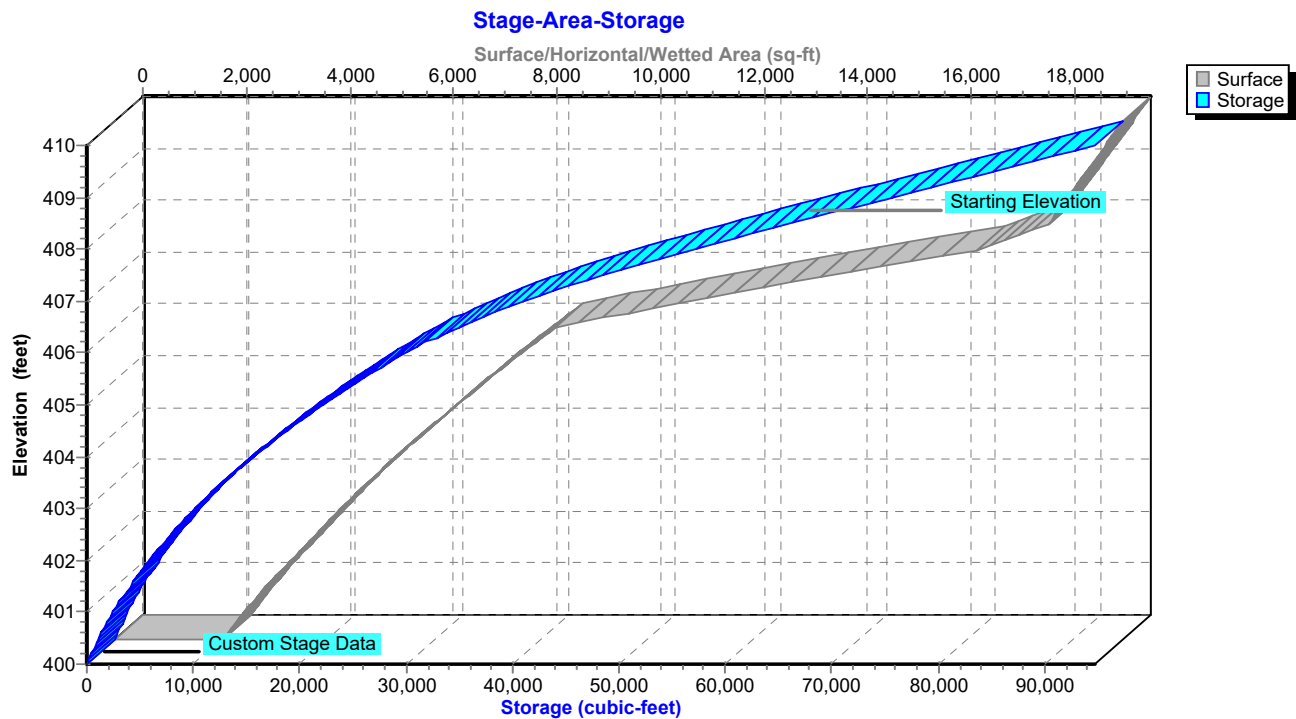

103.0301 - Hydrographs*NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"*

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 3

Stage-Discharge for Pond 1P: Forebay & Bio A1-A

Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)
400.00	0.00	402.60	0.00	405.20	0.00	407.80	0.00
400.05	0.00	402.65	0.00	405.25	0.00	407.85	0.00
400.10	0.00	402.70	0.00	405.30	0.00	407.90	0.00
400.15	0.00	402.75	0.00	405.35	0.00	407.95	0.00
400.20	0.00	402.80	0.00	405.40	0.00	408.00	0.00
400.25	0.00	402.85	0.00	405.45	0.00	408.05	0.00
400.30	0.00	402.90	0.00	405.50	0.00	408.10	0.00
400.35	0.00	402.95	0.00	405.55	0.00	408.15	0.00
400.40	0.00	403.00	0.00	405.60	0.00	408.20	0.00
400.45	0.00	403.05	0.00	405.65	0.00	408.25	0.00
400.50	0.00	403.10	0.00	405.70	0.00	408.30	0.00
400.55	0.00	403.15	0.00	405.75	0.00	408.35	0.00
400.60	0.00	403.20	0.00	405.80	0.00	408.40	0.00
400.65	0.00	403.25	0.00	405.85	0.00	408.45	0.00
400.70	0.00	403.30	0.00	405.90	0.00	408.50	0.00
400.75	0.00	403.35	0.00	405.95	0.00	408.55	1.50
400.80	0.00	403.40	0.00	406.00	0.00	408.60	4.26
400.85	0.00	403.45	0.00	406.05	0.00	408.65	7.86
400.90	0.00	403.50	0.00	406.10	0.00	408.70	12.14
400.95	0.00	403.55	0.00	406.15	0.00	408.75	17.05
401.00	0.00	403.60	0.00	406.20	0.00	408.80	22.52
401.05	0.00	403.65	0.00	406.25	0.00	408.85	28.53
401.10	0.00	403.70	0.00	406.30	0.00	408.90	35.03
401.15	0.00	403.75	0.00	406.35	0.00	408.95	41.93
401.20	0.00	403.80	0.00	406.40	0.00	409.00	49.26
401.25	0.00	403.85	0.00	406.45	0.00	409.05	57.00
401.30	0.00	403.90	0.00	406.50	0.00	409.10	65.15
401.35	0.00	403.95	0.00	406.55	0.00	409.15	73.28
401.40	0.00	404.00	0.00	406.60	0.00	409.20	81.69
401.45	0.00	404.05	0.00	406.65	0.00	409.25	90.36
401.50	0.00	404.10	0.00	406.70	0.00	409.30	99.29
401.55	0.00	404.15	0.00	406.75	0.00	409.35	108.97
401.60	0.00	404.20	0.00	406.80	0.00	409.40	118.97
401.65	0.00	404.25	0.00	406.85	0.00	409.45	129.29
401.70	0.00	404.30	0.00	406.90	0.00	409.50	139.92
401.75	0.00	404.35	0.00	406.95	0.00	409.55	151.14
401.80	0.00	404.40	0.00	407.00	0.00	409.60	162.70
401.85	0.00	404.45	0.00	407.05	0.00	409.65	174.60
401.90	0.00	404.50	0.00	407.10	0.00	409.70	186.84
401.95	0.00	404.55	0.00	407.15	0.00	409.75	199.23
402.00	0.00	404.60	0.00	407.20	0.00	409.80	211.93
402.05	0.00	404.65	0.00	407.25	0.00	409.85	224.94
402.10	0.00	404.70	0.00	407.30	0.00	409.90	238.25
402.15	0.00	404.75	0.00	407.35	0.00	409.95	251.63
402.20	0.00	404.80	0.00	407.40	0.00	410.00	265.28
402.25	0.00	404.85	0.00	407.45	0.00		
402.30	0.00	404.90	0.00	407.50	0.00		
402.35	0.00	404.95	0.00	407.55	0.00		
402.40	0.00	405.00	0.00	407.60	0.00		
402.45	0.00	405.05	0.00	407.65	0.00		
402.50	0.00	405.10	0.00	407.70	0.00		
402.55	0.00	405.15	0.00	407.75	0.00		

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 4

Stage-Area-Storage for Pond 1P: Forebay & Bio A1-A

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
400.00	2,093	0	405.20	7,445	23,674
400.10	2,168	213	405.30	7,573	24,425
400.20	2,245	434	405.40	7,703	25,189
400.30	2,323	662	405.50	7,833	25,965
400.40	2,403	898	405.60	7,964	26,755
400.50	2,483	1,143	405.70	8,097	27,558
400.60	2,565	1,395	405.80	8,231	28,375
400.70	2,649	1,656	405.90	8,365	29,205
400.80	2,733	1,925	406.00	8,501	30,048
400.90	2,819	2,202	406.10	8,959	30,921
401.00	2,907	2,489	406.20	9,429	31,840
401.10	2,996	2,784	406.30	9,911	32,807
401.20	3,086	3,088	406.40	10,405	33,823
401.30	3,177	3,401	406.50	10,912	34,888
401.40	3,270	3,723	406.60	11,430	36,005
401.50	3,364	4,055	406.70	11,960	37,175
401.60	3,459	4,396	406.80	12,502	38,398
401.70	3,556	4,747	406.90	13,056	39,676
401.80	3,654	5,107	407.00	13,623	41,009
401.90	3,753	5,478	407.10	14,201	42,401
402.00	3,854	5,858	407.20	14,791	43,850
402.10	3,950	6,248	407.30	15,393	45,359
402.20	4,047	6,648	407.40	16,008	46,929
402.30	4,145	7,058	407.50	16,634	48,561
402.40	4,244	7,477	407.60	16,909	50,238
402.50	4,345	7,907	407.70	17,186	51,943
402.60	4,446	8,346	407.80	17,465	53,675
402.70	4,549	8,796	407.90	17,746	55,436
402.80	4,653	9,256	408.00	18,030	57,225
402.90	4,758	9,727	408.10	18,101	59,031
403.00	4,865	10,208	408.20	18,172	60,845
403.10	4,972	10,699	408.30	18,243	62,666
403.20	5,081	11,202	408.40	18,314	64,493
403.30	5,191	11,716	408.50	18,385	66,328
403.40	5,302	12,240	408.60	18,456	68,170
403.50	5,414	12,776	408.70	18,528	70,020
403.60	5,528	13,323	408.80	18,600	71,876
403.70	5,642	13,882	408.90	18,672	73,740
403.80	5,758	14,452	409.00	18,744	75,610
403.90	5,875	15,033	409.10	18,816	77,488
404.00	5,993	15,627	409.20	18,888	79,373
404.10	6,108	16,232	409.30	18,960	81,266
404.20	6,224	16,848	409.40	19,033	83,166
404.30	6,341	17,477	409.50	19,106	85,072
404.40	6,460	18,117	409.60	19,178	86,987
404.50	6,579	18,769	409.70	19,251	88,908
404.60	6,699	19,432	409.80	19,324	90,837
404.70	6,821	20,109	409.90	19,398	92,773
404.80	6,944	20,797	410.00	19,471	94,716
404.90	7,067	21,497			
405.00	7,192	22,210			
405.10	7,318	22,936			

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 5

Summary for Pond 2P: Forebay & Bio A1-B

Inflow Area = 4.432 ac, 51.17% Impervious, Inflow Depth = 1.56" for 1-yr event
 Inflow = 5.36 cfs @ 12.25 hrs, Volume= 0.576 af
 Outflow = 4.88 cfs @ 12.33 hrs, Volume= 0.576 af, Atten= 9%, Lag= 4.8 min
 Primary = 4.88 cfs @ 12.33 hrs, Volume= 0.576 af
 Routed to Pond 4P : Detention Basin A1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
 Automatic Starting Elev= 408.50' Surf.Area= 19,240 sf Storage= 72,229 cf
 Peak Elev= 408.61' @ 12.33 hrs Surf.Area= 19,528 sf Storage= 74,349 cf (2,119 cf above start)

Plug-Flow detention time= (not calculated: initial storage exceeds outflow)

Center-of-Mass det. time= 14.3 min (860.7 - 846.4)

Volume	Invert	Avail.Storage	Storage Description	
#1	400.00'	104,144 cf	Custom Stage Data (Conic) Listed below (Recalc)	
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
400.00	3,314	0	0	3,314
402.00	4,891	8,154	8,154	4,954
404.00	6,756	11,597	19,751	6,896
406.00	8,917	15,623	35,374	9,146
407.50	16,689	18,903	54,277	16,940
408.00	17,949	8,658	62,934	18,222
410.00	23,380	41,210	104,144	23,747

Device	Routing	Invert	Outlet Devices									
#1	Primary	408.50'	50.0' long + 4.0 ' SideZ x 31.0' breadth Broad-Crested Rectangular Weir									
			Head (feet)	0.20	0.40	0.60	0.80	1.00	1.20	1.40	1.60	
			Coef. (English)	2.68	2.70	2.70	2.64	2.63	2.64	2.64	2.63	

Primary OutFlow Max=4.88 cfs @ 12.33 hrs HW=408.61' TW=402.01' (Dynamic Tailwater)

↑1=Broad-Crested Rectangular Weir (Weir Controls 4.88 cfs @ 0.88 fps)

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"


Printed 12/8/2025

Page 6

Pond 2P: Forebay & Bio A1-B

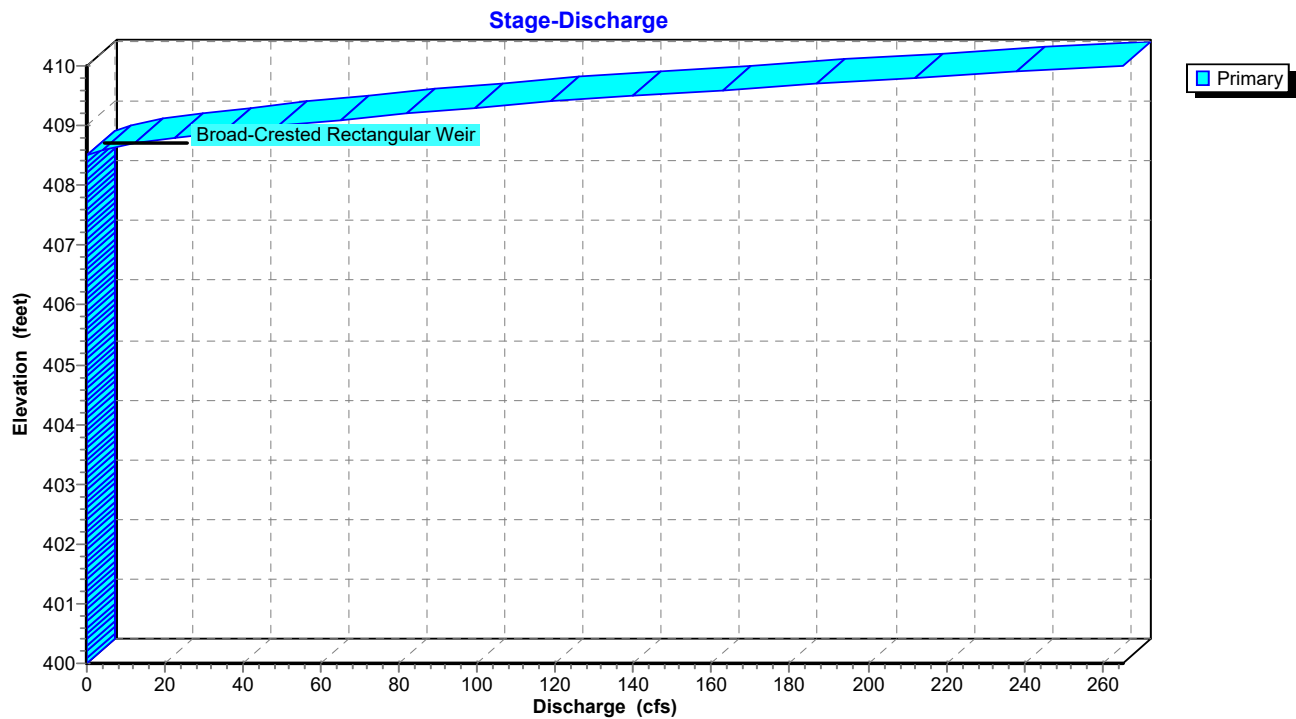

Pond 2P: Forebay & Bio A1-B

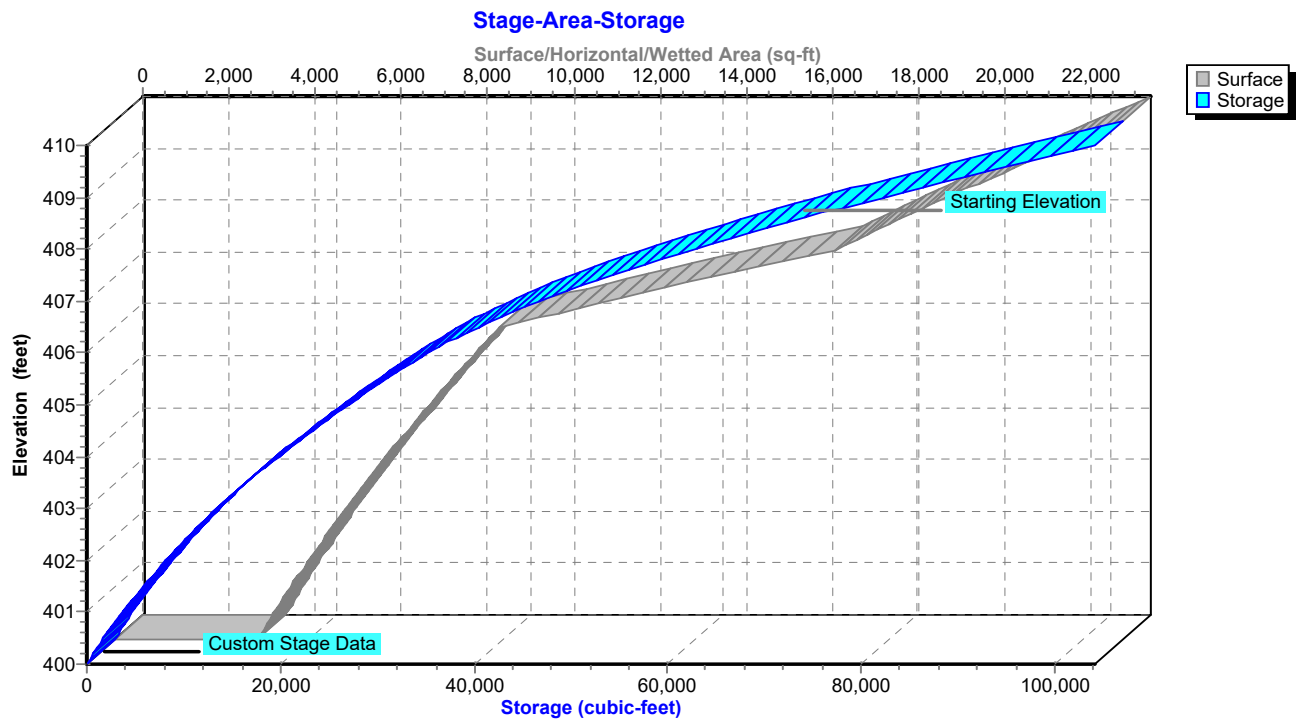

103.0301 - Hydrographs*NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"*

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 7

Stage-Discharge for Pond 2P: Forebay & Bio A1-B

Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)
400.00	0.00	402.60	0.00	405.20	0.00	407.80	0.00
400.05	0.00	402.65	0.00	405.25	0.00	407.85	0.00
400.10	0.00	402.70	0.00	405.30	0.00	407.90	0.00
400.15	0.00	402.75	0.00	405.35	0.00	407.95	0.00
400.20	0.00	402.80	0.00	405.40	0.00	408.00	0.00
400.25	0.00	402.85	0.00	405.45	0.00	408.05	0.00
400.30	0.00	402.90	0.00	405.50	0.00	408.10	0.00
400.35	0.00	402.95	0.00	405.55	0.00	408.15	0.00
400.40	0.00	403.00	0.00	405.60	0.00	408.20	0.00
400.45	0.00	403.05	0.00	405.65	0.00	408.25	0.00
400.50	0.00	403.10	0.00	405.70	0.00	408.30	0.00
400.55	0.00	403.15	0.00	405.75	0.00	408.35	0.00
400.60	0.00	403.20	0.00	405.80	0.00	408.40	0.00
400.65	0.00	403.25	0.00	405.85	0.00	408.45	0.00
400.70	0.00	403.30	0.00	405.90	0.00	408.50	0.00
400.75	0.00	403.35	0.00	405.95	0.00	408.55	1.50
400.80	0.00	403.40	0.00	406.00	0.00	408.60	4.26
400.85	0.00	403.45	0.00	406.05	0.00	408.65	7.86
400.90	0.00	403.50	0.00	406.10	0.00	408.70	12.14
400.95	0.00	403.55	0.00	406.15	0.00	408.75	17.05
401.00	0.00	403.60	0.00	406.20	0.00	408.80	22.52
401.05	0.00	403.65	0.00	406.25	0.00	408.85	28.53
401.10	0.00	403.70	0.00	406.30	0.00	408.90	35.03
401.15	0.00	403.75	0.00	406.35	0.00	408.95	41.93
401.20	0.00	403.80	0.00	406.40	0.00	409.00	49.26
401.25	0.00	403.85	0.00	406.45	0.00	409.05	57.00
401.30	0.00	403.90	0.00	406.50	0.00	409.10	65.15
401.35	0.00	403.95	0.00	406.55	0.00	409.15	73.28
401.40	0.00	404.00	0.00	406.60	0.00	409.20	81.69
401.45	0.00	404.05	0.00	406.65	0.00	409.25	90.36
401.50	0.00	404.10	0.00	406.70	0.00	409.30	99.29
401.55	0.00	404.15	0.00	406.75	0.00	409.35	108.97
401.60	0.00	404.20	0.00	406.80	0.00	409.40	118.97
401.65	0.00	404.25	0.00	406.85	0.00	409.45	129.29
401.70	0.00	404.30	0.00	406.90	0.00	409.50	139.92
401.75	0.00	404.35	0.00	406.95	0.00	409.55	151.14
401.80	0.00	404.40	0.00	407.00	0.00	409.60	162.70
401.85	0.00	404.45	0.00	407.05	0.00	409.65	174.60
401.90	0.00	404.50	0.00	407.10	0.00	409.70	186.84
401.95	0.00	404.55	0.00	407.15	0.00	409.75	199.23
402.00	0.00	404.60	0.00	407.20	0.00	409.80	211.93
402.05	0.00	404.65	0.00	407.25	0.00	409.85	224.94
402.10	0.00	404.70	0.00	407.30	0.00	409.90	238.25
402.15	0.00	404.75	0.00	407.35	0.00	409.95	251.63
402.20	0.00	404.80	0.00	407.40	0.00	410.00	265.28
402.25	0.00	404.85	0.00	407.45	0.00		
402.30	0.00	404.90	0.00	407.50	0.00		
402.35	0.00	404.95	0.00	407.55	0.00		
402.40	0.00	405.00	0.00	407.60	0.00		
402.45	0.00	405.05	0.00	407.65	0.00		
402.50	0.00	405.10	0.00	407.70	0.00		
402.55	0.00	405.15	0.00	407.75	0.00		

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 8

Stage-Area-Storage for Pond 2P: Forebay & Bio A1-B

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
400.00	3,314	0	405.20	8,017	28,604
400.10	3,386	335	405.30	8,127	29,411
400.20	3,458	677	405.40	8,237	30,229
400.30	3,531	1,027	405.50	8,349	31,058
400.40	3,605	1,383	405.60	8,461	31,899
400.50	3,680	1,748	405.70	8,574	32,751
400.60	3,755	2,119	405.80	8,687	33,614
400.70	3,831	2,499	405.90	8,802	34,488
400.80	3,908	2,886	406.00	8,917	35,374
400.90	3,986	3,280	406.10	9,360	36,288
401.00	4,064	3,683	406.20	9,814	37,246
401.10	4,143	4,093	406.30	10,278	38,251
401.20	4,223	4,511	406.40	10,753	39,302
401.30	4,304	4,938	406.50	11,239	40,402
401.40	4,386	5,372	406.60	11,736	41,551
401.50	4,468	5,815	406.70	12,243	42,749
401.60	4,551	6,266	406.80	12,761	44,000
401.70	4,635	6,725	406.90	13,290	45,302
401.80	4,720	7,193	407.00	13,830	46,658
401.90	4,805	7,669	407.10	14,380	48,068
402.00	4,891	8,154	407.20	14,941	49,534
402.10	4,977	8,647	407.30	15,513	51,057
402.20	5,064	9,149	407.40	16,096	52,637
402.30	5,152	9,660	407.50	16,689	54,277
402.40	5,240	10,180	407.60	16,937	55,958
402.50	5,329	10,708	407.70	17,187	57,664
402.60	5,419	11,246	407.80	17,439	59,395
402.70	5,510	11,792	407.90	17,693	61,152
402.80	5,601	12,348	408.00	17,949	62,934
402.90	5,693	12,912	408.10	18,204	64,742
403.00	5,786	13,486	408.20	18,460	66,575
403.10	5,880	14,069	408.30	18,718	68,434
403.20	5,974	14,662	408.40	18,978	70,319
403.30	6,069	15,264	408.50	19,240	72,229
403.40	6,165	15,876	408.60	19,503	74,166
403.50	6,262	16,497	408.70	19,768	76,130
403.60	6,359	17,128	408.80	20,035	78,120
403.70	6,457	17,769	408.90	20,304	80,137
403.80	6,556	18,420	409.00	20,575	82,181
403.90	6,656	19,080	409.10	20,847	84,252
404.00	6,756	19,751	409.20	21,122	86,351
404.10	6,857	20,432	409.30	21,398	88,477
404.20	6,959	21,122	409.40	21,675	90,630
404.30	7,061	21,823	409.50	21,955	92,812
404.40	7,164	22,535	409.60	22,236	95,021
404.50	7,268	23,256	409.70	22,520	97,259
404.60	7,373	23,988	409.80	22,805	99,525
404.70	7,478	24,731	409.90	23,091	101,820
404.80	7,584	25,484	410.00	23,380	104,144
404.90	7,691	26,248			
405.00	7,799	27,022			
405.10	7,908	27,808			

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 9

Summary for Pond 3P: Forebay & Bio B1-A

Inflow Area = 4.885 ac, 52.14% Impervious, Inflow Depth = 1.56" for 1-yr event
 Inflow = 5.82 cfs @ 12.26 hrs, Volume= 0.635 af
 Outflow = 4.70 cfs @ 12.39 hrs, Volume= 0.635 af, Atten= 19%, Lag= 8.0 min
 Primary = 4.70 cfs @ 12.39 hrs, Volume= 0.635 af
 Routed to Pond 7P : Detention Basin B1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
 Automatic Starting Elev= 408.50' Surf.Area= 16,412 sf Storage= 58,221 cf
 Peak Elev= 408.72' @ 12.39 hrs Surf.Area= 16,975 sf Storage= 61,882 cf (3,661 cf above start)

Plug-Flow detention time= (not calculated: initial storage exceeds outflow)
 Center-of-Mass det. time= 24.6 min (871.6 - 846.9)

Volume	Invert	Avail.Storage	Storage Description	
#1	400.00'	85,810 cf	Custom Stage Data (Conic) Listed below (Recalc)	
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
400.00	2,277	0	0	2,277
402.00	3,680	5,901	5,901	3,732
404.00	5,342	8,971	14,872	5,460
406.00	7,258	12,551	27,423	7,456
407.50	13,943	15,630	43,053	14,163
408.00	15,166	7,275	50,328	15,405
410.00	20,447	35,482	85,810	20,769

Device	Routing	Invert	Outlet Devices
#1	Primary	404.03'	18.0" Round Culvert L= 101.6' CMP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 404.03' / 402.00' S= 0.0200 '/' Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 1.77 sf
#2	Device 1	408.50'	36.0" x 48.0" Horiz. OS B1-A C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=4.70 cfs @ 12.39 hrs HW=408.72' TW=402.49' (Dynamic Tailwater)

↑ **1=Culvert** (Passes 4.70 cfs of 16.89 cfs potential flow)

↑ **2=OS B1-A** (Weir Controls 4.70 cfs @ 1.53 fps)

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"


Printed 12/8/2025

Page 10

Pond 3P: Forebay & Bio B1-A

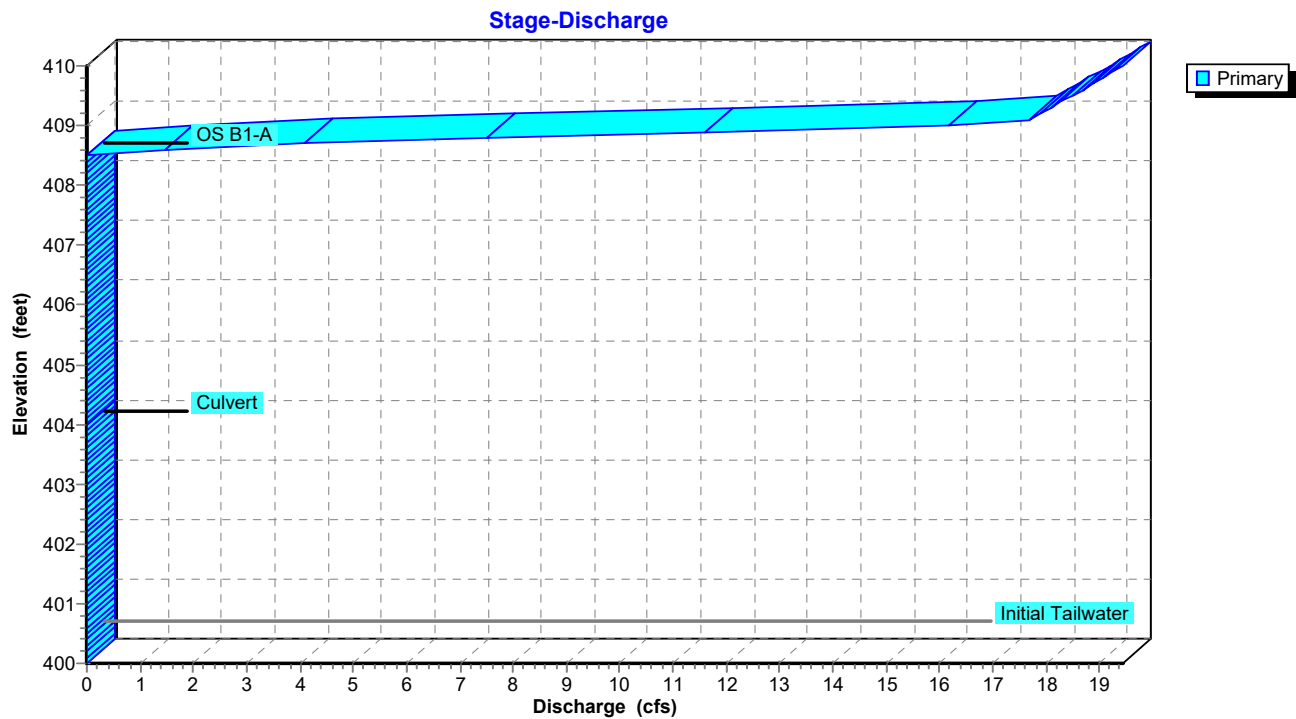

Pond 3P: Forebay & Bio B1-A

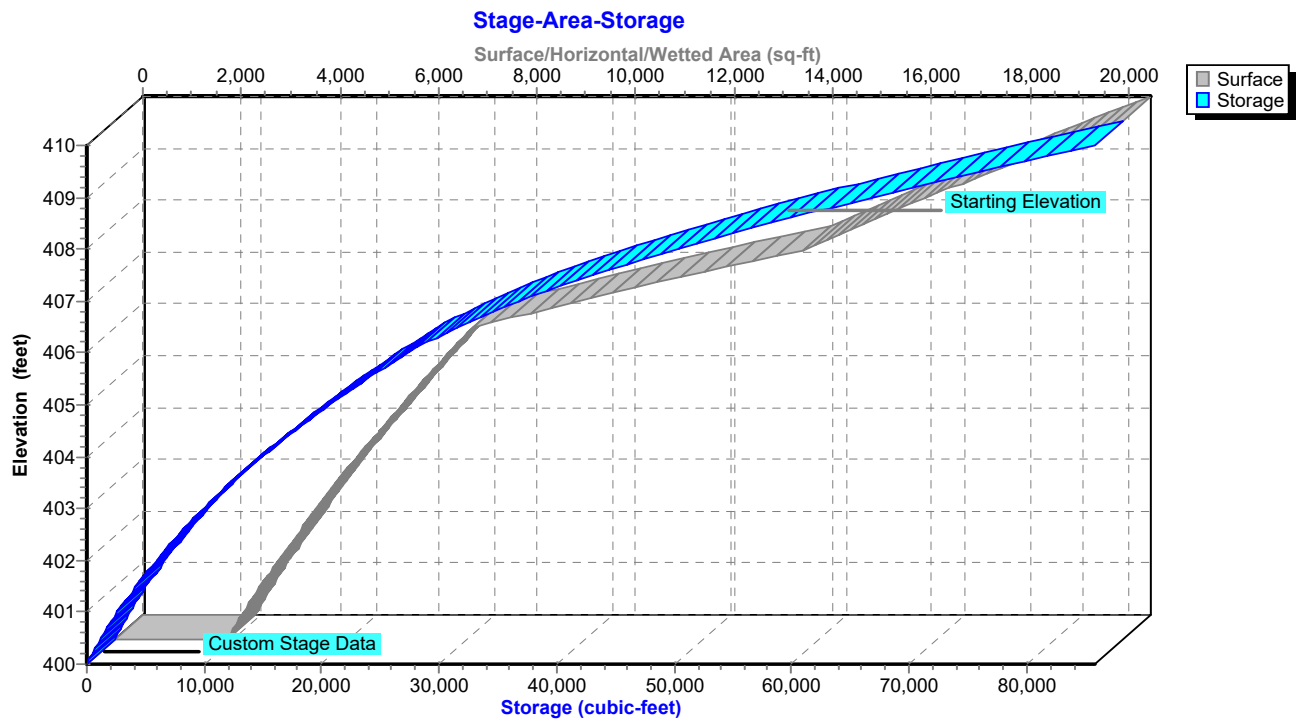

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"

Printed 12/8/2025

Page 11

Stage-Discharge for Pond 3P: Forebay & Bio B1-A

Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)
400.00	0.00	402.60	0.00	405.20	0.00	407.80	0.00
400.05	0.00	402.65	0.00	405.25	0.00	407.85	0.00
400.10	0.00	402.70	0.00	405.30	0.00	407.90	0.00
400.15	0.00	402.75	0.00	405.35	0.00	407.95	0.00
400.20	0.00	402.80	0.00	405.40	0.00	408.00	0.00
400.25	0.00	402.85	0.00	405.45	0.00	408.05	0.00
400.30	0.00	402.90	0.00	405.50	0.00	408.10	0.00
400.35	0.00	402.95	0.00	405.55	0.00	408.15	0.00
400.40	0.00	403.00	0.00	405.60	0.00	408.20	0.00
400.45	0.00	403.05	0.00	405.65	0.00	408.25	0.00
400.50	0.00	403.10	0.00	405.70	0.00	408.30	0.00
400.55	0.00	403.15	0.00	405.75	0.00	408.35	0.00
400.60	0.00	403.20	0.00	405.80	0.00	408.40	0.00
400.65	0.00	403.25	0.00	405.85	0.00	408.45	0.00
400.70	0.00	403.30	0.00	405.90	0.00	408.50	0.00
400.75	0.00	403.35	0.00	405.95	0.00	408.55	0.51
400.80	0.00	403.40	0.00	406.00	0.00	408.60	1.45
400.85	0.00	403.45	0.00	406.05	0.00	408.65	2.66
400.90	0.00	403.50	0.00	406.10	0.00	408.70	4.09
400.95	0.00	403.55	0.00	406.15	0.00	408.75	5.72
401.00	0.00	403.60	0.00	406.20	0.00	408.80	7.52
401.05	0.00	403.65	0.00	406.25	0.00	408.85	9.48
401.10	0.00	403.70	0.00	406.30	0.00	408.90	11.58
401.15	0.00	403.75	0.00	406.35	0.00	408.95	13.82
401.20	0.00	403.80	0.00	406.40	0.00	409.00	16.19
401.25	0.00	403.85	0.00	406.45	0.00	409.05	17.58
401.30	0.00	403.90	0.00	406.50	0.00	409.10	17.69
401.35	0.00	403.95	0.00	406.55	0.00	409.15	17.79
401.40	0.00	404.00	0.00	406.60	0.00	409.20	17.89
401.45	0.00	404.05	0.00	406.65	0.00	409.25	17.99
401.50	0.00	404.10	0.00	406.70	0.00	409.30	18.09
401.55	0.00	404.15	0.00	406.75	0.00	409.35	18.19
401.60	0.00	404.20	0.00	406.80	0.00	409.40	18.29
401.65	0.00	404.25	0.00	406.85	0.00	409.45	18.39
401.70	0.00	404.30	0.00	406.90	0.00	409.50	18.49
401.75	0.00	404.35	0.00	406.95	0.00	409.55	18.58
401.80	0.00	404.40	0.00	407.00	0.00	409.60	18.68
401.85	0.00	404.45	0.00	407.05	0.00	409.65	18.78
401.90	0.00	404.50	0.00	407.10	0.00	409.70	18.87
401.95	0.00	404.55	0.00	407.15	0.00	409.75	18.97
402.00	0.00	404.60	0.00	407.20	0.00	409.80	19.06
402.05	0.00	404.65	0.00	407.25	0.00	409.85	19.16
402.10	0.00	404.70	0.00	407.30	0.00	409.90	19.25
402.15	0.00	404.75	0.00	407.35	0.00	409.95	19.35
402.20	0.00	404.80	0.00	407.40	0.00	410.00	19.44
402.25	0.00	404.85	0.00	407.45	0.00		
402.30	0.00	404.90	0.00	407.50	0.00		
402.35	0.00	404.95	0.00	407.55	0.00		
402.40	0.00	405.00	0.00	407.60	0.00		
402.45	0.00	405.05	0.00	407.65	0.00		
402.50	0.00	405.10	0.00	407.70	0.00		
402.55	0.00	405.15	0.00	407.75	0.00		

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 12

Stage-Area-Storage for Pond 3P: Forebay & Bio B1-A

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
400.00	2,277	0	405.20	6,456	21,940
400.10	2,339	231	405.30	6,554	22,591
400.20	2,402	468	405.40	6,652	23,251
400.30	2,466	711	405.50	6,752	23,921
400.40	2,531	961	405.60	6,851	24,601
400.50	2,596	1,217	405.70	6,952	25,292
400.60	2,663	1,480	405.80	7,053	25,992
400.70	2,730	1,750	405.90	7,155	26,702
400.80	2,798	2,026	406.00	7,258	27,423
400.90	2,867	2,310	406.10	7,366	28,167
401.00	2,937	2,600	406.20	8,024	28,950
401.10	3,007	2,897	406.30	8,422	29,773
401.20	3,079	3,201	406.40	8,829	30,635
401.30	3,151	3,513	406.50	9,246	31,539
401.40	3,224	3,831	406.60	9,672	32,485
401.50	3,298	4,158	406.70	10,108	33,474
401.60	3,373	4,491	406.80	10,554	34,507
401.70	3,448	4,832	406.90	11,009	35,585
401.80	3,525	5,181	407.00	11,474	36,709
401.90	3,602	5,537	407.10	11,949	37,880
402.00	3,680	5,901	407.20	12,433	39,099
402.10	3,756	6,273	407.30	12,927	40,367
402.20	3,832	6,652	407.40	13,430	41,685
402.30	3,910	7,039	407.50	13,943	43,053
402.40	3,988	7,434	407.60	14,183	44,460
402.50	4,067	7,837	407.70	14,426	45,890
402.60	4,146	8,248	407.80	14,671	47,345
402.70	4,227	8,666	407.90	14,917	48,824
402.80	4,308	9,093	408.00	15,166	50,328
402.90	4,390	9,528	408.10	15,411	51,857
403.00	4,472	9,971	408.20	15,659	53,411
403.10	4,556	10,422	408.30	15,908	54,989
403.20	4,640	10,882	408.40	16,159	56,592
403.30	4,725	11,350	408.50	16,412	58,221
403.40	4,811	11,827	408.60	16,668	59,875
403.50	4,898	12,313	408.70	16,925	61,554
403.60	4,985	12,807	408.80	17,184	63,260
403.70	5,073	13,310	408.90	17,445	64,991
403.80	5,162	13,821	409.00	17,708	66,749
403.90	5,252	14,342	409.10	17,973	68,533
404.00	5,342	14,872	409.20	18,240	70,344
404.10	5,431	15,410	409.30	18,509	72,181
404.20	5,520	15,958	409.40	18,780	74,046
404.30	5,611	16,514	409.50	19,053	75,937
404.40	5,702	17,080	409.60	19,328	77,856
404.50	5,794	17,655	409.70	19,605	79,803
404.60	5,886	18,239	409.80	19,883	81,777
404.70	5,979	18,832	409.90	20,164	83,780
404.80	6,073	19,435	410.00	20,447	85,810
404.90	6,168	20,047			
405.00	6,263	20,668			
405.10	6,360	21,299			

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 13

Summary for Pond 4P: Detention Basin A1

Inflow Area = 10.068 ac, 49.91% Impervious, Inflow Depth = 1.56" for 1-yr event
Inflow = 10.87 cfs @ 12.33 hrs, Volume= 1.309 af
Outflow = 0.58 cfs @ 16.81 hrs, Volume= 1.305 af, Atten= 95%, Lag= 269.1 min
Primary = 0.58 cfs @ 16.81 hrs, Volume= 1.305 af
Routed to Pond PR-A : PR-A

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
Automatic Starting Elev= 398.50' Surf.Area= 2,907 sf Storage= 21,861 cf
Peak Elev= 404.55' @ 16.81 hrs Surf.Area= 10,746 sf Storage= 56,133 cf (34,272 cf above start)

Plug-Flow detention time= 1,163.9 min calculated for 0.804 af (61% of inflow)
Center-of-Mass det. time= 687.6 min (1,545.6 - 858.0)

Volume	Invert	Avail.Storage	Storage Description	
#1	388.00'	150,665 cf	Custom Stage Data (Conic) Listed below (Recalc)	
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
388.00	1,355	0	0	1,355
400.00	3,176	26,422	26,422	4,046
402.00	5,824	8,867	35,289	6,736
404.00	9,598	15,266	50,555	10,560
406.00	14,095	23,549	74,104	15,122
408.00	19,096	33,065	107,169	20,205
410.00	24,513	43,496	150,665	25,722

Device	Routing	Invert	Outlet Devices
#1	Primary	398.50'	18.0" Round 18" Culvert L= 56.0' CPP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 398.50' / 397.94' S= 0.0100 '/' Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 1.77 sf
#2	Device 1	388.50'	3.0" Vert. 3" Orifice C= 0.600 Limited to weir flow at low heads
#3	Device 1	408.50'	36.0" x 48.0" Horiz. OS A1 C= 0.600 Limited to weir flow at low heads
#4	Primary	409.00'	30.0' long + 2.0 ' SideZ x 50.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=0.58 cfs @ 16.81 hrs HW=404.55' TW=0.00' (Dynamic Tailwater)

- 1=18" Culvert (Passes 0.58 cfs of 19.59 cfs potential flow)
- 2=3" Orifice (Orifice Controls 0.58 cfs @ 11.84 fps)
- 3=OS A1 (Controls 0.00 cfs)
- 4=Broad-Crested Rectangular Weir(Controls 0.00 cfs)

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"


Printed 12/8/2025

Page 14

Pond 4P: Detention Basin A1

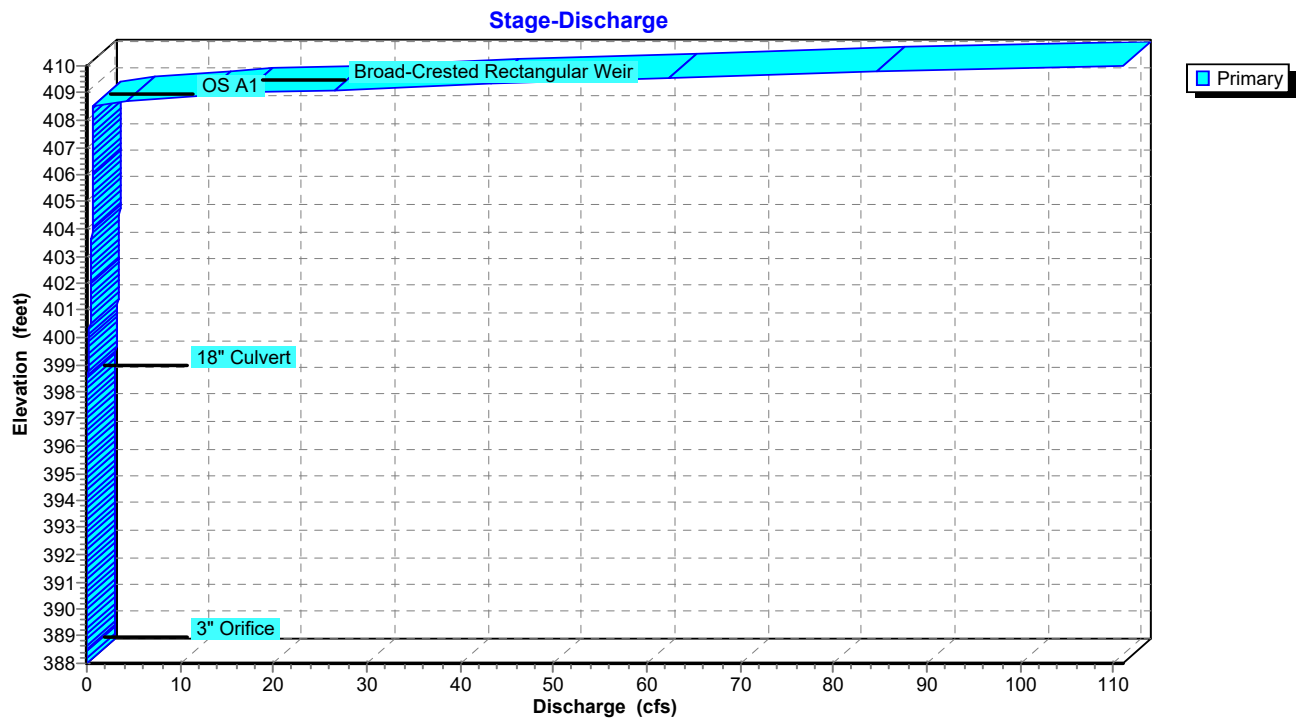

Pond 4P: Detention Basin A1

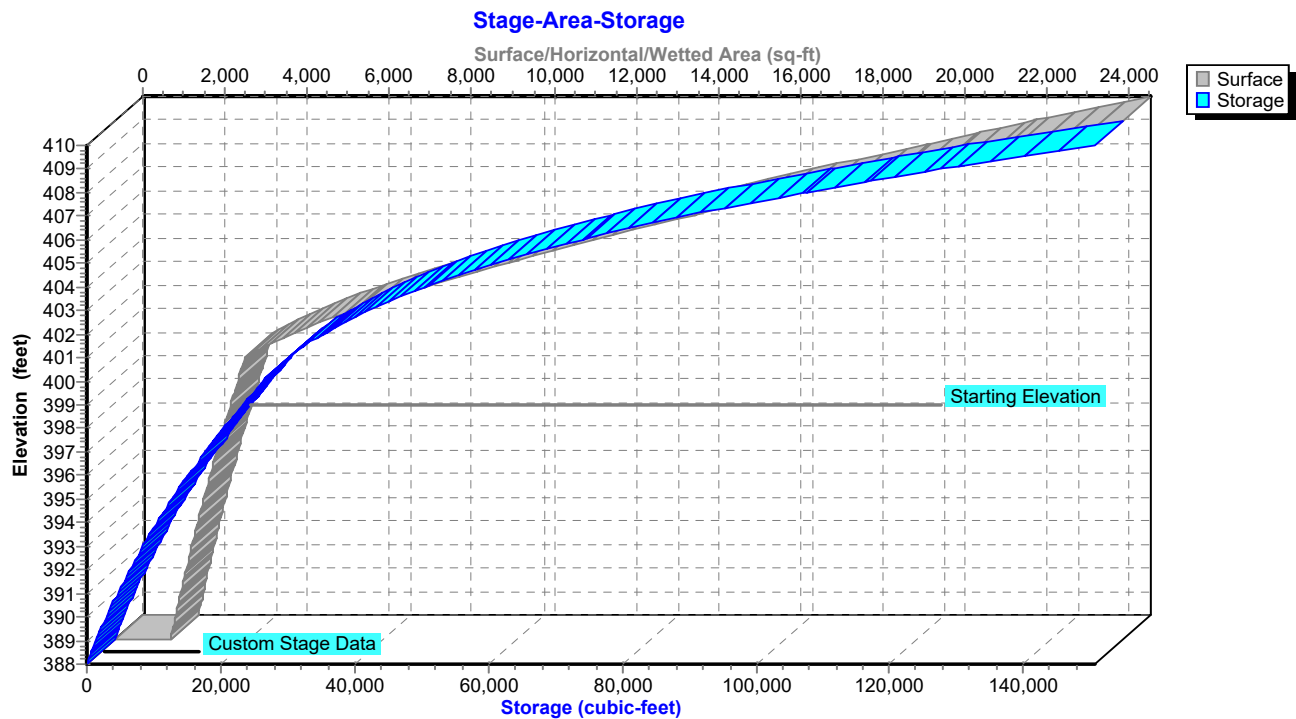

103.0301 - Hydrographs*NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"*

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 15

Stage-Discharge for Pond 4P: Detention Basin A1

Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)
388.00	0.00	398.40	0.00	408.80	8.28
388.20	0.00	398.60	0.05	409.00	16.95
388.40	0.00	398.80	0.13	409.20	34.11
388.60	0.00	399.00	0.17	409.40	48.04
388.80	0.00	399.20	0.20	409.60	66.22
389.00	0.00	399.40	0.22	409.80	86.73
389.20	0.00	399.60	0.25	410.00	111.01
389.40	0.00	399.80	0.27		
389.60	0.00	400.00	0.29		
389.80	0.00	400.20	0.31		
390.00	0.00	400.40	0.33		
390.20	0.00	400.60	0.34		
390.40	0.00	400.80	0.36		
390.60	0.00	401.00	0.37		
390.80	0.00	401.20	0.39		
391.00	0.00	401.40	0.40		
391.20	0.00	401.60	0.42		
391.40	0.00	401.80	0.43		
391.60	0.00	402.00	0.44		
391.80	0.00	402.20	0.45		
392.00	0.00	402.40	0.47		
392.20	0.00	402.60	0.48		
392.40	0.00	402.80	0.49		
392.60	0.00	403.00	0.50		
392.80	0.00	403.20	0.51		
393.00	0.00	403.40	0.52		
393.20	0.00	403.60	0.53		
393.40	0.00	403.80	0.54		
393.60	0.00	404.00	0.55		
393.80	0.00	404.20	0.56		
394.00	0.00	404.40	0.57		
394.20	0.00	404.60	0.58		
394.40	0.00	404.80	0.59		
394.60	0.00	405.00	0.60		
394.80	0.00	405.20	0.61		
395.00	0.00	405.40	0.62		
395.20	0.00	405.60	0.63		
395.40	0.00	405.80	0.64		
395.60	0.00	406.00	0.65		
395.80	0.00	406.20	0.66		
396.00	0.00	406.40	0.66		
396.20	0.00	406.60	0.67		
396.40	0.00	406.80	0.68		
396.60	0.00	407.00	0.69		
396.80	0.00	407.20	0.70		
397.00	0.00	407.40	0.71		
397.20	0.00	407.60	0.71		
397.40	0.00	407.80	0.72		
397.60	0.00	408.00	0.73		
397.80	0.00	408.20	0.74		
398.00	0.00	408.40	0.74		
398.20	0.00	408.60	2.20		

103.0301 - Hydrographs*NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"*

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 16

Stage-Area-Storage for Pond 4P: Detention Basin A1

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
388.00	1,355	0
388.50	1,416	693
389.00	1,478	1,416
389.50	1,541	2,170
390.00	1,605	2,957
390.50	1,671	3,776
391.00	1,739	4,628
391.50	1,807	5,515
392.00	1,877	6,436
392.50	1,948	7,392
393.00	2,021	8,384
393.50	2,095	9,413
394.00	2,170	10,479
394.50	2,247	11,584
395.00	2,324	12,726
395.50	2,404	13,908
396.00	2,484	15,130
396.50	2,566	16,392
397.00	2,649	17,696
397.50	2,734	19,042
398.00	2,819	20,430
398.50	2,907	21,861
399.00	2,995	23,337
399.50	3,085	24,857
400.00	3,176	26,422
400.50	3,763	28,155
401.00	4,400	30,194
401.50	5,087	32,563
402.00	5,824	35,289
402.50	6,680	38,413
403.00	7,594	41,978
403.50	8,567	46,016
404.00	9,598	50,555
404.50	10,641	55,612
405.00	11,739	61,205
405.50	12,890	67,360
406.00	14,095	74,104
406.50	15,274	81,445
407.00	16,501	89,386
407.50	17,775	97,953
408.00	19,096	107,169
408.50	20,387	117,038
409.00	21,720	127,563
409.50	23,095	138,765
410.00	24,513	150,665

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 17

Summary for Pond 6P: Forebay & Bio B1-B

Inflow Area = 0.610 ac, 25.08% Impervious, Inflow Depth = 0.09" for 1-yr event
 Inflow = 0.01 cfs @ 13.55 hrs, Volume= 0.005 af
 Outflow = 0.00 cfs @ 16.89 hrs, Volume= 0.005 af, Atten= 17%, Lag= 200.3 min
 Primary = 0.00 cfs @ 16.89 hrs, Volume= 0.005 af
 Routed to Pond 7P : Detention Basin B1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
 Automatic Starting Elev= 408.50' Surf.Area= 14,636 sf Storage= 43,121 cf
 Peak Elev= 408.50' @ 16.89 hrs Surf.Area= 14,642 sf Storage= 43,154 cf (33 cf above start)

Plug-Flow detention time= (not calculated: initial storage exceeds outflow)

Center-of-Mass det. time= 125.0 min (1,203.2 - 1,078.2)

Volume	Invert	Avail.Storage	Storage Description	
#1	400.00'	68,054 cf	Custom Stage Data (Conic) Listed below (Recalc)	
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
400.00	713	0	0	713
402.00	1,896	2,514	2,514	1,922
404.00	3,550	5,360	7,875	3,616
406.00	5,471	8,952	16,827	5,594
407.50	12,169	12,900	29,726	12,310
408.00	13,395	6,389	36,115	13,552
410.00	18,691	31,939	68,054	18,924

Device	Routing	Invert	Outlet Devices
#1	Primary	404.99'	18.0" Round Culvert L= 149.6' CPP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 404.99' / 402.00' S= 0.0200 '/' Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 1.77 sf
#2	Device 1	408.50'	36.0" x 48.0" Horiz. OS B1-B C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=0.00 cfs @ 16.89 hrs HW=408.50' TW=404.09' (Dynamic Tailwater)

↑1=Culvert (Passes 0.00 cfs of 14.14 cfs potential flow)

↑2=OS B1-B (Weir Controls 0.00 cfs @ 0.16 fps)

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"


Printed 12/8/2025

Page 18

Pond 6P: Forebay & Bio B1-B

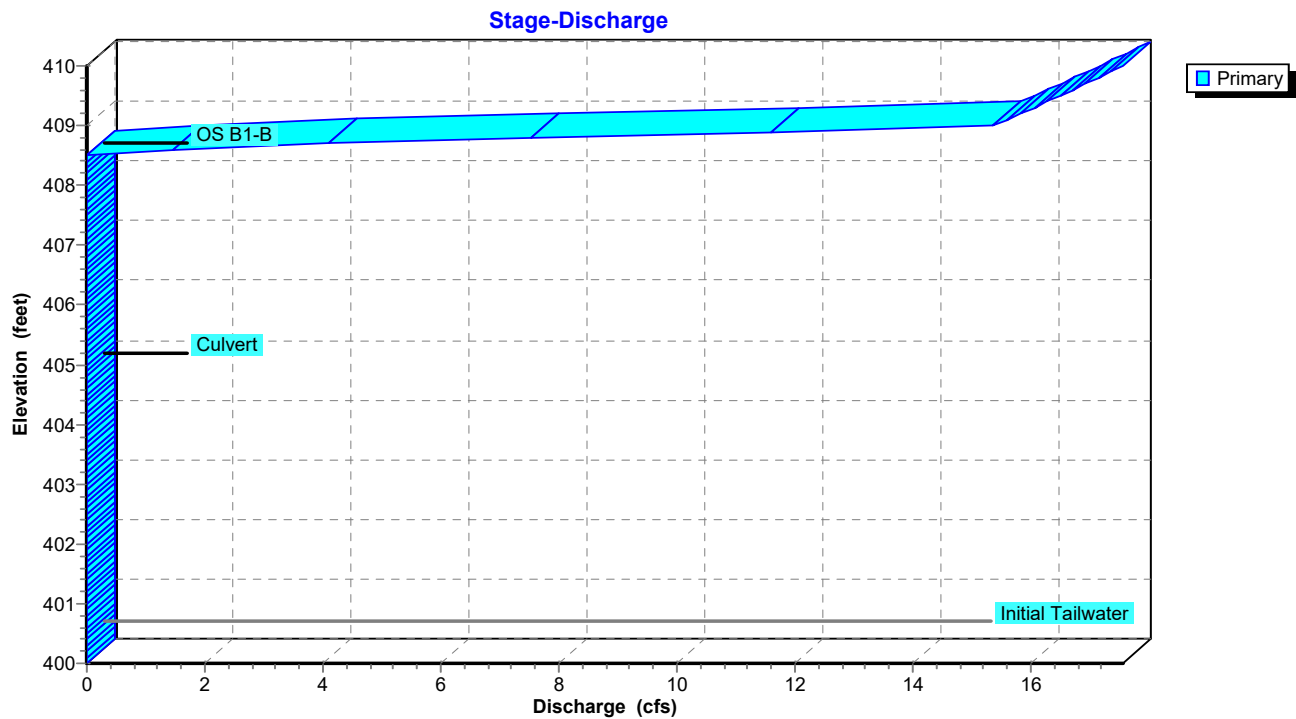

Pond 6P: Forebay & Bio B1-B

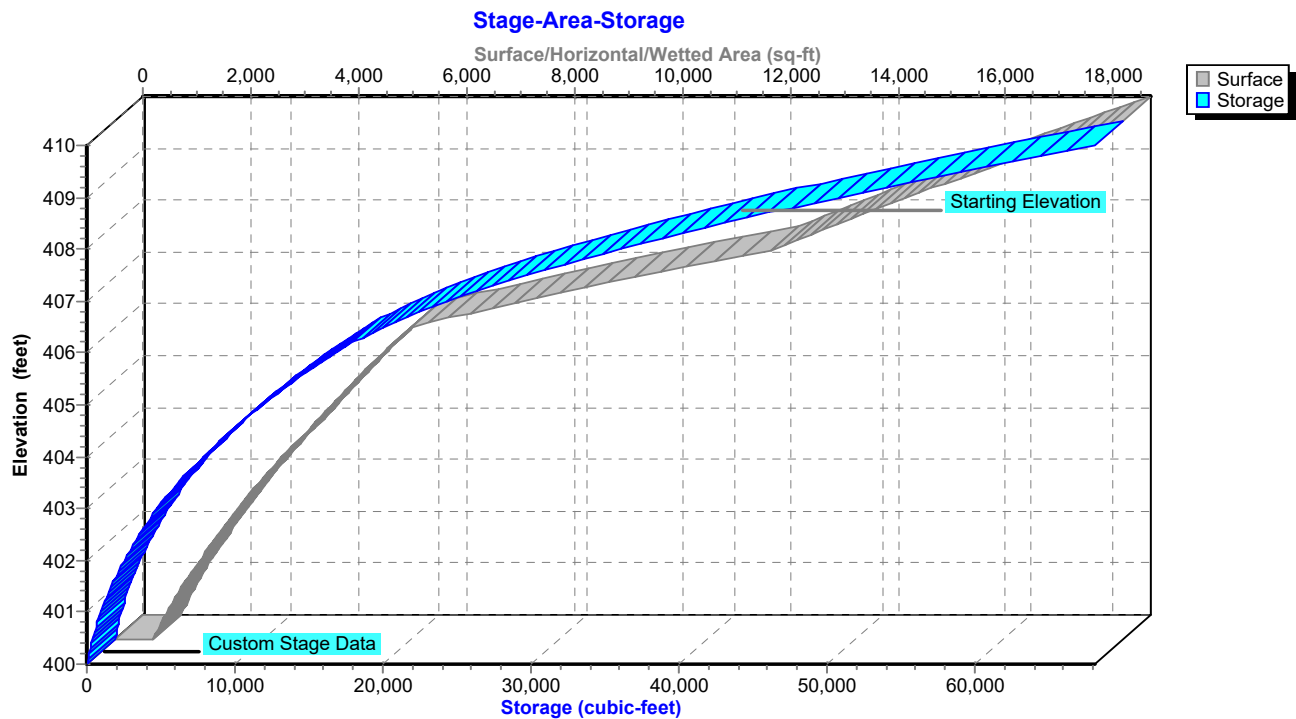

103.0301 - Hydrographs*NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"*

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 19

Stage-Discharge for Pond 6P: Forebay & Bio B1-B

Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)
400.00	0.00	402.60	0.00	405.20	0.00	407.80	0.00
400.05	0.00	402.65	0.00	405.25	0.00	407.85	0.00
400.10	0.00	402.70	0.00	405.30	0.00	407.90	0.00
400.15	0.00	402.75	0.00	405.35	0.00	407.95	0.00
400.20	0.00	402.80	0.00	405.40	0.00	408.00	0.00
400.25	0.00	402.85	0.00	405.45	0.00	408.05	0.00
400.30	0.00	402.90	0.00	405.50	0.00	408.10	0.00
400.35	0.00	402.95	0.00	405.55	0.00	408.15	0.00
400.40	0.00	403.00	0.00	405.60	0.00	408.20	0.00
400.45	0.00	403.05	0.00	405.65	0.00	408.25	0.00
400.50	0.00	403.10	0.00	405.70	0.00	408.30	0.00
400.55	0.00	403.15	0.00	405.75	0.00	408.35	0.00
400.60	0.00	403.20	0.00	405.80	0.00	408.40	0.00
400.65	0.00	403.25	0.00	405.85	0.00	408.45	0.00
400.70	0.00	403.30	0.00	405.90	0.00	408.50	0.00
400.75	0.00	403.35	0.00	405.95	0.00	408.55	0.51
400.80	0.00	403.40	0.00	406.00	0.00	408.60	1.45
400.85	0.00	403.45	0.00	406.05	0.00	408.65	2.66
400.90	0.00	403.50	0.00	406.10	0.00	408.70	4.09
400.95	0.00	403.55	0.00	406.15	0.00	408.75	5.72
401.00	0.00	403.60	0.00	406.20	0.00	408.80	7.52
401.05	0.00	403.65	0.00	406.25	0.00	408.85	9.48
401.10	0.00	403.70	0.00	406.30	0.00	408.90	11.58
401.15	0.00	403.75	0.00	406.35	0.00	408.95	13.82
401.20	0.00	403.80	0.00	406.40	0.00	409.00	15.36
401.25	0.00	403.85	0.00	406.45	0.00	409.05	15.48
401.30	0.00	403.90	0.00	406.50	0.00	409.10	15.60
401.35	0.00	403.95	0.00	406.55	0.00	409.15	15.71
401.40	0.00	404.00	0.00	406.60	0.00	409.20	15.83
401.45	0.00	404.05	0.00	406.65	0.00	409.25	15.94
401.50	0.00	404.10	0.00	406.70	0.00	409.30	16.05
401.55	0.00	404.15	0.00	406.75	0.00	409.35	16.17
401.60	0.00	404.20	0.00	406.80	0.00	409.40	16.28
401.65	0.00	404.25	0.00	406.85	0.00	409.45	16.39
401.70	0.00	404.30	0.00	406.90	0.00	409.50	16.50
401.75	0.00	404.35	0.00	406.95	0.00	409.55	16.61
401.80	0.00	404.40	0.00	407.00	0.00	409.60	16.72
401.85	0.00	404.45	0.00	407.05	0.00	409.65	16.82
401.90	0.00	404.50	0.00	407.10	0.00	409.70	16.93
401.95	0.00	404.55	0.00	407.15	0.00	409.75	17.04
402.00	0.00	404.60	0.00	407.20	0.00	409.80	17.14
402.05	0.00	404.65	0.00	407.25	0.00	409.85	17.25
402.10	0.00	404.70	0.00	407.30	0.00	409.90	17.35
402.15	0.00	404.75	0.00	407.35	0.00	409.95	17.46
402.20	0.00	404.80	0.00	407.40	0.00	410.00	17.56
402.25	0.00	404.85	0.00	407.45	0.00		
402.30	0.00	404.90	0.00	407.50	0.00		
402.35	0.00	404.95	0.00	407.55	0.00		
402.40	0.00	405.00	0.00	407.60	0.00		
402.45	0.00	405.05	0.00	407.65	0.00		
402.50	0.00	405.10	0.00	407.70	0.00		
402.55	0.00	405.15	0.00	407.75	0.00		

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 20

Stage-Area-Storage for Pond 6P: Forebay & Bio B1-B

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
400.00	713	0	405.20	4,653	12,782
400.10	759	74	405.30	4,752	13,252
400.20	806	152	405.40	4,851	13,732
400.30	854	235	405.50	4,952	14,222
400.40	904	323	405.60	5,054	14,722
400.50	956	416	405.70	5,156	15,233
400.60	1,008	514	405.80	5,260	15,754
400.70	1,063	617	405.90	5,365	16,285
400.80	1,118	726	406.00	5,471	16,827
400.90	1,175	841	406.10	5,835	17,392
401.00	1,234	961	406.20	6,211	17,994
401.10	1,293	1,088	406.30	6,599	18,635
401.20	1,355	1,220	406.40	6,999	19,314
401.30	1,417	1,359	406.50	7,410	20,035
401.40	1,482	1,504	406.60	7,833	20,797
401.50	1,547	1,655	406.70	8,268	21,602
401.60	1,614	1,813	406.80	8,714	22,451
401.70	1,682	1,978	406.90	9,173	23,345
401.80	1,752	2,150	407.00	9,643	24,286
401.90	1,823	2,329	407.10	10,125	25,274
402.00	1,896	2,514	407.20	10,618	26,311
402.10	1,966	2,708	407.30	11,123	27,398
402.20	2,038	2,908	407.40	11,640	28,536
402.30	2,111	3,115	407.50	12,169	29,726
402.40	2,186	3,330	407.60	12,409	30,955
402.50	2,261	3,552	407.70	12,652	32,208
402.60	2,338	3,782	407.80	12,898	33,486
402.70	2,416	4,020	407.90	13,145	34,788
402.80	2,496	4,266	408.00	13,395	36,115
402.90	2,577	4,519	408.10	13,639	37,467
403.00	2,659	4,781	408.20	13,885	38,843
403.10	2,742	5,051	408.30	14,133	40,244
403.20	2,827	5,330	408.40	14,384	41,670
403.30	2,913	5,616	408.50	14,636	43,121
403.40	3,000	5,912	408.60	14,891	44,597
403.50	3,088	6,216	408.70	15,148	46,099
403.60	3,178	6,530	408.80	15,408	47,627
403.70	3,269	6,852	408.90	15,669	49,181
403.80	3,361	7,184	409.00	15,933	50,761
403.90	3,455	7,524	409.10	16,199	52,367
404.00	3,550	7,875	409.20	16,467	54,001
404.10	3,636	8,234	409.30	16,737	55,661
404.20	3,723	8,602	409.40	17,010	57,348
404.30	3,812	8,979	409.50	17,284	59,063
404.40	3,901	9,364	409.60	17,561	60,805
404.50	3,991	9,759	409.70	17,840	62,575
404.60	4,083	10,163	409.80	18,122	64,373
404.70	4,175	10,576	409.90	18,405	66,200
404.80	4,269	10,998	410.00	18,691	68,054
404.90	4,363	11,429			
405.00	4,459	11,870			
405.10	4,555	12,321			

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 21

Summary for Pond 7P: Detention Basin B1

Inflow Area = 5.956 ac, 45.33% Impervious, Inflow Depth = 1.29" for 1-yr event
 Inflow = 4.70 cfs @ 12.39 hrs, Volume= 0.640 af
 Outflow = 0.45 cfs @ 14.89 hrs, Volume= 0.639 af, Atten= 91%, Lag= 150.1 min
 Primary = 0.45 cfs @ 14.89 hrs, Volume= 0.639 af
 Routed to Pond PR-B : PR-B

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
 Automatic Starting Elev= 400.50' Surf.Area= 1,825 sf Storage= 806 cf
 Peak Elev= 404.19' @ 14.89 hrs Surf.Area= 6,258 sf Storage= 15,118 cf (14,312 cf above start)

Plug-Flow detention time= 422.8 min calculated for 0.620 af (97% of inflow)
 Center-of-Mass det. time= 385.5 min (1,259.4 - 873.9)

Volume	Invert	Avail.Storage	Storage Description	
#1	400.00'	79,868 cf	Custom Stage Data (Conic) Listed below (Recalc)	
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
400.00	1,408	0	0	1,408
402.00	3,402	4,666	4,666	3,431
404.00	5,985	9,266	13,932	6,058
406.00	9,096	14,973	28,905	9,229
408.00	12,687	21,684	50,588	12,895
410.00	16,684	29,280	79,868	16,983

Device	Routing	Invert	Outlet Devices
#1	Primary	400.00'	18.0" Round Culvert L= 140.0' CPP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 400.00' / 398.00' S= 0.0143 '/' Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 1.77 sf
#2	Device 1	400.50'	3.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#3	Device 1	408.00'	36.0" x 48.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#4	Primary	409.00'	30.0' long + 2.0 ' SideZ x 50.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=0.45 cfs @ 14.89 hrs HW=404.19' TW=0.00' (Dynamic Tailwater)

- 1=Culvert (Passes 0.45 cfs of 15.79 cfs potential flow)
- 2=Orifice/Grate (Orifice Controls 0.45 cfs @ 9.10 fps)
- 3=Orifice/Grate (Controls 0.00 cfs)
- 4=Broad-Crested Rectangular Weir(Controls 0.00 cfs)

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"


Printed 12/8/2025

Page 22

Pond 7P: Detention Basin B1

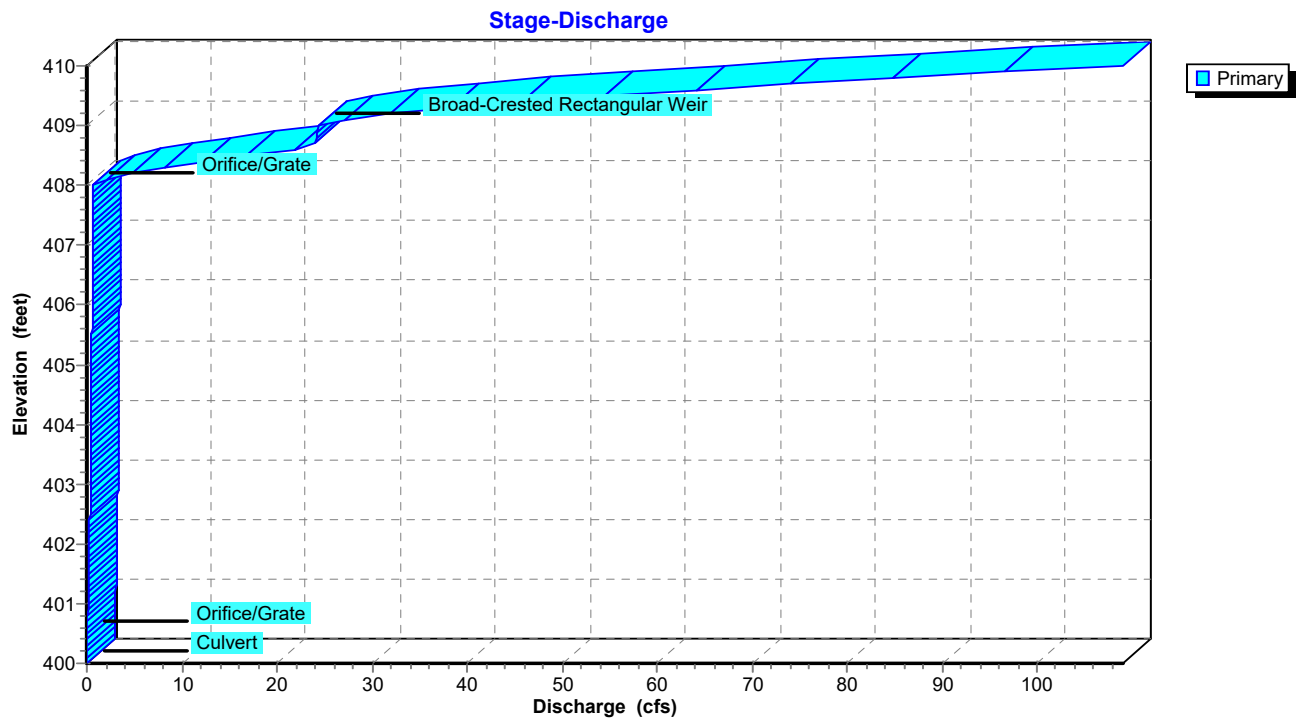

Pond 7P: Detention Basin B1

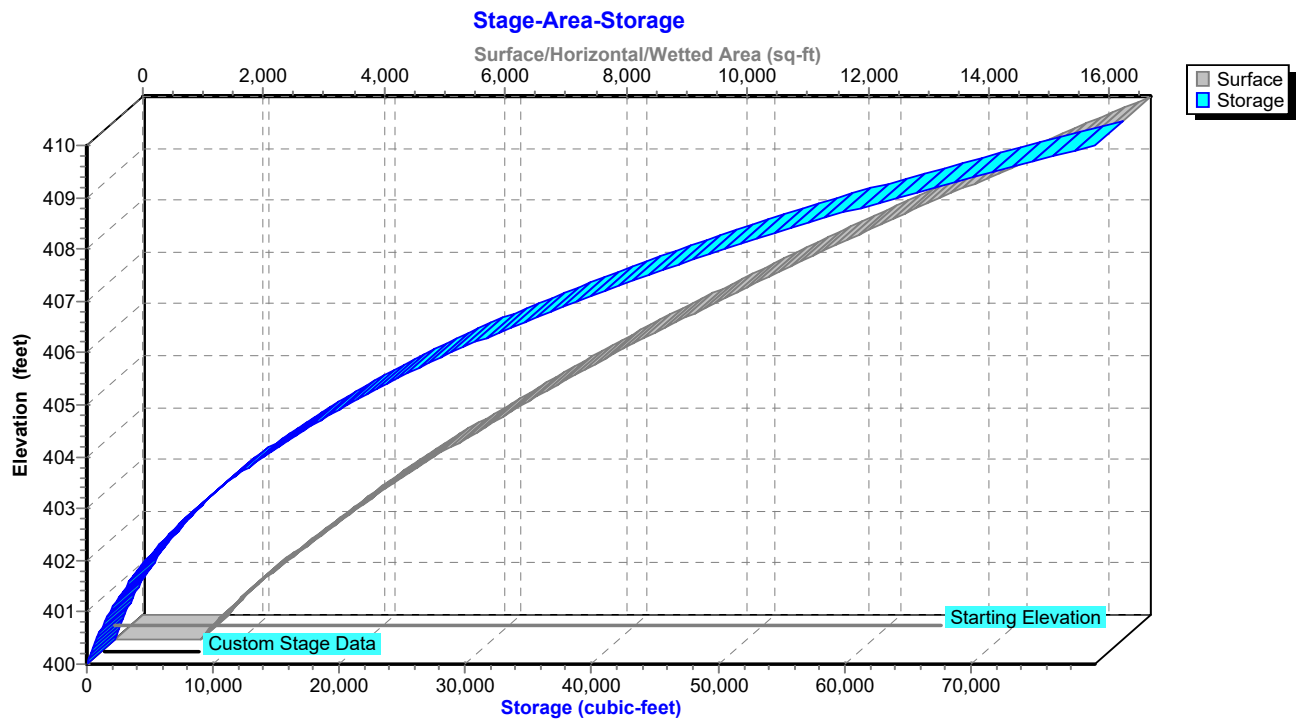

103.0301 - Hydrographs*NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"*

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 23

Stage-Discharge for Pond 7P: Detention Basin B1

Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)
400.00	0.00	402.60	0.33	405.20	0.51	407.80	0.63
400.05	0.00	402.65	0.34	405.25	0.51	407.85	0.64
400.10	0.00	402.70	0.34	405.30	0.51	407.90	0.64
400.15	0.00	402.75	0.34	405.35	0.51	407.95	0.64
400.20	0.00	402.80	0.35	405.40	0.52	408.00	0.64
400.25	0.00	402.85	0.35	405.45	0.52	408.05	1.16
400.30	0.00	402.90	0.36	405.50	0.52	408.10	2.09
400.35	0.00	402.95	0.36	405.55	0.52	408.15	3.31
400.40	0.00	403.00	0.36	405.60	0.53	408.20	4.75
400.45	0.00	403.05	0.37	405.65	0.53	408.25	6.38
400.50	0.00	403.10	0.37	405.70	0.53	408.30	8.18
400.55	0.01	403.15	0.38	405.75	0.54	408.35	10.14
400.60	0.02	403.20	0.38	405.80	0.54	408.40	12.24
400.65	0.04	403.25	0.38	405.85	0.54	408.45	14.48
400.70	0.06	403.30	0.39	405.90	0.54	408.50	16.85
400.75	0.08	403.35	0.39	405.95	0.55	408.55	19.34
400.80	0.10	403.40	0.39	406.00	0.55	408.60	21.94
400.85	0.11	403.45	0.40	406.05	0.55	408.65	23.92
400.90	0.12	403.50	0.40	406.10	0.55	408.70	23.99
400.95	0.13	403.55	0.40	406.15	0.56	408.75	24.07
401.00	0.14	403.60	0.41	406.20	0.56	408.80	24.14
401.05	0.15	403.65	0.41	406.25	0.56	408.85	24.22
401.10	0.16	403.70	0.41	406.30	0.56	408.90	24.29
401.15	0.17	403.75	0.42	406.35	0.57	408.95	24.37
401.20	0.18	403.80	0.42	406.40	0.57	409.00	24.44
401.25	0.19	403.85	0.42	406.45	0.57	409.05	25.41
401.30	0.19	403.90	0.43	406.50	0.57	409.10	27.14
401.35	0.20	403.95	0.43	406.55	0.58	409.15	29.37
401.40	0.21	404.00	0.43	406.60	0.58	409.20	32.00
401.45	0.21	404.05	0.44	406.65	0.58	409.25	35.01
401.50	0.22	404.10	0.44	406.70	0.58	409.30	38.35
401.55	0.23	404.15	0.44	406.75	0.58	409.35	42.01
401.60	0.23	404.20	0.45	406.80	0.59	409.40	45.95
401.65	0.24	404.25	0.45	406.85	0.59	409.45	50.14
401.70	0.25	404.30	0.45	406.90	0.59	409.50	54.57
401.75	0.25	404.35	0.46	406.95	0.59	409.55	59.25
401.80	0.26	404.40	0.46	407.00	0.60	409.60	64.16
401.85	0.26	404.45	0.46	407.05	0.60	409.65	69.06
401.90	0.27	404.50	0.47	407.10	0.60	409.70	74.12
401.95	0.27	404.55	0.47	407.15	0.60	409.75	79.33
402.00	0.28	404.60	0.47	407.20	0.61	409.80	84.69
402.05	0.28	404.65	0.47	407.25	0.61	409.85	90.49
402.10	0.29	404.70	0.48	407.30	0.61	409.90	96.47
402.15	0.29	404.75	0.48	407.35	0.61	409.95	102.64
402.20	0.30	404.80	0.48	407.40	0.62	410.00	108.99
402.25	0.30	404.85	0.49	407.45	0.62		
402.30	0.31	404.90	0.49	407.50	0.62		
402.35	0.31	404.95	0.49	407.55	0.62		
402.40	0.31	405.00	0.49	407.60	0.62		
402.45	0.32	405.05	0.50	407.65	0.63		
402.50	0.32	405.10	0.50	407.70	0.63		
402.55	0.33	405.15	0.50	407.75	0.63		

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 24

Stage-Area-Storage for Pond 7P: Detention Basin B1

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
400.00	1,408	0	405.20	7,774	22,164
400.10	1,487	145	405.30	7,933	22,949
400.20	1,568	298	405.40	8,095	23,751
400.30	1,652	459	405.50	8,257	24,568
400.40	1,738	628	405.60	8,422	25,402
400.50	1,825	806	405.70	8,588	26,253
400.60	1,915	993	405.80	8,756	27,120
400.70	2,007	1,189	405.90	8,925	28,004
400.80	2,102	1,395	406.00	9,096	28,905
400.90	2,198	1,610	406.10	9,261	29,823
401.00	2,297	1,834	406.20	9,428	30,757
401.10	2,398	2,069	406.30	9,597	31,708
401.20	2,501	2,314	406.40	9,767	32,677
401.30	2,606	2,569	406.50	9,938	33,662
401.40	2,713	2,835	406.60	10,111	34,664
401.50	2,822	3,112	406.70	10,285	35,684
401.60	2,934	3,400	406.80	10,461	36,721
401.70	3,048	3,699	406.90	10,638	37,776
401.80	3,164	4,009	407.00	10,817	38,849
401.90	3,282	4,332	407.10	10,997	39,940
402.00	3,402	4,666	407.20	11,179	41,048
402.10	3,514	5,012	407.30	11,362	42,175
402.20	3,628	5,369	407.40	11,547	43,321
402.30	3,743	5,737	407.50	11,733	44,485
402.40	3,861	6,117	407.60	11,921	45,668
402.50	3,980	6,509	407.70	12,110	46,869
402.60	4,101	6,913	407.80	12,301	48,090
402.70	4,224	7,330	407.90	12,493	49,329
402.80	4,348	7,758	408.00	12,687	50,588
402.90	4,475	8,199	408.10	12,874	51,867
403.00	4,603	8,653	408.20	13,062	53,163
403.10	4,733	9,120	408.30	13,252	54,479
403.20	4,865	9,600	408.40	13,443	55,814
403.30	4,999	10,093	408.50	13,635	57,168
403.40	5,134	10,600	408.60	13,829	58,541
403.50	5,271	11,120	408.70	14,024	59,933
403.60	5,410	11,654	408.80	14,220	61,346
403.70	5,551	12,202	408.90	14,418	62,777
403.80	5,694	12,764	409.00	14,617	64,229
403.90	5,839	13,341	409.10	14,818	65,701
404.00	5,985	13,932	409.20	15,020	67,193
404.10	6,125	14,537	409.30	15,223	68,705
404.20	6,267	15,157	409.40	15,428	70,237
404.30	6,410	15,791	409.50	15,634	71,790
404.40	6,555	16,439	409.60	15,841	73,364
404.50	6,702	17,102	409.70	16,050	74,959
404.60	6,850	17,780	409.80	16,260	76,574
404.70	7,000	18,472	409.90	16,471	78,211
404.80	7,152	19,180	410.00	16,684	79,868
404.90	7,305	19,902			
405.00	7,459	20,641			
405.10	7,616	21,394			

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 25

Summary for Pond PR-A: PR-A

Inflow Area = 37.077 ac, 36.24% Impervious, Inflow Depth > 0.98" for 1-yr event
Inflow = 15.32 cfs @ 12.26 hrs, Volume= 3.035 af
Primary = 15.32 cfs @ 12.26 hrs, Volume= 3.035 af, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 1-yr Rainfall=2.62"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 26

Summary for Pond PR-B: PR-B

Inflow Area = 17.738 ac, 22.72% Impervious, Inflow Depth > 0.59" for 1-yr event
Inflow = 1.22 cfs @ 12.58 hrs, Volume= 0.867 af
Primary = 1.22 cfs @ 12.58 hrs, Volume= 0.867 af, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 27

Summary for Pond 1P: Forebay & Bio A1-A

Inflow Area = 4.969 ac, 55.48% Impervious, Inflow Depth = 3.58" for 10-yr event
 Inflow = 12.66 cfs @ 12.26 hrs, Volume= 1.482 af
 Outflow = 12.09 cfs @ 12.31 hrs, Volume= 1.482 af, Atten= 4%, Lag= 3.3 min
 Primary = 12.09 cfs @ 12.31 hrs, Volume= 1.482 af
 Routed to Pond 4P : Detention Basin A1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
 Automatic Starting Elev= 408.50' Surf.Area= 18,385 sf Storage= 66,328 cf
 Peak Elev= 408.70' @ 12.31 hrs Surf.Area= 18,528 sf Storage= 70,010 cf (3,682 cf above start)

Plug-Flow detention time= (not calculated: initial storage exceeds outflow)

Center-of-Mass det. time= 10.3 min (826.4 - 816.1)

Volume	Invert	Avail.Storage	Storage Description	
#1	400.00'	94,716 cf	Custom Stage Data (Conic) Listed below (Recalc)	
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
400.00	2,093	0	0	2,093
402.00	3,854	5,858	5,858	3,895
404.00	5,993	9,769	15,627	6,090
406.00	8,501	14,421	30,048	8,669
407.50	16,634	18,513	48,561	16,824
408.00	18,030	8,664	57,225	18,239
410.00	19,471	37,492	94,716	19,977

Device	Routing	Invert	Outlet Devices									
#1	Primary	408.50'	50.0' long + 4.0 ' SideZ x 31.0' breadth Broad-Crested Rectangular Weir									
			Head (feet)	0.20	0.40	0.60	0.80	1.00	1.20	1.40	1.60	
			Coef. (English)	2.68	2.70	2.70	2.64	2.63	2.64	2.64	2.63	

Primary OutFlow Max=12.09 cfs @ 12.31 hrs HW=408.70' TW=404.83' (Dynamic Tailwater)

↑1=Broad-Crested Rectangular Weir (Weir Controls 12.09 cfs @ 1.19 fps)

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"


Printed 12/8/2025

Page 28

Pond 1P: Forebay & Bio A1-A

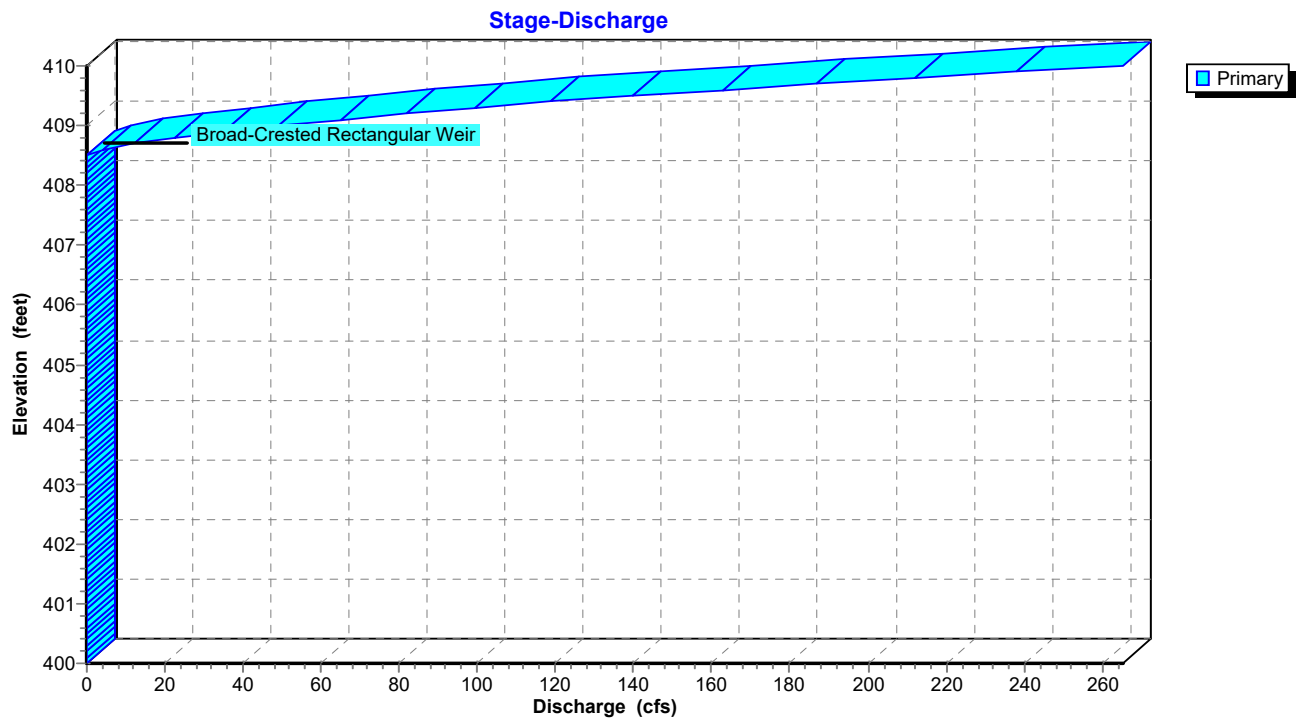

Pond 1P: Forebay & Bio A1-A

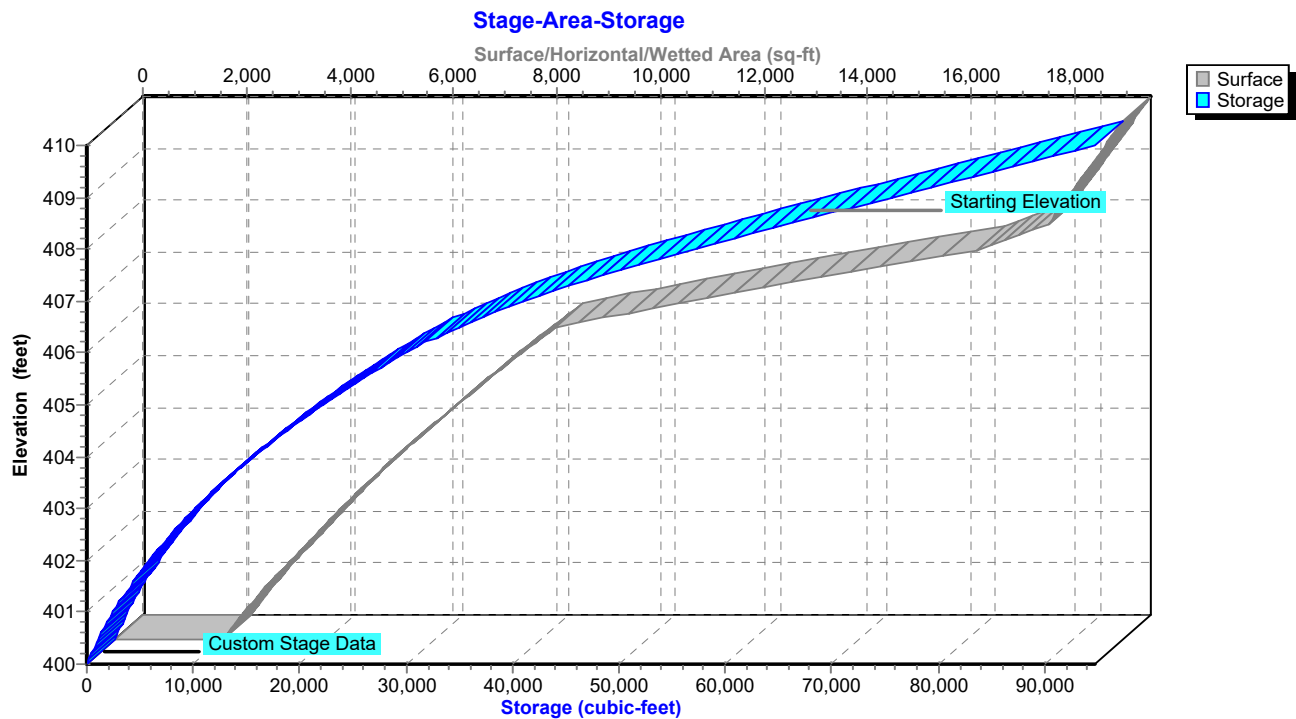

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 29

Stage-Discharge for Pond 1P: Forebay & Bio A1-A

Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)
400.00	0.00	402.60	0.00	405.20	0.00	407.80	0.00
400.05	0.00	402.65	0.00	405.25	0.00	407.85	0.00
400.10	0.00	402.70	0.00	405.30	0.00	407.90	0.00
400.15	0.00	402.75	0.00	405.35	0.00	407.95	0.00
400.20	0.00	402.80	0.00	405.40	0.00	408.00	0.00
400.25	0.00	402.85	0.00	405.45	0.00	408.05	0.00
400.30	0.00	402.90	0.00	405.50	0.00	408.10	0.00
400.35	0.00	402.95	0.00	405.55	0.00	408.15	0.00
400.40	0.00	403.00	0.00	405.60	0.00	408.20	0.00
400.45	0.00	403.05	0.00	405.65	0.00	408.25	0.00
400.50	0.00	403.10	0.00	405.70	0.00	408.30	0.00
400.55	0.00	403.15	0.00	405.75	0.00	408.35	0.00
400.60	0.00	403.20	0.00	405.80	0.00	408.40	0.00
400.65	0.00	403.25	0.00	405.85	0.00	408.45	0.00
400.70	0.00	403.30	0.00	405.90	0.00	408.50	0.00
400.75	0.00	403.35	0.00	405.95	0.00	408.55	1.50
400.80	0.00	403.40	0.00	406.00	0.00	408.60	4.26
400.85	0.00	403.45	0.00	406.05	0.00	408.65	7.86
400.90	0.00	403.50	0.00	406.10	0.00	408.70	12.14
400.95	0.00	403.55	0.00	406.15	0.00	408.75	17.05
401.00	0.00	403.60	0.00	406.20	0.00	408.80	22.52
401.05	0.00	403.65	0.00	406.25	0.00	408.85	28.53
401.10	0.00	403.70	0.00	406.30	0.00	408.90	35.03
401.15	0.00	403.75	0.00	406.35	0.00	408.95	41.93
401.20	0.00	403.80	0.00	406.40	0.00	409.00	49.26
401.25	0.00	403.85	0.00	406.45	0.00	409.05	57.00
401.30	0.00	403.90	0.00	406.50	0.00	409.10	65.15
401.35	0.00	403.95	0.00	406.55	0.00	409.15	73.28
401.40	0.00	404.00	0.00	406.60	0.00	409.20	81.69
401.45	0.00	404.05	0.00	406.65	0.00	409.25	90.36
401.50	0.00	404.10	0.00	406.70	0.00	409.30	99.29
401.55	0.00	404.15	0.00	406.75	0.00	409.35	108.97
401.60	0.00	404.20	0.00	406.80	0.00	409.40	118.97
401.65	0.00	404.25	0.00	406.85	0.00	409.45	129.29
401.70	0.00	404.30	0.00	406.90	0.00	409.50	139.92
401.75	0.00	404.35	0.00	406.95	0.00	409.55	151.14
401.80	0.00	404.40	0.00	407.00	0.00	409.60	162.70
401.85	0.00	404.45	0.00	407.05	0.00	409.65	174.60
401.90	0.00	404.50	0.00	407.10	0.00	409.70	186.84
401.95	0.00	404.55	0.00	407.15	0.00	409.75	199.23
402.00	0.00	404.60	0.00	407.20	0.00	409.80	211.93
402.05	0.00	404.65	0.00	407.25	0.00	409.85	224.94
402.10	0.00	404.70	0.00	407.30	0.00	409.90	238.25
402.15	0.00	404.75	0.00	407.35	0.00	409.95	251.63
402.20	0.00	404.80	0.00	407.40	0.00	410.00	265.28
402.25	0.00	404.85	0.00	407.45	0.00		
402.30	0.00	404.90	0.00	407.50	0.00		
402.35	0.00	404.95	0.00	407.55	0.00		
402.40	0.00	405.00	0.00	407.60	0.00		
402.45	0.00	405.05	0.00	407.65	0.00		
402.50	0.00	405.10	0.00	407.70	0.00		
402.55	0.00	405.15	0.00	407.75	0.00		

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 30

Stage-Area-Storage for Pond 1P: Forebay & Bio A1-A

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
400.00	2,093	0	405.20	7,445	23,674
400.10	2,168	213	405.30	7,573	24,425
400.20	2,245	434	405.40	7,703	25,189
400.30	2,323	662	405.50	7,833	25,965
400.40	2,403	898	405.60	7,964	26,755
400.50	2,483	1,143	405.70	8,097	27,558
400.60	2,565	1,395	405.80	8,231	28,375
400.70	2,649	1,656	405.90	8,365	29,205
400.80	2,733	1,925	406.00	8,501	30,048
400.90	2,819	2,202	406.10	8,959	30,921
401.00	2,907	2,489	406.20	9,429	31,840
401.10	2,996	2,784	406.30	9,911	32,807
401.20	3,086	3,088	406.40	10,405	33,823
401.30	3,177	3,401	406.50	10,912	34,888
401.40	3,270	3,723	406.60	11,430	36,005
401.50	3,364	4,055	406.70	11,960	37,175
401.60	3,459	4,396	406.80	12,502	38,398
401.70	3,556	4,747	406.90	13,056	39,676
401.80	3,654	5,107	407.00	13,623	41,009
401.90	3,753	5,478	407.10	14,201	42,401
402.00	3,854	5,858	407.20	14,791	43,850
402.10	3,950	6,248	407.30	15,393	45,359
402.20	4,047	6,648	407.40	16,008	46,929
402.30	4,145	7,058	407.50	16,634	48,561
402.40	4,244	7,477	407.60	16,909	50,238
402.50	4,345	7,907	407.70	17,186	51,943
402.60	4,446	8,346	407.80	17,465	53,675
402.70	4,549	8,796	407.90	17,746	55,436
402.80	4,653	9,256	408.00	18,030	57,225
402.90	4,758	9,727	408.10	18,101	59,031
403.00	4,865	10,208	408.20	18,172	60,845
403.10	4,972	10,699	408.30	18,243	62,666
403.20	5,081	11,202	408.40	18,314	64,493
403.30	5,191	11,716	408.50	18,385	66,328
403.40	5,302	12,240	408.60	18,456	68,170
403.50	5,414	12,776	408.70	18,528	70,020
403.60	5,528	13,323	408.80	18,600	71,876
403.70	5,642	13,882	408.90	18,672	73,740
403.80	5,758	14,452	409.00	18,744	75,610
403.90	5,875	15,033	409.10	18,816	77,488
404.00	5,993	15,627	409.20	18,888	79,373
404.10	6,108	16,232	409.30	18,960	81,266
404.20	6,224	16,848	409.40	19,033	83,166
404.30	6,341	17,477	409.50	19,106	85,072
404.40	6,460	18,117	409.60	19,178	86,987
404.50	6,579	18,769	409.70	19,251	88,908
404.60	6,699	19,432	409.80	19,324	90,837
404.70	6,821	20,109	409.90	19,398	92,773
404.80	6,944	20,797	410.00	19,471	94,716
404.90	7,067	21,497			
405.00	7,192	22,210			
405.10	7,318	22,936			

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 31

Summary for Pond 2P: Forebay & Bio A1-B

Inflow Area = 4.432 ac, 51.17% Impervious, Inflow Depth = 3.48" for 10-yr event
 Inflow = 11.19 cfs @ 12.24 hrs, Volume= 1.284 af
 Outflow = 10.58 cfs @ 12.31 hrs, Volume= 1.284 af, Atten= 5%, Lag= 4.0 min
 Primary = 10.58 cfs @ 12.31 hrs, Volume= 1.284 af
 Routed to Pond 4P : Detention Basin A1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
 Automatic Starting Elev= 408.50' Surf.Area= 19,240 sf Storage= 72,229 cf
 Peak Elev= 408.68' @ 12.31 hrs Surf.Area= 19,722 sf Storage= 75,787 cf (3,558 cf above start)


Plug-Flow detention time= (not calculated: initial storage exceeds outflow)
 Center-of-Mass det. time= 11.3 min (831.3 - 820.0)

Volume	Invert	Avail.Storage	Storage Description	
#1	400.00'	104,144 cf	Custom Stage Data (Conic) Listed below (Recalc)	
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
400.00	3,314	0	0	3,314
402.00	4,891	8,154	8,154	4,954
404.00	6,756	11,597	19,751	6,896
406.00	8,917	15,623	35,374	9,146
407.50	16,689	18,903	54,277	16,940
408.00	17,949	8,658	62,934	18,222
410.00	23,380	41,210	104,144	23,747


Device	Routing	Invert	Outlet Devices									
#1	Primary	408.50'	50.0' long + 4.0 ' SideZ x 31.0' breadth Broad-Crested Rectangular Weir									
			Head (feet)	0.20	0.40	0.60	0.80	1.00	1.20	1.40	1.60	
			Coef. (English)	2.68	2.70	2.70	2.64	2.63	2.64	2.64	2.63	

Primary OutFlow Max=10.58 cfs @ 12.31 hrs HW=408.68' TW=404.82' (Dynamic Tailwater)
 ↑1=**Broad-Crested Rectangular Weir**(Weir Controls 10.58 cfs @ 1.14 fps)

Pond 2P: Forebay & Bio A1-B

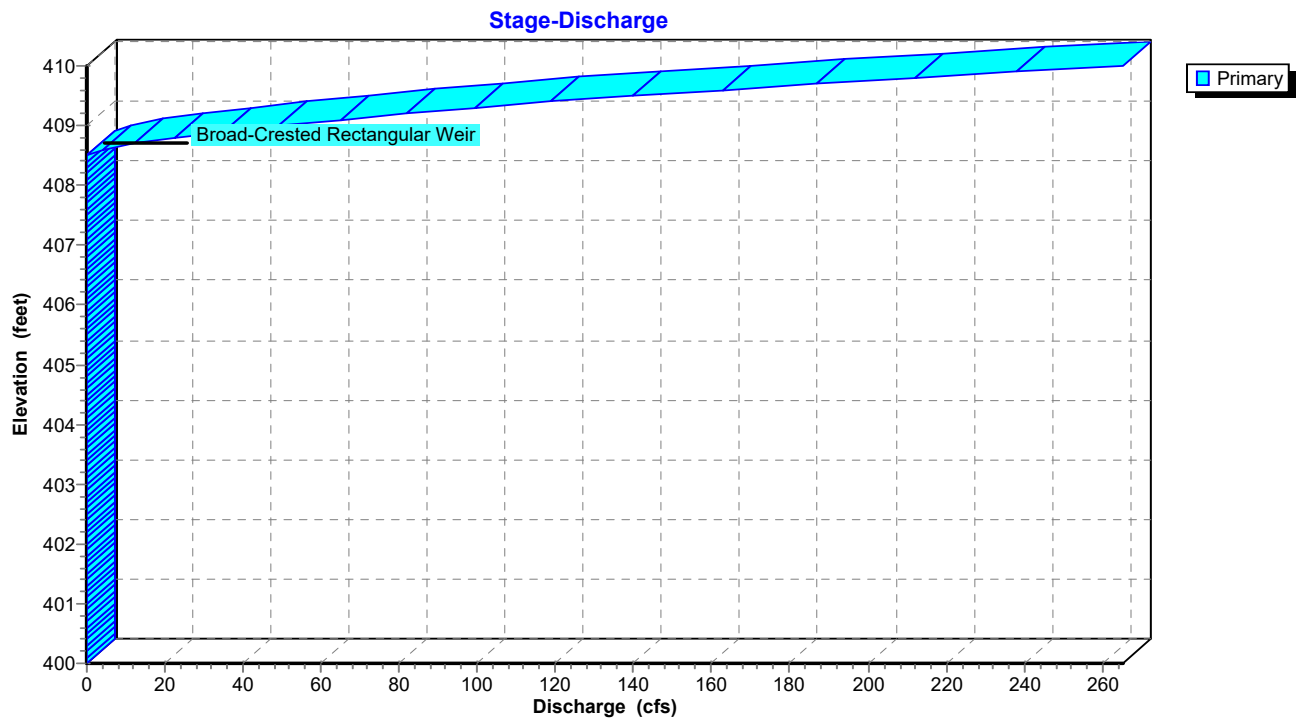

Pond 2P: Forebay & Bio A1-B

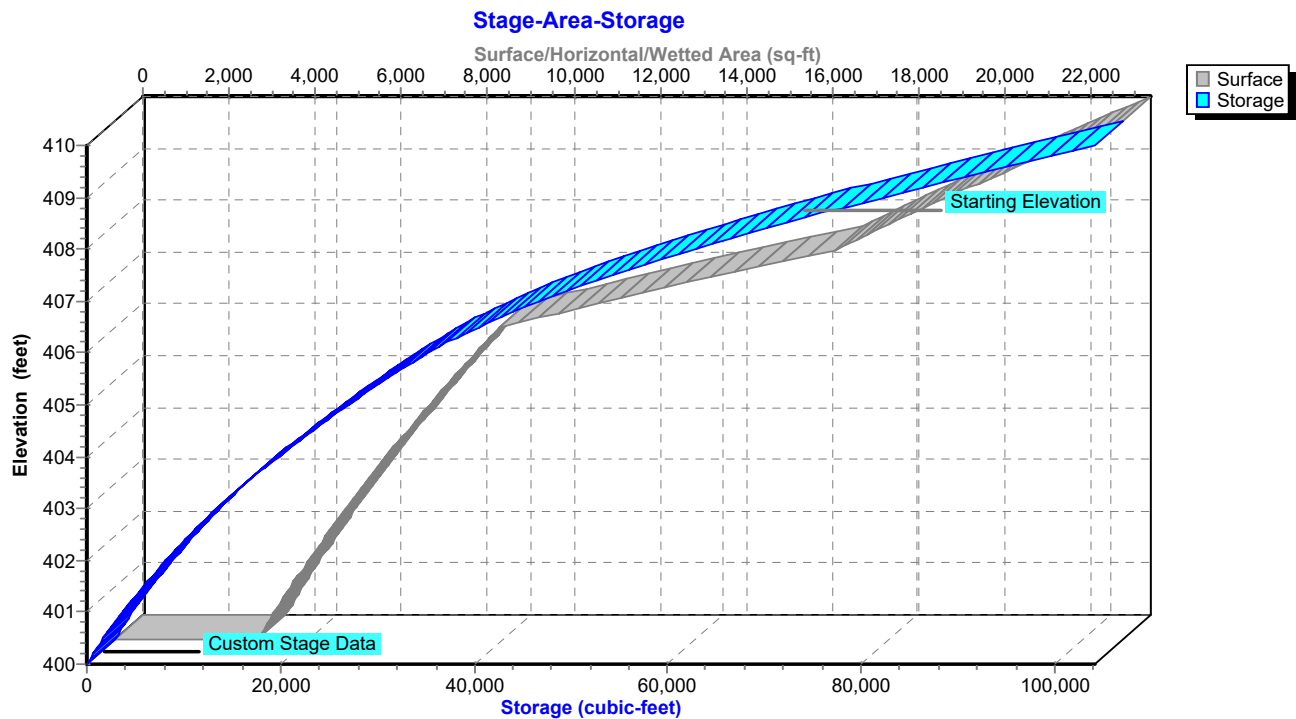

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 33

Stage-Discharge for Pond 2P: Forebay & Bio A1-B

Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)
400.00	0.00	402.60	0.00	405.20	0.00	407.80	0.00
400.05	0.00	402.65	0.00	405.25	0.00	407.85	0.00
400.10	0.00	402.70	0.00	405.30	0.00	407.90	0.00
400.15	0.00	402.75	0.00	405.35	0.00	407.95	0.00
400.20	0.00	402.80	0.00	405.40	0.00	408.00	0.00
400.25	0.00	402.85	0.00	405.45	0.00	408.05	0.00
400.30	0.00	402.90	0.00	405.50	0.00	408.10	0.00
400.35	0.00	402.95	0.00	405.55	0.00	408.15	0.00
400.40	0.00	403.00	0.00	405.60	0.00	408.20	0.00
400.45	0.00	403.05	0.00	405.65	0.00	408.25	0.00
400.50	0.00	403.10	0.00	405.70	0.00	408.30	0.00
400.55	0.00	403.15	0.00	405.75	0.00	408.35	0.00
400.60	0.00	403.20	0.00	405.80	0.00	408.40	0.00
400.65	0.00	403.25	0.00	405.85	0.00	408.45	0.00
400.70	0.00	403.30	0.00	405.90	0.00	408.50	0.00
400.75	0.00	403.35	0.00	405.95	0.00	408.55	1.50
400.80	0.00	403.40	0.00	406.00	0.00	408.60	4.26
400.85	0.00	403.45	0.00	406.05	0.00	408.65	7.86
400.90	0.00	403.50	0.00	406.10	0.00	408.70	12.14
400.95	0.00	403.55	0.00	406.15	0.00	408.75	17.05
401.00	0.00	403.60	0.00	406.20	0.00	408.80	22.52
401.05	0.00	403.65	0.00	406.25	0.00	408.85	28.53
401.10	0.00	403.70	0.00	406.30	0.00	408.90	35.03
401.15	0.00	403.75	0.00	406.35	0.00	408.95	41.93
401.20	0.00	403.80	0.00	406.40	0.00	409.00	49.26
401.25	0.00	403.85	0.00	406.45	0.00	409.05	57.00
401.30	0.00	403.90	0.00	406.50	0.00	409.10	65.15
401.35	0.00	403.95	0.00	406.55	0.00	409.15	73.28
401.40	0.00	404.00	0.00	406.60	0.00	409.20	81.69
401.45	0.00	404.05	0.00	406.65	0.00	409.25	90.36
401.50	0.00	404.10	0.00	406.70	0.00	409.30	99.29
401.55	0.00	404.15	0.00	406.75	0.00	409.35	108.97
401.60	0.00	404.20	0.00	406.80	0.00	409.40	118.97
401.65	0.00	404.25	0.00	406.85	0.00	409.45	129.29
401.70	0.00	404.30	0.00	406.90	0.00	409.50	139.92
401.75	0.00	404.35	0.00	406.95	0.00	409.55	151.14
401.80	0.00	404.40	0.00	407.00	0.00	409.60	162.70
401.85	0.00	404.45	0.00	407.05	0.00	409.65	174.60
401.90	0.00	404.50	0.00	407.10	0.00	409.70	186.84
401.95	0.00	404.55	0.00	407.15	0.00	409.75	199.23
402.00	0.00	404.60	0.00	407.20	0.00	409.80	211.93
402.05	0.00	404.65	0.00	407.25	0.00	409.85	224.94
402.10	0.00	404.70	0.00	407.30	0.00	409.90	238.25
402.15	0.00	404.75	0.00	407.35	0.00	409.95	251.63
402.20	0.00	404.80	0.00	407.40	0.00	410.00	265.28
402.25	0.00	404.85	0.00	407.45	0.00		
402.30	0.00	404.90	0.00	407.50	0.00		
402.35	0.00	404.95	0.00	407.55	0.00		
402.40	0.00	405.00	0.00	407.60	0.00		
402.45	0.00	405.05	0.00	407.65	0.00		
402.50	0.00	405.10	0.00	407.70	0.00		
402.55	0.00	405.15	0.00	407.75	0.00		

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 34

Stage-Area-Storage for Pond 2P: Forebay & Bio A1-B

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
400.00	3,314	0	405.20	8,017	28,604
400.10	3,386	335	405.30	8,127	29,411
400.20	3,458	677	405.40	8,237	30,229
400.30	3,531	1,027	405.50	8,349	31,058
400.40	3,605	1,383	405.60	8,461	31,899
400.50	3,680	1,748	405.70	8,574	32,751
400.60	3,755	2,119	405.80	8,687	33,614
400.70	3,831	2,499	405.90	8,802	34,488
400.80	3,908	2,886	406.00	8,917	35,374
400.90	3,986	3,280	406.10	9,360	36,288
401.00	4,064	3,683	406.20	9,814	37,246
401.10	4,143	4,093	406.30	10,278	38,251
401.20	4,223	4,511	406.40	10,753	39,302
401.30	4,304	4,938	406.50	11,239	40,402
401.40	4,386	5,372	406.60	11,736	41,551
401.50	4,468	5,815	406.70	12,243	42,749
401.60	4,551	6,266	406.80	12,761	44,000
401.70	4,635	6,725	406.90	13,290	45,302
401.80	4,720	7,193	407.00	13,830	46,658
401.90	4,805	7,669	407.10	14,380	48,068
402.00	4,891	8,154	407.20	14,941	49,534
402.10	4,977	8,647	407.30	15,513	51,057
402.20	5,064	9,149	407.40	16,096	52,637
402.30	5,152	9,660	407.50	16,689	54,277
402.40	5,240	10,180	407.60	16,937	55,958
402.50	5,329	10,708	407.70	17,187	57,664
402.60	5,419	11,246	407.80	17,439	59,395
402.70	5,510	11,792	407.90	17,693	61,152
402.80	5,601	12,348	408.00	17,949	62,934
402.90	5,693	12,912	408.10	18,204	64,742
403.00	5,786	13,486	408.20	18,460	66,575
403.10	5,880	14,069	408.30	18,718	68,434
403.20	5,974	14,662	408.40	18,978	70,319
403.30	6,069	15,264	408.50	19,240	72,229
403.40	6,165	15,876	408.60	19,503	74,166
403.50	6,262	16,497	408.70	19,768	76,130
403.60	6,359	17,128	408.80	20,035	78,120
403.70	6,457	17,769	408.90	20,304	80,137
403.80	6,556	18,420	409.00	20,575	82,181
403.90	6,656	19,080	409.10	20,847	84,252
404.00	6,756	19,751	409.20	21,122	86,351
404.10	6,857	20,432	409.30	21,398	88,477
404.20	6,959	21,122	409.40	21,675	90,630
404.30	7,061	21,823	409.50	21,955	92,812
404.40	7,164	22,535	409.60	22,236	95,021
404.50	7,268	23,256	409.70	22,520	97,259
404.60	7,373	23,988	409.80	22,805	99,525
404.70	7,478	24,731	409.90	23,091	101,820
404.80	7,584	25,484	410.00	23,380	104,144
404.90	7,691	26,248			
405.00	7,799	27,022			
405.10	7,908	27,808			

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 35

Summary for Pond 3P: Forebay & Bio B1-A

Inflow Area = 4.885 ac, 52.14% Impervious, Inflow Depth = 3.48" for 10-yr event
 Inflow = 12.16 cfs @ 12.26 hrs, Volume= 1.415 af
 Outflow = 10.57 cfs @ 12.36 hrs, Volume= 1.415 af, Atten= 13%, Lag= 6.3 min
 Primary = 10.57 cfs @ 12.36 hrs, Volume= 1.415 af
 Routed to Pond 7P : Detention Basin B1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
 Automatic Starting Elev= 408.50' Surf.Area= 16,412 sf Storage= 58,221 cf
 Peak Elev= 408.88' @ 12.36 hrs Surf.Area= 17,383 sf Storage= 64,578 cf (6,357 cf above start)

Plug-Flow detention time= 930.7 min calculated for 0.078 af (6% of inflow)
 Center-of-Mass det. time= 19.5 min (840.0 - 820.6)

Volume	Invert	Avail.Storage	Storage Description	
#1	400.00'	85,810 cf	Custom Stage Data (Conic) Listed below (Recalc)	
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
400.00	2,277	0	0	2,277
402.00	3,680	5,901	5,901	3,732
404.00	5,342	8,971	14,872	5,460
406.00	7,258	12,551	27,423	7,456
407.50	13,943	15,630	43,053	14,163
408.00	15,166	7,275	50,328	15,405
410.00	20,447	35,482	85,810	20,769

Device	Routing	Invert	Outlet Devices
#1	Primary	404.03'	18.0" Round Culvert L= 101.6' CMP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 404.03' / 402.00' S= 0.0200 '/' Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 1.77 sf
#2	Device 1	408.50'	36.0" x 48.0" Horiz. OS B1-A C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=10.56 cfs @ 12.36 hrs HW=408.88' TW=404.42' (Dynamic Tailwater)

↑ **1=Culvert** (Passes 10.56 cfs of 17.22 cfs potential flow)

↑ **2=OS B1-A** (Weir Controls 10.56 cfs @ 2.01 fps)

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"


Printed 12/8/2025

Page 36

Pond 3P: Forebay & Bio B1-A

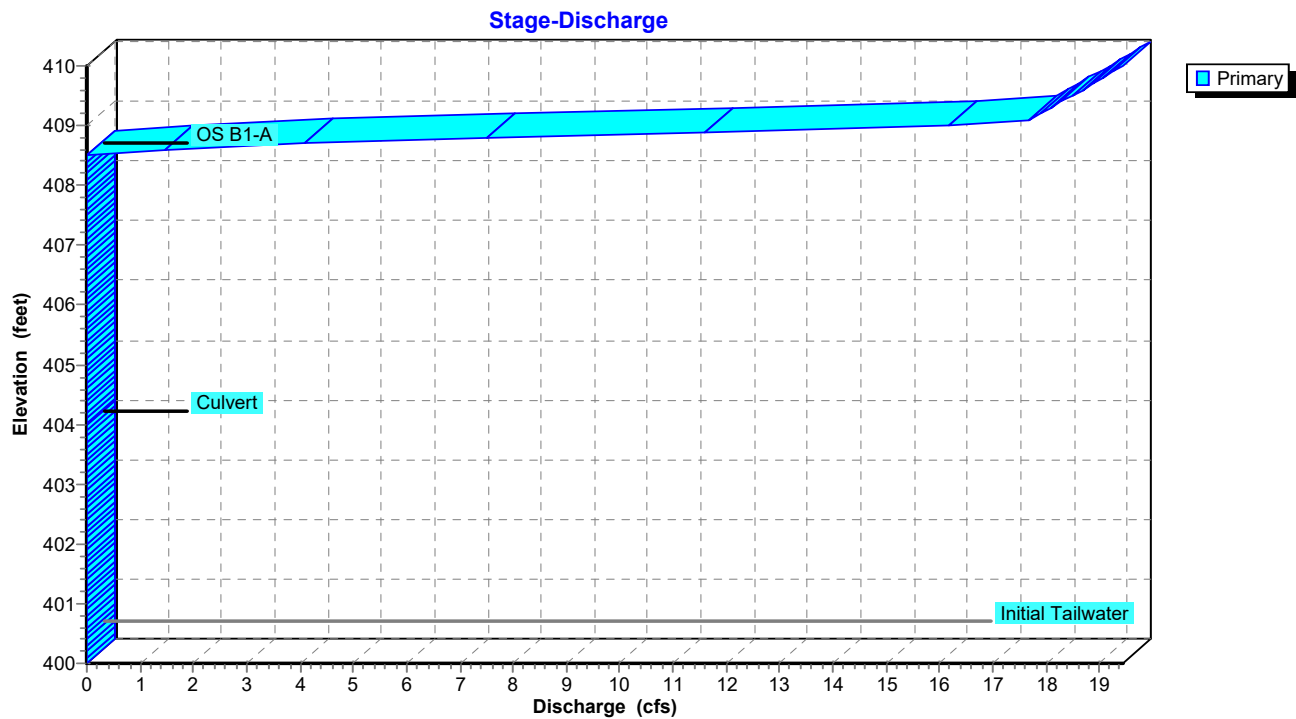

Pond 3P: Forebay & Bio B1-A

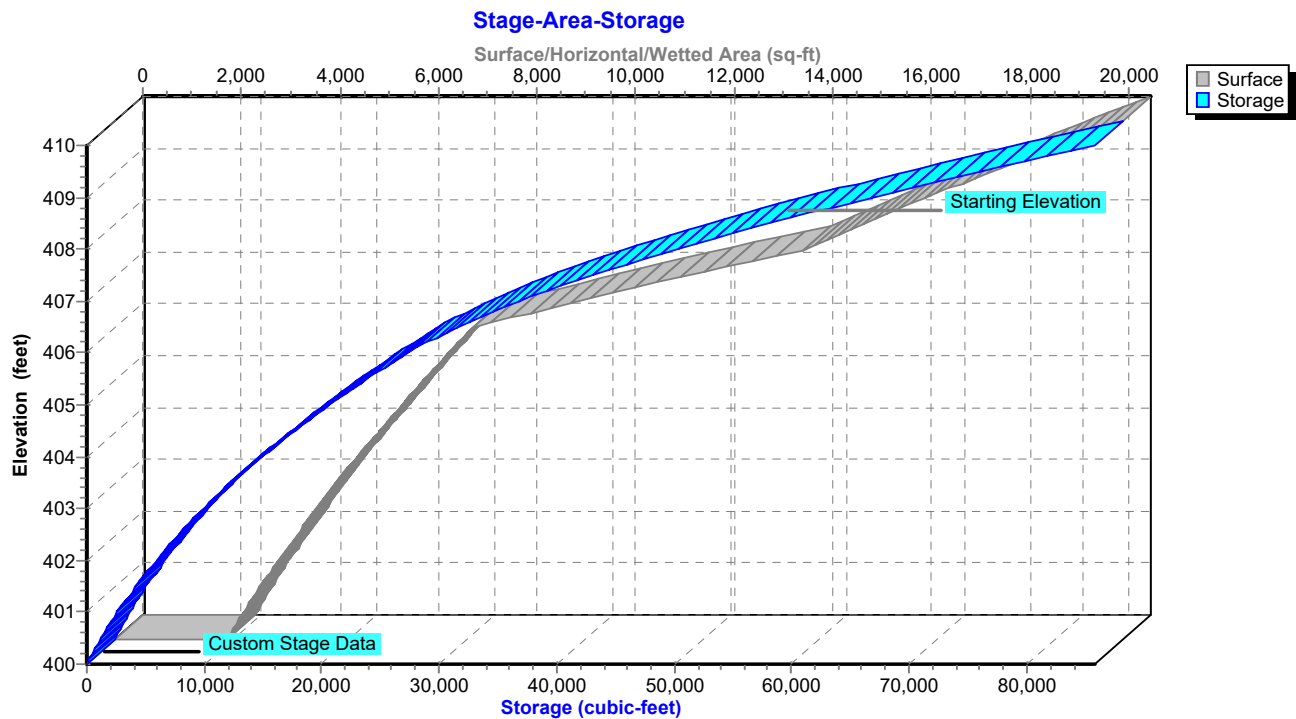

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 37

Stage-Discharge for Pond 3P: Forebay & Bio B1-A

Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)
400.00	0.00	402.60	0.00	405.20	0.00	407.80	0.00
400.05	0.00	402.65	0.00	405.25	0.00	407.85	0.00
400.10	0.00	402.70	0.00	405.30	0.00	407.90	0.00
400.15	0.00	402.75	0.00	405.35	0.00	407.95	0.00
400.20	0.00	402.80	0.00	405.40	0.00	408.00	0.00
400.25	0.00	402.85	0.00	405.45	0.00	408.05	0.00
400.30	0.00	402.90	0.00	405.50	0.00	408.10	0.00
400.35	0.00	402.95	0.00	405.55	0.00	408.15	0.00
400.40	0.00	403.00	0.00	405.60	0.00	408.20	0.00
400.45	0.00	403.05	0.00	405.65	0.00	408.25	0.00
400.50	0.00	403.10	0.00	405.70	0.00	408.30	0.00
400.55	0.00	403.15	0.00	405.75	0.00	408.35	0.00
400.60	0.00	403.20	0.00	405.80	0.00	408.40	0.00
400.65	0.00	403.25	0.00	405.85	0.00	408.45	0.00
400.70	0.00	403.30	0.00	405.90	0.00	408.50	0.00
400.75	0.00	403.35	0.00	405.95	0.00	408.55	0.51
400.80	0.00	403.40	0.00	406.00	0.00	408.60	1.45
400.85	0.00	403.45	0.00	406.05	0.00	408.65	2.66
400.90	0.00	403.50	0.00	406.10	0.00	408.70	4.09
400.95	0.00	403.55	0.00	406.15	0.00	408.75	5.72
401.00	0.00	403.60	0.00	406.20	0.00	408.80	7.52
401.05	0.00	403.65	0.00	406.25	0.00	408.85	9.48
401.10	0.00	403.70	0.00	406.30	0.00	408.90	11.58
401.15	0.00	403.75	0.00	406.35	0.00	408.95	13.82
401.20	0.00	403.80	0.00	406.40	0.00	409.00	16.19
401.25	0.00	403.85	0.00	406.45	0.00	409.05	17.58
401.30	0.00	403.90	0.00	406.50	0.00	409.10	17.69
401.35	0.00	403.95	0.00	406.55	0.00	409.15	17.79
401.40	0.00	404.00	0.00	406.60	0.00	409.20	17.89
401.45	0.00	404.05	0.00	406.65	0.00	409.25	17.99
401.50	0.00	404.10	0.00	406.70	0.00	409.30	18.09
401.55	0.00	404.15	0.00	406.75	0.00	409.35	18.19
401.60	0.00	404.20	0.00	406.80	0.00	409.40	18.29
401.65	0.00	404.25	0.00	406.85	0.00	409.45	18.39
401.70	0.00	404.30	0.00	406.90	0.00	409.50	18.49
401.75	0.00	404.35	0.00	406.95	0.00	409.55	18.58
401.80	0.00	404.40	0.00	407.00	0.00	409.60	18.68
401.85	0.00	404.45	0.00	407.05	0.00	409.65	18.78
401.90	0.00	404.50	0.00	407.10	0.00	409.70	18.87
401.95	0.00	404.55	0.00	407.15	0.00	409.75	18.97
402.00	0.00	404.60	0.00	407.20	0.00	409.80	19.06
402.05	0.00	404.65	0.00	407.25	0.00	409.85	19.16
402.10	0.00	404.70	0.00	407.30	0.00	409.90	19.25
402.15	0.00	404.75	0.00	407.35	0.00	409.95	19.35
402.20	0.00	404.80	0.00	407.40	0.00	410.00	19.44
402.25	0.00	404.85	0.00	407.45	0.00		
402.30	0.00	404.90	0.00	407.50	0.00		
402.35	0.00	404.95	0.00	407.55	0.00		
402.40	0.00	405.00	0.00	407.60	0.00		
402.45	0.00	405.05	0.00	407.65	0.00		
402.50	0.00	405.10	0.00	407.70	0.00		
402.55	0.00	405.15	0.00	407.75	0.00		

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 38

Stage-Area-Storage for Pond 3P: Forebay & Bio B1-A

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
400.00	2,277	0	405.20	6,456	21,940
400.10	2,339	231	405.30	6,554	22,591
400.20	2,402	468	405.40	6,652	23,251
400.30	2,466	711	405.50	6,752	23,921
400.40	2,531	961	405.60	6,851	24,601
400.50	2,596	1,217	405.70	6,952	25,292
400.60	2,663	1,480	405.80	7,053	25,992
400.70	2,730	1,750	405.90	7,155	26,702
400.80	2,798	2,026	406.00	7,258	27,423
400.90	2,867	2,310	406.10	7,366	28,167
401.00	2,937	2,600	406.20	7,474	28,925
401.10	3,007	2,897	406.30	7,582	29,697
401.20	3,079	3,201	406.40	7,690	30,483
401.30	3,151	3,513	406.50	7,798	31,283
401.40	3,224	3,831	406.60	7,906	32,097
401.50	3,298	4,158	406.70	8,014	32,925
401.60	3,373	4,491	406.80	8,122	33,767
401.70	3,448	4,832	406.90	8,230	34,623
401.80	3,525	5,181	407.00	8,338	35,493
401.90	3,602	5,537	407.10	8,446	36,377
402.00	3,680	5,901	407.20	8,554	37,275
402.10	3,756	6,273	407.30	8,662	38,187
402.20	3,832	6,652	407.40	8,770	39,113
402.30	3,910	7,039	407.50	8,878	40,053
402.40	3,988	7,434	407.60	8,986	41,007
402.50	4,067	7,837	407.70	9,094	41,975
402.60	4,146	8,248	407.80	9,202	42,957
402.70	4,227	8,666	407.90	9,310	43,953
402.80	4,308	9,093	408.00	9,418	44,963
402.90	4,390	9,528	408.10	9,526	45,987
403.00	4,472	9,971	408.20	9,634	47,025
403.10	4,556	10,422	408.30	9,742	48,077
403.20	4,640	10,882	408.40	9,850	49,143
403.30	4,725	11,350	408.50	9,958	50,223
403.40	4,811	11,827	408.60	10,066	51,317
403.50	4,898	12,313	408.70	10,174	52,425
403.60	4,985	12,807	408.80	10,282	53,547
403.70	5,073	13,310	408.90	10,390	54,683
403.80	5,162	13,821	409.00	10,498	55,833
403.90	5,252	14,342	409.10	10,606	56,997
404.00	5,342	14,872	409.20	10,714	58,175
404.10	5,431	15,410	409.30	10,822	59,367
404.20	5,520	15,958	409.40	10,930	60,573
404.30	5,611	16,514	409.50	11,038	61,793
404.40	5,702	17,080	409.60	11,146	63,027
404.50	5,794	17,655	409.70	11,254	64,275
404.60	5,886	18,239	409.80	11,362	65,537
404.70	5,979	18,832	409.90	11,470	66,813
404.80	6,073	19,435	410.00	20,447	85,810
404.90	6,168	20,047			
405.00	6,263	20,668			
405.10	6,360	21,299			

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 39

Summary for Pond 4P: Detention Basin A1

Inflow Area = 10.068 ac, 49.91% Impervious, Inflow Depth = 3.47" for 10-yr event
 Inflow = 23.33 cfs @ 12.31 hrs, Volume= 2.911 af
 Outflow = 0.74 cfs @ 20.75 hrs, Volume= 2.162 af, Atten= 97%, Lag= 506.7 min
 Primary = 0.74 cfs @ 20.75 hrs, Volume= 2.162 af
 Routed to Pond PR-A : PR-A

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
 Automatic Starting Elev= 398.50' Surf.Area= 2,907 sf Storage= 21,861 cf
 Peak Elev= 408.23' @ 20.75 hrs Surf.Area= 19,676 sf Storage= 111,560 cf (89,699 cf above start)

Plug-Flow detention time= 1,252.4 min calculated for 1.660 af (57% of inflow)
 Center-of-Mass det. time= 863.7 min (1,692.9 - 829.2)


Volume	Invert	Avail.Storage	Storage Description	
#1	388.00'	150,665 cf	Custom Stage Data (Conic) Listed below (Recalc)	
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
388.00	1,355	0	0	1,355
400.00	3,176	26,422	26,422	4,046
402.00	5,824	8,867	35,289	6,736
404.00	9,598	15,266	50,555	10,560
406.00	14,095	23,549	74,104	15,122
408.00	19,096	33,065	107,169	20,205
410.00	24,513	43,496	150,665	25,722

Device	Routing	Invert	Outlet Devices
#1	Primary	398.50'	18.0" Round 18" Culvert L= 56.0' CPP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 398.50' / 397.94' S= 0.0100 '/' Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 1.77 sf
#2	Device 1	388.50'	3.0" Vert. 3" Orifice C= 0.600 Limited to weir flow at low heads
#3	Device 1	408.50'	36.0" x 48.0" Horiz. OS A1 C= 0.600 Limited to weir flow at low heads
#4	Primary	409.00'	30.0' long + 2.0 ' SideZ x 50.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63


Primary OutFlow Max=0.74 cfs @ 20.75 hrs HW=408.23' TW=0.00' (Dynamic Tailwater)

- 1=18" Culvert (Passes 0.74 cfs of 25.49 cfs potential flow)
 2=3" Orifice (Orifice Controls 0.74 cfs @ 15.02 fps)
 3=OS A1 (Controls 0.00 cfs)
 4=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Pond 4P: Detention Basin A1

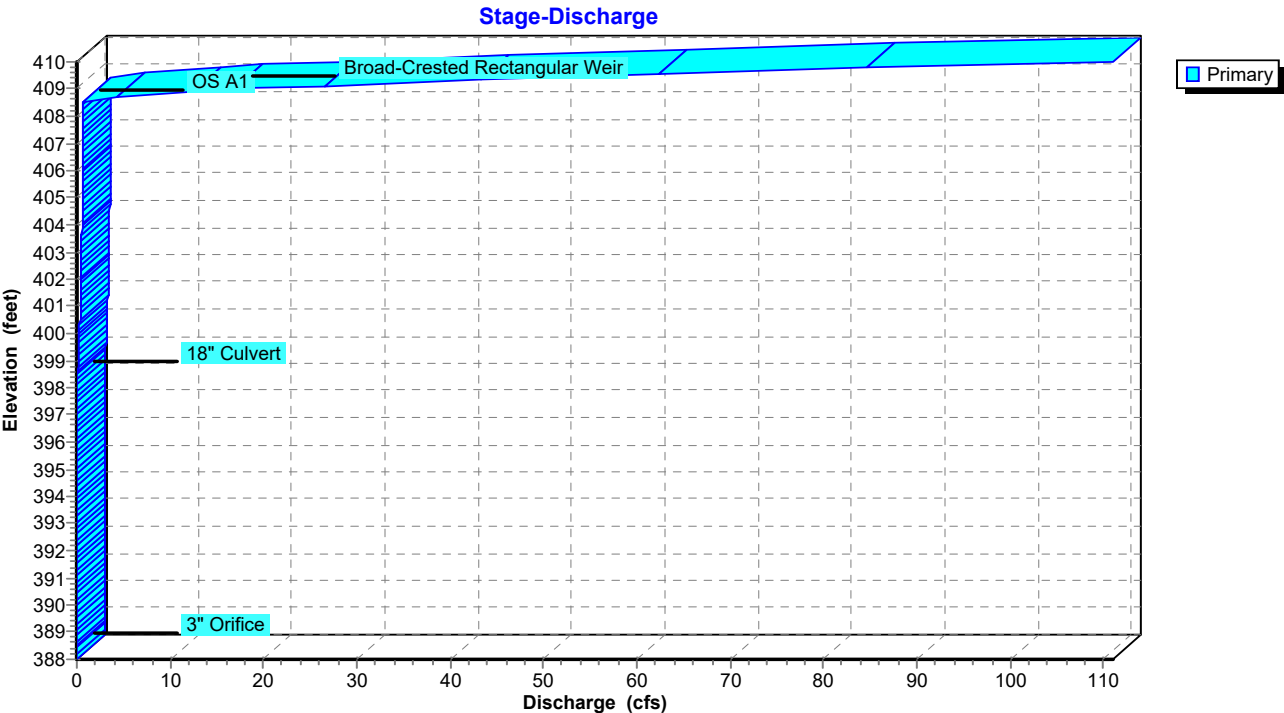

Pond 4P: Detention Basin A1

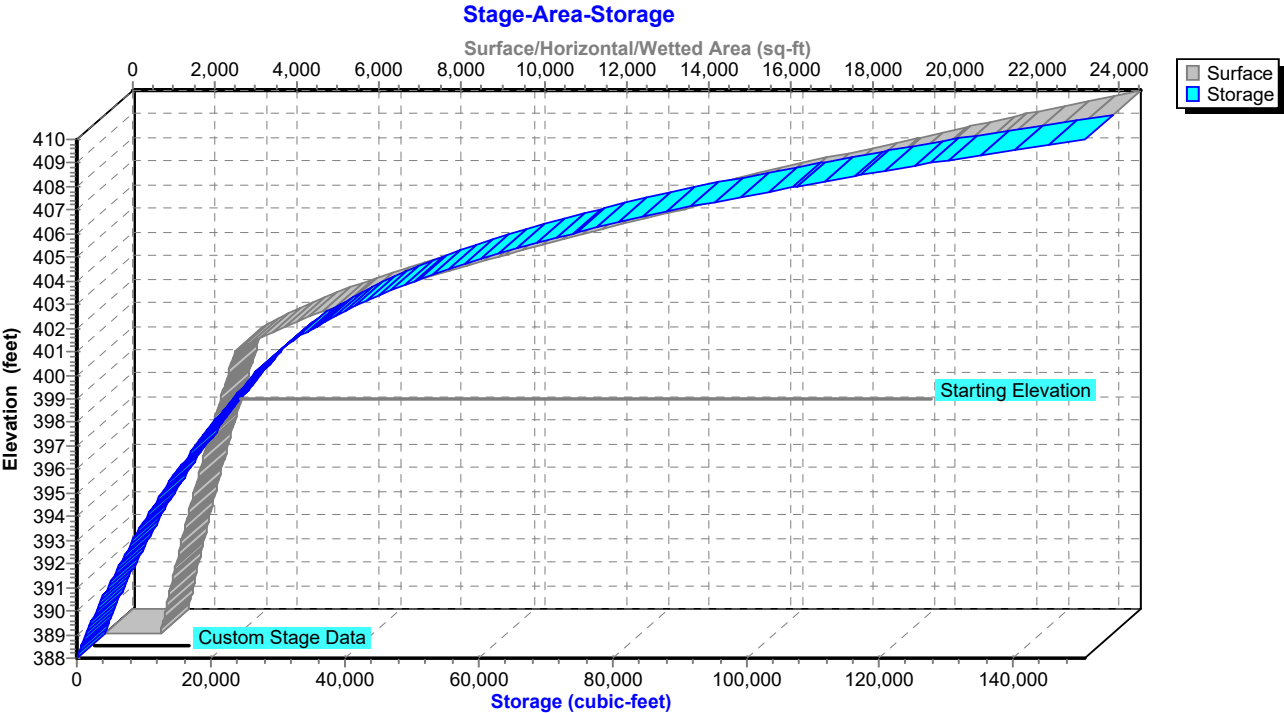

103.0301 - Hydrographs*NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"*

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 41

Stage-Discharge for Pond 4P: Detention Basin A1

Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)
388.00	0.00	398.40	0.00	408.80	8.28
388.20	0.00	398.60	0.05	409.00	16.95
388.40	0.00	398.80	0.13	409.20	34.11
388.60	0.00	399.00	0.17	409.40	48.04
388.80	0.00	399.20	0.20	409.60	66.22
389.00	0.00	399.40	0.22	409.80	86.73
389.20	0.00	399.60	0.25	410.00	111.01
389.40	0.00	399.80	0.27		
389.60	0.00	400.00	0.29		
389.80	0.00	400.20	0.31		
390.00	0.00	400.40	0.33		
390.20	0.00	400.60	0.34		
390.40	0.00	400.80	0.36		
390.60	0.00	401.00	0.37		
390.80	0.00	401.20	0.39		
391.00	0.00	401.40	0.40		
391.20	0.00	401.60	0.42		
391.40	0.00	401.80	0.43		
391.60	0.00	402.00	0.44		
391.80	0.00	402.20	0.45		
392.00	0.00	402.40	0.47		
392.20	0.00	402.60	0.48		
392.40	0.00	402.80	0.49		
392.60	0.00	403.00	0.50		
392.80	0.00	403.20	0.51		
393.00	0.00	403.40	0.52		
393.20	0.00	403.60	0.53		
393.40	0.00	403.80	0.54		
393.60	0.00	404.00	0.55		
393.80	0.00	404.20	0.56		
394.00	0.00	404.40	0.57		
394.20	0.00	404.60	0.58		
394.40	0.00	404.80	0.59		
394.60	0.00	405.00	0.60		
394.80	0.00	405.20	0.61		
395.00	0.00	405.40	0.62		
395.20	0.00	405.60	0.63		
395.40	0.00	405.80	0.64		
395.60	0.00	406.00	0.65		
395.80	0.00	406.20	0.66		
396.00	0.00	406.40	0.66		
396.20	0.00	406.60	0.67		
396.40	0.00	406.80	0.68		
396.60	0.00	407.00	0.69		
396.80	0.00	407.20	0.70		
397.00	0.00	407.40	0.71		
397.20	0.00	407.60	0.71		
397.40	0.00	407.80	0.72		
397.60	0.00	408.00	0.73		
397.80	0.00	408.20	0.74		
398.00	0.00	408.40	0.74		
398.20	0.00	408.60	2.20		

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 42

Stage-Area-Storage for Pond 4P: Detention Basin A1

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
388.00	1,355	0
388.50	1,416	693
389.00	1,478	1,416
389.50	1,541	2,170
390.00	1,605	2,957
390.50	1,671	3,776
391.00	1,739	4,628
391.50	1,807	5,515
392.00	1,877	6,436
392.50	1,948	7,392
393.00	2,021	8,384
393.50	2,095	9,413
394.00	2,170	10,479
394.50	2,247	11,584
395.00	2,324	12,726
395.50	2,404	13,908
396.00	2,484	15,130
396.50	2,566	16,392
397.00	2,649	17,696
397.50	2,734	19,042
398.00	2,819	20,430
398.50	2,907	21,861
399.00	2,995	23,337
399.50	3,085	24,857
400.00	3,176	26,422
400.50	3,763	28,155
401.00	4,400	30,194
401.50	5,087	32,563
402.00	5,824	35,289
402.50	6,680	38,413
403.00	7,594	41,978
403.50	8,567	46,016
404.00	9,598	50,555
404.50	10,641	55,612
405.00	11,739	61,205
405.50	12,890	67,360
406.00	14,095	74,104
406.50	15,274	81,445
407.00	16,501	89,386
407.50	17,775	97,953
408.00	19,096	107,169
408.50	20,387	117,038
409.00	21,720	127,563
409.50	23,095	138,765
410.00	24,513	150,665

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 43

Summary for Pond 6P: Forebay & Bio B1-B

Inflow Area = 0.610 ac, 25.08% Impervious, Inflow Depth = 0.78" for 10-yr event
 Inflow = 0.25 cfs @ 12.28 hrs, Volume= 0.039 af
 Outflow = 0.13 cfs @ 12.75 hrs, Volume= 0.039 af, Atten= 46%, Lag= 28.0 min
 Primary = 0.13 cfs @ 12.75 hrs, Volume= 0.039 af
 Routed to Pond 7P : Detention Basin B1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
 Automatic Starting Elev= 408.50' Surf.Area= 14,636 sf Storage= 43,121 cf
 Peak Elev= 408.52' @ 12.75 hrs Surf.Area= 14,689 sf Storage= 43,421 cf (301 cf above start)

Plug-Flow detention time= (not calculated: initial storage exceeds outflow)

Center-of-Mass det. time= 57.4 min (1,000.2 - 942.7)

Volume	Invert	Avail.Storage	Storage Description	
#1	400.00'	68,054 cf	Custom Stage Data (Conic) Listed below (Recalc)	
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
400.00	713	0	0	713
402.00	1,896	2,514	2,514	1,922
404.00	3,550	5,360	7,875	3,616
406.00	5,471	8,952	16,827	5,594
407.50	12,169	12,900	29,726	12,310
408.00	13,395	6,389	36,115	13,552
410.00	18,691	31,939	68,054	18,924

Device	Routing	Invert	Outlet Devices
#1	Primary	404.99'	18.0" Round Culvert L= 149.6' CPP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 404.99' / 402.00' S= 0.0200 ' / Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 1.77 sf
#2	Device 1	408.50'	36.0" x 48.0" Horiz. OS B1-B C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=0.13 cfs @ 12.75 hrs HW=408.52' TW=405.88' (Dynamic Tailwater)

↑ **1=Culvert** (Passes 0.13 cfs of 13.05 cfs potential flow)

↑ **2=OS B1-B** (Weir Controls 0.13 cfs @ 0.47 fps)

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"


Printed 12/8/2025

Page 44

Pond 6P: Forebay & Bio B1-B

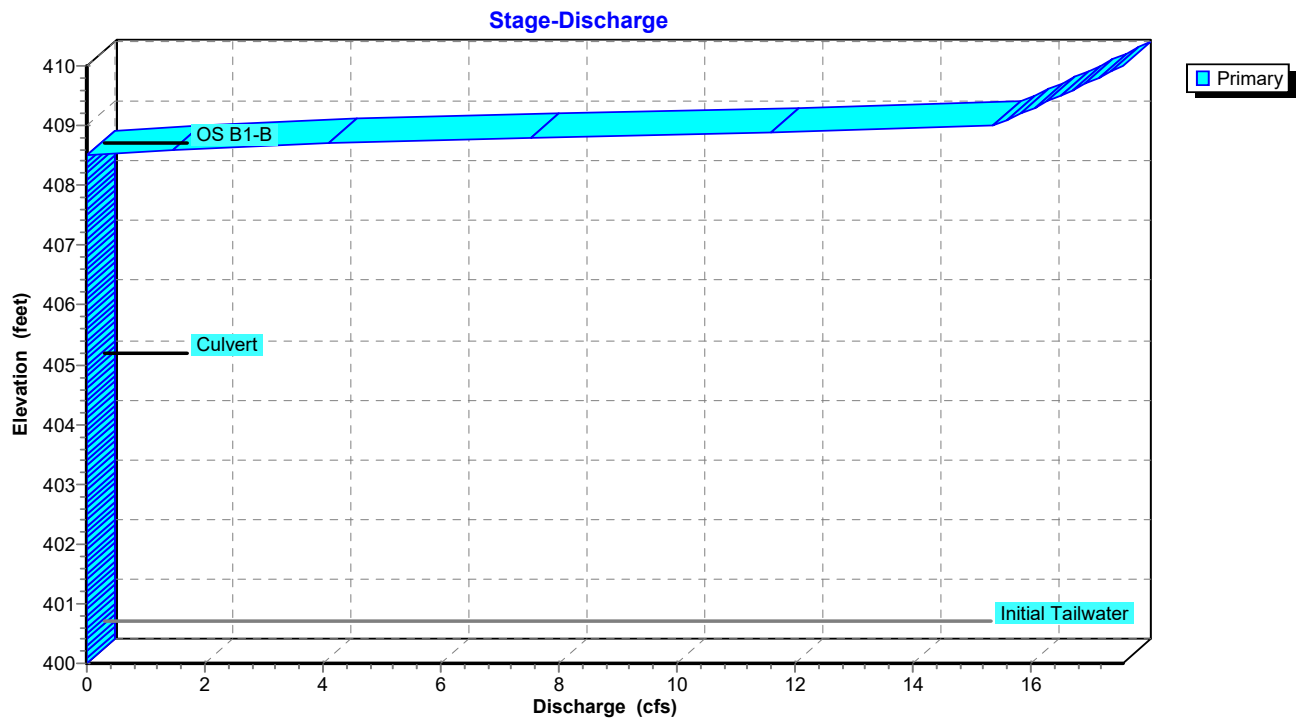

Pond 6P: Forebay & Bio B1-B

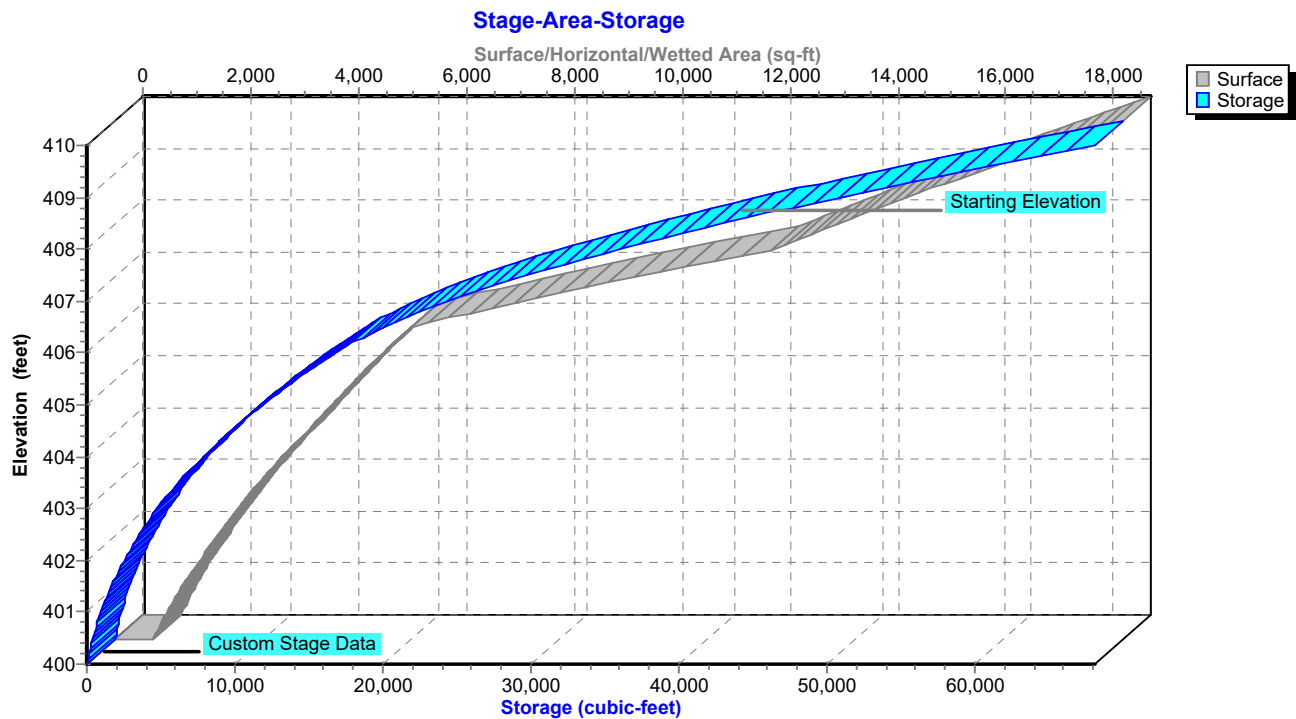

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 45

Stage-Discharge for Pond 6P: Forebay & Bio B1-B

Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)
400.00	0.00	402.60	0.00	405.20	0.00	407.80	0.00
400.05	0.00	402.65	0.00	405.25	0.00	407.85	0.00
400.10	0.00	402.70	0.00	405.30	0.00	407.90	0.00
400.15	0.00	402.75	0.00	405.35	0.00	407.95	0.00
400.20	0.00	402.80	0.00	405.40	0.00	408.00	0.00
400.25	0.00	402.85	0.00	405.45	0.00	408.05	0.00
400.30	0.00	402.90	0.00	405.50	0.00	408.10	0.00
400.35	0.00	402.95	0.00	405.55	0.00	408.15	0.00
400.40	0.00	403.00	0.00	405.60	0.00	408.20	0.00
400.45	0.00	403.05	0.00	405.65	0.00	408.25	0.00
400.50	0.00	403.10	0.00	405.70	0.00	408.30	0.00
400.55	0.00	403.15	0.00	405.75	0.00	408.35	0.00
400.60	0.00	403.20	0.00	405.80	0.00	408.40	0.00
400.65	0.00	403.25	0.00	405.85	0.00	408.45	0.00
400.70	0.00	403.30	0.00	405.90	0.00	408.50	0.00
400.75	0.00	403.35	0.00	405.95	0.00	408.55	0.51
400.80	0.00	403.40	0.00	406.00	0.00	408.60	1.45
400.85	0.00	403.45	0.00	406.05	0.00	408.65	2.66
400.90	0.00	403.50	0.00	406.10	0.00	408.70	4.09
400.95	0.00	403.55	0.00	406.15	0.00	408.75	5.72
401.00	0.00	403.60	0.00	406.20	0.00	408.80	7.52
401.05	0.00	403.65	0.00	406.25	0.00	408.85	9.48
401.10	0.00	403.70	0.00	406.30	0.00	408.90	11.58
401.15	0.00	403.75	0.00	406.35	0.00	408.95	13.82
401.20	0.00	403.80	0.00	406.40	0.00	409.00	15.36
401.25	0.00	403.85	0.00	406.45	0.00	409.05	15.48
401.30	0.00	403.90	0.00	406.50	0.00	409.10	15.60
401.35	0.00	403.95	0.00	406.55	0.00	409.15	15.71
401.40	0.00	404.00	0.00	406.60	0.00	409.20	15.83
401.45	0.00	404.05	0.00	406.65	0.00	409.25	15.94
401.50	0.00	404.10	0.00	406.70	0.00	409.30	16.05
401.55	0.00	404.15	0.00	406.75	0.00	409.35	16.17
401.60	0.00	404.20	0.00	406.80	0.00	409.40	16.28
401.65	0.00	404.25	0.00	406.85	0.00	409.45	16.39
401.70	0.00	404.30	0.00	406.90	0.00	409.50	16.50
401.75	0.00	404.35	0.00	406.95	0.00	409.55	16.61
401.80	0.00	404.40	0.00	407.00	0.00	409.60	16.72
401.85	0.00	404.45	0.00	407.05	0.00	409.65	16.82
401.90	0.00	404.50	0.00	407.10	0.00	409.70	16.93
401.95	0.00	404.55	0.00	407.15	0.00	409.75	17.04
402.00	0.00	404.60	0.00	407.20	0.00	409.80	17.14
402.05	0.00	404.65	0.00	407.25	0.00	409.85	17.25
402.10	0.00	404.70	0.00	407.30	0.00	409.90	17.35
402.15	0.00	404.75	0.00	407.35	0.00	409.95	17.46
402.20	0.00	404.80	0.00	407.40	0.00	410.00	17.56
402.25	0.00	404.85	0.00	407.45	0.00		
402.30	0.00	404.90	0.00	407.50	0.00		
402.35	0.00	404.95	0.00	407.55	0.00		
402.40	0.00	405.00	0.00	407.60	0.00		
402.45	0.00	405.05	0.00	407.65	0.00		
402.50	0.00	405.10	0.00	407.70	0.00		
402.55	0.00	405.15	0.00	407.75	0.00		

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 46

Stage-Area-Storage for Pond 6P: Forebay & Bio B1-B

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
400.00	713	0	405.20	4,653	12,782
400.10	759	74	405.30	4,752	13,252
400.20	806	152	405.40	4,851	13,732
400.30	854	235	405.50	4,952	14,222
400.40	904	323	405.60	5,054	14,722
400.50	956	416	405.70	5,156	15,233
400.60	1,008	514	405.80	5,260	15,754
400.70	1,063	617	405.90	5,365	16,285
400.80	1,118	726	406.00	5,471	16,827
400.90	1,175	841	406.10	5,835	17,392
401.00	1,234	961	406.20	6,211	17,994
401.10	1,293	1,088	406.30	6,599	18,635
401.20	1,355	1,220	406.40	6,999	19,314
401.30	1,417	1,359	406.50	7,410	20,035
401.40	1,482	1,504	406.60	7,833	20,797
401.50	1,547	1,655	406.70	8,268	21,602
401.60	1,614	1,813	406.80	8,714	22,451
401.70	1,682	1,978	406.90	9,173	23,345
401.80	1,752	2,150	407.00	9,643	24,286
401.90	1,823	2,329	407.10	10,125	25,274
402.00	1,896	2,514	407.20	10,618	26,311
402.10	1,966	2,708	407.30	11,123	27,398
402.20	2,038	2,908	407.40	11,640	28,536
402.30	2,111	3,115	407.50	12,169	29,726
402.40	2,186	3,330	407.60	12,409	30,955
402.50	2,261	3,552	407.70	12,652	32,208
402.60	2,338	3,782	407.80	12,898	33,486
402.70	2,416	4,020	407.90	13,145	34,788
402.80	2,496	4,266	408.00	13,395	36,115
402.90	2,577	4,519	408.10	13,639	37,467
403.00	2,659	4,781	408.20	13,885	38,843
403.10	2,742	5,051	408.30	14,133	40,244
403.20	2,827	5,330	408.40	14,384	41,670
403.30	2,913	5,616	408.50	14,636	43,121
403.40	3,000	5,912	408.60	14,891	44,597
403.50	3,088	6,216	408.70	15,148	46,099
403.60	3,178	6,530	408.80	15,408	47,627
403.70	3,269	6,852	408.90	15,669	49,181
403.80	3,361	7,184	409.00	15,933	50,761
403.90	3,455	7,524	409.10	16,199	52,367
404.00	3,550	7,875	409.20	16,467	54,001
404.10	3,636	8,234	409.30	16,737	55,661
404.20	3,723	8,602	409.40	17,010	57,348
404.30	3,812	8,979	409.50	17,284	59,063
404.40	3,901	9,364	409.60	17,561	60,805
404.50	3,991	9,759	409.70	17,840	62,575
404.60	4,083	10,163	409.80	18,122	64,373
404.70	4,175	10,576	409.90	18,405	66,200
404.80	4,269	10,998	410.00	18,691	68,054
404.90	4,363	11,429			
405.00	4,459	11,870			
405.10	4,555	12,321			

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 47

Summary for Pond 7P: Detention Basin B1

Inflow Area = 5.956 ac, 45.33% Impervious, Inflow Depth = 2.94" for 10-yr event
 Inflow = 10.64 cfs @ 12.36 hrs, Volume= 1.460 af
 Outflow = 0.60 cfs @ 16.91 hrs, Volume= 1.450 af, Atten= 94%, Lag= 273.0 min
 Primary = 0.60 cfs @ 16.91 hrs, Volume= 1.450 af
 Routed to Pond PR-B : PR-B

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
 Automatic Starting Elev= 400.50' Surf.Area= 1,825 sf Storage= 806 cf
 Peak Elev= 407.04' @ 16.91 hrs Surf.Area= 10,885 sf Storage= 39,262 cf (38,456 cf above start)

Plug-Flow detention time= 753.0 min calculated for 1.431 af (98% of inflow)
 Center-of-Mass det. time= 725.8 min (1,571.0 - 845.2)

Volume	Invert	Avail.Storage	Storage Description	
#1	400.00'	79,868 cf	Custom Stage Data (Conic) Listed below (Recalc)	
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
400.00	1,408	0	0	1,408
402.00	3,402	4,666	4,666	3,431
404.00	5,985	9,266	13,932	6,058
406.00	9,096	14,973	28,905	9,229
408.00	12,687	21,684	50,588	12,895
410.00	16,684	29,280	79,868	16,983

Device	Routing	Invert	Outlet Devices
#1	Primary	400.00'	18.0" Round Culvert L= 140.0' CPP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 400.00' / 398.00' S= 0.0143 '/' Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 1.77 sf
#2	Device 1	400.50'	3.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#3	Device 1	408.00'	36.0" x 48.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#4	Primary	409.00'	30.0' long + 2.0 ' SideZ x 50.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=0.60 cfs @ 16.91 hrs HW=407.04' TW=0.00' (Dynamic Tailwater)

- 1=Culvert (Passes 0.60 cfs of 21.34 cfs potential flow)
- 2=Orifice/Grate (Orifice Controls 0.60 cfs @ 12.19 fps)
- 3=Orifice/Grate (Controls 0.00 cfs)
- 4=Broad-Crested Rectangular Weir(Controls 0.00 cfs)

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"


Printed 12/8/2025

Page 48

Pond 7P: Detention Basin B1

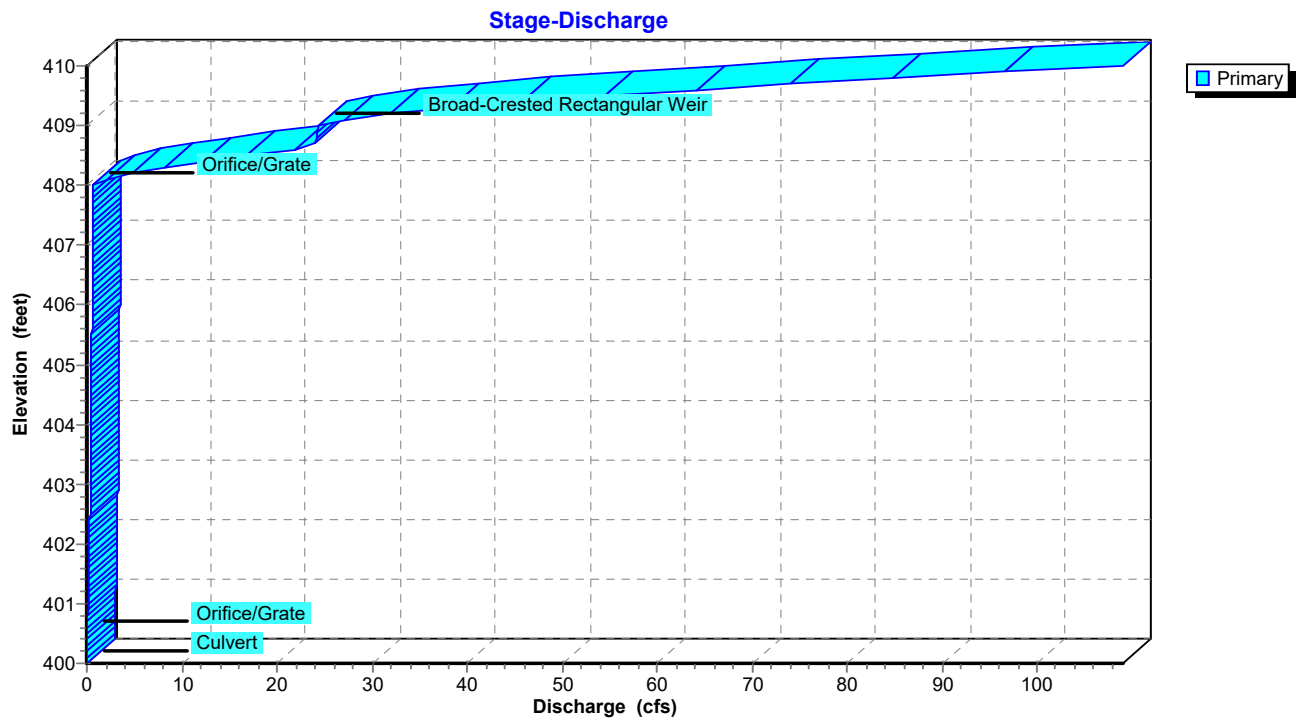

Pond 7P: Detention Basin B1

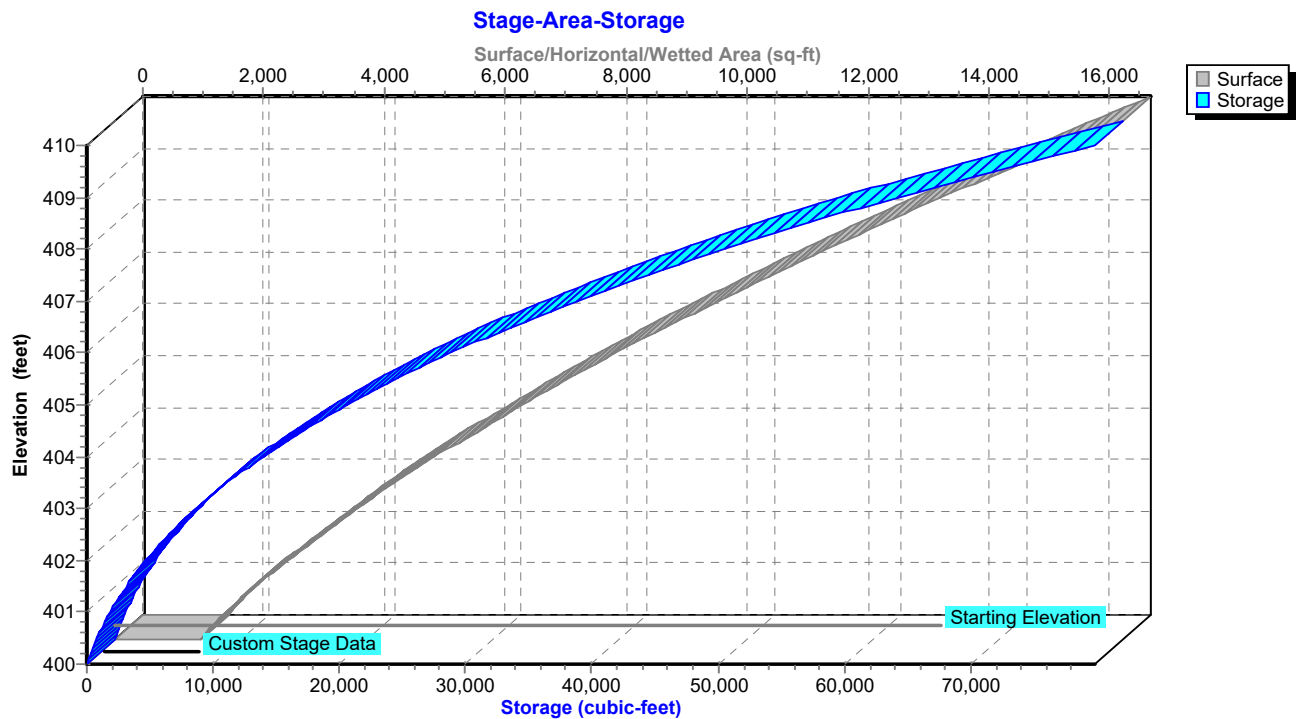

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 49

Stage-Discharge for Pond 7P: Detention Basin B1

Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)
400.00	0.00	402.60	0.33	405.20	0.51	407.80	0.63
400.05	0.00	402.65	0.34	405.25	0.51	407.85	0.64
400.10	0.00	402.70	0.34	405.30	0.51	407.90	0.64
400.15	0.00	402.75	0.34	405.35	0.51	407.95	0.64
400.20	0.00	402.80	0.35	405.40	0.52	408.00	0.64
400.25	0.00	402.85	0.35	405.45	0.52	408.05	1.16
400.30	0.00	402.90	0.36	405.50	0.52	408.10	2.09
400.35	0.00	402.95	0.36	405.55	0.52	408.15	3.31
400.40	0.00	403.00	0.36	405.60	0.53	408.20	4.75
400.45	0.00	403.05	0.37	405.65	0.53	408.25	6.38
400.50	0.00	403.10	0.37	405.70	0.53	408.30	8.18
400.55	0.01	403.15	0.38	405.75	0.54	408.35	10.14
400.60	0.02	403.20	0.38	405.80	0.54	408.40	12.24
400.65	0.04	403.25	0.38	405.85	0.54	408.45	14.48
400.70	0.06	403.30	0.39	405.90	0.54	408.50	16.85
400.75	0.08	403.35	0.39	405.95	0.55	408.55	19.34
400.80	0.10	403.40	0.39	406.00	0.55	408.60	21.94
400.85	0.11	403.45	0.40	406.05	0.55	408.65	23.92
400.90	0.12	403.50	0.40	406.10	0.55	408.70	23.99
400.95	0.13	403.55	0.40	406.15	0.56	408.75	24.07
401.00	0.14	403.60	0.41	406.20	0.56	408.80	24.14
401.05	0.15	403.65	0.41	406.25	0.56	408.85	24.22
401.10	0.16	403.70	0.41	406.30	0.56	408.90	24.29
401.15	0.17	403.75	0.42	406.35	0.57	408.95	24.37
401.20	0.18	403.80	0.42	406.40	0.57	409.00	24.44
401.25	0.19	403.85	0.42	406.45	0.57	409.05	25.41
401.30	0.19	403.90	0.43	406.50	0.57	409.10	27.14
401.35	0.20	403.95	0.43	406.55	0.58	409.15	29.37
401.40	0.21	404.00	0.43	406.60	0.58	409.20	32.00
401.45	0.21	404.05	0.44	406.65	0.58	409.25	35.01
401.50	0.22	404.10	0.44	406.70	0.58	409.30	38.35
401.55	0.23	404.15	0.44	406.75	0.58	409.35	42.01
401.60	0.23	404.20	0.45	406.80	0.59	409.40	45.95
401.65	0.24	404.25	0.45	406.85	0.59	409.45	50.14
401.70	0.25	404.30	0.45	406.90	0.59	409.50	54.57
401.75	0.25	404.35	0.46	406.95	0.59	409.55	59.25
401.80	0.26	404.40	0.46	407.00	0.60	409.60	64.16
401.85	0.26	404.45	0.46	407.05	0.60	409.65	69.06
401.90	0.27	404.50	0.47	407.10	0.60	409.70	74.12
401.95	0.27	404.55	0.47	407.15	0.60	409.75	79.33
402.00	0.28	404.60	0.47	407.20	0.61	409.80	84.69
402.05	0.28	404.65	0.47	407.25	0.61	409.85	90.49
402.10	0.29	404.70	0.48	407.30	0.61	409.90	96.47
402.15	0.29	404.75	0.48	407.35	0.61	409.95	102.64
402.20	0.30	404.80	0.48	407.40	0.62	410.00	108.99
402.25	0.30	404.85	0.49	407.45	0.62		
402.30	0.31	404.90	0.49	407.50	0.62		
402.35	0.31	404.95	0.49	407.55	0.62		
402.40	0.31	405.00	0.49	407.60	0.62		
402.45	0.32	405.05	0.50	407.65	0.63		
402.50	0.32	405.10	0.50	407.70	0.63		
402.55	0.33	405.15	0.50	407.75	0.63		

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 50

Stage-Area-Storage for Pond 7P: Detention Basin B1

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
400.00	1,408	0	405.20	7,774	22,164
400.10	1,487	145	405.30	7,933	22,949
400.20	1,568	298	405.40	8,095	23,751
400.30	1,652	459	405.50	8,257	24,568
400.40	1,738	628	405.60	8,422	25,402
400.50	1,825	806	405.70	8,588	26,253
400.60	1,915	993	405.80	8,756	27,120
400.70	2,007	1,189	405.90	8,925	28,004
400.80	2,102	1,395	406.00	9,096	28,905
400.90	2,198	1,610	406.10	9,261	29,823
401.00	2,297	1,834	406.20	9,428	30,757
401.10	2,398	2,069	406.30	9,597	31,708
401.20	2,501	2,314	406.40	9,767	32,677
401.30	2,606	2,569	406.50	9,938	33,662
401.40	2,713	2,835	406.60	10,111	34,664
401.50	2,822	3,112	406.70	10,285	35,684
401.60	2,934	3,400	406.80	10,461	36,721
401.70	3,048	3,699	406.90	10,638	37,776
401.80	3,164	4,009	407.00	10,817	38,849
401.90	3,282	4,332	407.10	10,997	39,940
402.00	3,402	4,666	407.20	11,179	41,048
402.10	3,514	5,012	407.30	11,362	42,175
402.20	3,628	5,369	407.40	11,547	43,321
402.30	3,743	5,737	407.50	11,733	44,485
402.40	3,861	6,117	407.60	11,921	45,668
402.50	3,980	6,509	407.70	12,110	46,869
402.60	4,101	6,913	407.80	12,301	48,090
402.70	4,224	7,330	407.90	12,493	49,329
402.80	4,348	7,758	408.00	12,687	50,588
402.90	4,475	8,199	408.10	12,874	51,867
403.00	4,603	8,653	408.20	13,062	53,163
403.10	4,733	9,120	408.30	13,252	54,479
403.20	4,865	9,600	408.40	13,443	55,814
403.30	4,999	10,093	408.50	13,635	57,168
403.40	5,134	10,600	408.60	13,829	58,541
403.50	5,271	11,120	408.70	14,024	59,933
403.60	5,410	11,654	408.80	14,220	61,346
403.70	5,551	12,202	408.90	14,418	62,777
403.80	5,694	12,764	409.00	14,617	64,229
403.90	5,839	13,341	409.10	14,818	65,701
404.00	5,985	13,932	409.20	15,020	67,193
404.10	6,125	14,537	409.30	15,223	68,705
404.20	6,267	15,157	409.40	15,428	70,237
404.30	6,410	15,791	409.50	15,634	71,790
404.40	6,555	16,439	409.60	15,841	73,364
404.50	6,702	17,102	409.70	16,050	74,959
404.60	6,850	17,780	409.80	16,260	76,574
404.70	7,000	18,472	409.90	16,471	78,211
404.80	7,152	19,180	410.00	16,684	79,868
404.90	7,305	19,902			
405.00	7,459	20,641			
405.10	7,616	21,394			

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 51

Summary for Pond PR-A: PR-A

Inflow Area = 37.077 ac, 36.24% Impervious, Inflow Depth > 2.36" for 10-yr event
Inflow = 46.77 cfs @ 12.24 hrs, Volume= 7.299 af
Primary = 46.77 cfs @ 12.24 hrs, Volume= 7.299 af, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 10-yr Rainfall=4.69"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 52

Summary for Pond PR-B: PR-B

Inflow Area = 17.738 ac, 22.72% Impervious, Inflow Depth > 1.77" for 10-yr event
Inflow = 9.53 cfs @ 12.26 hrs, Volume= 2.615 af
Primary = 9.53 cfs @ 12.26 hrs, Volume= 2.615 af, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 53

Summary for Pond 1P: Forebay & Bio A1-A

Inflow Area = 4.969 ac, 55.48% Impervious, Inflow Depth = 7.05" for 100-yr event
 Inflow = 22.90 cfs @ 12.26 hrs, Volume= 2.920 af
 Outflow = 22.25 cfs @ 12.30 hrs, Volume= 2.920 af, Atten= 3%, Lag= 2.5 min
 Primary = 22.25 cfs @ 12.30 hrs, Volume= 2.920 af
 Routed to Pond 4P : Detention Basin A1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
 Automatic Starting Elev= 408.50' Surf.Area= 18,385 sf Storage= 66,328 cf
 Peak Elev= 409.00' @ 12.73 hrs Surf.Area= 18,745 sf Storage= 75,659 cf (9,331 cf above start)

Plug-Flow detention time= 323.9 min calculated for 1.397 af (48% of inflow)
 Center-of-Mass det. time= 17.3 min (812.6 - 795.3)

Volume	Invert	Avail.Storage	Storage Description	
#1	400.00'	94,716 cf	Custom Stage Data (Conic) Listed below (Recalc)	
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
400.00	2,093	0	0	2,093
402.00	3,854	5,858	5,858	3,895
404.00	5,993	9,769	15,627	6,090
406.00	8,501	14,421	30,048	8,669
407.50	16,634	18,513	48,561	16,824
408.00	18,030	8,664	57,225	18,239
410.00	19,471	37,492	94,716	19,977

Device	Routing	Invert	Outlet Devices								
#1	Primary	408.50'	50.0' long + 4.0 ' SideZ x 31.0' breadth Broad-Crested Rectangular Weir								
			Head (feet)	0.20	0.40	0.60	0.80	1.00	1.20	1.40	1.60
			Coef. (English)	2.68	2.70	2.70	2.64	2.63	2.64	2.64	2.63

Primary OutFlow Max=22.25 cfs @ 12.30 hrs HW=408.80' TW=408.10' (Dynamic Tailwater)
 ↑1=**Broad-Crested Rectangular Weir**(Weir Controls 22.25 cfs @ 1.46 fps)

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"


Printed 12/8/2025

Page 54

Pond 1P: Forebay & Bio A1-A

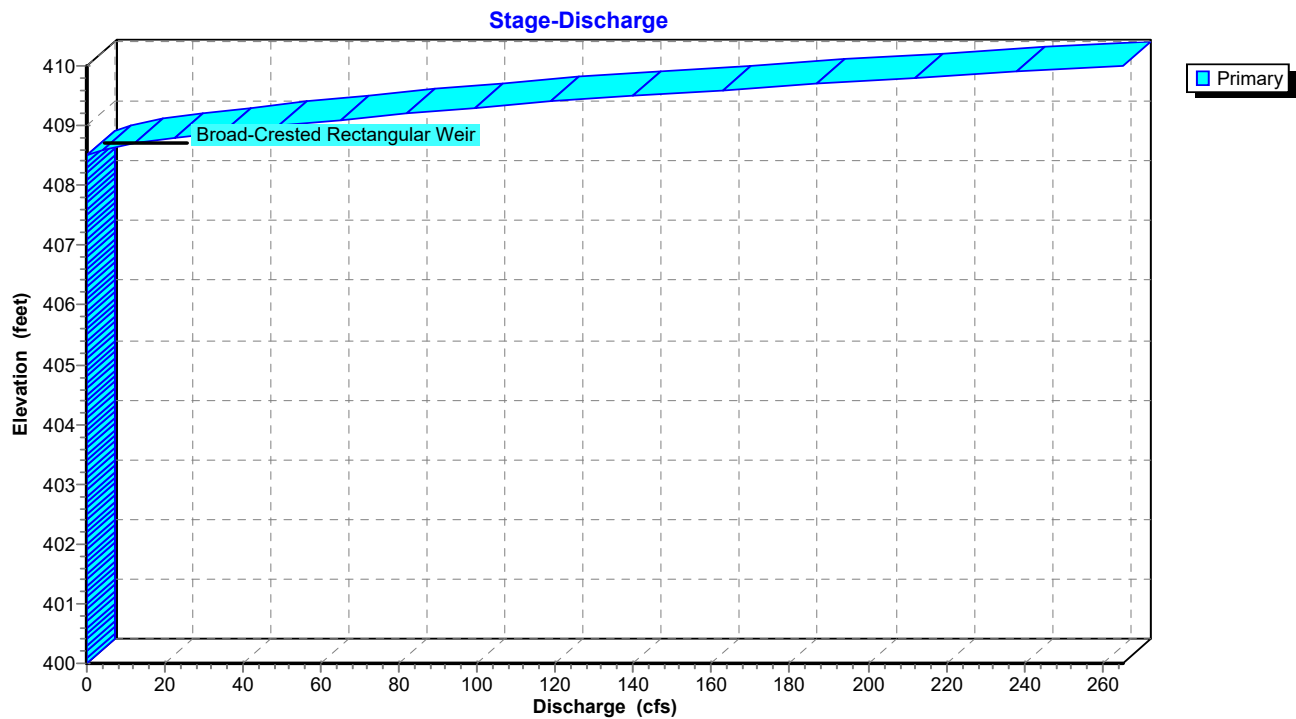

Pond 1P: Forebay & Bio A1-A

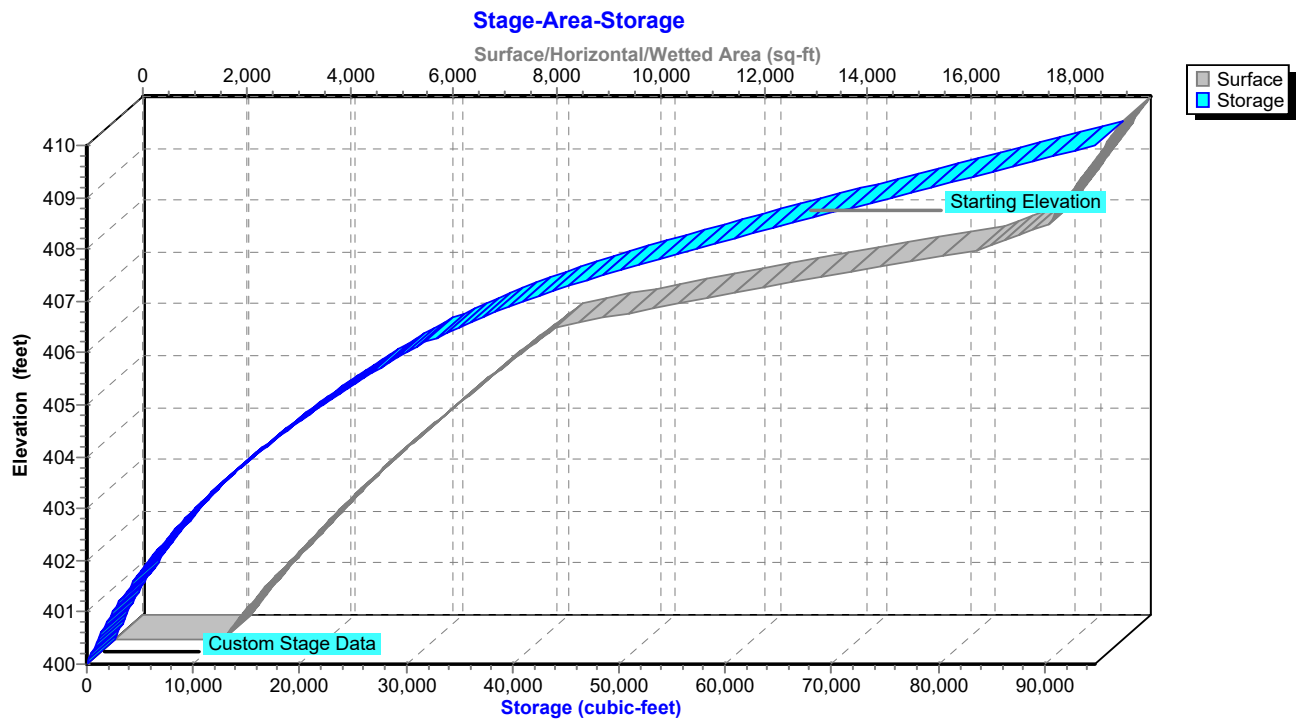

103.0301 - Hydrographs*NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"*

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 55

Stage-Discharge for Pond 1P: Forebay & Bio A1-A

Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)
400.00	0.00	402.60	0.00	405.20	0.00	407.80	0.00
400.05	0.00	402.65	0.00	405.25	0.00	407.85	0.00
400.10	0.00	402.70	0.00	405.30	0.00	407.90	0.00
400.15	0.00	402.75	0.00	405.35	0.00	407.95	0.00
400.20	0.00	402.80	0.00	405.40	0.00	408.00	0.00
400.25	0.00	402.85	0.00	405.45	0.00	408.05	0.00
400.30	0.00	402.90	0.00	405.50	0.00	408.10	0.00
400.35	0.00	402.95	0.00	405.55	0.00	408.15	0.00
400.40	0.00	403.00	0.00	405.60	0.00	408.20	0.00
400.45	0.00	403.05	0.00	405.65	0.00	408.25	0.00
400.50	0.00	403.10	0.00	405.70	0.00	408.30	0.00
400.55	0.00	403.15	0.00	405.75	0.00	408.35	0.00
400.60	0.00	403.20	0.00	405.80	0.00	408.40	0.00
400.65	0.00	403.25	0.00	405.85	0.00	408.45	0.00
400.70	0.00	403.30	0.00	405.90	0.00	408.50	0.00
400.75	0.00	403.35	0.00	405.95	0.00	408.55	1.50
400.80	0.00	403.40	0.00	406.00	0.00	408.60	4.26
400.85	0.00	403.45	0.00	406.05	0.00	408.65	7.86
400.90	0.00	403.50	0.00	406.10	0.00	408.70	12.14
400.95	0.00	403.55	0.00	406.15	0.00	408.75	17.05
401.00	0.00	403.60	0.00	406.20	0.00	408.80	22.52
401.05	0.00	403.65	0.00	406.25	0.00	408.85	28.53
401.10	0.00	403.70	0.00	406.30	0.00	408.90	35.03
401.15	0.00	403.75	0.00	406.35	0.00	408.95	41.93
401.20	0.00	403.80	0.00	406.40	0.00	409.00	49.26
401.25	0.00	403.85	0.00	406.45	0.00	409.05	57.00
401.30	0.00	403.90	0.00	406.50	0.00	409.10	65.15
401.35	0.00	403.95	0.00	406.55	0.00	409.15	73.28
401.40	0.00	404.00	0.00	406.60	0.00	409.20	81.69
401.45	0.00	404.05	0.00	406.65	0.00	409.25	90.36
401.50	0.00	404.10	0.00	406.70	0.00	409.30	99.29
401.55	0.00	404.15	0.00	406.75	0.00	409.35	108.97
401.60	0.00	404.20	0.00	406.80	0.00	409.40	118.97
401.65	0.00	404.25	0.00	406.85	0.00	409.45	129.29
401.70	0.00	404.30	0.00	406.90	0.00	409.50	139.92
401.75	0.00	404.35	0.00	406.95	0.00	409.55	151.14
401.80	0.00	404.40	0.00	407.00	0.00	409.60	162.70
401.85	0.00	404.45	0.00	407.05	0.00	409.65	174.60
401.90	0.00	404.50	0.00	407.10	0.00	409.70	186.84
401.95	0.00	404.55	0.00	407.15	0.00	409.75	199.23
402.00	0.00	404.60	0.00	407.20	0.00	409.80	211.93
402.05	0.00	404.65	0.00	407.25	0.00	409.85	224.94
402.10	0.00	404.70	0.00	407.30	0.00	409.90	238.25
402.15	0.00	404.75	0.00	407.35	0.00	409.95	251.63
402.20	0.00	404.80	0.00	407.40	0.00	410.00	265.28
402.25	0.00	404.85	0.00	407.45	0.00		
402.30	0.00	404.90	0.00	407.50	0.00		
402.35	0.00	404.95	0.00	407.55	0.00		
402.40	0.00	405.00	0.00	407.60	0.00		
402.45	0.00	405.05	0.00	407.65	0.00		
402.50	0.00	405.10	0.00	407.70	0.00		
402.55	0.00	405.15	0.00	407.75	0.00		

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 56

Stage-Area-Storage for Pond 1P: Forebay & Bio A1-A

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
400.00	2,093	0	405.20	7,445	23,674
400.10	2,168	213	405.30	7,573	24,425
400.20	2,245	434	405.40	7,703	25,189
400.30	2,323	662	405.50	7,833	25,965
400.40	2,403	898	405.60	7,964	26,755
400.50	2,483	1,143	405.70	8,097	27,558
400.60	2,565	1,395	405.80	8,231	28,375
400.70	2,649	1,656	405.90	8,365	29,205
400.80	2,733	1,925	406.00	8,501	30,048
400.90	2,819	2,202	406.10	8,959	30,921
401.00	2,907	2,489	406.20	9,429	31,840
401.10	2,996	2,784	406.30	9,911	32,807
401.20	3,086	3,088	406.40	10,405	33,823
401.30	3,177	3,401	406.50	10,912	34,888
401.40	3,270	3,723	406.60	11,430	36,005
401.50	3,364	4,055	406.70	11,960	37,175
401.60	3,459	4,396	406.80	12,502	38,398
401.70	3,556	4,747	406.90	13,056	39,676
401.80	3,654	5,107	407.00	13,623	41,009
401.90	3,753	5,478	407.10	14,201	42,401
402.00	3,854	5,858	407.20	14,791	43,850
402.10	3,950	6,248	407.30	15,393	45,359
402.20	4,047	6,648	407.40	16,008	46,929
402.30	4,145	7,058	407.50	16,634	48,561
402.40	4,244	7,477	407.60	16,909	50,238
402.50	4,345	7,907	407.70	17,186	51,943
402.60	4,446	8,346	407.80	17,465	53,675
402.70	4,549	8,796	407.90	17,746	55,436
402.80	4,653	9,256	408.00	18,030	57,225
402.90	4,758	9,727	408.10	18,101	59,031
403.00	4,865	10,208	408.20	18,172	60,845
403.10	4,972	10,699	408.30	18,243	62,666
403.20	5,081	11,202	408.40	18,314	64,493
403.30	5,191	11,716	408.50	18,385	66,328
403.40	5,302	12,240	408.60	18,456	68,170
403.50	5,414	12,776	408.70	18,528	70,020
403.60	5,528	13,323	408.80	18,600	71,876
403.70	5,642	13,882	408.90	18,672	73,740
403.80	5,758	14,452	409.00	18,744	75,610
403.90	5,875	15,033	409.10	18,816	77,488
404.00	5,993	15,627	409.20	18,888	79,373
404.10	6,108	16,232	409.30	18,960	81,266
404.20	6,224	16,848	409.40	19,033	83,166
404.30	6,341	17,477	409.50	19,106	85,072
404.40	6,460	18,117	409.60	19,178	86,987
404.50	6,579	18,769	409.70	19,251	88,908
404.60	6,699	19,432	409.80	19,324	90,837
404.70	6,821	20,109	409.90	19,398	92,773
404.80	6,944	20,797	410.00	19,471	94,716
404.90	7,067	21,497			
405.00	7,192	22,210			
405.10	7,318	22,936			

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 57

Summary for Pond 2P: Forebay & Bio A1-B

Inflow Area = 4.432 ac, 51.17% Impervious, Inflow Depth = 6.93" for 100-yr event
 Inflow = 20.50 cfs @ 12.24 hrs, Volume= 2.560 af
 Outflow = 19.78 cfs @ 12.29 hrs, Volume= 2.560 af, Atten= 3%, Lag= 3.2 min
 Primary = 19.78 cfs @ 12.29 hrs, Volume= 2.560 af
 Routed to Pond 4P : Detention Basin A1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
 Automatic Starting Elev= 408.50' Surf.Area= 19,240 sf Storage= 72,229 cf
 Peak Elev= 409.00' @ 12.74 hrs Surf.Area= 20,579 sf Storage= 82,211 cf (9,981 cf above start)

Plug-Flow detention time= 426.6 min calculated for 0.902 af (35% of inflow)
 Center-of-Mass det. time= 20.3 min (818.8 - 798.5)

Volume	Invert	Avail.Storage	Storage Description	
#1	400.00'	104,144 cf	Custom Stage Data (Conic) Listed below (Recalc)	
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
400.00	3,314	0	0	3,314
402.00	4,891	8,154	8,154	4,954
404.00	6,756	11,597	19,751	6,896
406.00	8,917	15,623	35,374	9,146
407.50	16,689	18,903	54,277	16,940
408.00	17,949	8,658	62,934	18,222
410.00	23,380	41,210	104,144	23,747

Device	Routing	Invert	Outlet Devices								
#1	Primary	408.50'	50.0' long + 4.0 ' SideZ x 31.0' breadth Broad-Crested Rectangular Weir								
			Head (feet)	0.20	0.40	0.60	0.80	1.00	1.20	1.40	1.60
			Coef. (English)	2.68	2.70	2.70	2.64	2.63	2.64	2.64	2.63

Primary OutFlow Max=19.78 cfs @ 12.29 hrs HW=408.78' TW=408.07' (Dynamic Tailwater)
 ↑1=**Broad-Crested Rectangular Weir**(Weir Controls 19.78 cfs @ 1.40 fps)

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"


Printed 12/8/2025

Page 58

Pond 2P: Forebay & Bio A1-B

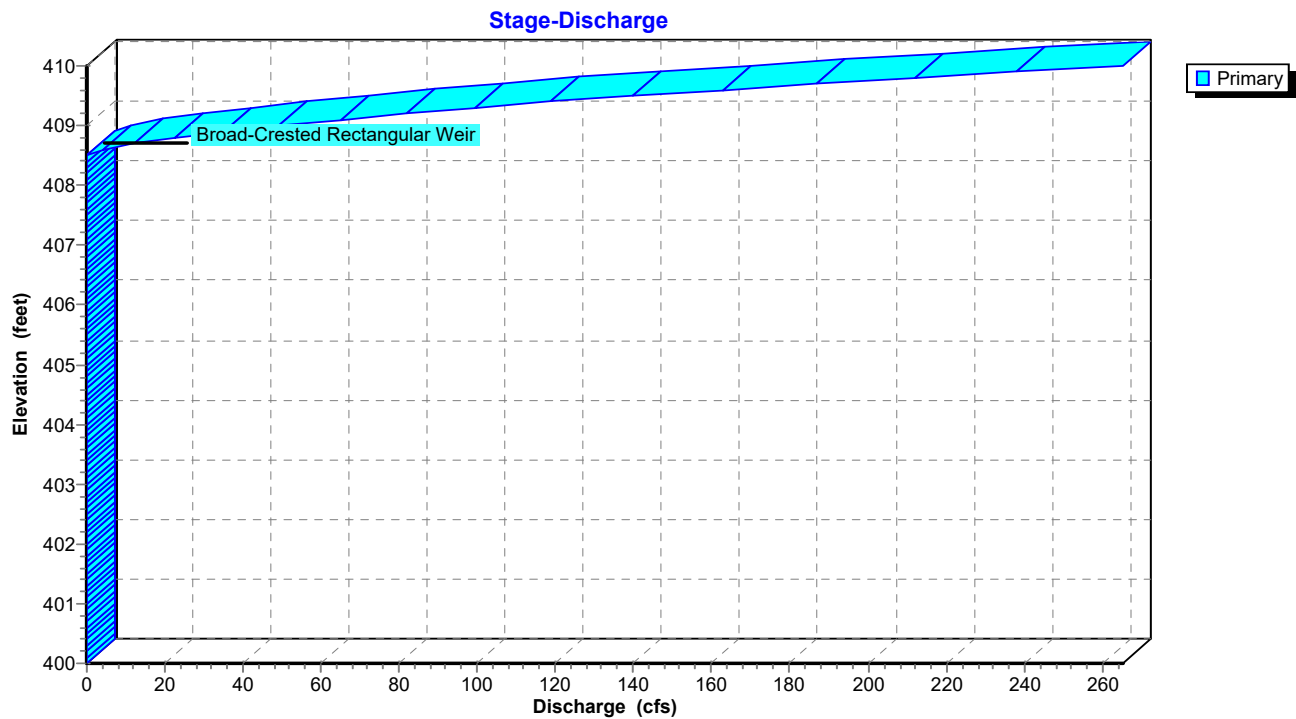

Pond 2P: Forebay & Bio A1-B

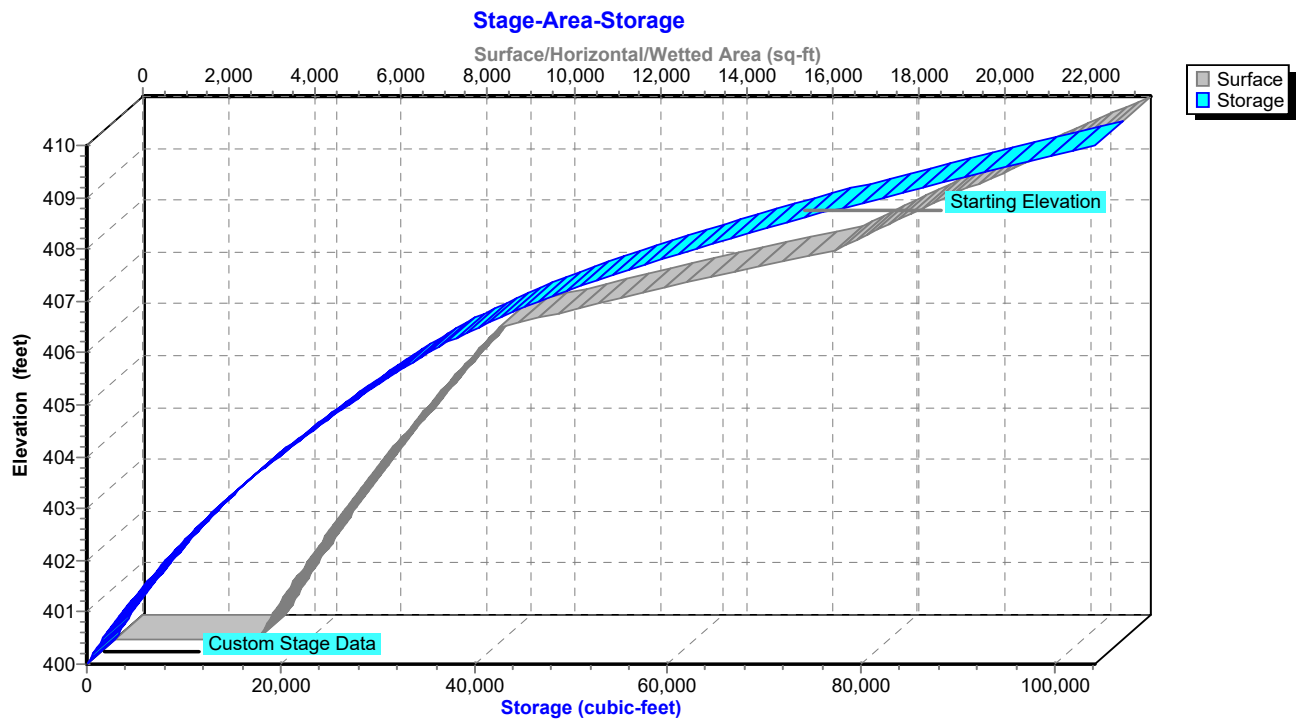

103.0301 - Hydrographs*NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"*

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 59

Stage-Discharge for Pond 2P: Forebay & Bio A1-B

Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)
400.00	0.00	402.60	0.00	405.20	0.00	407.80	0.00
400.05	0.00	402.65	0.00	405.25	0.00	407.85	0.00
400.10	0.00	402.70	0.00	405.30	0.00	407.90	0.00
400.15	0.00	402.75	0.00	405.35	0.00	407.95	0.00
400.20	0.00	402.80	0.00	405.40	0.00	408.00	0.00
400.25	0.00	402.85	0.00	405.45	0.00	408.05	0.00
400.30	0.00	402.90	0.00	405.50	0.00	408.10	0.00
400.35	0.00	402.95	0.00	405.55	0.00	408.15	0.00
400.40	0.00	403.00	0.00	405.60	0.00	408.20	0.00
400.45	0.00	403.05	0.00	405.65	0.00	408.25	0.00
400.50	0.00	403.10	0.00	405.70	0.00	408.30	0.00
400.55	0.00	403.15	0.00	405.75	0.00	408.35	0.00
400.60	0.00	403.20	0.00	405.80	0.00	408.40	0.00
400.65	0.00	403.25	0.00	405.85	0.00	408.45	0.00
400.70	0.00	403.30	0.00	405.90	0.00	408.50	0.00
400.75	0.00	403.35	0.00	405.95	0.00	408.55	1.50
400.80	0.00	403.40	0.00	406.00	0.00	408.60	4.26
400.85	0.00	403.45	0.00	406.05	0.00	408.65	7.86
400.90	0.00	403.50	0.00	406.10	0.00	408.70	12.14
400.95	0.00	403.55	0.00	406.15	0.00	408.75	17.05
401.00	0.00	403.60	0.00	406.20	0.00	408.80	22.52
401.05	0.00	403.65	0.00	406.25	0.00	408.85	28.53
401.10	0.00	403.70	0.00	406.30	0.00	408.90	35.03
401.15	0.00	403.75	0.00	406.35	0.00	408.95	41.93
401.20	0.00	403.80	0.00	406.40	0.00	409.00	49.26
401.25	0.00	403.85	0.00	406.45	0.00	409.05	57.00
401.30	0.00	403.90	0.00	406.50	0.00	409.10	65.15
401.35	0.00	403.95	0.00	406.55	0.00	409.15	73.28
401.40	0.00	404.00	0.00	406.60	0.00	409.20	81.69
401.45	0.00	404.05	0.00	406.65	0.00	409.25	90.36
401.50	0.00	404.10	0.00	406.70	0.00	409.30	99.29
401.55	0.00	404.15	0.00	406.75	0.00	409.35	108.97
401.60	0.00	404.20	0.00	406.80	0.00	409.40	118.97
401.65	0.00	404.25	0.00	406.85	0.00	409.45	129.29
401.70	0.00	404.30	0.00	406.90	0.00	409.50	139.92
401.75	0.00	404.35	0.00	406.95	0.00	409.55	151.14
401.80	0.00	404.40	0.00	407.00	0.00	409.60	162.70
401.85	0.00	404.45	0.00	407.05	0.00	409.65	174.60
401.90	0.00	404.50	0.00	407.10	0.00	409.70	186.84
401.95	0.00	404.55	0.00	407.15	0.00	409.75	199.23
402.00	0.00	404.60	0.00	407.20	0.00	409.80	211.93
402.05	0.00	404.65	0.00	407.25	0.00	409.85	224.94
402.10	0.00	404.70	0.00	407.30	0.00	409.90	238.25
402.15	0.00	404.75	0.00	407.35	0.00	409.95	251.63
402.20	0.00	404.80	0.00	407.40	0.00	410.00	265.28
402.25	0.00	404.85	0.00	407.45	0.00		
402.30	0.00	404.90	0.00	407.50	0.00		
402.35	0.00	404.95	0.00	407.55	0.00		
402.40	0.00	405.00	0.00	407.60	0.00		
402.45	0.00	405.05	0.00	407.65	0.00		
402.50	0.00	405.10	0.00	407.70	0.00		
402.55	0.00	405.15	0.00	407.75	0.00		

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 60

Stage-Area-Storage for Pond 2P: Forebay & Bio A1-B

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
400.00	3,314	0	405.20	8,017	28,604
400.10	3,386	335	405.30	8,127	29,411
400.20	3,458	677	405.40	8,237	30,229
400.30	3,531	1,027	405.50	8,349	31,058
400.40	3,605	1,383	405.60	8,461	31,899
400.50	3,680	1,748	405.70	8,574	32,751
400.60	3,755	2,119	405.80	8,687	33,614
400.70	3,831	2,499	405.90	8,802	34,488
400.80	3,908	2,886	406.00	8,917	35,374
400.90	3,986	3,280	406.10	9,360	36,288
401.00	4,064	3,683	406.20	9,814	37,246
401.10	4,143	4,093	406.30	10,278	38,251
401.20	4,223	4,511	406.40	10,753	39,302
401.30	4,304	4,938	406.50	11,239	40,402
401.40	4,386	5,372	406.60	11,736	41,551
401.50	4,468	5,815	406.70	12,243	42,749
401.60	4,551	6,266	406.80	12,761	44,000
401.70	4,635	6,725	406.90	13,290	45,302
401.80	4,720	7,193	407.00	13,830	46,658
401.90	4,805	7,669	407.10	14,380	48,068
402.00	4,891	8,154	407.20	14,941	49,534
402.10	4,977	8,647	407.30	15,513	51,057
402.20	5,064	9,149	407.40	16,096	52,637
402.30	5,152	9,660	407.50	16,689	54,277
402.40	5,240	10,180	407.60	16,937	55,958
402.50	5,329	10,708	407.70	17,187	57,664
402.60	5,419	11,246	407.80	17,439	59,395
402.70	5,510	11,792	407.90	17,693	61,152
402.80	5,601	12,348	408.00	17,949	62,934
402.90	5,693	12,912	408.10	18,204	64,742
403.00	5,786	13,486	408.20	18,460	66,575
403.10	5,880	14,069	408.30	18,718	68,434
403.20	5,974	14,662	408.40	18,978	70,319
403.30	6,069	15,264	408.50	19,240	72,229
403.40	6,165	15,876	408.60	19,503	74,166
403.50	6,262	16,497	408.70	19,768	76,130
403.60	6,359	17,128	408.80	20,035	78,120
403.70	6,457	17,769	408.90	20,304	80,137
403.80	6,556	18,420	409.00	20,575	82,181
403.90	6,656	19,080	409.10	20,847	84,252
404.00	6,756	19,751	409.20	21,122	86,351
404.10	6,857	20,432	409.30	21,398	88,477
404.20	6,959	21,122	409.40	21,675	90,630
404.30	7,061	21,823	409.50	21,955	92,812
404.40	7,164	22,535	409.60	22,236	95,021
404.50	7,268	23,256	409.70	22,520	97,259
404.60	7,373	23,988	409.80	22,805	99,525
404.70	7,478	24,731	409.90	23,091	101,820
404.80	7,584	25,484	410.00	23,380	104,144
404.90	7,691	26,248			
405.00	7,799	27,022			
405.10	7,908	27,808			

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 61

Summary for Pond 3P: Forebay & Bio B1-A

Inflow Area = 4.885 ac, 52.14% Impervious, Inflow Depth = 6.93" for 100-yr event
 Inflow = 22.28 cfs @ 12.26 hrs, Volume= 2.822 af
 Outflow = 14.85 cfs @ 12.19 hrs, Volume= 2.822 af, Atten= 33%, Lag= 0.0 min
 Primary = 14.85 cfs @ 12.19 hrs, Volume= 2.822 af
 Routed to Pond 7P : Detention Basin B1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
 Automatic Starting Elev= 408.50' Surf.Area= 16,412 sf Storage= 58,221 cf
 Peak Elev= 409.39' @ 12.67 hrs Surf.Area= 18,746 sf Storage= 73,813 cf (15,592 cf above start)

Plug-Flow detention time= 291.6 min calculated for 1.485 af (53% of inflow)
 Center-of-Mass det. time= 20.2 min (819.2 - 799.1)

Volume	Invert	Avail.Storage	Storage Description	
#1	400.00'	85,810 cf	Custom Stage Data (Conic) Listed below (Recalc)	
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
400.00	2,277	0	0	2,277
402.00	3,680	5,901	5,901	3,732
404.00	5,342	8,971	14,872	5,460
406.00	7,258	12,551	27,423	7,456
407.50	13,943	15,630	43,053	14,163
408.00	15,166	7,275	50,328	15,405
410.00	20,447	35,482	85,810	20,769

Device	Routing	Invert	Outlet Devices
#1	Primary	404.03'	18.0" Round Culvert L= 101.6' CMP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 404.03' / 402.00' S= 0.0200 ' / Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 1.77 sf
#2	Device 1	408.50'	36.0" x 48.0" Horiz. OS B1-A C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=14.70 cfs @ 12.19 hrs HW=408.98' TW=406.00' (Dynamic Tailwater)

↑ **1=Culvert** (Inlet Controls 14.70 cfs @ 8.32 fps)

↑ **2=OS B1-A** (Passes 14.70 cfs of 15.34 cfs potential flow)

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"


Printed 12/8/2025

Page 62

Pond 3P: Forebay & Bio B1-A

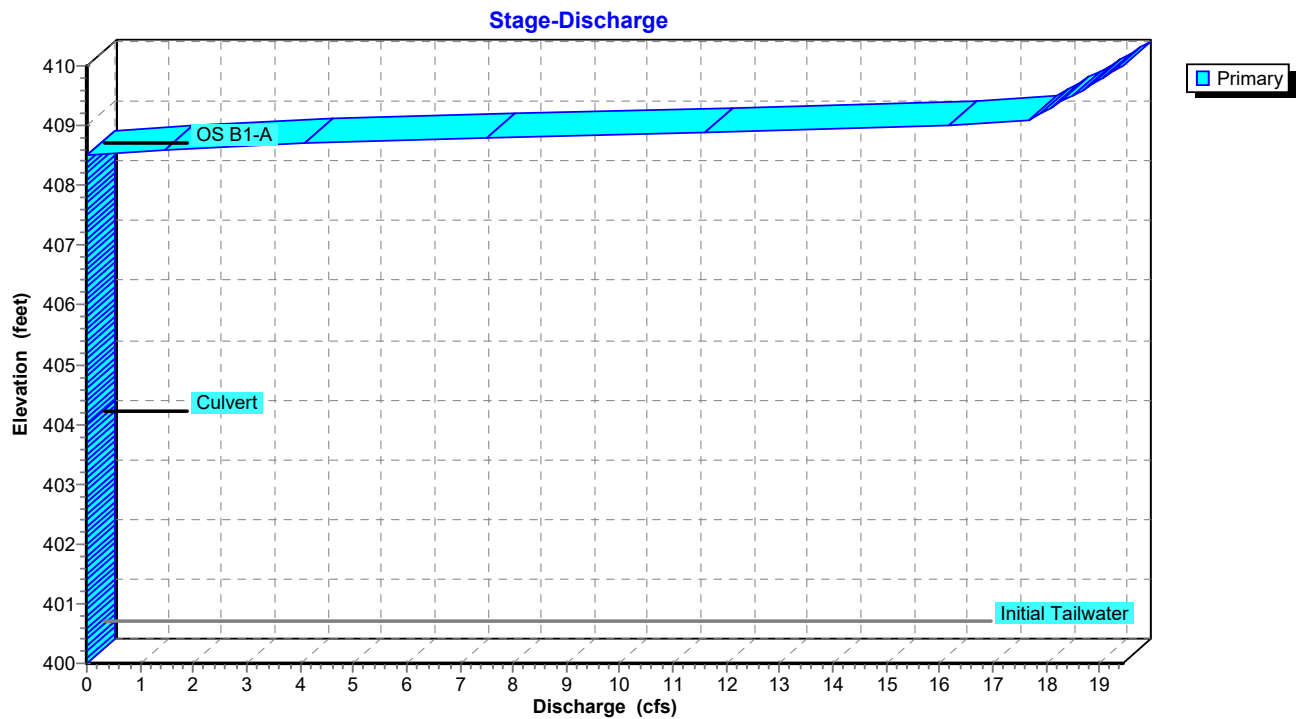

Pond 3P: Forebay & Bio B1-A

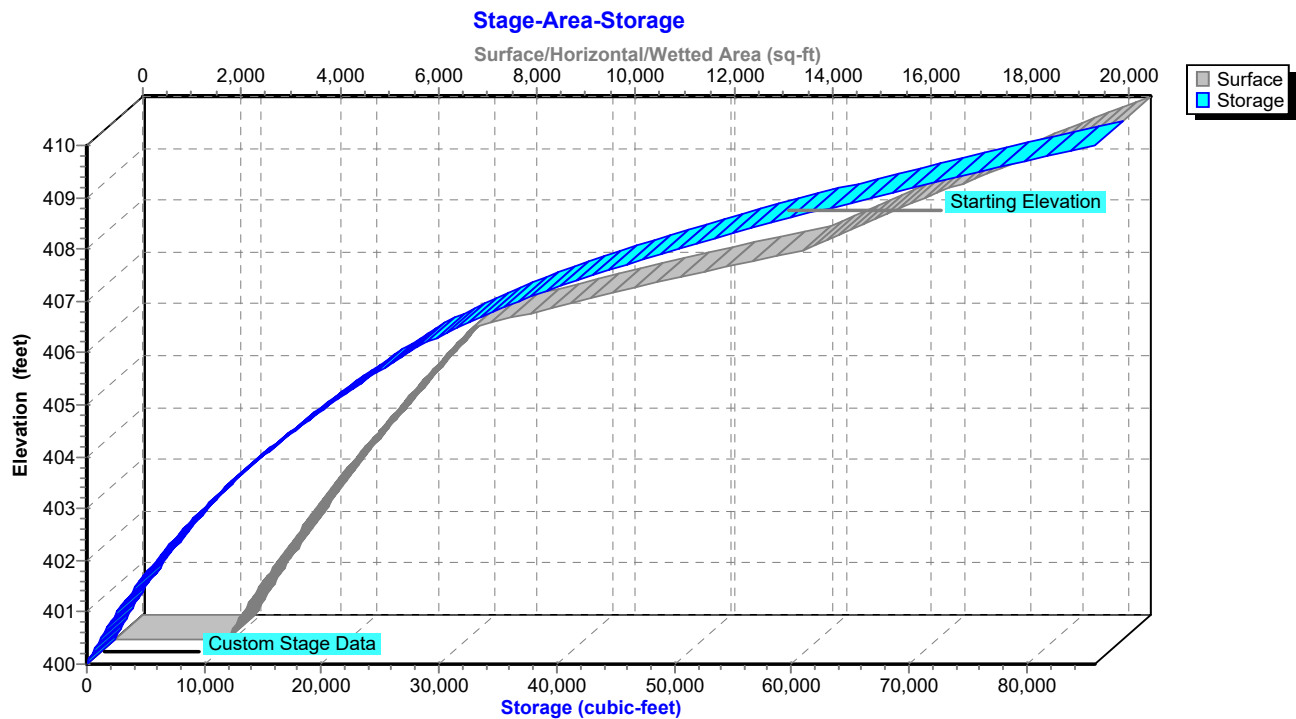

103.0301 - Hydrographs*NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"*

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 63

Stage-Discharge for Pond 3P: Forebay & Bio B1-A

Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)
400.00	0.00	402.60	0.00	405.20	0.00	407.80	0.00
400.05	0.00	402.65	0.00	405.25	0.00	407.85	0.00
400.10	0.00	402.70	0.00	405.30	0.00	407.90	0.00
400.15	0.00	402.75	0.00	405.35	0.00	407.95	0.00
400.20	0.00	402.80	0.00	405.40	0.00	408.00	0.00
400.25	0.00	402.85	0.00	405.45	0.00	408.05	0.00
400.30	0.00	402.90	0.00	405.50	0.00	408.10	0.00
400.35	0.00	402.95	0.00	405.55	0.00	408.15	0.00
400.40	0.00	403.00	0.00	405.60	0.00	408.20	0.00
400.45	0.00	403.05	0.00	405.65	0.00	408.25	0.00
400.50	0.00	403.10	0.00	405.70	0.00	408.30	0.00
400.55	0.00	403.15	0.00	405.75	0.00	408.35	0.00
400.60	0.00	403.20	0.00	405.80	0.00	408.40	0.00
400.65	0.00	403.25	0.00	405.85	0.00	408.45	0.00
400.70	0.00	403.30	0.00	405.90	0.00	408.50	0.00
400.75	0.00	403.35	0.00	405.95	0.00	408.55	0.51
400.80	0.00	403.40	0.00	406.00	0.00	408.60	1.45
400.85	0.00	403.45	0.00	406.05	0.00	408.65	2.66
400.90	0.00	403.50	0.00	406.10	0.00	408.70	4.09
400.95	0.00	403.55	0.00	406.15	0.00	408.75	5.72
401.00	0.00	403.60	0.00	406.20	0.00	408.80	7.52
401.05	0.00	403.65	0.00	406.25	0.00	408.85	9.48
401.10	0.00	403.70	0.00	406.30	0.00	408.90	11.58
401.15	0.00	403.75	0.00	406.35	0.00	408.95	13.82
401.20	0.00	403.80	0.00	406.40	0.00	409.00	16.19
401.25	0.00	403.85	0.00	406.45	0.00	409.05	17.58
401.30	0.00	403.90	0.00	406.50	0.00	409.10	17.69
401.35	0.00	403.95	0.00	406.55	0.00	409.15	17.79
401.40	0.00	404.00	0.00	406.60	0.00	409.20	17.89
401.45	0.00	404.05	0.00	406.65	0.00	409.25	17.99
401.50	0.00	404.10	0.00	406.70	0.00	409.30	18.09
401.55	0.00	404.15	0.00	406.75	0.00	409.35	18.19
401.60	0.00	404.20	0.00	406.80	0.00	409.40	18.29
401.65	0.00	404.25	0.00	406.85	0.00	409.45	18.39
401.70	0.00	404.30	0.00	406.90	0.00	409.50	18.49
401.75	0.00	404.35	0.00	406.95	0.00	409.55	18.58
401.80	0.00	404.40	0.00	407.00	0.00	409.60	18.68
401.85	0.00	404.45	0.00	407.05	0.00	409.65	18.78
401.90	0.00	404.50	0.00	407.10	0.00	409.70	18.87
401.95	0.00	404.55	0.00	407.15	0.00	409.75	18.97
402.00	0.00	404.60	0.00	407.20	0.00	409.80	19.06
402.05	0.00	404.65	0.00	407.25	0.00	409.85	19.16
402.10	0.00	404.70	0.00	407.30	0.00	409.90	19.25
402.15	0.00	404.75	0.00	407.35	0.00	409.95	19.35
402.20	0.00	404.80	0.00	407.40	0.00	410.00	19.44
402.25	0.00	404.85	0.00	407.45	0.00		
402.30	0.00	404.90	0.00	407.50	0.00		
402.35	0.00	404.95	0.00	407.55	0.00		
402.40	0.00	405.00	0.00	407.60	0.00		
402.45	0.00	405.05	0.00	407.65	0.00		
402.50	0.00	405.10	0.00	407.70	0.00		
402.55	0.00	405.15	0.00	407.75	0.00		

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 64

Stage-Area-Storage for Pond 3P: Forebay & Bio B1-A

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
400.00	2,277	0	405.20	6,456	21,940
400.10	2,339	231	405.30	6,554	22,591
400.20	2,402	468	405.40	6,652	23,251
400.30	2,466	711	405.50	6,752	23,921
400.40	2,531	961	405.60	6,851	24,601
400.50	2,596	1,217	405.70	6,952	25,292
400.60	2,663	1,480	405.80	7,053	25,992
400.70	2,730	1,750	405.90	7,155	26,702
400.80	2,798	2,026	406.00	7,258	27,423
400.90	2,867	2,310	406.10	7,366	28,167
401.00	2,937	2,600	406.20	7,474	28,925
401.10	3,007	2,897	406.30	7,582	29,697
401.20	3,079	3,201	406.40	7,690	30,483
401.30	3,151	3,513	406.50	7,798	31,283
401.40	3,224	3,831	406.60	7,906	32,097
401.50	3,298	4,158	406.70	8,014	32,925
401.60	3,373	4,491	406.80	8,122	33,767
401.70	3,448	4,832	406.90	8,230	34,623
401.80	3,525	5,181	407.00	8,338	35,493
401.90	3,602	5,537	407.10	8,446	36,377
402.00	3,680	5,901	407.20	8,554	37,275
402.10	3,756	6,273	407.30	8,662	38,187
402.20	3,832	6,652	407.40	8,770	39,113
402.30	3,910	7,039	407.50	8,878	40,053
402.40	3,988	7,434	407.60	8,986	41,007
402.50	4,067	7,837	407.70	9,094	41,975
402.60	4,146	8,248	407.80	9,202	42,957
402.70	4,227	8,666	407.90	9,310	43,953
402.80	4,308	9,093	408.00	9,418	44,963
402.90	4,390	9,528	408.10	9,526	45,987
403.00	4,472	9,971	408.20	9,634	47,025
403.10	4,556	10,422	408.30	9,742	48,077
403.20	4,640	10,882	408.40	9,850	49,143
403.30	4,725	11,350	408.50	9,958	50,223
403.40	4,811	11,827	408.60	10,066	51,317
403.50	4,898	12,313	408.70	10,174	52,425
403.60	4,985	12,807	408.80	10,282	53,547
403.70	5,073	13,310	408.90	10,390	54,683
403.80	5,162	13,821	409.00	10,498	55,833
403.90	5,252	14,342	409.10	10,606	56,997
404.00	5,342	14,872	409.20	10,714	58,175
404.10	5,431	15,410	409.30	10,822	59,367
404.20	5,520	15,958	409.40	10,930	60,573
404.30	5,611	16,514	409.50	11,038	61,793
404.40	5,702	17,080	409.60	11,146	63,027
404.50	5,794	17,655	409.70	11,254	64,275
404.60	5,886	18,239	409.80	11,362	65,537
404.70	5,979	18,832	409.90	11,470	66,813
404.80	6,073	19,435	410.00	20,447	85,810
404.90	6,168	20,047			
405.00	6,263	20,668			
405.10	6,360	21,299			

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 65

Summary for Pond 4P: Detention Basin A1

Inflow Area = 10.068 ac, 49.91% Impervious, Inflow Depth = 6.92" for 100-yr event
 Inflow = 43.47 cfs @ 12.29 hrs, Volume= 5.806 af
 Outflow = 16.90 cfs @ 12.73 hrs, Volume= 4.909 af, Atten= 61%, Lag= 26.1 min
 Primary = 16.90 cfs @ 12.73 hrs, Volume= 4.909 af
 Routed to Pond PR-A : PR-A

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
 Automatic Starting Elev= 398.50' Surf.Area= 2,907 sf Storage= 21,861 cf
 Peak Elev= 409.00' @ 12.73 hrs Surf.Area= 21,717 sf Storage= 127,540 cf (105,679 cf above start)

Plug-Flow detention time= 604.4 min calculated for 4.407 af (76% of inflow)
 Center-of-Mass det. time= 432.7 min (1,248.0 - 815.3)

Volume	Invert	Avail.Storage	Storage Description	
#1	388.00'	150,665 cf	Custom Stage Data (Conic) Listed below (Recalc)	
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
388.00	1,355	0	0	1,355
400.00	3,176	26,422	26,422	4,046
402.00	5,824	8,867	35,289	6,736
404.00	9,598	15,266	50,555	10,560
406.00	14,095	23,549	74,104	15,122
408.00	19,096	33,065	107,169	20,205
410.00	24,513	43,496	150,665	25,722

Device	Routing	Invert	Outlet Devices
#1	Primary	398.50'	18.0" Round 18" Culvert L= 56.0' CPP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 398.50' / 397.94' S= 0.0100 '/' Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 1.77 sf
#2	Device 1	388.50'	3.0" Vert. 3" Orifice C= 0.600 Limited to weir flow at low heads
#3	Device 1	408.50'	36.0" x 48.0" Horiz. OS A1 C= 0.600 Limited to weir flow at low heads
#4	Primary	409.00'	30.0' long + 2.0 ' SideZ x 50.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=16.90 cfs @ 12.73 hrs HW=409.00' TW=0.00' (Dynamic Tailwater)

- 1=18" Culvert (Passes 16.90 cfs of 26.57 cfs potential flow)
- 2=3" Orifice (Orifice Controls 0.77 cfs @ 15.60 fps)
- 3=OS A1 (Weir Controls 16.13 cfs @ 2.31 fps)
- 4=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"


Printed 12/8/2025

Page 66

Pond 4P: Detention Basin A1

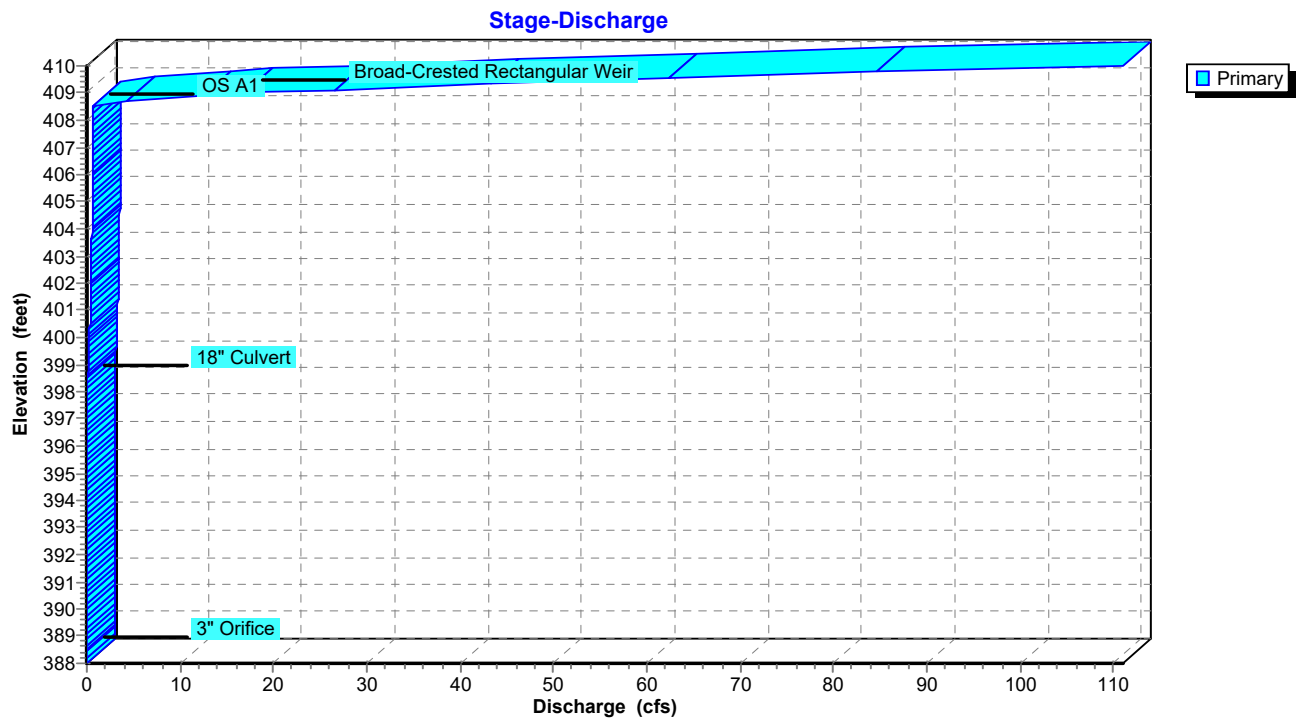

Pond 4P: Detention Basin A1

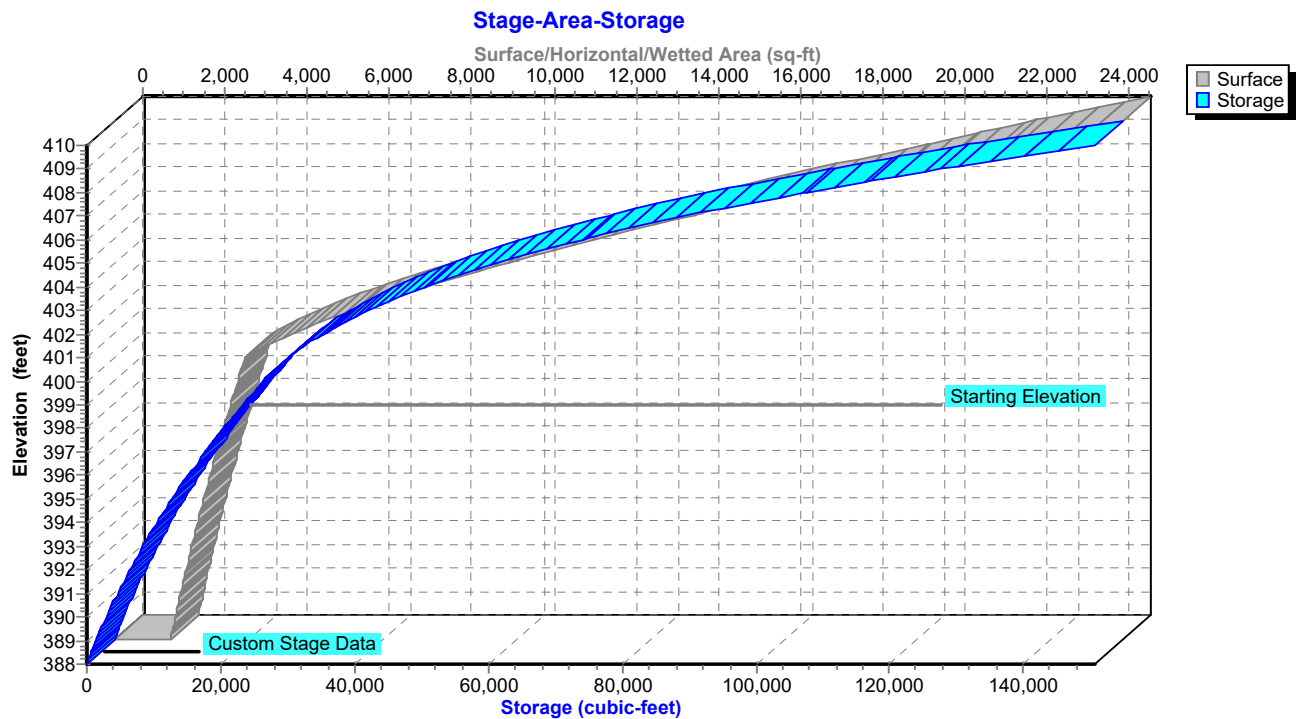

103.0301 - Hydrographs*NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"*

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 67

Stage-Discharge for Pond 4P: Detention Basin A1

Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)
388.00	0.00	398.40	0.00	408.80	8.28
388.20	0.00	398.60	0.05	409.00	16.95
388.40	0.00	398.80	0.13	409.20	34.11
388.60	0.00	399.00	0.17	409.40	48.04
388.80	0.00	399.20	0.20	409.60	66.22
389.00	0.00	399.40	0.22	409.80	86.73
389.20	0.00	399.60	0.25	410.00	111.01
389.40	0.00	399.80	0.27		
389.60	0.00	400.00	0.29		
389.80	0.00	400.20	0.31		
390.00	0.00	400.40	0.33		
390.20	0.00	400.60	0.34		
390.40	0.00	400.80	0.36		
390.60	0.00	401.00	0.37		
390.80	0.00	401.20	0.39		
391.00	0.00	401.40	0.40		
391.20	0.00	401.60	0.42		
391.40	0.00	401.80	0.43		
391.60	0.00	402.00	0.44		
391.80	0.00	402.20	0.45		
392.00	0.00	402.40	0.47		
392.20	0.00	402.60	0.48		
392.40	0.00	402.80	0.49		
392.60	0.00	403.00	0.50		
392.80	0.00	403.20	0.51		
393.00	0.00	403.40	0.52		
393.20	0.00	403.60	0.53		
393.40	0.00	403.80	0.54		
393.60	0.00	404.00	0.55		
393.80	0.00	404.20	0.56		
394.00	0.00	404.40	0.57		
394.20	0.00	404.60	0.58		
394.40	0.00	404.80	0.59		
394.60	0.00	405.00	0.60		
394.80	0.00	405.20	0.61		
395.00	0.00	405.40	0.62		
395.20	0.00	405.60	0.63		
395.40	0.00	405.80	0.64		
395.60	0.00	406.00	0.65		
395.80	0.00	406.20	0.66		
396.00	0.00	406.40	0.66		
396.20	0.00	406.60	0.67		
396.40	0.00	406.80	0.68		
396.60	0.00	407.00	0.69		
396.80	0.00	407.20	0.70		
397.00	0.00	407.40	0.71		
397.20	0.00	407.60	0.71		
397.40	0.00	407.80	0.72		
397.60	0.00	408.00	0.73		
397.80	0.00	408.20	0.74		
398.00	0.00	408.40	0.74		
398.20	0.00	408.60	2.20		

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 68

Stage-Area-Storage for Pond 4P: Detention Basin A1

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
388.00	1,355	0
388.50	1,416	693
389.00	1,478	1,416
389.50	1,541	2,170
390.00	1,605	2,957
390.50	1,671	3,776
391.00	1,739	4,628
391.50	1,807	5,515
392.00	1,877	6,436
392.50	1,948	7,392
393.00	2,021	8,384
393.50	2,095	9,413
394.00	2,170	10,479
394.50	2,247	11,584
395.00	2,324	12,726
395.50	2,404	13,908
396.00	2,484	15,130
396.50	2,566	16,392
397.00	2,649	17,696
397.50	2,734	19,042
398.00	2,819	20,430
398.50	2,907	21,861
399.00	2,995	23,337
399.50	3,085	24,857
400.00	3,176	26,422
400.50	3,763	28,155
401.00	4,400	30,194
401.50	5,087	32,563
402.00	5,824	35,289
402.50	6,680	38,413
403.00	7,594	41,978
403.50	8,567	46,016
404.00	9,598	50,555
404.50	10,641	55,612
405.00	11,739	61,205
405.50	12,890	67,360
406.00	14,095	74,104
406.50	15,274	81,445
407.00	16,501	89,386
407.50	17,775	97,953
408.00	19,096	107,169
408.50	20,387	117,038
409.00	21,720	127,563
409.50	23,095	138,765
410.00	24,513	150,665

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 69

Summary for Pond 6P: Forebay & Bio B1-B

Inflow Area = 0.610 ac, 25.08% Impervious, Inflow Depth = 2.84" for 100-yr event
 Inflow = 1.20 cfs @ 12.23 hrs, Volume= 0.145 af
 Outflow = 0.83 cfs @ 12.47 hrs, Volume= 0.145 af, Atten= 31%, Lag= 13.9 min
 Primary = 0.83 cfs @ 12.47 hrs, Volume= 0.145 af
 Routed to Pond 7P : Detention Basin B1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
 Automatic Starting Elev= 408.50' Surf.Area= 14,636 sf Storage= 43,121 cf
 Peak Elev= 408.57' @ 12.47 hrs Surf.Area= 14,812 sf Storage= 44,137 cf (1,016 cf above start)

Plug-Flow detention time= (not calculated: initial storage exceeds outflow)

Center-of-Mass det. time= 35.5 min (928.4 - 892.9)

Volume	Invert	Avail.Storage	Storage Description	
#1	400.00'	68,054 cf	Custom Stage Data (Conic) Listed below (Recalc)	
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
400.00	713	0	0	713
402.00	1,896	2,514	2,514	1,922
404.00	3,550	5,360	7,875	3,616
406.00	5,471	8,952	16,827	5,594
407.50	12,169	12,900	29,726	12,310
408.00	13,395	6,389	36,115	13,552
410.00	18,691	31,939	68,054	18,924

Device	Routing	Invert	Outlet Devices
#1	Primary	404.99'	18.0" Round Culvert L= 149.6' CPP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 404.99' / 402.00' S= 0.0200 '/' Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 1.77 sf
#2	Device 1	408.50'	36.0" x 48.0" Horiz. OS B1-B C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=0.83 cfs @ 12.47 hrs HW=408.57' TW=407.34' (Dynamic Tailwater)

↑ **1=Culvert** (Passes 0.83 cfs of 8.91 cfs potential flow)

↑ **2=OS B1-B** (Weir Controls 0.83 cfs @ 0.86 fps)

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"


Printed 12/8/2025

Page 70

Pond 6P: Forebay & Bio B1-B

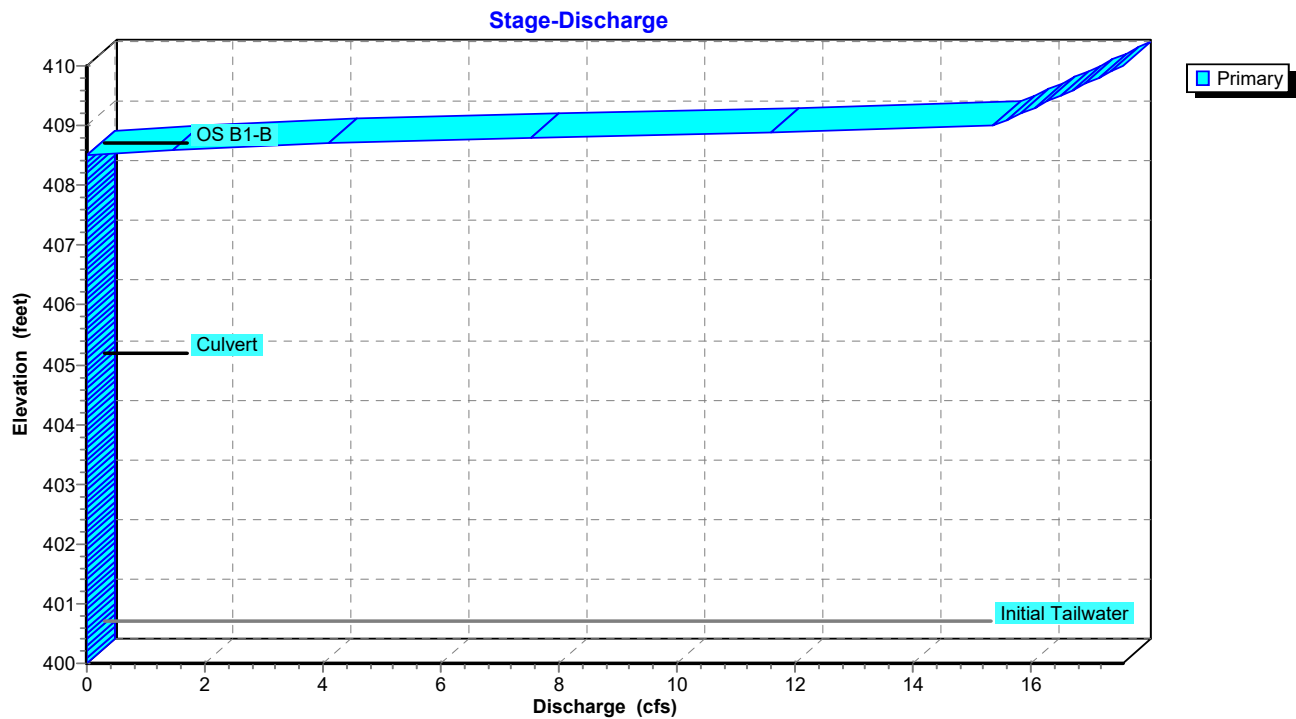

Pond 6P: Forebay & Bio B1-B

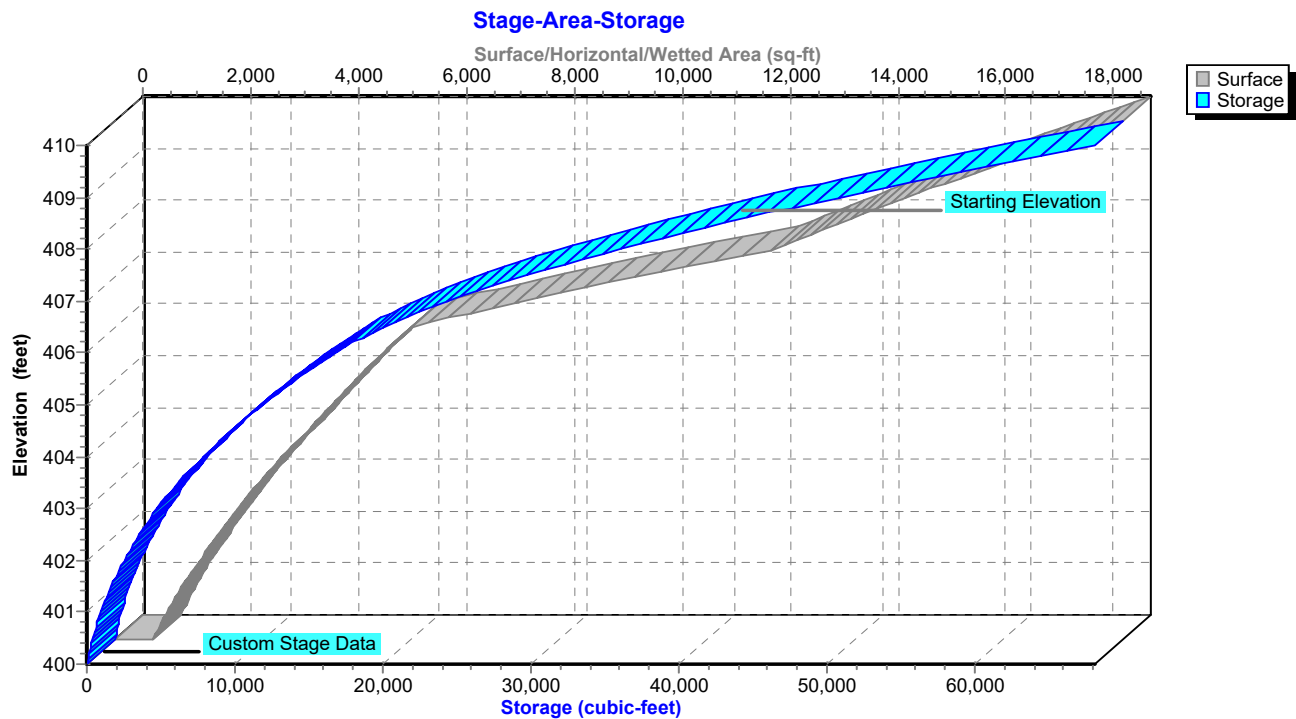

103.0301 - Hydrographs*NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"*

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 71

Stage-Discharge for Pond 6P: Forebay & Bio B1-B

Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)
400.00	0.00	402.60	0.00	405.20	0.00	407.80	0.00
400.05	0.00	402.65	0.00	405.25	0.00	407.85	0.00
400.10	0.00	402.70	0.00	405.30	0.00	407.90	0.00
400.15	0.00	402.75	0.00	405.35	0.00	407.95	0.00
400.20	0.00	402.80	0.00	405.40	0.00	408.00	0.00
400.25	0.00	402.85	0.00	405.45	0.00	408.05	0.00
400.30	0.00	402.90	0.00	405.50	0.00	408.10	0.00
400.35	0.00	402.95	0.00	405.55	0.00	408.15	0.00
400.40	0.00	403.00	0.00	405.60	0.00	408.20	0.00
400.45	0.00	403.05	0.00	405.65	0.00	408.25	0.00
400.50	0.00	403.10	0.00	405.70	0.00	408.30	0.00
400.55	0.00	403.15	0.00	405.75	0.00	408.35	0.00
400.60	0.00	403.20	0.00	405.80	0.00	408.40	0.00
400.65	0.00	403.25	0.00	405.85	0.00	408.45	0.00
400.70	0.00	403.30	0.00	405.90	0.00	408.50	0.00
400.75	0.00	403.35	0.00	405.95	0.00	408.55	0.51
400.80	0.00	403.40	0.00	406.00	0.00	408.60	1.45
400.85	0.00	403.45	0.00	406.05	0.00	408.65	2.66
400.90	0.00	403.50	0.00	406.10	0.00	408.70	4.09
400.95	0.00	403.55	0.00	406.15	0.00	408.75	5.72
401.00	0.00	403.60	0.00	406.20	0.00	408.80	7.52
401.05	0.00	403.65	0.00	406.25	0.00	408.85	9.48
401.10	0.00	403.70	0.00	406.30	0.00	408.90	11.58
401.15	0.00	403.75	0.00	406.35	0.00	408.95	13.82
401.20	0.00	403.80	0.00	406.40	0.00	409.00	15.36
401.25	0.00	403.85	0.00	406.45	0.00	409.05	15.48
401.30	0.00	403.90	0.00	406.50	0.00	409.10	15.60
401.35	0.00	403.95	0.00	406.55	0.00	409.15	15.71
401.40	0.00	404.00	0.00	406.60	0.00	409.20	15.83
401.45	0.00	404.05	0.00	406.65	0.00	409.25	15.94
401.50	0.00	404.10	0.00	406.70	0.00	409.30	16.05
401.55	0.00	404.15	0.00	406.75	0.00	409.35	16.17
401.60	0.00	404.20	0.00	406.80	0.00	409.40	16.28
401.65	0.00	404.25	0.00	406.85	0.00	409.45	16.39
401.70	0.00	404.30	0.00	406.90	0.00	409.50	16.50
401.75	0.00	404.35	0.00	406.95	0.00	409.55	16.61
401.80	0.00	404.40	0.00	407.00	0.00	409.60	16.72
401.85	0.00	404.45	0.00	407.05	0.00	409.65	16.82
401.90	0.00	404.50	0.00	407.10	0.00	409.70	16.93
401.95	0.00	404.55	0.00	407.15	0.00	409.75	17.04
402.00	0.00	404.60	0.00	407.20	0.00	409.80	17.14
402.05	0.00	404.65	0.00	407.25	0.00	409.85	17.25
402.10	0.00	404.70	0.00	407.30	0.00	409.90	17.35
402.15	0.00	404.75	0.00	407.35	0.00	409.95	17.46
402.20	0.00	404.80	0.00	407.40	0.00	410.00	17.56
402.25	0.00	404.85	0.00	407.45	0.00		
402.30	0.00	404.90	0.00	407.50	0.00		
402.35	0.00	404.95	0.00	407.55	0.00		
402.40	0.00	405.00	0.00	407.60	0.00		
402.45	0.00	405.05	0.00	407.65	0.00		
402.50	0.00	405.10	0.00	407.70	0.00		
402.55	0.00	405.15	0.00	407.75	0.00		

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 72

Stage-Area-Storage for Pond 6P: Forebay & Bio B1-B

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
400.00	713	0	405.20	4,653	12,782
400.10	759	74	405.30	4,752	13,252
400.20	806	152	405.40	4,851	13,732
400.30	854	235	405.50	4,952	14,222
400.40	904	323	405.60	5,054	14,722
400.50	956	416	405.70	5,156	15,233
400.60	1,008	514	405.80	5,260	15,754
400.70	1,063	617	405.90	5,365	16,285
400.80	1,118	726	406.00	5,471	16,827
400.90	1,175	841	406.10	5,835	17,392
401.00	1,234	961	406.20	6,211	17,994
401.10	1,293	1,088	406.30	6,599	18,635
401.20	1,355	1,220	406.40	6,999	19,314
401.30	1,417	1,359	406.50	7,410	20,035
401.40	1,482	1,504	406.60	7,833	20,797
401.50	1,547	1,655	406.70	8,268	21,602
401.60	1,614	1,813	406.80	8,714	22,451
401.70	1,682	1,978	406.90	9,173	23,345
401.80	1,752	2,150	407.00	9,643	24,286
401.90	1,823	2,329	407.10	10,125	25,274
402.00	1,896	2,514	407.20	10,618	26,311
402.10	1,966	2,708	407.30	11,123	27,398
402.20	2,038	2,908	407.40	11,640	28,536
402.30	2,111	3,115	407.50	12,169	29,726
402.40	2,186	3,330	407.60	12,409	30,955
402.50	2,261	3,552	407.70	12,652	32,208
402.60	2,338	3,782	407.80	12,898	33,486
402.70	2,416	4,020	407.90	13,145	34,788
402.80	2,496	4,266	408.00	13,395	36,115
402.90	2,577	4,519	408.10	13,639	37,467
403.00	2,659	4,781	408.20	13,885	38,843
403.10	2,742	5,051	408.30	14,133	40,244
403.20	2,827	5,330	408.40	14,384	41,670
403.30	2,913	5,616	408.50	14,636	43,121
403.40	3,000	5,912	408.60	14,891	44,597
403.50	3,088	6,216	408.70	15,148	46,099
403.60	3,178	6,530	408.80	15,408	47,627
403.70	3,269	6,852	408.90	15,669	49,181
403.80	3,361	7,184	409.00	15,933	50,761
403.90	3,455	7,524	409.10	16,199	52,367
404.00	3,550	7,875	409.20	16,467	54,001
404.10	3,636	8,234	409.30	16,737	55,661
404.20	3,723	8,602	409.40	17,010	57,348
404.30	3,812	8,979	409.50	17,284	59,063
404.40	3,901	9,364	409.60	17,561	60,805
404.50	3,991	9,759	409.70	17,840	62,575
404.60	4,083	10,163	409.80	18,122	64,373
404.70	4,175	10,576	409.90	18,405	66,200
404.80	4,269	10,998	410.00	18,691	68,054
404.90	4,363	11,429			
405.00	4,459	11,870			
405.10	4,555	12,321			

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 73

Summary for Pond 7P: Detention Basin B1

Inflow Area = 5.956 ac, 45.33% Impervious, Inflow Depth = 6.07" for 100-yr event
 Inflow = 15.58 cfs @ 12.19 hrs, Volume= 3.015 af
 Outflow = 8.76 cfs @ 13.01 hrs, Volume= 2.868 af, Atten= 44%, Lag= 48.9 min
 Primary = 8.76 cfs @ 13.01 hrs, Volume= 2.868 af
 Routed to Pond PR-B : PR-B

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
 Automatic Starting Elev= 400.50' Surf.Area= 1,825 sf Storage= 806 cf
 Peak Elev= 408.32' @ 13.01 hrs Surf.Area= 13,281 sf Storage= 54,682 cf (53,876 cf above start)

Plug-Flow detention time= 548.1 min calculated for 2.849 af (94% of inflow)
 Center-of-Mass det. time= 508.6 min (1,335.0 - 826.4)

Volume	Invert	Avail.Storage	Storage Description	
#1	400.00'	79,868 cf	Custom Stage Data (Conic) Listed below (Recalc)	
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
400.00	1,408	0	0	1,408
402.00	3,402	4,666	4,666	3,431
404.00	5,985	9,266	13,932	6,058
406.00	9,096	14,973	28,905	9,229
408.00	12,687	21,684	50,588	12,895
410.00	16,684	29,280	79,868	16,983

Device	Routing	Invert	Outlet Devices
#1	Primary	400.00'	18.0" Round Culvert L= 140.0' CPP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 400.00' / 398.00' S= 0.0143 '/' Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 1.77 sf
#2	Device 1	400.50'	3.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#3	Device 1	408.00'	36.0" x 48.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#4	Primary	409.00'	30.0' long + 2.0 ' SideZ x 50.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=8.76 cfs @ 13.01 hrs HW=408.32' TW=0.00' (Dynamic Tailwater)

- 1=Culvert (Passes 8.76 cfs of 23.40 cfs potential flow)
 2=Orifice/Grate (Orifice Controls 0.66 cfs @ 13.35 fps)
 3=Orifice/Grate (Weir Controls 8.10 cfs @ 1.84 fps)
 4=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"


Printed 12/8/2025

Page 74

Pond 7P: Detention Basin B1

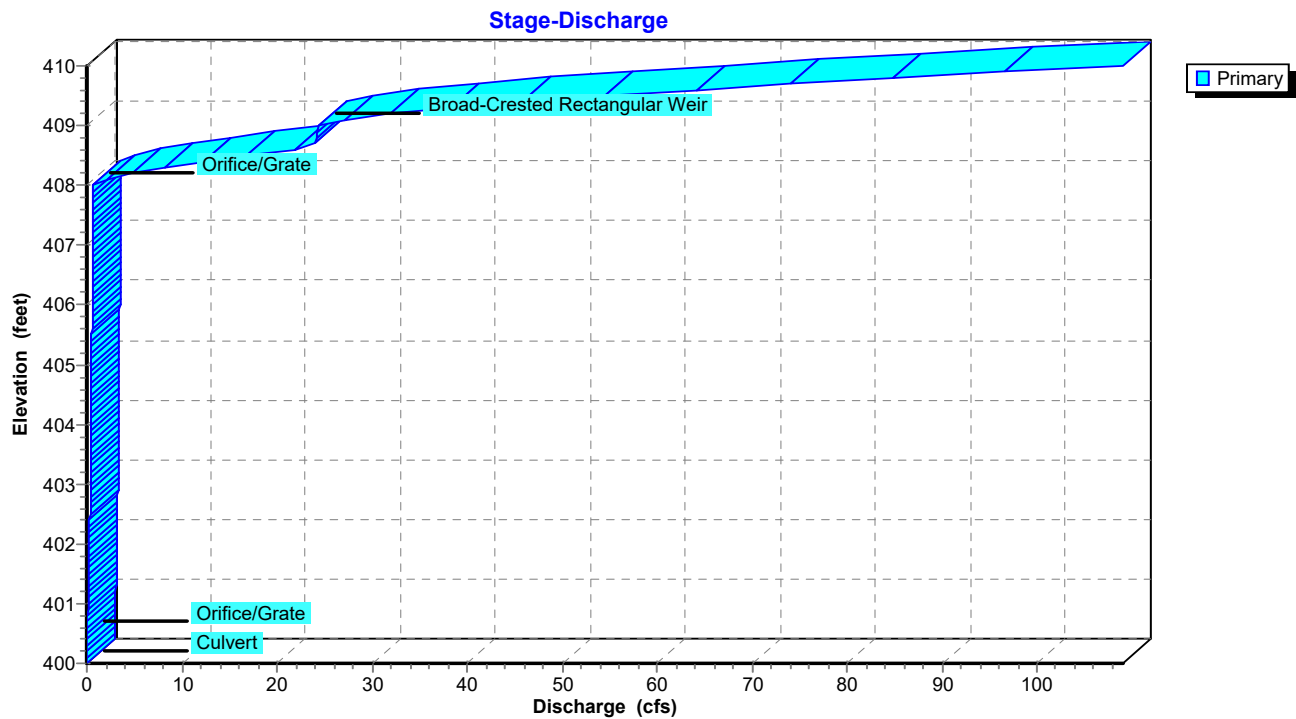

Pond 7P: Detention Basin B1

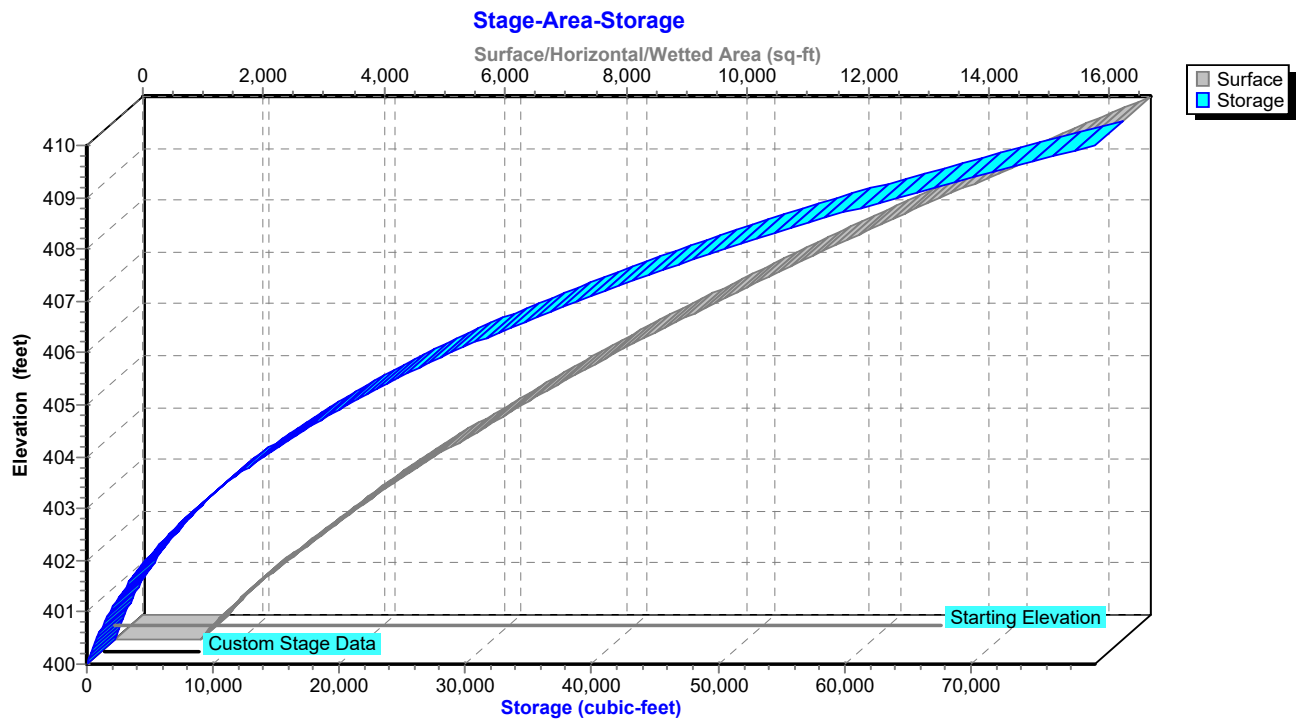

103.0301 - Hydrographs*NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"*

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 75

Stage-Discharge for Pond 7P: Detention Basin B1

Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)
400.00	0.00	402.60	0.33	405.20	0.51	407.80	0.63
400.05	0.00	402.65	0.34	405.25	0.51	407.85	0.64
400.10	0.00	402.70	0.34	405.30	0.51	407.90	0.64
400.15	0.00	402.75	0.34	405.35	0.51	407.95	0.64
400.20	0.00	402.80	0.35	405.40	0.52	408.00	0.64
400.25	0.00	402.85	0.35	405.45	0.52	408.05	1.16
400.30	0.00	402.90	0.36	405.50	0.52	408.10	2.09
400.35	0.00	402.95	0.36	405.55	0.52	408.15	3.31
400.40	0.00	403.00	0.36	405.60	0.53	408.20	4.75
400.45	0.00	403.05	0.37	405.65	0.53	408.25	6.38
400.50	0.00	403.10	0.37	405.70	0.53	408.30	8.18
400.55	0.01	403.15	0.38	405.75	0.54	408.35	10.14
400.60	0.02	403.20	0.38	405.80	0.54	408.40	12.24
400.65	0.04	403.25	0.38	405.85	0.54	408.45	14.48
400.70	0.06	403.30	0.39	405.90	0.54	408.50	16.85
400.75	0.08	403.35	0.39	405.95	0.55	408.55	19.34
400.80	0.10	403.40	0.39	406.00	0.55	408.60	21.94
400.85	0.11	403.45	0.40	406.05	0.55	408.65	23.92
400.90	0.12	403.50	0.40	406.10	0.55	408.70	23.99
400.95	0.13	403.55	0.40	406.15	0.56	408.75	24.07
401.00	0.14	403.60	0.41	406.20	0.56	408.80	24.14
401.05	0.15	403.65	0.41	406.25	0.56	408.85	24.22
401.10	0.16	403.70	0.41	406.30	0.56	408.90	24.29
401.15	0.17	403.75	0.42	406.35	0.57	408.95	24.37
401.20	0.18	403.80	0.42	406.40	0.57	409.00	24.44
401.25	0.19	403.85	0.42	406.45	0.57	409.05	25.41
401.30	0.19	403.90	0.43	406.50	0.57	409.10	27.14
401.35	0.20	403.95	0.43	406.55	0.58	409.15	29.37
401.40	0.21	404.00	0.43	406.60	0.58	409.20	32.00
401.45	0.21	404.05	0.44	406.65	0.58	409.25	35.01
401.50	0.22	404.10	0.44	406.70	0.58	409.30	38.35
401.55	0.23	404.15	0.44	406.75	0.58	409.35	42.01
401.60	0.23	404.20	0.45	406.80	0.59	409.40	45.95
401.65	0.24	404.25	0.45	406.85	0.59	409.45	50.14
401.70	0.25	404.30	0.45	406.90	0.59	409.50	54.57
401.75	0.25	404.35	0.46	406.95	0.59	409.55	59.25
401.80	0.26	404.40	0.46	407.00	0.60	409.60	64.16
401.85	0.26	404.45	0.46	407.05	0.60	409.65	69.06
401.90	0.27	404.50	0.47	407.10	0.60	409.70	74.12
401.95	0.27	404.55	0.47	407.15	0.60	409.75	79.33
402.00	0.28	404.60	0.47	407.20	0.61	409.80	84.69
402.05	0.28	404.65	0.47	407.25	0.61	409.85	90.49
402.10	0.29	404.70	0.48	407.30	0.61	409.90	96.47
402.15	0.29	404.75	0.48	407.35	0.61	409.95	102.64
402.20	0.30	404.80	0.48	407.40	0.62	410.00	108.99
402.25	0.30	404.85	0.49	407.45	0.62		
402.30	0.31	404.90	0.49	407.50	0.62		
402.35	0.31	404.95	0.49	407.55	0.62		
402.40	0.31	405.00	0.49	407.60	0.62		
402.45	0.32	405.05	0.50	407.65	0.63		
402.50	0.32	405.10	0.50	407.70	0.63		
402.55	0.33	405.15	0.50	407.75	0.63		

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 76

Stage-Area-Storage for Pond 7P: Detention Basin B1

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
400.00	1,408	0	405.20	7,774	22,164
400.10	1,487	145	405.30	7,933	22,949
400.20	1,568	298	405.40	8,095	23,751
400.30	1,652	459	405.50	8,257	24,568
400.40	1,738	628	405.60	8,422	25,402
400.50	1,825	806	405.70	8,588	26,253
400.60	1,915	993	405.80	8,756	27,120
400.70	2,007	1,189	405.90	8,925	28,004
400.80	2,102	1,395	406.00	9,096	28,905
400.90	2,198	1,610	406.10	9,261	29,823
401.00	2,297	1,834	406.20	9,428	30,757
401.10	2,398	2,069	406.30	9,597	31,708
401.20	2,501	2,314	406.40	9,767	32,677
401.30	2,606	2,569	406.50	9,938	33,662
401.40	2,713	2,835	406.60	10,111	34,664
401.50	2,822	3,112	406.70	10,285	35,684
401.60	2,934	3,400	406.80	10,461	36,721
401.70	3,048	3,699	406.90	10,638	37,776
401.80	3,164	4,009	407.00	10,817	38,849
401.90	3,282	4,332	407.10	10,997	39,940
402.00	3,402	4,666	407.20	11,179	41,048
402.10	3,514	5,012	407.30	11,362	42,175
402.20	3,628	5,369	407.40	11,547	43,321
402.30	3,743	5,737	407.50	11,733	44,485
402.40	3,861	6,117	407.60	11,921	45,668
402.50	3,980	6,509	407.70	12,110	46,869
402.60	4,101	6,913	407.80	12,301	48,090
402.70	4,224	7,330	407.90	12,493	49,329
402.80	4,348	7,758	408.00	12,687	50,588
402.90	4,475	8,199	408.10	12,874	51,867
403.00	4,603	8,653	408.20	13,062	53,163
403.10	4,733	9,120	408.30	13,252	54,479
403.20	4,865	9,600	408.40	13,443	55,814
403.30	4,999	10,093	408.50	13,635	57,168
403.40	5,134	10,600	408.60	13,829	58,541
403.50	5,271	11,120	408.70	14,024	59,933
403.60	5,410	11,654	408.80	14,220	61,346
403.70	5,551	12,202	408.90	14,418	62,777
403.80	5,694	12,764	409.00	14,617	64,229
403.90	5,839	13,341	409.10	14,818	65,701
404.00	5,985	13,932	409.20	15,020	67,193
404.10	6,125	14,537	409.30	15,223	68,705
404.20	6,267	15,157	409.40	15,428	70,237
404.30	6,410	15,791	409.50	15,634	71,790
404.40	6,555	16,439	409.60	15,841	73,364
404.50	6,702	17,102	409.70	16,050	74,959
404.60	6,850	17,780	409.80	16,260	76,574
404.70	7,000	18,472	409.90	16,471	78,211
404.80	7,152	19,180	410.00	16,684	79,868
404.90	7,305	19,902			
405.00	7,459	20,641			
405.10	7,616	21,394			

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 77

Summary for Pond PR-A: PR-A

Inflow Area = 37.077 ac, 36.24% Impervious, Inflow Depth > 5.51" for 100-yr event

Inflow = 104.61 cfs @ 12.23 hrs, Volume= 17.031 af

Primary = 104.61 cfs @ 12.23 hrs, Volume= 17.031 af, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 100-yr Rainfall=8.25"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 78

Summary for Pond PR-B: PR-B

Inflow Area = 17.738 ac, 22.72% Impervious, Inflow Depth > 4.36" for 100-yr event

Inflow = 30.65 cfs @ 12.25 hrs, Volume= 6.438 af

Primary = 30.65 cfs @ 12.25 hrs, Volume= 6.438 af, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 79

Summary for Pond 1P: Forebay & Bio A1-A

Inflow Area = 4.969 ac, 55.48% Impervious, Inflow Depth = 11.06" for 500-yr event
 Inflow = 33.81 cfs @ 12.26 hrs, Volume= 4.580 af
 Outflow = 26.06 cfs @ 12.34 hrs, Volume= 4.580 af, Atten= 23%, Lag= 5.0 min
 Primary = 26.06 cfs @ 12.34 hrs, Volume= 4.580 af
 Routed to Pond 4P : Detention Basin A1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
 Automatic Starting Elev= 408.50' Surf.Area= 18,385 sf Storage= 66,328 cf
 Peak Elev= 409.40' @ 12.45 hrs Surf.Area= 19,035 sf Storage= 83,225 cf (16,896 cf above start)


Plug-Flow detention time= 237.1 min calculated for 3.057 af (67% of inflow)
 Center-of-Mass det. time= 16.9 min (799.7 - 782.9)

Volume	Invert	Avail.Storage	Storage Description	
#1	400.00'	94,716 cf	Custom Stage Data (Conic) Listed below (Recalc)	
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
400.00	2,093	0	0	2,093
402.00	3,854	5,858	5,858	3,895
404.00	5,993	9,769	15,627	6,090
406.00	8,501	14,421	30,048	8,669
407.50	16,634	18,513	48,561	16,824
408.00	18,030	8,664	57,225	18,239
410.00	19,471	37,492	94,716	19,977


Device	Routing	Invert	Outlet Devices									
#1	Primary	408.50'	50.0' long + 4.0 ' SideZ x 31.0' breadth Broad-Crested Rectangular Weir									
			Head (feet)	0.20	0.40	0.60	0.80	1.00	1.20	1.40	1.60	
			Coef. (English)	2.68	2.70	2.70	2.64	2.63	2.64	2.64	2.63	

Primary OutFlow Max=16.41 cfs @ 12.34 hrs HW=409.36' TW=409.35' (Dynamic Tailwater)
 ↑1=**Broad-Crested Rectangular Weir**(Weir Controls 16.41 cfs @ 0.36 fps)

Pond 1P: Forebay & Bio A1-A

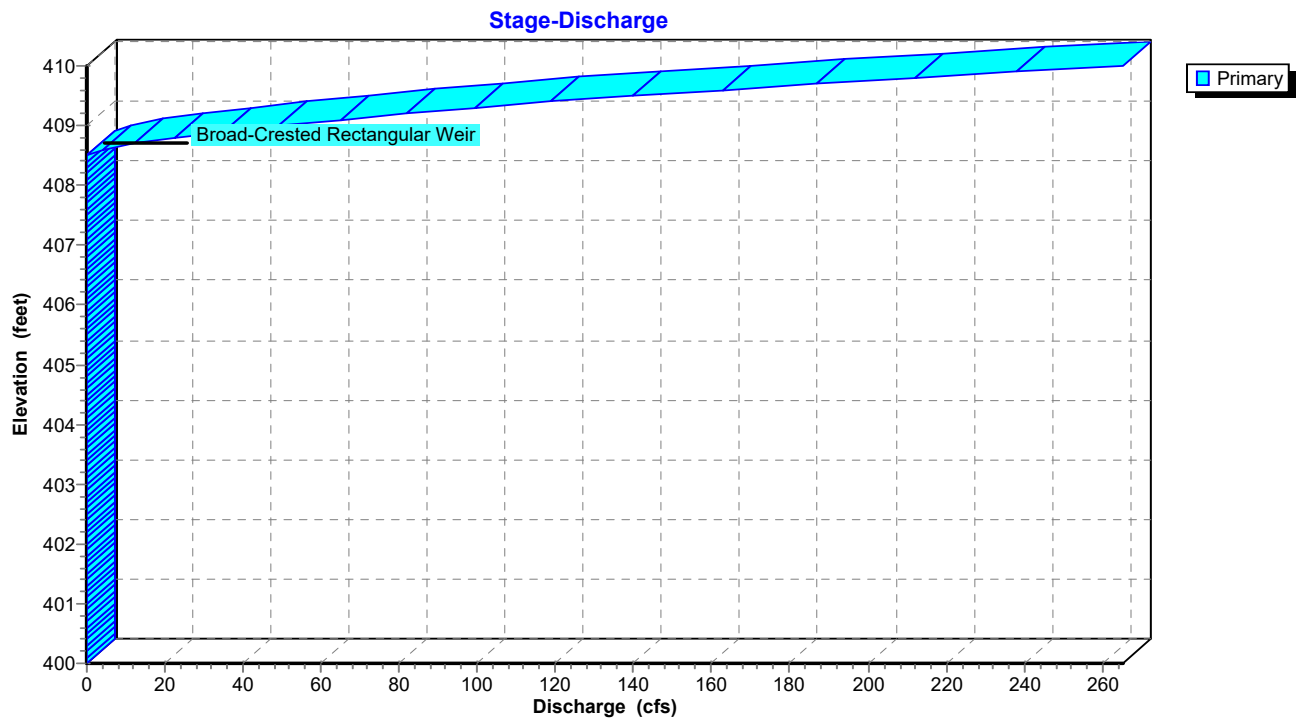

Pond 1P: Forebay & Bio A1-A

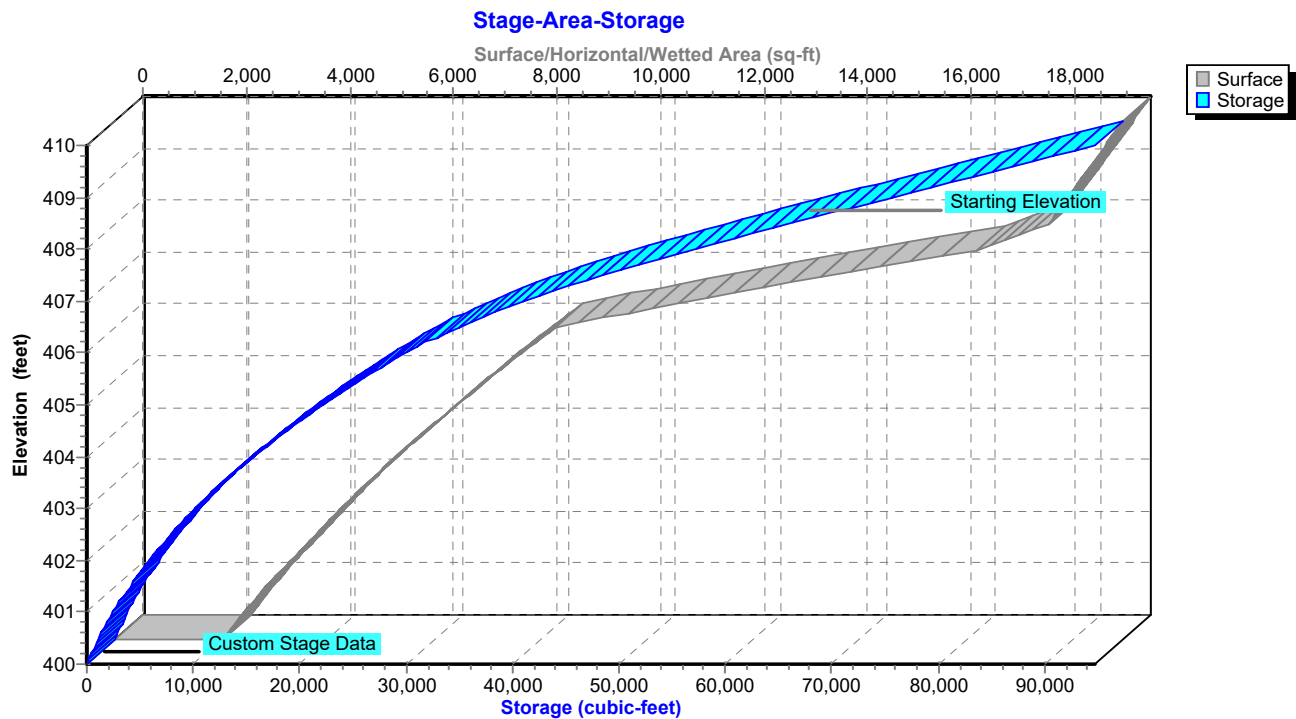

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 81

Stage-Discharge for Pond 1P: Forebay & Bio A1-A

Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)
400.00	0.00	402.60	0.00	405.20	0.00	407.80	0.00
400.05	0.00	402.65	0.00	405.25	0.00	407.85	0.00
400.10	0.00	402.70	0.00	405.30	0.00	407.90	0.00
400.15	0.00	402.75	0.00	405.35	0.00	407.95	0.00
400.20	0.00	402.80	0.00	405.40	0.00	408.00	0.00
400.25	0.00	402.85	0.00	405.45	0.00	408.05	0.00
400.30	0.00	402.90	0.00	405.50	0.00	408.10	0.00
400.35	0.00	402.95	0.00	405.55	0.00	408.15	0.00
400.40	0.00	403.00	0.00	405.60	0.00	408.20	0.00
400.45	0.00	403.05	0.00	405.65	0.00	408.25	0.00
400.50	0.00	403.10	0.00	405.70	0.00	408.30	0.00
400.55	0.00	403.15	0.00	405.75	0.00	408.35	0.00
400.60	0.00	403.20	0.00	405.80	0.00	408.40	0.00
400.65	0.00	403.25	0.00	405.85	0.00	408.45	0.00
400.70	0.00	403.30	0.00	405.90	0.00	408.50	0.00
400.75	0.00	403.35	0.00	405.95	0.00	408.55	1.50
400.80	0.00	403.40	0.00	406.00	0.00	408.60	4.26
400.85	0.00	403.45	0.00	406.05	0.00	408.65	7.86
400.90	0.00	403.50	0.00	406.10	0.00	408.70	12.14
400.95	0.00	403.55	0.00	406.15	0.00	408.75	17.05
401.00	0.00	403.60	0.00	406.20	0.00	408.80	22.52
401.05	0.00	403.65	0.00	406.25	0.00	408.85	28.53
401.10	0.00	403.70	0.00	406.30	0.00	408.90	35.03
401.15	0.00	403.75	0.00	406.35	0.00	408.95	41.93
401.20	0.00	403.80	0.00	406.40	0.00	409.00	49.26
401.25	0.00	403.85	0.00	406.45	0.00	409.05	57.00
401.30	0.00	403.90	0.00	406.50	0.00	409.10	65.15
401.35	0.00	403.95	0.00	406.55	0.00	409.15	73.28
401.40	0.00	404.00	0.00	406.60	0.00	409.20	81.69
401.45	0.00	404.05	0.00	406.65	0.00	409.25	90.36
401.50	0.00	404.10	0.00	406.70	0.00	409.30	99.29
401.55	0.00	404.15	0.00	406.75	0.00	409.35	108.97
401.60	0.00	404.20	0.00	406.80	0.00	409.40	118.97
401.65	0.00	404.25	0.00	406.85	0.00	409.45	129.29
401.70	0.00	404.30	0.00	406.90	0.00	409.50	139.92
401.75	0.00	404.35	0.00	406.95	0.00	409.55	151.14
401.80	0.00	404.40	0.00	407.00	0.00	409.60	162.70
401.85	0.00	404.45	0.00	407.05	0.00	409.65	174.60
401.90	0.00	404.50	0.00	407.10	0.00	409.70	186.84
401.95	0.00	404.55	0.00	407.15	0.00	409.75	199.23
402.00	0.00	404.60	0.00	407.20	0.00	409.80	211.93
402.05	0.00	404.65	0.00	407.25	0.00	409.85	224.94
402.10	0.00	404.70	0.00	407.30	0.00	409.90	238.25
402.15	0.00	404.75	0.00	407.35	0.00	409.95	251.63
402.20	0.00	404.80	0.00	407.40	0.00	410.00	265.28
402.25	0.00	404.85	0.00	407.45	0.00		
402.30	0.00	404.90	0.00	407.50	0.00		
402.35	0.00	404.95	0.00	407.55	0.00		
402.40	0.00	405.00	0.00	407.60	0.00		
402.45	0.00	405.05	0.00	407.65	0.00		
402.50	0.00	405.10	0.00	407.70	0.00		
402.55	0.00	405.15	0.00	407.75	0.00		

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 82

Stage-Area-Storage for Pond 1P: Forebay & Bio A1-A

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
400.00	2,093	0	405.20	7,445	23,674
400.10	2,168	213	405.30	7,573	24,425
400.20	2,245	434	405.40	7,703	25,189
400.30	2,323	662	405.50	7,833	25,965
400.40	2,403	898	405.60	7,964	26,755
400.50	2,483	1,143	405.70	8,097	27,558
400.60	2,565	1,395	405.80	8,231	28,375
400.70	2,649	1,656	405.90	8,365	29,205
400.80	2,733	1,925	406.00	8,501	30,048
400.90	2,819	2,202	406.10	8,959	30,921
401.00	2,907	2,489	406.20	9,429	31,840
401.10	2,996	2,784	406.30	9,911	32,807
401.20	3,086	3,088	406.40	10,405	33,823
401.30	3,177	3,401	406.50	10,912	34,888
401.40	3,270	3,723	406.60	11,430	36,005
401.50	3,364	4,055	406.70	11,960	37,175
401.60	3,459	4,396	406.80	12,502	38,398
401.70	3,556	4,747	406.90	13,056	39,676
401.80	3,654	5,107	407.00	13,623	41,009
401.90	3,753	5,478	407.10	14,201	42,401
402.00	3,854	5,858	407.20	14,791	43,850
402.10	3,950	6,248	407.30	15,393	45,359
402.20	4,047	6,648	407.40	16,008	46,929
402.30	4,145	7,058	407.50	16,634	48,561
402.40	4,244	7,477	407.60	16,909	50,238
402.50	4,345	7,907	407.70	17,186	51,943
402.60	4,446	8,346	407.80	17,465	53,675
402.70	4,549	8,796	407.90	17,746	55,436
402.80	4,653	9,256	408.00	18,030	57,225
402.90	4,758	9,727	408.10	18,101	59,031
403.00	4,865	10,208	408.20	18,172	60,845
403.10	4,972	10,699	408.30	18,243	62,666
403.20	5,081	11,202	408.40	18,314	64,493
403.30	5,191	11,716	408.50	18,385	66,328
403.40	5,302	12,240	408.60	18,456	68,170
403.50	5,414	12,776	408.70	18,528	70,020
403.60	5,528	13,323	408.80	18,600	71,876
403.70	5,642	13,882	408.90	18,672	73,740
403.80	5,758	14,452	409.00	18,744	75,610
403.90	5,875	15,033	409.10	18,816	77,488
404.00	5,993	15,627	409.20	18,888	79,373
404.10	6,108	16,232	409.30	18,960	81,266
404.20	6,224	16,848	409.40	19,033	83,166
404.30	6,341	17,477	409.50	19,106	85,072
404.40	6,460	18,117	409.60	19,178	86,987
404.50	6,579	18,769	409.70	19,251	88,908
404.60	6,699	19,432	409.80	19,324	90,837
404.70	6,821	20,109	409.90	19,398	92,773
404.80	6,944	20,797	410.00	19,471	94,716
404.90	7,067	21,497			
405.00	7,192	22,210			
405.10	7,318	22,936			

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 83

Summary for Pond 2P: Forebay & Bio A1-B

Inflow Area = 4.432 ac, 51.17% Impervious, Inflow Depth = 10.93" for 500-yr event
 Inflow = 30.39 cfs @ 12.24 hrs, Volume= 4.037 af
 Outflow = 21.67 cfs @ 12.37 hrs, Volume= 4.037 af, Atten= 29%, Lag= 7.7 min
 Primary = 21.67 cfs @ 12.37 hrs, Volume= 4.037 af
 Routed to Pond 4P : Detention Basin A1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
 Automatic Starting Elev= 408.50' Surf.Area= 19,240 sf Storage= 72,229 cf
 Peak Elev= 409.40' @ 12.46 hrs Surf.Area= 21,676 sf Storage= 90,637 cf (18,407 cf above start)

Plug-Flow detention time= 274.7 min calculated for 2.379 af (59% of inflow)
 Center-of-Mass det. time= 20.0 min (805.4 - 785.5)

Volume	Invert	Avail.Storage	Storage Description	
#1	400.00'	104,144 cf	Custom Stage Data (Conic) Listed below (Recalc)	
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
400.00	3,314	0	0	3,314
402.00	4,891	8,154	8,154	4,954
404.00	6,756	11,597	19,751	6,896
406.00	8,917	15,623	35,374	9,146
407.50	16,689	18,903	54,277	16,940
408.00	17,949	8,658	62,934	18,222
410.00	23,380	41,210	104,144	23,747

Device	Routing	Invert	Outlet Devices								
#1	Primary	408.50'	50.0' long + 4.0 ' SideZ x 31.0' breadth Broad-Crested Rectangular Weir								
			Head (feet)	0.20	0.40	0.60	0.80	1.00	1.20	1.40	1.60
			Coef. (English)	2.68	2.70	2.70	2.64	2.63	2.64	2.64	2.63

Primary OutFlow Max=11.19 cfs @ 12.37 hrs HW=409.37' TW=409.37' (Dynamic Tailwater)
 ↑1=**Broad-Crested Rectangular Weir**(Weir Controls 11.19 cfs @ 0.24 fps)

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"


Printed 12/8/2025

Page 84

Pond 2P: Forebay & Bio A1-B

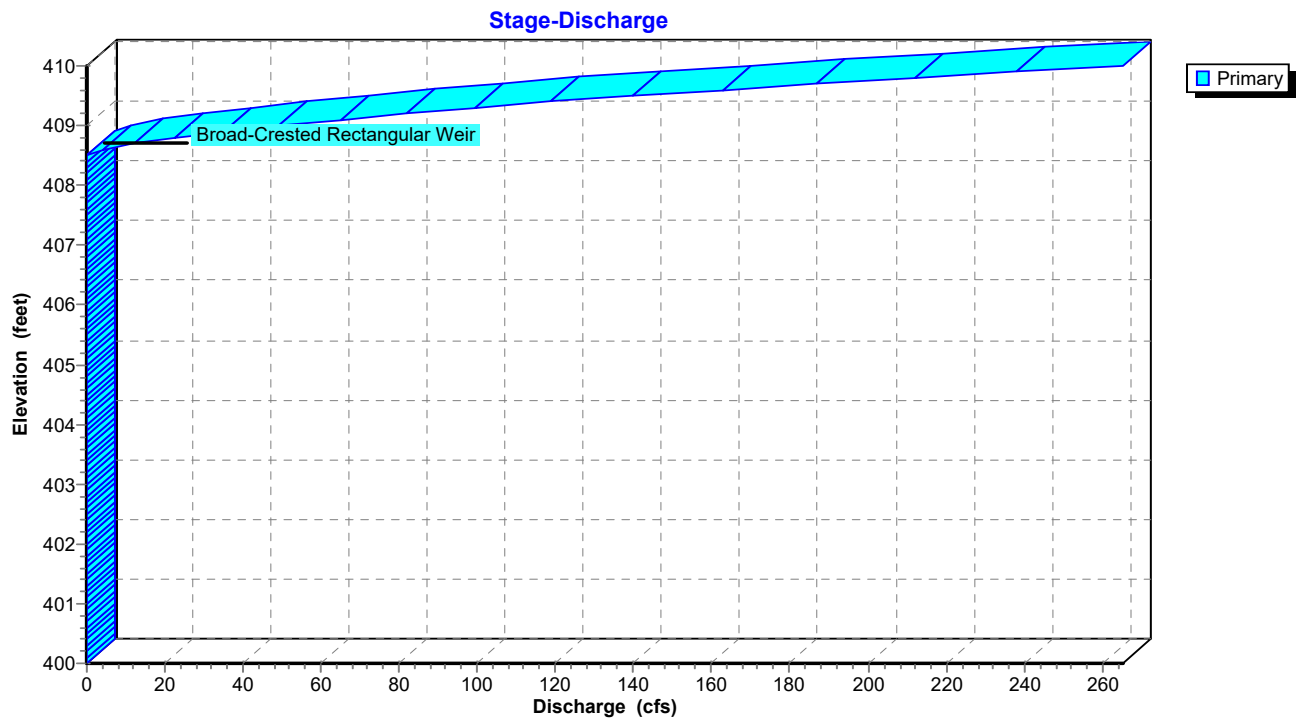

Pond 2P: Forebay & Bio A1-B

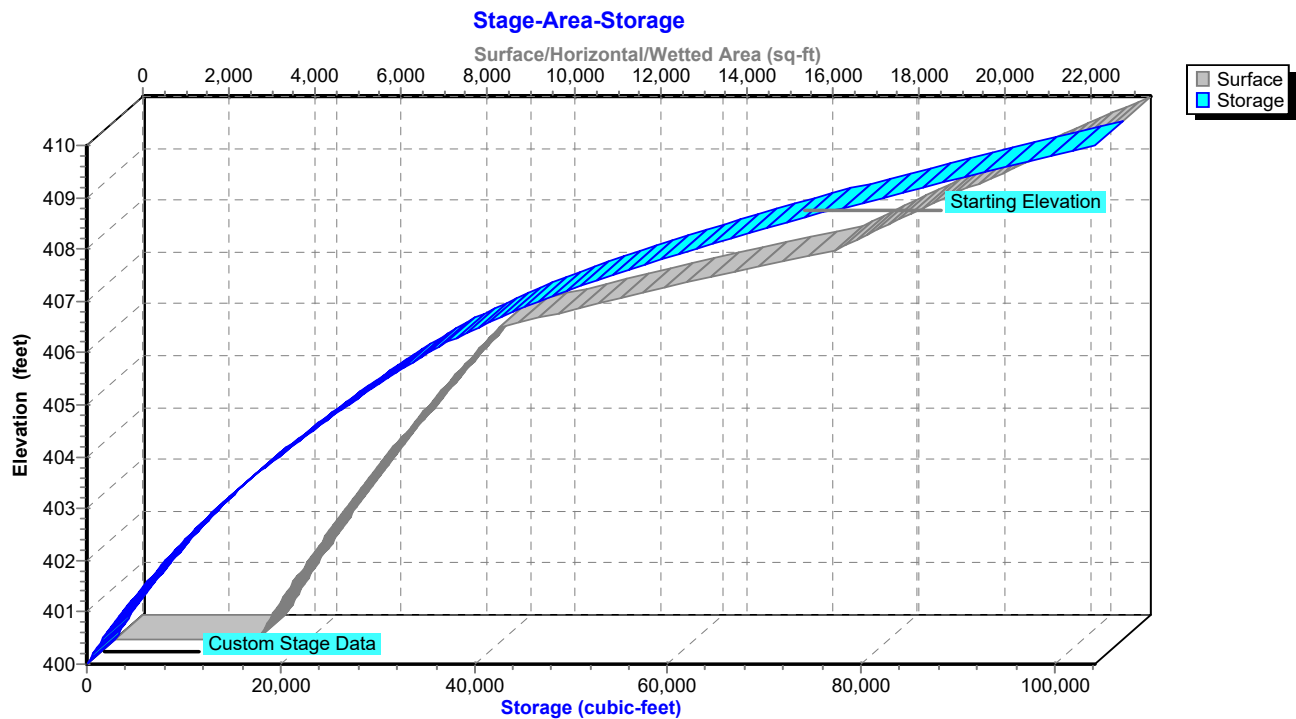

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 85

Stage-Discharge for Pond 2P: Forebay & Bio A1-B

Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)
400.00	0.00	402.60	0.00	405.20	0.00	407.80	0.00
400.05	0.00	402.65	0.00	405.25	0.00	407.85	0.00
400.10	0.00	402.70	0.00	405.30	0.00	407.90	0.00
400.15	0.00	402.75	0.00	405.35	0.00	407.95	0.00
400.20	0.00	402.80	0.00	405.40	0.00	408.00	0.00
400.25	0.00	402.85	0.00	405.45	0.00	408.05	0.00
400.30	0.00	402.90	0.00	405.50	0.00	408.10	0.00
400.35	0.00	402.95	0.00	405.55	0.00	408.15	0.00
400.40	0.00	403.00	0.00	405.60	0.00	408.20	0.00
400.45	0.00	403.05	0.00	405.65	0.00	408.25	0.00
400.50	0.00	403.10	0.00	405.70	0.00	408.30	0.00
400.55	0.00	403.15	0.00	405.75	0.00	408.35	0.00
400.60	0.00	403.20	0.00	405.80	0.00	408.40	0.00
400.65	0.00	403.25	0.00	405.85	0.00	408.45	0.00
400.70	0.00	403.30	0.00	405.90	0.00	408.50	0.00
400.75	0.00	403.35	0.00	405.95	0.00	408.55	1.50
400.80	0.00	403.40	0.00	406.00	0.00	408.60	4.26
400.85	0.00	403.45	0.00	406.05	0.00	408.65	7.86
400.90	0.00	403.50	0.00	406.10	0.00	408.70	12.14
400.95	0.00	403.55	0.00	406.15	0.00	408.75	17.05
401.00	0.00	403.60	0.00	406.20	0.00	408.80	22.52
401.05	0.00	403.65	0.00	406.25	0.00	408.85	28.53
401.10	0.00	403.70	0.00	406.30	0.00	408.90	35.03
401.15	0.00	403.75	0.00	406.35	0.00	408.95	41.93
401.20	0.00	403.80	0.00	406.40	0.00	409.00	49.26
401.25	0.00	403.85	0.00	406.45	0.00	409.05	57.00
401.30	0.00	403.90	0.00	406.50	0.00	409.10	65.15
401.35	0.00	403.95	0.00	406.55	0.00	409.15	73.28
401.40	0.00	404.00	0.00	406.60	0.00	409.20	81.69
401.45	0.00	404.05	0.00	406.65	0.00	409.25	90.36
401.50	0.00	404.10	0.00	406.70	0.00	409.30	99.29
401.55	0.00	404.15	0.00	406.75	0.00	409.35	108.97
401.60	0.00	404.20	0.00	406.80	0.00	409.40	118.97
401.65	0.00	404.25	0.00	406.85	0.00	409.45	129.29
401.70	0.00	404.30	0.00	406.90	0.00	409.50	139.92
401.75	0.00	404.35	0.00	406.95	0.00	409.55	151.14
401.80	0.00	404.40	0.00	407.00	0.00	409.60	162.70
401.85	0.00	404.45	0.00	407.05	0.00	409.65	174.60
401.90	0.00	404.50	0.00	407.10	0.00	409.70	186.84
401.95	0.00	404.55	0.00	407.15	0.00	409.75	199.23
402.00	0.00	404.60	0.00	407.20	0.00	409.80	211.93
402.05	0.00	404.65	0.00	407.25	0.00	409.85	224.94
402.10	0.00	404.70	0.00	407.30	0.00	409.90	238.25
402.15	0.00	404.75	0.00	407.35	0.00	409.95	251.63
402.20	0.00	404.80	0.00	407.40	0.00	410.00	265.28
402.25	0.00	404.85	0.00	407.45	0.00		
402.30	0.00	404.90	0.00	407.50	0.00		
402.35	0.00	404.95	0.00	407.55	0.00		
402.40	0.00	405.00	0.00	407.60	0.00		
402.45	0.00	405.05	0.00	407.65	0.00		
402.50	0.00	405.10	0.00	407.70	0.00		
402.55	0.00	405.15	0.00	407.75	0.00		

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 86

Stage-Area-Storage for Pond 2P: Forebay & Bio A1-B

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
400.00	3,314	0	405.20	8,017	28,604
400.10	3,386	335	405.30	8,127	29,411
400.20	3,458	677	405.40	8,237	30,229
400.30	3,531	1,027	405.50	8,349	31,058
400.40	3,605	1,383	405.60	8,461	31,899
400.50	3,680	1,748	405.70	8,574	32,751
400.60	3,755	2,119	405.80	8,687	33,614
400.70	3,831	2,499	405.90	8,802	34,488
400.80	3,908	2,886	406.00	8,917	35,374
400.90	3,986	3,280	406.10	9,360	36,288
401.00	4,064	3,683	406.20	9,814	37,246
401.10	4,143	4,093	406.30	10,278	38,251
401.20	4,223	4,511	406.40	10,753	39,302
401.30	4,304	4,938	406.50	11,239	40,402
401.40	4,386	5,372	406.60	11,736	41,551
401.50	4,468	5,815	406.70	12,243	42,749
401.60	4,551	6,266	406.80	12,761	44,000
401.70	4,635	6,725	406.90	13,290	45,302
401.80	4,720	7,193	407.00	13,830	46,658
401.90	4,805	7,669	407.10	14,380	48,068
402.00	4,891	8,154	407.20	14,941	49,534
402.10	4,977	8,647	407.30	15,513	51,057
402.20	5,064	9,149	407.40	16,096	52,637
402.30	5,152	9,660	407.50	16,689	54,277
402.40	5,240	10,180	407.60	16,937	55,958
402.50	5,329	10,708	407.70	17,187	57,664
402.60	5,419	11,246	407.80	17,439	59,395
402.70	5,510	11,792	407.90	17,693	61,152
402.80	5,601	12,348	408.00	17,949	62,934
402.90	5,693	12,912	408.10	18,204	64,742
403.00	5,786	13,486	408.20	18,460	66,575
403.10	5,880	14,069	408.30	18,718	68,434
403.20	5,974	14,662	408.40	18,978	70,319
403.30	6,069	15,264	408.50	19,240	72,229
403.40	6,165	15,876	408.60	19,503	74,166
403.50	6,262	16,497	408.70	19,768	76,130
403.60	6,359	17,128	408.80	20,035	78,120
403.70	6,457	17,769	408.90	20,304	80,137
403.80	6,556	18,420	409.00	20,575	82,181
403.90	6,656	19,080	409.10	20,847	84,252
404.00	6,756	19,751	409.20	21,122	86,351
404.10	6,857	20,432	409.30	21,398	88,477
404.20	6,959	21,122	409.40	21,675	90,630
404.30	7,061	21,823	409.50	21,955	92,812
404.40	7,164	22,535	409.60	22,236	95,021
404.50	7,268	23,256	409.70	22,520	97,259
404.60	7,373	23,988	409.80	22,805	99,525
404.70	7,478	24,731	409.90	23,091	101,820
404.80	7,584	25,484	410.00	23,380	104,144
404.90	7,691	26,248			
405.00	7,799	27,022			
405.10	7,908	27,808			

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 87

Summary for Pond 3P: Forebay & Bio B1-A

Inflow Area = 4.885 ac, 52.14% Impervious, Inflow Depth = 10.93" for 500-yr event
 Inflow = 33.05 cfs @ 12.26 hrs, Volume= 4.450 af
 Outflow = 38.57 cfs @ 12.35 hrs, Volume= 4.450 af, Atten= 0%, Lag= 5.6 min
 Primary = 38.57 cfs @ 12.35 hrs, Volume= 4.450 af
 Routed to Pond 7P : Detention Basin B1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
 Automatic Starting Elev= 408.50' Surf.Area= 16,412 sf Storage= 58,221 cf
 Peak Elev= 428.93' @ 12.35 hrs Surf.Area= 20,447 sf Storage= 85,810 cf (27,589 cf above start)

Plug-Flow detention time= 227.0 min calculated for 3.113 af (70% of inflow)
 Center-of-Mass det. time= 22.9 min (808.9 - 786.0)

Volume	Invert	Avail.Storage	Storage Description	
#1	400.00'	85,810 cf	Custom Stage Data (Conic) Listed below (Recalc)	
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
400.00	2,277	0	0	2,277
402.00	3,680	5,901	5,901	3,732
404.00	5,342	8,971	14,872	5,460
406.00	7,258	12,551	27,423	7,456
407.50	13,943	15,630	43,053	14,163
408.00	15,166	7,275	50,328	15,405
410.00	20,447	35,482	85,810	20,769

Device	Routing	Invert	Outlet Devices
#1	Primary	404.03'	18.0" Round Culvert L= 101.6' CMP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 404.03' / 402.00' S= 0.0200 '/' Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 1.77 sf
#2	Device 1	408.50'	36.0" x 48.0" Horiz. OS B1-A C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=38.53 cfs @ 12.35 hrs HW=428.86' TW=408.36' (Dynamic Tailwater)

↑ **1=Culvert** (Inlet Controls 38.53 cfs @ 21.80 fps)

↑ **2=OS B1-A** (Passes 38.53 cfs of 260.74 cfs potential flow)

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"


Printed 12/8/2025

Page 88

Pond 3P: Forebay & Bio B1-A

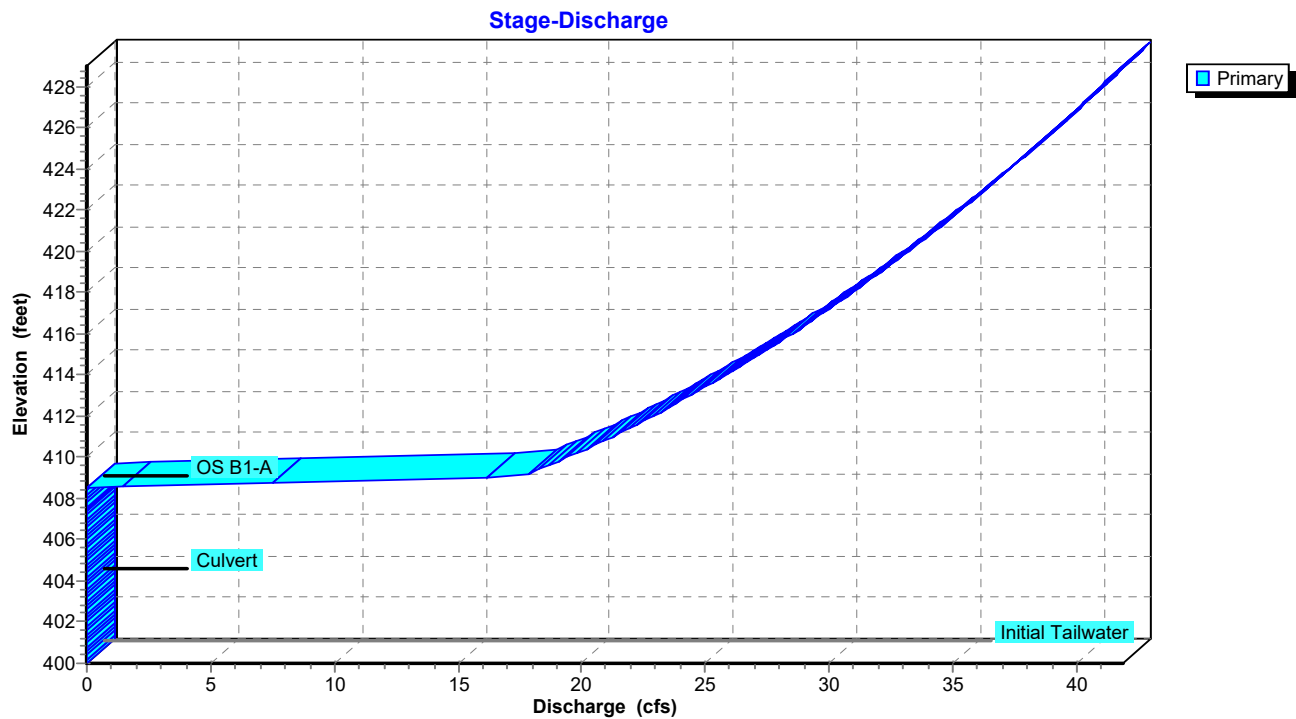

Pond 3P: Forebay & Bio B1-A

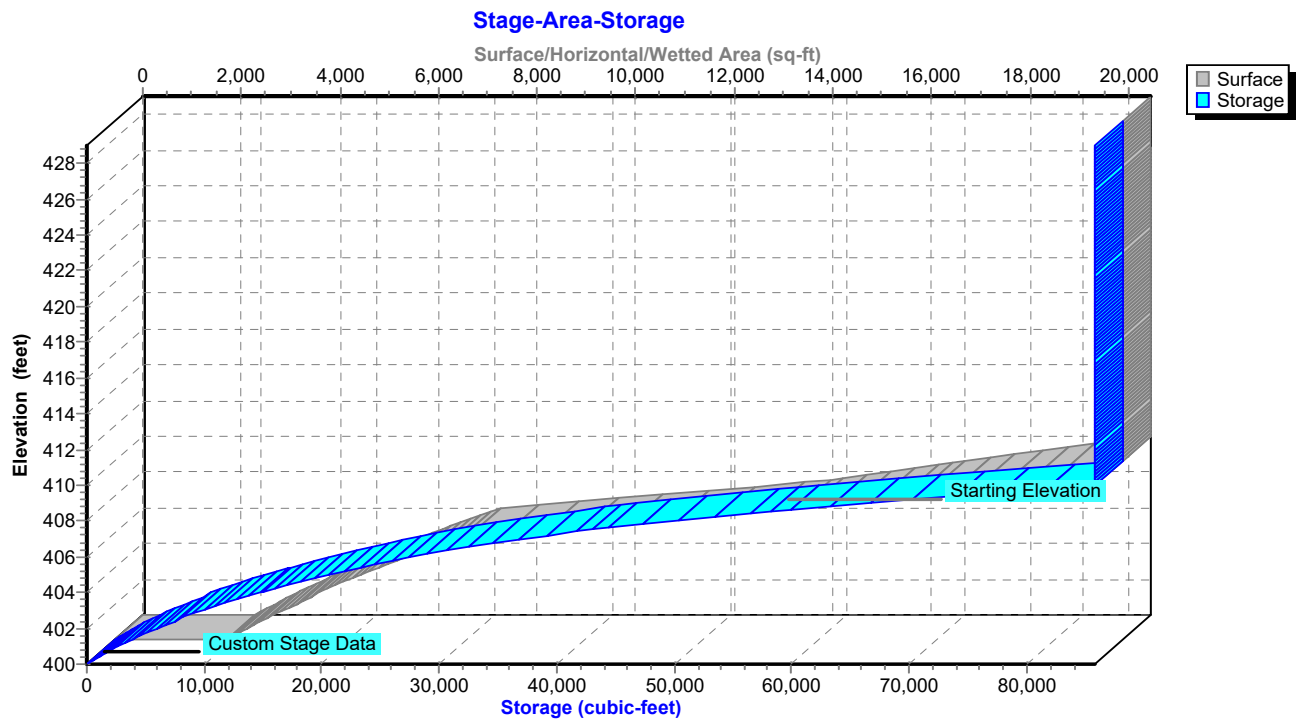

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 89

Stage-Discharge for Pond 3P: Forebay & Bio B1-A

Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)
400.00	0.00	410.40	20.17	420.80	34.06
400.20	0.00	410.60	20.53	421.00	34.27
400.40	0.00	410.80	20.88	421.20	34.48
400.60	0.00	411.00	21.22	421.40	34.69
400.80	0.00	411.20	21.56	421.60	34.90
401.00	0.00	411.40	21.89	421.80	35.10
401.20	0.00	411.60	22.22	422.00	35.31
401.40	0.00	411.80	22.54	422.20	35.51
401.60	0.00	412.00	22.86	422.40	35.72
401.80	0.00	412.20	23.18	422.60	35.92
402.00	0.00	412.40	23.49	422.80	36.12
402.20	0.00	412.60	23.79	423.00	36.32
402.40	0.00	412.80	24.10	423.20	36.52
402.60	0.00	413.00	24.40	423.40	36.72
402.80	0.00	413.20	24.69	423.60	36.91
403.00	0.00	413.40	24.98	423.80	37.11
403.20	0.00	413.60	25.27	424.00	37.30
403.40	0.00	413.80	25.55	424.20	37.50
403.60	0.00	414.00	25.84	424.40	37.69
403.80	0.00	414.20	26.12	424.60	37.88
404.00	0.00	414.40	26.39	424.80	38.07
404.20	0.00	414.60	26.66	425.00	38.26
404.40	0.00	414.80	26.93	425.20	38.45
404.60	0.00	415.00	27.20	425.40	38.64
404.80	0.00	415.20	27.47	425.60	38.82
405.00	0.00	415.40	27.73	425.80	39.01
405.20	0.00	415.60	27.99	426.00	39.20
405.40	0.00	415.80	28.25	426.20	39.38
405.60	0.00	416.00	28.50	426.40	39.56
405.80	0.00	416.20	28.75	426.60	39.75
406.00	0.00	416.40	29.00	426.80	39.93
406.20	0.00	416.60	29.25	427.00	40.11
406.40	0.00	416.80	29.50	427.20	40.29
406.60	0.00	417.00	29.74	427.40	40.47
406.80	0.00	417.20	29.99	427.60	40.65
407.00	0.00	417.40	30.23	427.80	40.82
407.20	0.00	417.60	30.47	428.00	41.00
407.40	0.00	417.80	30.70	428.20	41.18
407.60	0.00	418.00	30.94	428.40	41.35
407.80	0.00	418.20	31.17	428.60	41.53
408.00	0.00	418.40	31.40	428.80	41.70
408.20	0.00	418.60	31.63	429.00	41.87
408.40	0.00	418.80	31.86		
408.60	1.45	419.00	32.09		
408.80	7.52	419.20	32.31		
409.00	16.19	419.40	32.53		
409.20	17.89	419.60	32.76		
409.40	18.29	419.80	32.98		
409.60	18.68	420.00	33.20		
409.80	19.06	420.20	33.41		
410.00	19.44	420.40	33.63		
410.20	19.81	420.60	33.84		

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 90

Stage-Area-Storage for Pond 3P: Forebay & Bio B1-A

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
400.00	2,277	0	426.00	20,447	85,810
400.50	2,596	1,217	426.50	20,447	85,810
401.00	2,937	2,600	427.00	20,447	85,810
401.50	3,298	4,158	427.50	20,447	85,810
402.00	3,680	5,901	428.00	20,447	85,810
402.50	4,067	7,837	428.50	20,447	85,810
403.00	4,472	9,971	429.00	20,447	85,810
403.50	4,898	12,313			
404.00	5,342	14,872			
404.50	5,794	17,655			
405.00	6,263	20,668			
405.50	6,752	23,921			
406.00	7,258	27,423			
406.50	9,246	31,539			
407.00	11,474	36,709			
407.50	13,943	43,053			
408.00	15,166	50,328			
408.50	16,412	58,221			
409.00	17,708	66,749			
409.50	19,053	75,937			
410.00	20,447	85,810			
410.50	20,447	85,810			
411.00	20,447	85,810			
411.50	20,447	85,810			
412.00	20,447	85,810			
412.50	20,447	85,810			
413.00	20,447	85,810			
413.50	20,447	85,810			
414.00	20,447	85,810			
414.50	20,447	85,810			
415.00	20,447	85,810			
415.50	20,447	85,810			
416.00	20,447	85,810			
416.50	20,447	85,810			
417.00	20,447	85,810			
417.50	20,447	85,810			
418.00	20,447	85,810			
418.50	20,447	85,810			
419.00	20,447	85,810			
419.50	20,447	85,810			
420.00	20,447	85,810			
420.50	20,447	85,810			
421.00	20,447	85,810			
421.50	20,447	85,810			
422.00	20,447	85,810			
422.50	20,447	85,810			
423.00	20,447	85,810			
423.50	20,447	85,810			
424.00	20,447	85,810			
424.50	20,447	85,810			
425.00	20,447	85,810			
425.50	20,447	85,810			

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 91

Summary for Pond 4P: Detention Basin A1

Inflow Area = 10.068 ac, 49.91% Impervious, Inflow Depth = 10.92" for 500-yr event
 Inflow = 49.78 cfs @ 12.34 hrs, Volume= 9.159 af
 Outflow = 47.53 cfs @ 12.45 hrs, Volume= 8.242 af, Atten= 5%, Lag= 6.3 min
 Primary = 47.53 cfs @ 12.45 hrs, Volume= 8.242 af
 Routed to Pond PR-A : PR-A

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
 Automatic Starting Elev= 398.50' Surf.Area= 2,907 sf Storage= 21,861 cf
 Peak Elev= 409.39' @ 12.45 hrs Surf.Area= 22,800 sf Storage= 136,327 cf (114,466 cf above start)

Plug-Flow detention time= 390.9 min calculated for 7.740 af (85% of inflow)
 Center-of-Mass det. time= 279.5 min (1,081.5 - 802.0)

Volume	Invert	Avail.Storage	Storage Description	
#1	388.00'	150,665 cf	Custom Stage Data (Conic) Listed below (Recalc)	
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
388.00	1,355	0	0	1,355
400.00	3,176	26,422	26,422	4,046
402.00	5,824	8,867	35,289	6,736
404.00	9,598	15,266	50,555	10,560
406.00	14,095	23,549	74,104	15,122
408.00	19,096	33,065	107,169	20,205
410.00	24,513	43,496	150,665	25,722

Device	Routing	Invert	Outlet Devices
#1	Primary	398.50'	18.0" Round 18" Culvert L= 56.0' CPP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 398.50' / 397.94' S= 0.0100 '/' Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 1.77 sf
#2	Device 1	388.50'	3.0" Vert. 3" Orifice C= 0.600 Limited to weir flow at low heads
#3	Device 1	408.50'	36.0" x 48.0" Horiz. OS A1 C= 0.600 Limited to weir flow at low heads
#4	Primary	409.00'	30.0' long + 2.0 ' SideZ x 50.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=47.52 cfs @ 12.45 hrs HW=409.39' TW=0.00' (Dynamic Tailwater)

- 1=18" Culvert (Inlet Controls 27.10 cfs @ 15.34 fps)
- 2=3" Orifice (Passes < 0.78 cfs potential flow)
- 3=OS A1 (Passes < 38.68 cfs potential flow)
- 4=Broad-Crested Rectangular Weir (Weir Controls 20.43 cfs @ 1.69 fps)

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"


Printed 12/8/2025

Page 92

Pond 4P: Detention Basin A1

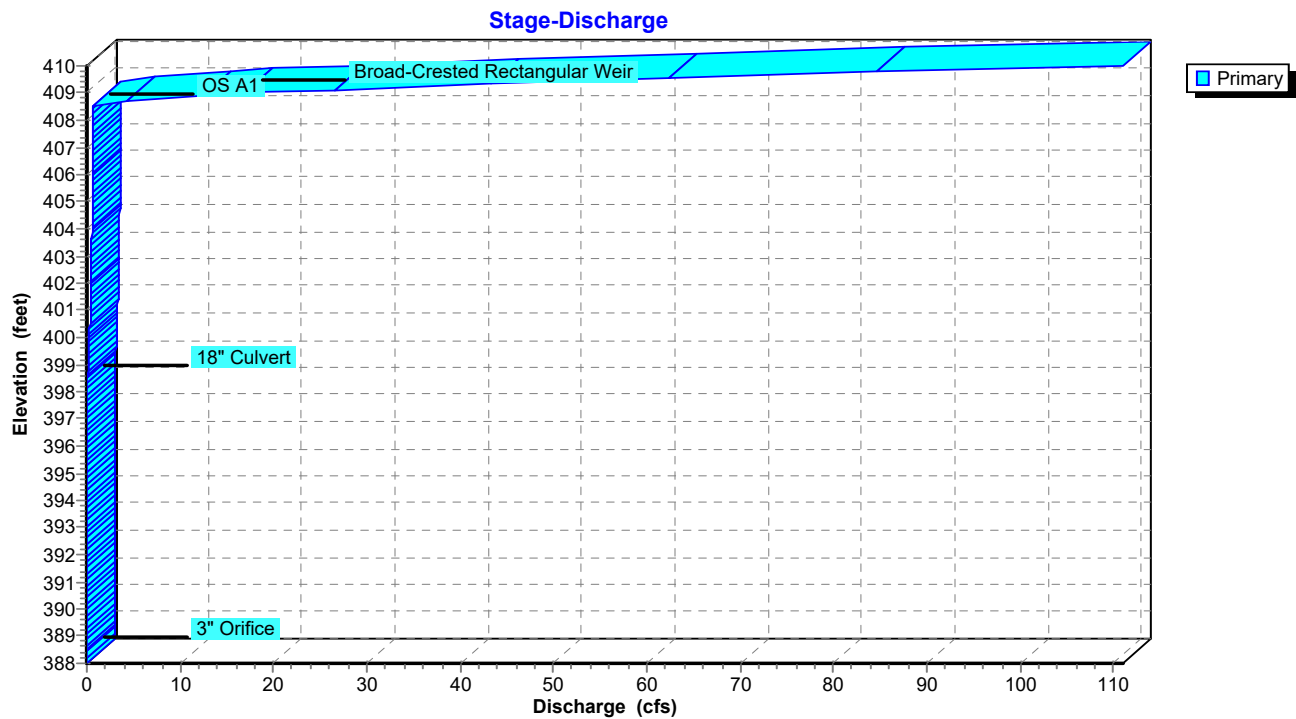

Pond 4P: Detention Basin A1

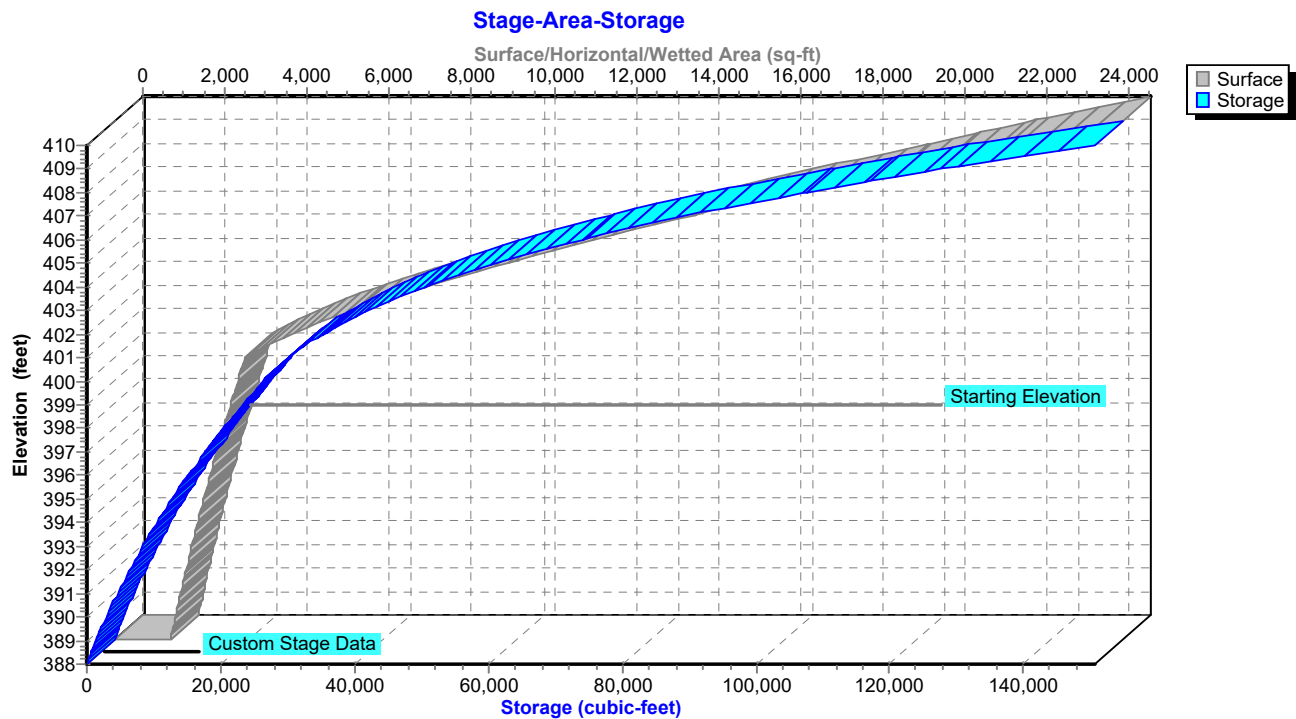

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 93

Stage-Discharge for Pond 4P: Detention Basin A1

Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)
388.00	0.00	398.40	0.00	408.80	8.28
388.20	0.00	398.60	0.05	409.00	16.95
388.40	0.00	398.80	0.13	409.20	34.11
388.60	0.00	399.00	0.17	409.40	48.04
388.80	0.00	399.20	0.20	409.60	66.22
389.00	0.00	399.40	0.22	409.80	86.73
389.20	0.00	399.60	0.25	410.00	111.01
389.40	0.00	399.80	0.27		
389.60	0.00	400.00	0.29		
389.80	0.00	400.20	0.31		
390.00	0.00	400.40	0.33		
390.20	0.00	400.60	0.34		
390.40	0.00	400.80	0.36		
390.60	0.00	401.00	0.37		
390.80	0.00	401.20	0.39		
391.00	0.00	401.40	0.40		
391.20	0.00	401.60	0.42		
391.40	0.00	401.80	0.43		
391.60	0.00	402.00	0.44		
391.80	0.00	402.20	0.45		
392.00	0.00	402.40	0.47		
392.20	0.00	402.60	0.48		
392.40	0.00	402.80	0.49		
392.60	0.00	403.00	0.50		
392.80	0.00	403.20	0.51		
393.00	0.00	403.40	0.52		
393.20	0.00	403.60	0.53		
393.40	0.00	403.80	0.54		
393.60	0.00	404.00	0.55		
393.80	0.00	404.20	0.56		
394.00	0.00	404.40	0.57		
394.20	0.00	404.60	0.58		
394.40	0.00	404.80	0.59		
394.60	0.00	405.00	0.60		
394.80	0.00	405.20	0.61		
395.00	0.00	405.40	0.62		
395.20	0.00	405.60	0.63		
395.40	0.00	405.80	0.64		
395.60	0.00	406.00	0.65		
395.80	0.00	406.20	0.66		
396.00	0.00	406.40	0.66		
396.20	0.00	406.60	0.67		
396.40	0.00	406.80	0.68		
396.60	0.00	407.00	0.69		
396.80	0.00	407.20	0.70		
397.00	0.00	407.40	0.71		
397.20	0.00	407.60	0.71		
397.40	0.00	407.80	0.72		
397.60	0.00	408.00	0.73		
397.80	0.00	408.20	0.74		
398.00	0.00	408.40	0.74		
398.20	0.00	408.60	2.20		

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 94

Stage-Area-Storage for Pond 4P: Detention Basin A1

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
388.00	1,355	0
388.50	1,416	693
389.00	1,478	1,416
389.50	1,541	2,170
390.00	1,605	2,957
390.50	1,671	3,776
391.00	1,739	4,628
391.50	1,807	5,515
392.00	1,877	6,436
392.50	1,948	7,392
393.00	2,021	8,384
393.50	2,095	9,413
394.00	2,170	10,479
394.50	2,247	11,584
395.00	2,324	12,726
395.50	2,404	13,908
396.00	2,484	15,130
396.50	2,566	16,392
397.00	2,649	17,696
397.50	2,734	19,042
398.00	2,819	20,430
398.50	2,907	21,861
399.00	2,995	23,337
399.50	3,085	24,857
400.00	3,176	26,422
400.50	3,763	28,155
401.00	4,400	30,194
401.50	5,087	32,563
402.00	5,824	35,289
402.50	6,680	38,413
403.00	7,594	41,978
403.50	8,567	46,016
404.00	9,598	50,555
404.50	10,641	55,612
405.00	11,739	61,205
405.50	12,890	67,360
406.00	14,095	74,104
406.50	15,274	81,445
407.00	16,501	89,386
407.50	17,775	97,953
408.00	19,096	107,169
408.50	20,387	117,038
409.00	21,720	127,563
409.50	23,095	138,765
410.00	24,513	150,665

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 95

Summary for Pond 6P: Forebay & Bio B1-B

Inflow Area = 0.610 ac, 25.08% Impervious, Inflow Depth = 5.87" for 500-yr event
 Inflow = 2.51 cfs @ 12.23 hrs, Volume= 0.299 af
 Outflow = 1.95 cfs @ 12.66 hrs, Volume= 0.299 af, Atten= 22%, Lag= 26.1 min
 Primary = 1.95 cfs @ 12.66 hrs, Volume= 0.299 af
 Routed to Pond 7P : Detention Basin B1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
 Automatic Starting Elev= 408.50' Surf.Area= 14,636 sf Storage= 43,121 cf
 Peak Elev= 408.65' @ 12.56 hrs Surf.Area= 15,013 sf Storage= 45,305 cf (2,184 cf above start)

Plug-Flow detention time= (not calculated: initial storage exceeds outflow)
 Center-of-Mass det. time= 29.0 min (897.2 - 868.2)

Volume	Invert	Avail.Storage	Storage Description	
#1	400.00'	68,054 cf	Custom Stage Data (Conic) Listed below (Recalc)	
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
400.00	713	0	0	713
402.00	1,896	2,514	2,514	1,922
404.00	3,550	5,360	7,875	3,616
406.00	5,471	8,952	16,827	5,594
407.50	12,169	12,900	29,726	12,310
408.00	13,395	6,389	36,115	13,552
410.00	18,691	31,939	68,054	18,924

Device	Routing	Invert	Outlet Devices
#1	Primary	404.99'	18.0" Round Culvert L= 149.6' CPP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 404.99' / 402.00' S= 0.0200 '/' Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 1.77 sf
#2	Device 1	408.50'	36.0" x 48.0" Horiz. OS B1-B C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=1.99 cfs @ 12.66 hrs HW=408.64' TW=408.56' (Dynamic Tailwater)

↑ **1=Culvert** (Passes 1.99 cfs of 2.16 cfs potential flow)

↑ **2=OS B1-B** (Weir Controls 1.99 cfs @ 1.04 fps)

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"


Printed 12/8/2025

Page 96

Pond 6P: Forebay & Bio B1-B

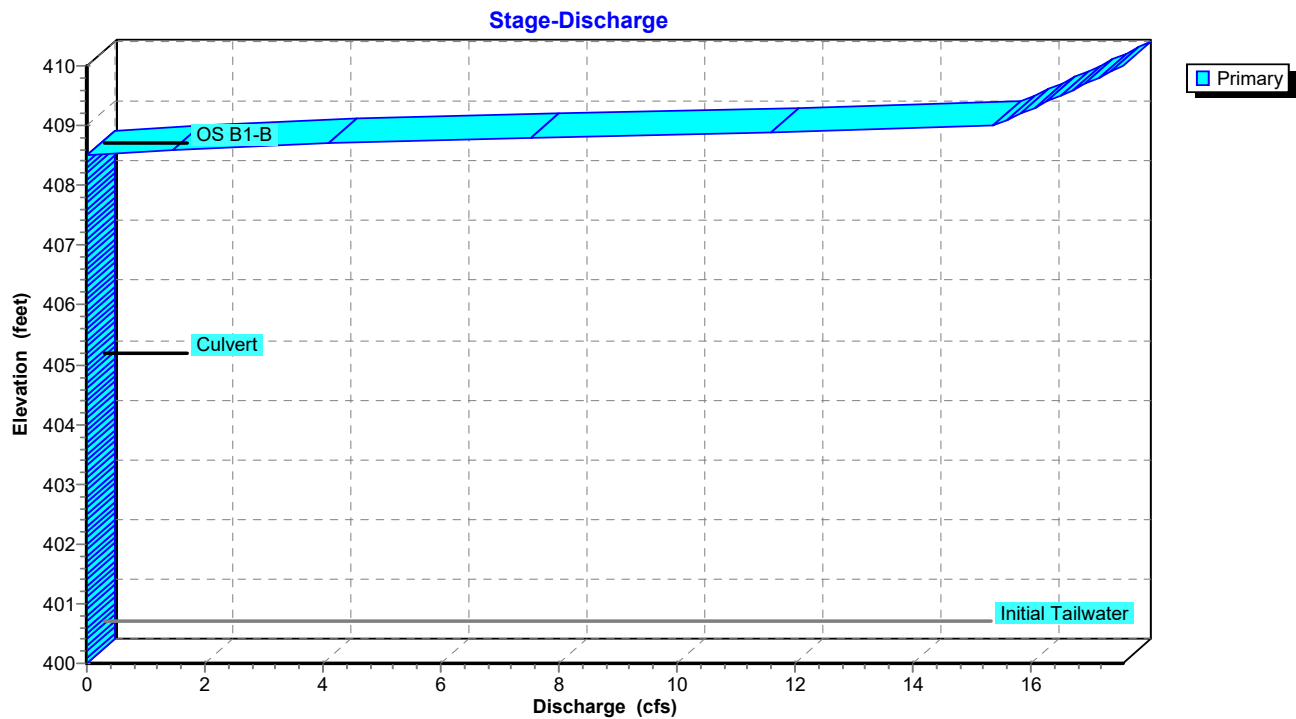

Pond 6P: Forebay & Bio B1-B

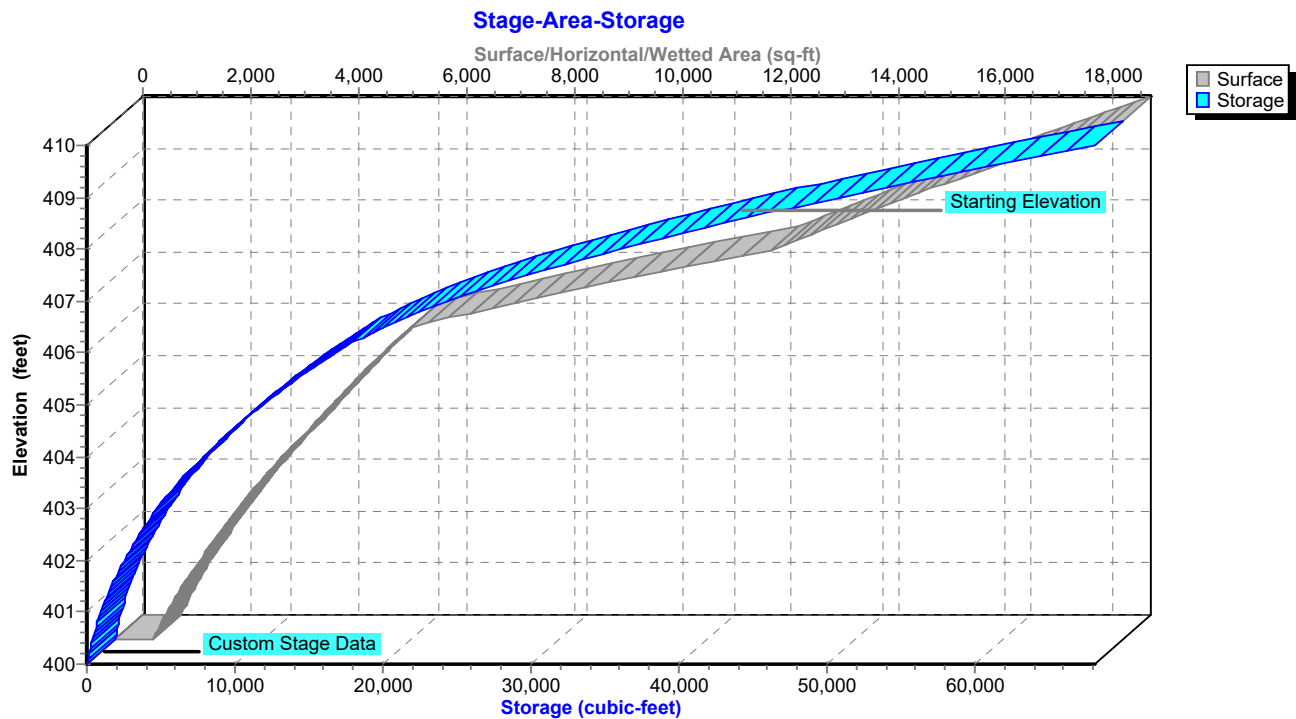

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 97

Stage-Discharge for Pond 6P: Forebay & Bio B1-B

Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)
400.00	0.00	402.60	0.00	405.20	0.00	407.80	0.00
400.05	0.00	402.65	0.00	405.25	0.00	407.85	0.00
400.10	0.00	402.70	0.00	405.30	0.00	407.90	0.00
400.15	0.00	402.75	0.00	405.35	0.00	407.95	0.00
400.20	0.00	402.80	0.00	405.40	0.00	408.00	0.00
400.25	0.00	402.85	0.00	405.45	0.00	408.05	0.00
400.30	0.00	402.90	0.00	405.50	0.00	408.10	0.00
400.35	0.00	402.95	0.00	405.55	0.00	408.15	0.00
400.40	0.00	403.00	0.00	405.60	0.00	408.20	0.00
400.45	0.00	403.05	0.00	405.65	0.00	408.25	0.00
400.50	0.00	403.10	0.00	405.70	0.00	408.30	0.00
400.55	0.00	403.15	0.00	405.75	0.00	408.35	0.00
400.60	0.00	403.20	0.00	405.80	0.00	408.40	0.00
400.65	0.00	403.25	0.00	405.85	0.00	408.45	0.00
400.70	0.00	403.30	0.00	405.90	0.00	408.50	0.00
400.75	0.00	403.35	0.00	405.95	0.00	408.55	0.51
400.80	0.00	403.40	0.00	406.00	0.00	408.60	1.45
400.85	0.00	403.45	0.00	406.05	0.00	408.65	2.66
400.90	0.00	403.50	0.00	406.10	0.00	408.70	4.09
400.95	0.00	403.55	0.00	406.15	0.00	408.75	5.72
401.00	0.00	403.60	0.00	406.20	0.00	408.80	7.52
401.05	0.00	403.65	0.00	406.25	0.00	408.85	9.48
401.10	0.00	403.70	0.00	406.30	0.00	408.90	11.58
401.15	0.00	403.75	0.00	406.35	0.00	408.95	13.82
401.20	0.00	403.80	0.00	406.40	0.00	409.00	15.36
401.25	0.00	403.85	0.00	406.45	0.00	409.05	15.48
401.30	0.00	403.90	0.00	406.50	0.00	409.10	15.60
401.35	0.00	403.95	0.00	406.55	0.00	409.15	15.71
401.40	0.00	404.00	0.00	406.60	0.00	409.20	15.83
401.45	0.00	404.05	0.00	406.65	0.00	409.25	15.94
401.50	0.00	404.10	0.00	406.70	0.00	409.30	16.05
401.55	0.00	404.15	0.00	406.75	0.00	409.35	16.17
401.60	0.00	404.20	0.00	406.80	0.00	409.40	16.28
401.65	0.00	404.25	0.00	406.85	0.00	409.45	16.39
401.70	0.00	404.30	0.00	406.90	0.00	409.50	16.50
401.75	0.00	404.35	0.00	406.95	0.00	409.55	16.61
401.80	0.00	404.40	0.00	407.00	0.00	409.60	16.72
401.85	0.00	404.45	0.00	407.05	0.00	409.65	16.82
401.90	0.00	404.50	0.00	407.10	0.00	409.70	16.93
401.95	0.00	404.55	0.00	407.15	0.00	409.75	17.04
402.00	0.00	404.60	0.00	407.20	0.00	409.80	17.14
402.05	0.00	404.65	0.00	407.25	0.00	409.85	17.25
402.10	0.00	404.70	0.00	407.30	0.00	409.90	17.35
402.15	0.00	404.75	0.00	407.35	0.00	409.95	17.46
402.20	0.00	404.80	0.00	407.40	0.00	410.00	17.56
402.25	0.00	404.85	0.00	407.45	0.00		
402.30	0.00	404.90	0.00	407.50	0.00		
402.35	0.00	404.95	0.00	407.55	0.00		
402.40	0.00	405.00	0.00	407.60	0.00		
402.45	0.00	405.05	0.00	407.65	0.00		
402.50	0.00	405.10	0.00	407.70	0.00		
402.55	0.00	405.15	0.00	407.75	0.00		

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 98

Stage-Area-Storage for Pond 6P: Forebay & Bio B1-B

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
400.00	713	0	405.20	4,653	12,782
400.10	759	74	405.30	4,752	13,252
400.20	806	152	405.40	4,851	13,732
400.30	854	235	405.50	4,952	14,222
400.40	904	323	405.60	5,054	14,722
400.50	956	416	405.70	5,156	15,233
400.60	1,008	514	405.80	5,260	15,754
400.70	1,063	617	405.90	5,365	16,285
400.80	1,118	726	406.00	5,471	16,827
400.90	1,175	841	406.10	5,835	17,392
401.00	1,234	961	406.20	6,211	17,994
401.10	1,293	1,088	406.30	6,599	18,635
401.20	1,355	1,220	406.40	6,999	19,314
401.30	1,417	1,359	406.50	7,410	20,035
401.40	1,482	1,504	406.60	7,833	20,797
401.50	1,547	1,655	406.70	8,268	21,602
401.60	1,614	1,813	406.80	8,714	22,451
401.70	1,682	1,978	406.90	9,173	23,345
401.80	1,752	2,150	407.00	9,643	24,286
401.90	1,823	2,329	407.10	10,125	25,274
402.00	1,896	2,514	407.20	10,618	26,311
402.10	1,966	2,708	407.30	11,123	27,398
402.20	2,038	2,908	407.40	11,640	28,536
402.30	2,111	3,115	407.50	12,169	29,726
402.40	2,186	3,330	407.60	12,409	30,955
402.50	2,261	3,552	407.70	12,652	32,208
402.60	2,338	3,782	407.80	12,898	33,486
402.70	2,416	4,020	407.90	13,145	34,788
402.80	2,496	4,266	408.00	13,395	36,115
402.90	2,577	4,519	408.10	13,639	37,467
403.00	2,659	4,781	408.20	13,885	38,843
403.10	2,742	5,051	408.30	14,133	40,244
403.20	2,827	5,330	408.40	14,384	41,670
403.30	2,913	5,616	408.50	14,636	43,121
403.40	3,000	5,912	408.60	14,891	44,597
403.50	3,088	6,216	408.70	15,148	46,099
403.60	3,178	6,530	408.80	15,408	47,627
403.70	3,269	6,852	408.90	15,669	49,181
403.80	3,361	7,184	409.00	15,933	50,761
403.90	3,455	7,524	409.10	16,199	52,367
404.00	3,550	7,875	409.20	16,467	54,001
404.10	3,636	8,234	409.30	16,737	55,661
404.20	3,723	8,602	409.40	17,010	57,348
404.30	3,812	8,979	409.50	17,284	59,063
404.40	3,901	9,364	409.60	17,561	60,805
404.50	3,991	9,759	409.70	17,840	62,575
404.60	4,083	10,163	409.80	18,122	64,373
404.70	4,175	10,576	409.90	18,405	66,200
404.80	4,269	10,998	410.00	18,691	68,054
404.90	4,363	11,429			
405.00	4,459	11,870			
405.10	4,555	12,321			

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 99

Summary for Pond 7P: Detention Basin B1

Inflow Area = 5.956 ac, 45.33% Impervious, Inflow Depth = 9.83" for 500-yr event
 Inflow = 41.12 cfs @ 12.35 hrs, Volume= 4.879 af
 Outflow = 23.73 cfs @ 12.48 hrs, Volume= 4.723 af, Atten= 42%, Lag= 7.6 min
 Primary = 23.73 cfs @ 12.48 hrs, Volume= 4.723 af
 Routed to Pond PR-B : PR-B

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
 Automatic Starting Elev= 400.50' Surf.Area= 1,825 sf Storage= 806 cf
 Peak Elev= 408.63' @ 12.48 hrs Surf.Area= 13,893 sf Storage= 59,000 cf (58,194 cf above start)

Plug-Flow detention time= 354.7 min calculated for 4.705 af (96% of inflow)
 Center-of-Mass det. time= 328.7 min (1,145.5 - 816.7)

Volume	Invert	Avail.Storage	Storage Description	
#1	400.00'	79,868 cf	Custom Stage Data (Conic) Listed below (Recalc)	
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
400.00	1,408	0	0	1,408
402.00	3,402	4,666	4,666	3,431
404.00	5,985	9,266	13,932	6,058
406.00	9,096	14,973	28,905	9,229
408.00	12,687	21,684	50,588	12,895
410.00	16,684	29,280	79,868	16,983

Device	Routing	Invert	Outlet Devices
#1	Primary	400.00'	18.0" Round Culvert L= 140.0' CPP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 400.00' / 398.00' S= 0.0143 '/' Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 1.77 sf
#2	Device 1	400.50'	3.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#3	Device 1	408.00'	36.0" x 48.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#4	Primary	409.00'	30.0' long + 2.0 ' SideZ x 50.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=23.73 cfs @ 12.48 hrs HW=408.63' TW=0.00' (Dynamic Tailwater)

- 1=Culvert (Passes 23.73 cfs of 23.89 cfs potential flow)
- 2=Orifice/Grate (Orifice Controls 0.67 cfs @ 13.63 fps)
- 3=Orifice/Grate (Weir Controls 23.06 cfs @ 2.60 fps)
- 4=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

103.0301 - Hydrographs

Prepared by Engineering Surveying Properties


HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"


Printed 12/8/2025

Page 100

Pond 7P: Detention Basin B1

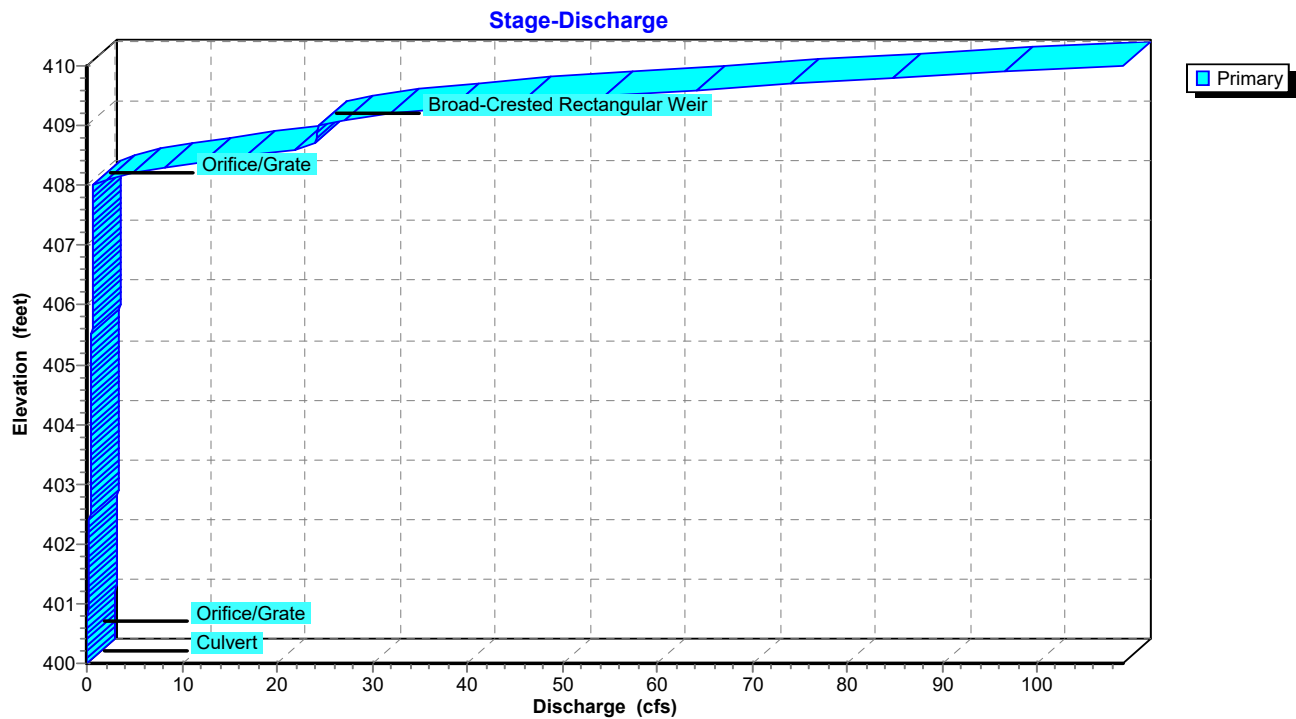

Pond 7P: Detention Basin B1

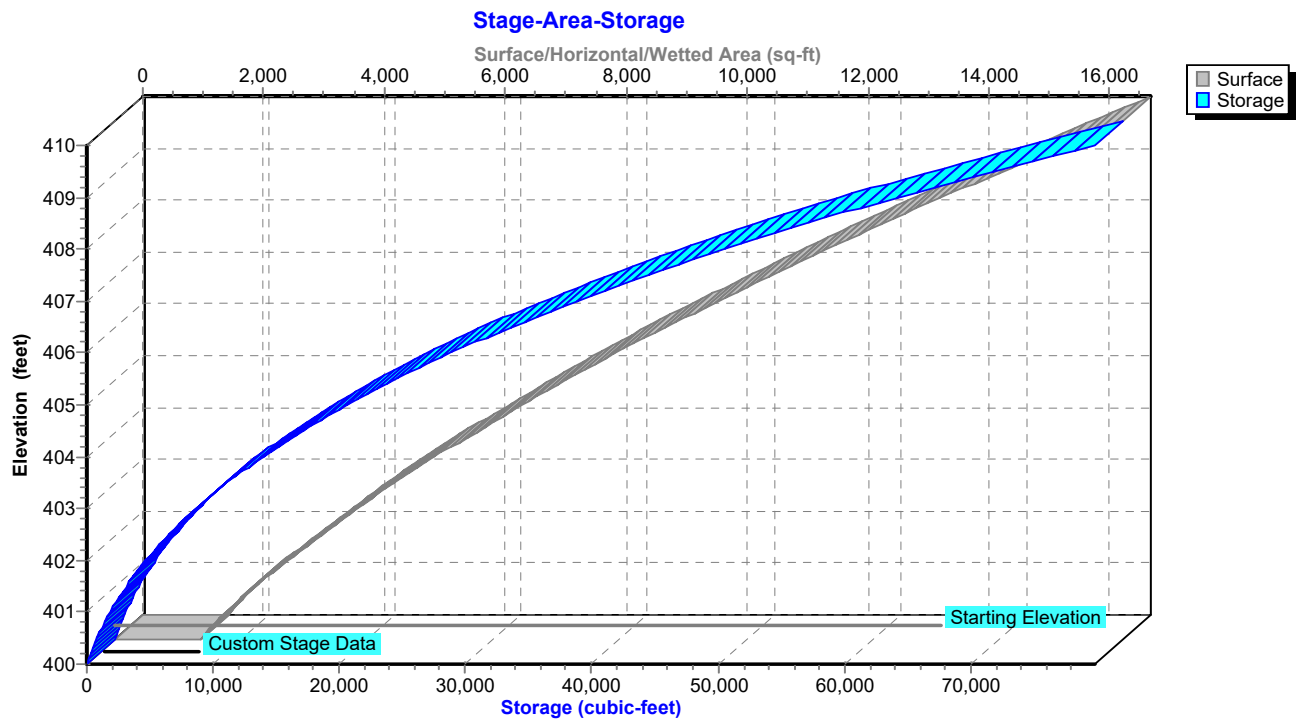

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 101

Stage-Discharge for Pond 7P: Detention Basin B1

Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)	Elevation (feet)	Primary (cfs)
400.00	0.00	402.60	0.33	405.20	0.51	407.80	0.63
400.05	0.00	402.65	0.34	405.25	0.51	407.85	0.64
400.10	0.00	402.70	0.34	405.30	0.51	407.90	0.64
400.15	0.00	402.75	0.34	405.35	0.51	407.95	0.64
400.20	0.00	402.80	0.35	405.40	0.52	408.00	0.64
400.25	0.00	402.85	0.35	405.45	0.52	408.05	1.16
400.30	0.00	402.90	0.36	405.50	0.52	408.10	2.09
400.35	0.00	402.95	0.36	405.55	0.52	408.15	3.31
400.40	0.00	403.00	0.36	405.60	0.53	408.20	4.75
400.45	0.00	403.05	0.37	405.65	0.53	408.25	6.38
400.50	0.00	403.10	0.37	405.70	0.53	408.30	8.18
400.55	0.01	403.15	0.38	405.75	0.54	408.35	10.14
400.60	0.02	403.20	0.38	405.80	0.54	408.40	12.24
400.65	0.04	403.25	0.38	405.85	0.54	408.45	14.48
400.70	0.06	403.30	0.39	405.90	0.54	408.50	16.85
400.75	0.08	403.35	0.39	405.95	0.55	408.55	19.34
400.80	0.10	403.40	0.39	406.00	0.55	408.60	21.94
400.85	0.11	403.45	0.40	406.05	0.55	408.65	23.92
400.90	0.12	403.50	0.40	406.10	0.55	408.70	23.99
400.95	0.13	403.55	0.40	406.15	0.56	408.75	24.07
401.00	0.14	403.60	0.41	406.20	0.56	408.80	24.14
401.05	0.15	403.65	0.41	406.25	0.56	408.85	24.22
401.10	0.16	403.70	0.41	406.30	0.56	408.90	24.29
401.15	0.17	403.75	0.42	406.35	0.57	408.95	24.37
401.20	0.18	403.80	0.42	406.40	0.57	409.00	24.44
401.25	0.19	403.85	0.42	406.45	0.57	409.05	25.41
401.30	0.19	403.90	0.43	406.50	0.57	409.10	27.14
401.35	0.20	403.95	0.43	406.55	0.58	409.15	29.37
401.40	0.21	404.00	0.43	406.60	0.58	409.20	32.00
401.45	0.21	404.05	0.44	406.65	0.58	409.25	35.01
401.50	0.22	404.10	0.44	406.70	0.58	409.30	38.35
401.55	0.23	404.15	0.44	406.75	0.58	409.35	42.01
401.60	0.23	404.20	0.45	406.80	0.59	409.40	45.95
401.65	0.24	404.25	0.45	406.85	0.59	409.45	50.14
401.70	0.25	404.30	0.45	406.90	0.59	409.50	54.57
401.75	0.25	404.35	0.46	406.95	0.59	409.55	59.25
401.80	0.26	404.40	0.46	407.00	0.60	409.60	64.16
401.85	0.26	404.45	0.46	407.05	0.60	409.65	69.06
401.90	0.27	404.50	0.47	407.10	0.60	409.70	74.12
401.95	0.27	404.55	0.47	407.15	0.60	409.75	79.33
402.00	0.28	404.60	0.47	407.20	0.61	409.80	84.69
402.05	0.28	404.65	0.47	407.25	0.61	409.85	90.49
402.10	0.29	404.70	0.48	407.30	0.61	409.90	96.47
402.15	0.29	404.75	0.48	407.35	0.61	409.95	102.64
402.20	0.30	404.80	0.48	407.40	0.62	410.00	108.99
402.25	0.30	404.85	0.49	407.45	0.62		
402.30	0.31	404.90	0.49	407.50	0.62		
402.35	0.31	404.95	0.49	407.55	0.62		
402.40	0.31	405.00	0.49	407.60	0.62		
402.45	0.32	405.05	0.50	407.65	0.63		
402.50	0.32	405.10	0.50	407.70	0.63		
402.55	0.33	405.15	0.50	407.75	0.63		

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 102

Stage-Area-Storage for Pond 7P: Detention Basin B1

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
400.00	1,408	0	405.20	7,774	22,164
400.10	1,487	145	405.30	7,933	22,949
400.20	1,568	298	405.40	8,095	23,751
400.30	1,652	459	405.50	8,257	24,568
400.40	1,738	628	405.60	8,422	25,402
400.50	1,825	806	405.70	8,588	26,253
400.60	1,915	993	405.80	8,756	27,120
400.70	2,007	1,189	405.90	8,925	28,004
400.80	2,102	1,395	406.00	9,096	28,905
400.90	2,198	1,610	406.10	9,261	29,823
401.00	2,297	1,834	406.20	9,428	30,757
401.10	2,398	2,069	406.30	9,597	31,708
401.20	2,501	2,314	406.40	9,767	32,677
401.30	2,606	2,569	406.50	9,938	33,662
401.40	2,713	2,835	406.60	10,111	34,664
401.50	2,822	3,112	406.70	10,285	35,684
401.60	2,934	3,400	406.80	10,461	36,721
401.70	3,048	3,699	406.90	10,638	37,776
401.80	3,164	4,009	407.00	10,817	38,849
401.90	3,282	4,332	407.10	10,997	39,940
402.00	3,402	4,666	407.20	11,179	41,048
402.10	3,514	5,012	407.30	11,362	42,175
402.20	3,628	5,369	407.40	11,547	43,321
402.30	3,743	5,737	407.50	11,733	44,485
402.40	3,861	6,117	407.60	11,921	45,668
402.50	3,980	6,509	407.70	12,110	46,869
402.60	4,101	6,913	407.80	12,301	48,090
402.70	4,224	7,330	407.90	12,493	49,329
402.80	4,348	7,758	408.00	12,687	50,588
402.90	4,475	8,199	408.10	12,874	51,867
403.00	4,603	8,653	408.20	13,062	53,163
403.10	4,733	9,120	408.30	13,252	54,479
403.20	4,865	9,600	408.40	13,443	55,814
403.30	4,999	10,093	408.50	13,635	57,168
403.40	5,134	10,600	408.60	13,829	58,541
403.50	5,271	11,120	408.70	14,024	59,933
403.60	5,410	11,654	408.80	14,220	61,346
403.70	5,551	12,202	408.90	14,418	62,777
403.80	5,694	12,764	409.00	14,617	64,229
403.90	5,839	13,341	409.10	14,818	65,701
404.00	5,985	13,932	409.20	15,020	67,193
404.10	6,125	14,537	409.30	15,223	68,705
404.20	6,267	15,157	409.40	15,428	70,237
404.30	6,410	15,791	409.50	15,634	71,790
404.40	6,555	16,439	409.60	15,841	73,364
404.50	6,702	17,102	409.70	16,050	74,959
404.60	6,850	17,780	409.80	16,260	76,574
404.70	7,000	18,472	409.90	16,471	78,211
404.80	7,152	19,180	410.00	16,684	79,868
404.90	7,305	19,902			
405.00	7,459	20,641			
405.10	7,616	21,394			

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 103

Summary for Pond PR-A: PR-A

Inflow Area = 37.077 ac, 36.24% Impervious, Inflow Depth > 9.36" for 500-yr event

Inflow = 203.38 cfs @ 12.26 hrs, Volume= 28.911 af

Primary = 203.38 cfs @ 12.26 hrs, Volume= 28.911 af, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs

103.0301 - Hydrographs

NY-Sheffield 24-hr S1 500-yr Rainfall=12.30"

Prepared by Engineering Surveying Properties

Printed 12/8/2025

HydroCAD® 10.20-5c s/n 12896 © 2023 HydroCAD Software Solutions LLC

Page 104

Summary for Pond PR-B: PR-B

Inflow Area = 17.738 ac, 22.72% Impervious, Inflow Depth > 7.83" for 500-yr event

Inflow = 64.67 cfs @ 12.41 hrs, Volume= 11.572 af

Primary = 64.67 cfs @ 12.41 hrs, Volume= 11.572 af, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs

APPENDIX 13

FOREBAY & WQV

CALCULATIONS

WQv Provided in SMP

WO. NO. 1146.01	DATE Jan '24	REVISED Dec '25	SHEET 1	OF 8
---------------------------	------------------------	---------------------------	-------------------	----------------

PROJECT TITLE
Sheffield Gardens

LOCATION
Town of Montgomery

CALCULATED BY
ZS

APPROVED BY
RW


REF DRAWING(S)

Basin **Forebay A1-A**

WQv provided: **1.041** ac-ft

Water Surface Elevation (Feet)	Surface Area (Square Feet)	Average Area (Square Feet)	Difference in Elevation (Feet)	Incremental Storage (Cubic Feet)	Total Storage Volume (Cubic Feet)
400.00	2,093.0	--	--	--	0.0
402.00	3,854.0	2,973.5	2.0	5,947.0	5,947.0
404.00	5,993.0	4,923.5	2.0	9,847.0	15,794.0
406.00	8,917.0	7,455.0	2.0	14,910.0	30,704.0
407.50	10,633.0	9,775.0	1.5	14,662.5	45,366.5
408.00	11,395.0	11,014.0	0.5	5,507.0	50,873.5
410.00	12,177.0	11,786.0	2.0	23,572.0	74,445.5

Stage Storage Curve

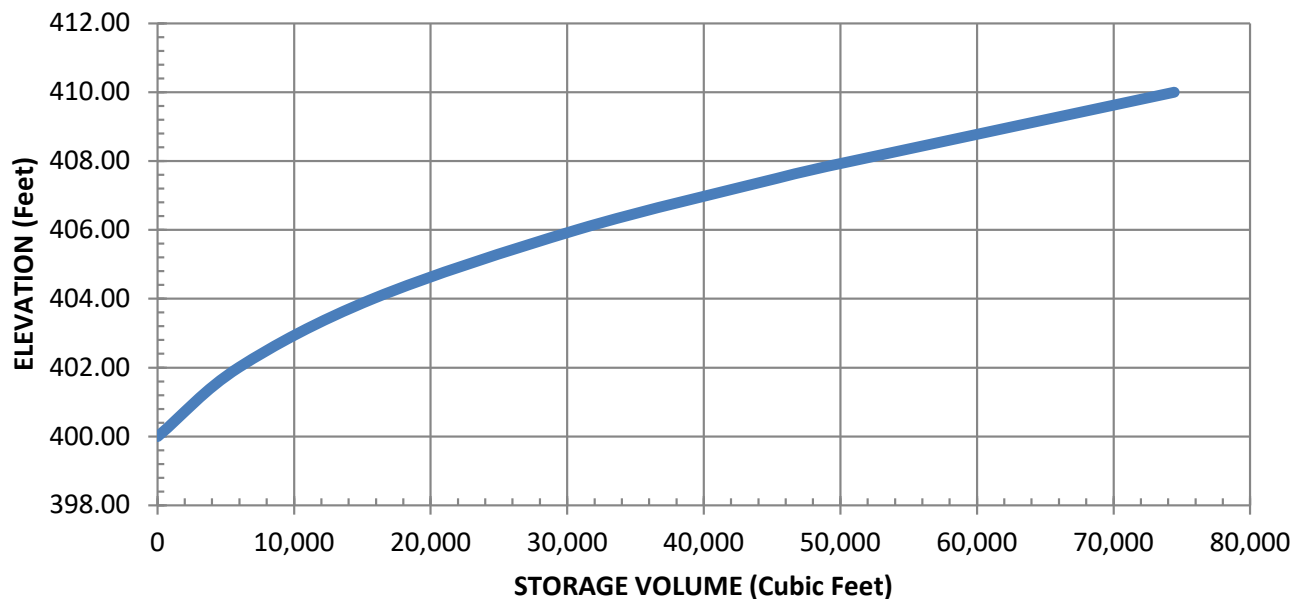

WQv Provided in SMP

WO. NO.	DATE	REVISED	SHEET	OF
1146.01	Jan '24	Dec '25	2	8

PROJECT TITLE
Sheffield Gardens

LOCATION
Town of Montgomery

CALCULATED BY
ZS

APPROVED BY
RW


REF DRAWING(S)

Basin **Bio-Ret A1-A**

WQv provided: 0.414 ac-ft

Water Surface Elevation (Feet)	Surface Area (Square Feet)	Average Area (Square Feet)	Difference in Elevation (Feet)	Incremental Storage (Cubic Feet)	Total Storage Volume (Cubic Feet)
407.50	16,634.0	--	--	--	0.0
408.00	18,030.0	17,332.0	0.5	8,666.0	8,666.0
408.50	19,471.0	18,750.5	0.5	9,375.3	18,041.3
410.00	24,063.0	21,767.0	1.5	32,650.5	50,691.8

Stage Storage Curve

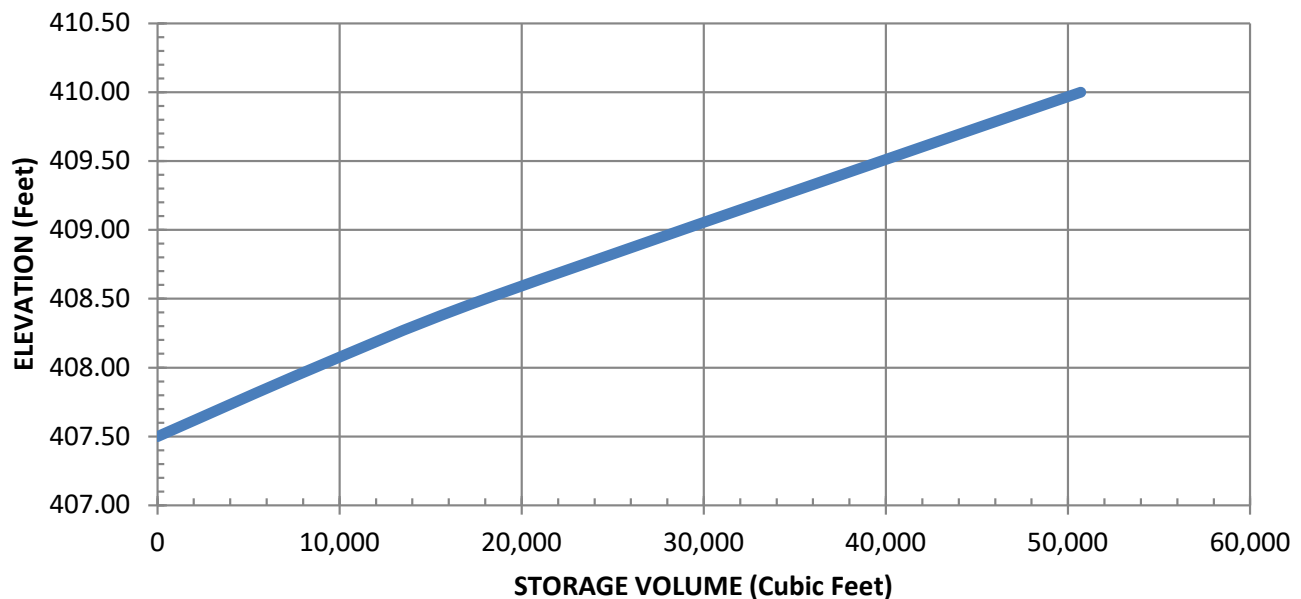

WQv Provided in SMP

WO. NO. 1146.01	DATE Jan '24	REVISED Dec '25	SHEET 3	OF 8
---------------------------	------------------------	---------------------------	-------------------	----------------

PROJECT TITLE
Sheffield Gardens

LOCATION
Town of Montgomery

CALCULATED BY
ZS

APPROVED BY
RW


REF DRAWING(S)

Basin **Forebay A1-B**

WQv provided: **1.154** ac-ft

Water Surface Elevation (Feet)	Surface Area (Square Feet)	Average Area (Square Feet)	Difference in Elevation (Feet)	Incremental Storage (Cubic Feet)	Total Storage Volume (Cubic Feet)
400.00	3,314.0	--	--	--	0.0
402.00	4,891.0	4,102.5	2.0	8,205.0	8,205.0
404.00	6,756.0	5,823.5	2.0	11,647.0	19,852.0
406.00	8,917.0	7,836.5	2.0	15,673.0	35,525.0
407.50	10,720.0	9,818.5	1.5	14,727.8	50,252.8
408.00	11,349.0	11,034.5	0.5	5,517.3	55,770.0
410.00	14,008.0	12,678.5	2.0	25,357.0	81,127.0

Stage Storage Curve

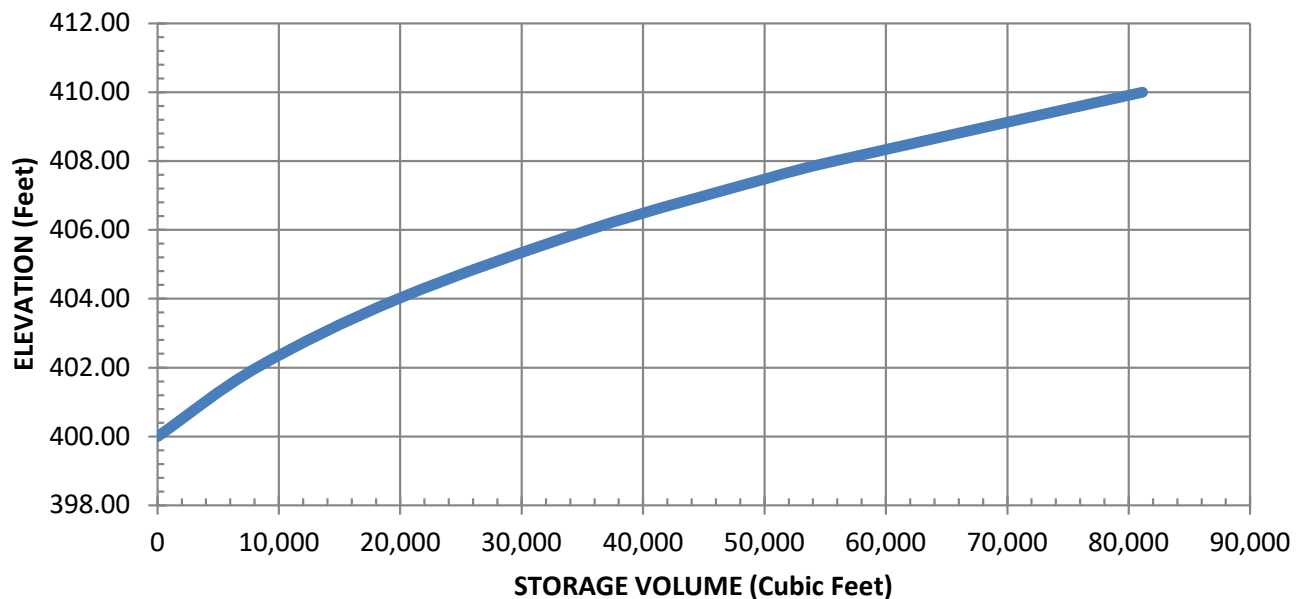



WQv Provided in SMP

WO. NO.	DATE	REVISED	SHEET	OF
1146.01	Jan '24	Dec '25	4	8

PROJECT TITLE
Sheffield Gardens

LOCATION
Town of Montgomery

CALCULATED BY
ZS

APPROVED BY
RW


REF DRAWING(S)

Basin **Bio-Ret A1-B**

WQv provided: 0.412 ac-ft

Water Surface Elevation (Feet)	Surface Area (Square Feet)	Average Area (Square Feet)	Difference in Elevation (Feet)	Incremental Storage (Cubic Feet)	Total Storage Volume (Cubic Feet)
407.50	16,689.0	--	--	--	0.0
408.00	17,949.0	17,319.0	0.5	8,659.5	8,659.5
408.50	19,248.0	18,598.5	0.5	9,299.3	17,958.8
410.00	23,380.0	21,314.0	1.5	31,971.0	49,929.8

Stage Storage Curve

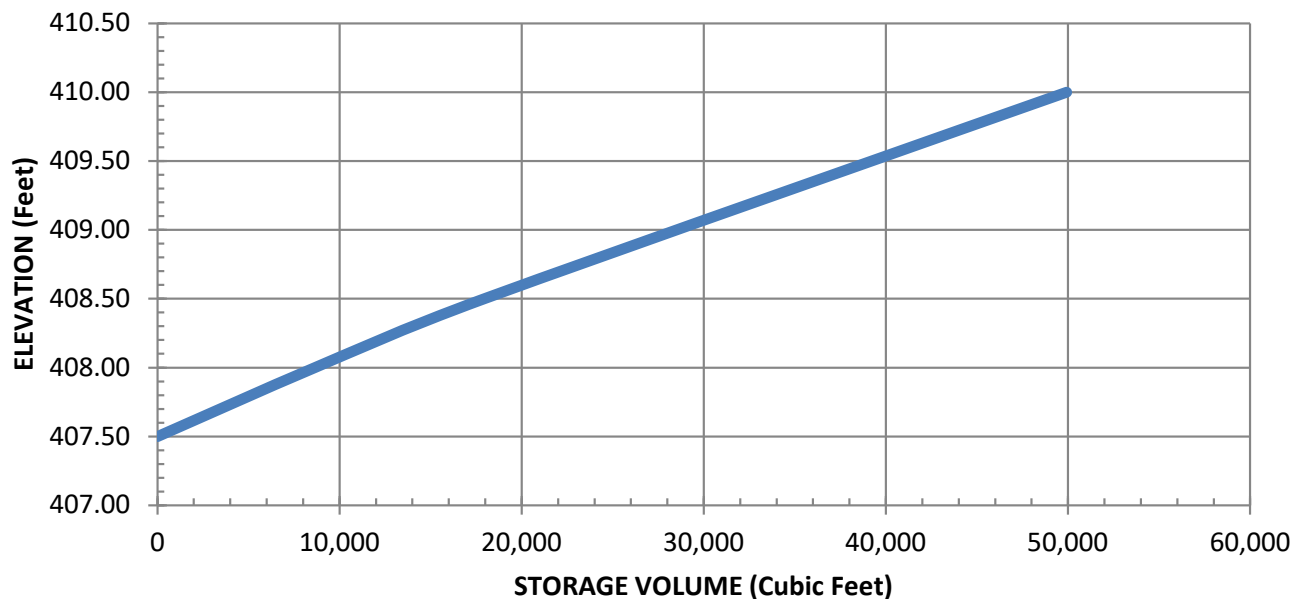

WQv Provided in SMP

WO. NO.	DATE	REVISED	SHEET	OF
1146.01	Jan '24	Dec '25	5	8

PROJECT TITLE
Sheffield Gardens

LOCATION
Town of Montgomery

CALCULATED BY
ZS

APPROVED BY
RW


REF DRAWING(S)

Basin Forebay B1-A

WQv provided: 0.911 ac-ft

Water Surface Elevation (Feet)	Surface Area (Square Feet)	Average Area (Square Feet)	Difference in Elevation (Feet)	Incremental Storage (Cubic Feet)	Total Storage Volume (Cubic Feet)
400.00	2,277.0	--	--	--	0.0
402.00	3,680.0	2,978.5	2.0	5,957.0	5,957.0
404.00	5,342.0	4,511.0	2.0	9,022.0	14,979.0
406.00	7,258.0	6,300.0	2.0	12,600.0	27,579.0
407.50	8,858.0	8,058.0	1.5	12,087.0	39,666.0
408.00	9,420.0	9,139.0	0.5	4,569.5	44,235.5
410.00	11,808.0	10,614.0	2.0	21,228.0	65,463.5

Stage Storage Curve

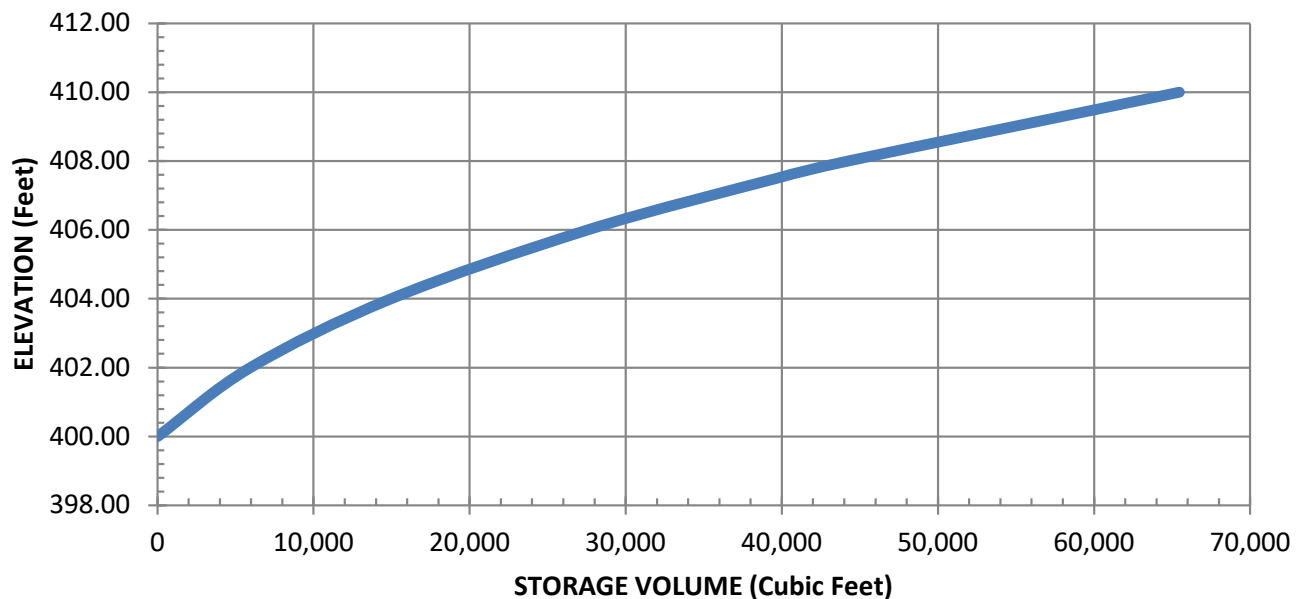

WQv Provided in SMP

WO. NO. 1146.01	DATE Jan '24	REVISED Dec '25	SHEET 6	OF 8
---------------------------	------------------------	---------------------------	-------------------	----------------

PROJECT TITLE
Sheffield Gardens

LOCATION
Town of Montgomery

CALCULATED BY
ZS

APPROVED BY
RW


REF DRAWING(S)

Basin **Bio-Ret B1-A**

WQv provided: **0.348** ac-ft

Water Surface Elevation (Feet)	Surface Area (Square Feet)	Average Area (Square Feet)	Difference in Elevation (Feet)	Incremental Storage (Cubic Feet)	Total Storage Volume (Cubic Feet)
407.50	13,943.0	--	--	--	0.0
408.00	15,166.0	14,554.5	0.5	7,277.3	7,277.3
408.50	16,427.0	15,796.5	0.5	7,898.3	15,175.5
410.00	20,447.0	18,437.0	1.5	27,655.5	42,831.0

Stage Storage Curve

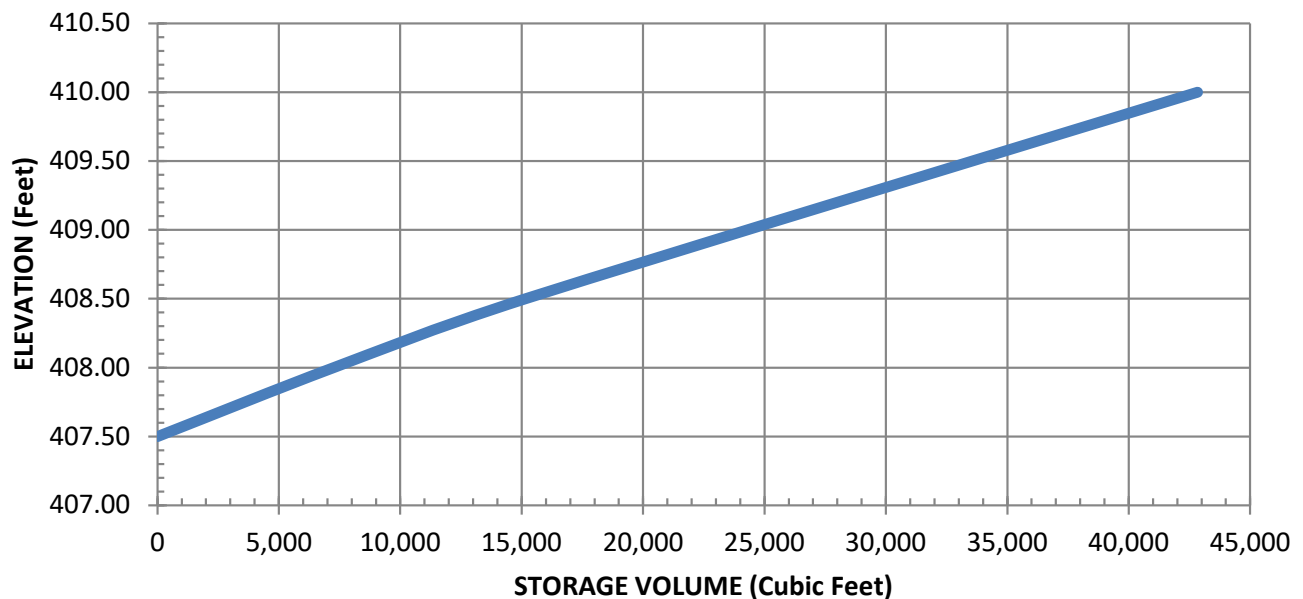

WQv Provided in SMP

WO. NO. 1146.01	DATE Jan '24	REVISED Dec '25	SHEET 7	OF 8
---------------------------	------------------------	---------------------------	-------------------	----------------

PROJECT TITLE
Sheffield Gardens

LOCATION
Town of Montgomery

CALCULATED BY
ZS

APPROVED BY
RW


REF DRAWING(S)

Basin **Forebay B1-B**

WQv provided: **0.608** ac-ft

Water Surface Elevation (Feet)	Surface Area (Square Feet)	Average Area (Square Feet)	Difference in Elevation (Feet)	Incremental Storage (Cubic Feet)	Total Storage Volume (Cubic Feet)
400.00	713.0	--	--	--	0.0
402.00	1,896.0	1,304.5	2.0	2,609.0	2,609.0
404.00	3,550.0	2,723.0	2.0	5,446.0	8,055.0
406.00	5,471.0	4,510.5	2.0	9,021.0	17,076.0
407.50	7,078.0	6,274.5	1.5	9,411.8	26,487.8
408.00	7,642.0	7,360.0	0.5	3,680.0	30,167.8
410.00	10,040.0	8,841.0	2.0	17,682.0	47,849.8

Stage Storage Curve

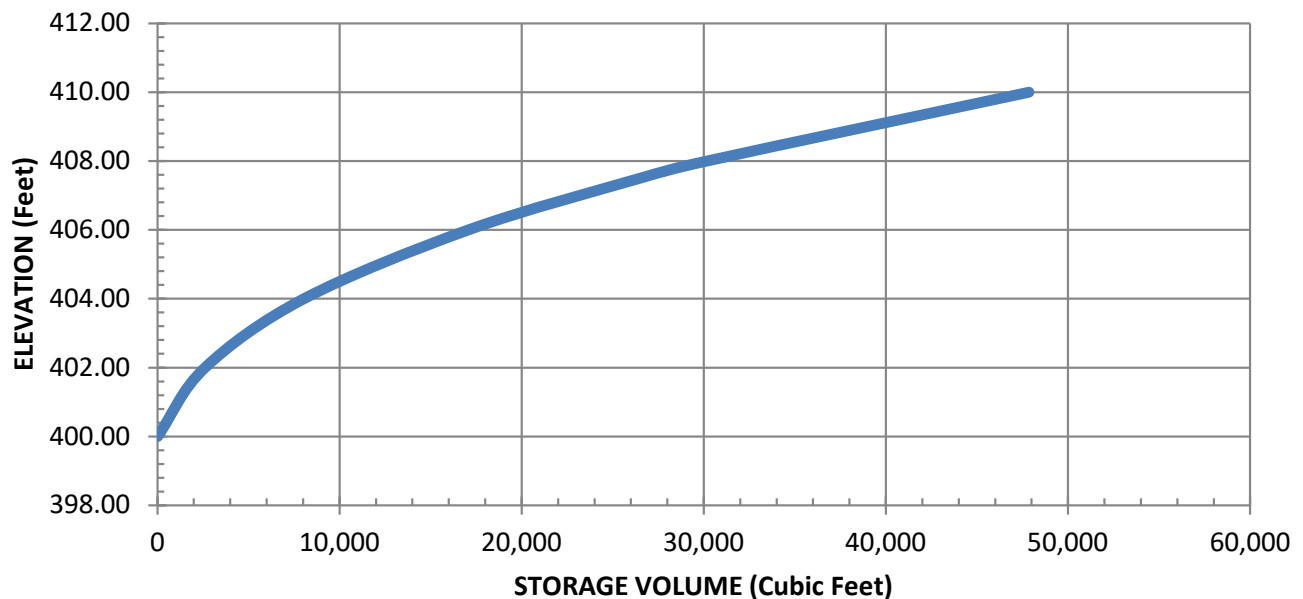

WQv Provided in SMP

WO. NO. 1146.01	DATE Jan '24	REVISED Dec '25	SHEET 8	OF 8
---------------------------	------------------------	---------------------------	-------------------	----------------

PROJECT TITLE
Sheffield Gardens

LOCATION
Town of Montgomery

CALCULATED BY
ZS

APPROVED BY
RW


REF DRAWING(S)

Basin **Bio-Ret B1-B**

WQv provided: **0.308** ac-ft

Water Surface Elevation (Feet)	Surface Area (Square Feet)	Average Area (Square Feet)	Difference in Elevation (Feet)	Incremental Storage (Cubic Feet)	Total Storage Volume (Cubic Feet)
407.50	12,169.0	--	--	--	0.0
408.00	13,395.0	12,782.0	0.5	6,391.0	6,391.0
408.50	14,660.0	14,027.5	0.5	7,013.8	13,404.8
410.00	18,691.0	16,675.5	1.5	25,013.3	38,418.0

Stage Storage Curve

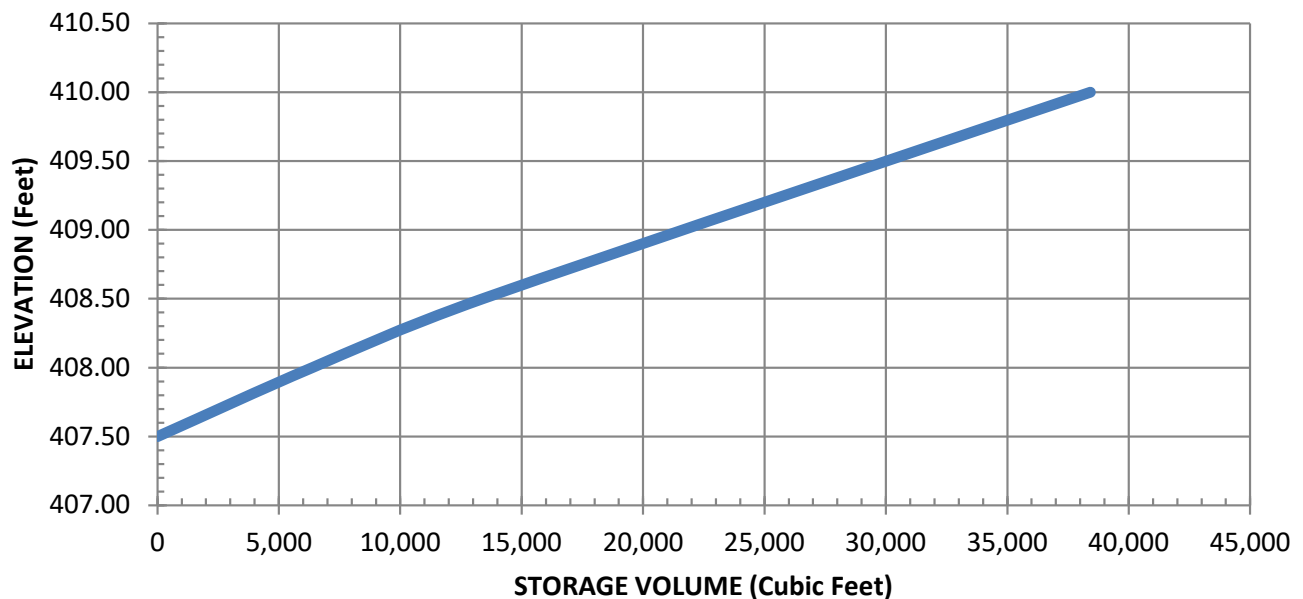

APPENDIX 14

DRAINAGE PIPE

CALCULATIONS



STORM DRAINAGE PIPE DESIGN WORKSHEET

WO. NO.	DATE	REVISED	SHEET
103.0301	09/17/24	12/08/25	1 OF 4

PROJECT TITLE Sheffield Gardens		LOCATION Town of Montgomery		STORM FREQUENCY 10 Year		PIPE TYPE HDPE
CALCULATED BY ZS	APPROVED BY RW	REF DRAWING(S) DWG LAST REV. 12/2025		RAINFALL CURVE Orange County, NY		

LOCATION		ROAD STA.	ACRES		" C "	CA	ΣCA	TIME CONC. - MIN			" i "	" Q "		PIPE								DROP (feet)	INV Upper	INV Lower	GRATE Elev	Depth to INV	Cover Upper	Cover Lower		
FROM	TO		SUB.	TOTAL				Inlet	Pipe	TOTAL		Des.	Cap.	" n "	Size	Height	V Des	V Cap	Slope	Lgth.	Fall									
CB11	CB12		0.12	0.17	0.90	0.12	0.12	5.00	-	5.00	6.78	0.8	8.40	0.010	15		4.3	6.8	1.00%	48	0.48	0.00	420.21	419.73	423.77	3.56	2.31	2.00		
			0.05		0.30																									
			0.34		0.90																									
CB12	CB13		0.24	0.75	0.30	0.38	0.50	5.00	0.18	5.18	6.78	3.4	8.40	0.010	15		6.5	6.8	1.00%	87	0.87	0.00	419.73	418.86	422.98	3.25	2.00	2.87		
			0.28		0.90																									
CB13	DMH14		0.25	1.29	0.30	0.33	0.83	5.18	0.22	5.41	6.73	5.6	8.40	0.010	15		7.3	6.8	1.00%	60	0.60	0.00	418.86	418.26	422.98	4.12	2.87	4.35		
			-		0.90																									
DMH14	DMH15		-	1.29	0.30	-	0.83	5.41	0.14	5.55	6.66	5.5	9.61	0.010	15		8.1	7.8	1.31%	208	2.72	0.00	418.26	415.49	423.86	5.60	4.35	6.82		
			-		0.90																									
DMH15	CB16		-	1.29	0.30	-	1.82	5.55	0.43	5.98	6.63	12.0	13.66	0.010	18		8.7	7.7	1.00%	71	0.71	0.25	415.24	414.53	423.56	8.32	6.82	6.07		
			0.35		0.90																									
CB16	CB17		0.09	1.72	0.30	0.34	2.16	5.98	0.14	6.11	6.51	14.0	29.41	0.010	24		9.2	9.4	1.00%	247	2.47	0.50	414.03	411.56	422.10	8.07	6.07	8.11		
			0.36		0.90																									
CB17	CB18		0.07	2.14	0.30	0.34	2.50	6.11	0.45	6.56	6.48	16.2	29.41	0.010	24		9.5	9.4	1.00%	58	0.58	0.00	411.56	410.98	421.67	10.11	8.11	9.34		
			0.20		0.90																									
CB18	CB19		0.02	2.36	0.30	0.19	2.69	6.56	0.10	6.66	6.36	17.1	29.41	0.010	24		9.7	9.4	1.00%	127	1.27	0.00	410.98	409.71	422.32	11.34	9.34	10.97		
			0.19		0.90																									
CB19	ES3		0.02	2.57	0.30	0.17	2.86	6.66	0.22	6.88	6.34	18.1	57.18	0.010	24		16.0	18.2	3.78%	83	3.14	0.00	409.71	406.57	422.68	12.97	10.97	-408.57		
CB20	CB21		0.57	0.97	0.90	0.63	0.63	-	-	-	8.63	5.4	8.40	0.010	15		7.3	6.8	1.00%	247	2.47	1.25	418.92	416.45	422.17	3.25	2.00	4.90		
			0.40		0.30																									
CB21	DMH15		0.35	1.46	0.90	0.36	0.99	-	0.57	0.57	8.63	8.5	13.66	0.010	18		8.1	7.7	1.00%	71	0.71	0.25	416.20	415.49	422.60	6.40	4.90	-416.99		
			0.15		0.30																									
																								</						



STORM DRAINAGE PIPE DESIGN WORKSHEET

WO. NO.	DATE	REVISED	SHEET
103.0301	09/17/24	12/08/25	2 OF 4

PROJECT TITLE Sheffield Gardens		LOCATION Town of Montgomery		STORM FREQUENCY 10 Year		PIPE TYPE HDPE
CALCULATED BY ZS	APPROVED BY RW	REF DRAWING(S) DWG LAST REV. 12/2025		RAINFALL CURVE Orange County, NY		

LOCATION		ROAD STA.	ACRES		" C "	CA	ΣCA	TIME CONC. - MIN			" i "	" Q "		PIPE							DROP (feet)	INV Upper	INV Lower	GRATE Elev	Depth to INV	Cover Upper	Cover Lower	
FROM	TO		SUB.	TOTAL				Inlet	Pipe	TOTAL		Des.	Cap.	" n "	Size	Height	V Des	V Cap	Slope	Lgth.								Fall
CB1	CB2		0.27	0.54	0.90	0.33	0.33	5.00	-	5.00	6.78	2.2	8.40	0.010	15		5.8	6.8	1.00%	87	0.87	0.00	419.23	418.36	422.48	3.25	2.00	2.87
			0.26		0.30																							
			0.36		0.90																							
CB2	CB3		0.22	1.12	0.30	0.39	0.72	5.00	0.25	5.25	6.78	4.9	8.40	0.010	15		7.1	6.8	1.00%	49	0.49	0.00	418.36	417.87	422.48	4.12	2.87	4.15
			0.13		0.90																							
CB3	CB4		0.04	1.29	0.30	0.13	0.85	5.25	0.12	5.37	6.71	5.7	8.40	0.010	15		7.3	6.8	1.00%	55	0.55	0.00	417.87	417.32	423.27	5.40	4.15	4.70
			0.13		0.90																							
CB4	CB5		0.04	1.46	0.30	0.13	0.98	5.37	0.12	5.49	6.68	6.5	8.40	0.010	15		7.6	6.8	1.00%	49	0.49	0.00	417.32	416.83	423.27	5.95	4.70	4.40
			0.36		0.90																							
CB5	CB6		0.22	2.04	0.30	0.39	1.37	5.49	0.11	5.60	6.64	9.1	13.66	0.010	18		8.2	7.7	1.00%	87	0.87	0.25	416.58	415.71	422.48	5.90	4.40	5.27
			0.30		0.90																							
CB6	DMH7		0.24	2.59	0.30	0.34	1.71	5.60	0.18	5.78	6.61	11.3	13.66	0.010	18		8.6	7.7	1.00%	89	0.89	0.00	415.71	414.82	422.48	6.77	5.27	8.17
			-		0.90																							
DMH7	DMH8		-	2.59	0.30	-	1.71	5.78	0.17	5.95	6.57	11.2	13.66	0.010	18		8.6	7.7	1.00%	159	1.59	0.00	414.82	413.23	424.49	9.67	8.17	7.27
			-		0.90																							
DMH8	ES 1		-	2.59	0.30	-	1.87	5.95	0.31	6.26	6.52	12.2	13.66	0.010	18		9.9	7.7	1.00%	79	0.79	0.00	413.23	412.44	422.00	8.77	7.27	-413.94
			-		0.90																							
CB7	CB8		0.05	0.05	0.90	0.04	0.041	-	-	-	8.63	0.4	8.40	0.010	15		3.2	6.8	1.00%	21	0.21	1.25	414.93	414.72	418.18	3.25	2.00	2.21
			-		0.30																							
			0.12		0.90																							
CB8	DMH8		0.03	0.20	0.30	0.12	0.16	-	0.11	0.11	8.63	1.4	8.40	0.010	15		5.0	6.8	1.00%	113	1.13	0.00	414.72	413.59	418.18	3.46	2.21	-414.84
			-		0.90																							
CB9	CB10		0.28	0.33	0.90	0.27	0.27	-	-	-	8.63	2.3	8.40	0.010	15		5.8	6.8	1.00%	257	2.57	1.25	418.93	416.36	422.18	3.25	2.00	4.90
			0.05		0.30																							
CB10	ES2		0.21	0.60	0.90	0.21	0.47	-	0.74	0.74	8.63	4.1	8.40	0.010	15		6.8	6.8	1.00%	113	1.13	0.00	416.36	415.23	422.51	6.15	4.90	-416.48
			0.05		0.30																							




STORM DRAINAGE PIPE DESIGN WORKSHEET

WO. NO.	DATE	REVISED	SHEET
103.0301	09/17/24	12/08/25	3 OF 4

PROJECT TITLE Sheffield Gardens		LOCATION Town of Montgomery		STORM FREQUENCY 10 Year		PIPE TYPE HDPE
CALCULATED BY ZS	APPROVED BY RW	REF DRAWING(S) DWG LAST REV. 12/2025		RAINFALL CURVE Orange County, NY		

LOCATION		ROAD STA.	ACRES		" C "	CA	ΣCA	TIME CONC. - MIN			" i "	" Q "		PIPE							DROP (feet)	INV Upper	INV Lower	GRATE Elev	Depth to INV	Cover Upper	Cover Lower	
FROM	TO		SUB.	TOTAL				Inlet	Pipe	TOTAL		Des.	Cap.	" n "	Size	Height	V Des	V Cap	Slope	Lgth.								Fall
CB22	CB23		0.11	0.17	0.90	0.12	0.12	5.00	-	5.00	6.78	0.8	8.40	0.010	15		4.2	6.8	1.00%	48	0.48	0.00	420.21	419.73	423.77	3.56	2.31	2.00
			0.06		0.30																							
CB23	CB24		0.33	0.75	0.90	0.37	0.49	5.00	0.19	5.19	6.78	3.3	8.40	0.010	15		6.4	6.8	1.00%	87	0.87	0.00	419.73	418.86	422.98	3.25	2.00	2.87
			0.25		0.30																							
CB24	DMH25		0.28	1.29	0.90	0.33	0.82	5.19	0.23	5.42	6.73	5.5	8.40	0.010	15		7.3	6.8	1.00%	64	0.64	0.00	418.86	418.22	422.98	4.12	2.87	4.21
			0.26		0.30																							
DMH25	DMH26		-	1.29	0.90	-	0.82	5.42	0.15	5.56	6.66	5.4	9.39	0.010	15		7.9	7.7	1.25%	224	2.80	0.00	418.22	415.42	423.68	5.46	4.21	5.34
			-		0.30																							
DMH26	CB27		-	1.29	0.90	-	1.90	5.56	0.47	6.04	6.62	12.6	13.66	0.010	18		8.8	7.7	1.00%	26	0.26	0.25	415.17	414.91	422.01	6.84	5.34	5.29
			-		0.30																							
CB27	CB28		0.34	1.72	0.90	0.33	2.23	6.04	0.05	6.09	6.50	14.5	29.41	0.010	24		9.3	9.4	1.00%	269	2.69	0.50	414.41	411.72	421.70	7.29	5.29	8.14
			0.10		0.30																							
CB28	CB29		0.29	2.05	0.90	0.28	2.51	6.09	0.48	6.57	6.48	16.3	29.41	0.010	24		9.6	9.4	1.00%	68	0.68	0.00	411.72	411.04	421.86	10.14	8.14	9.71
			0.04		0.30																							
CB29	ES4		0.18	2.25	0.90	0.17	2.67	6.57	0.12	6.69	6.36	17.0	29.41	0.010	24		9.7	9.4	1.00%	127	1.27	0.00	411.04	409.77	422.75	11.71	9.71	-411.77
			0.02		0.30																							
ES4																												
CB30	CB31		0.58	1.27	0.90	0.73	0.73	-	-	-	8.63	6.3	8.40	0.010	15		7.5	6.8	1.00%	226	2.26	1.25	418.92	416.66	422.17	3.25	2.00	4.90
			0.69		0.30																							
CB31	CB32		0.21	1.55	0.90	0.21	0.94	-	0.50	0.50	8.63	8.1	8.40	0.010	15		7.8	6.8	1.00%	63	0.63	0.00	416.66	416.03	422.81	6.15	4.90	5.18
			0.07		0.30																							
CB32	DMH26		0.13	1.76	0.90	0.14	1.08	0.50	0.13	0.64	8.40	9.1	13.66	0.010	18		8.2	7.7	1.00%	36	0.36	0.25	415.78	415.42	422.46	6.68	5.18	-416.92
			0.08		0.30																							

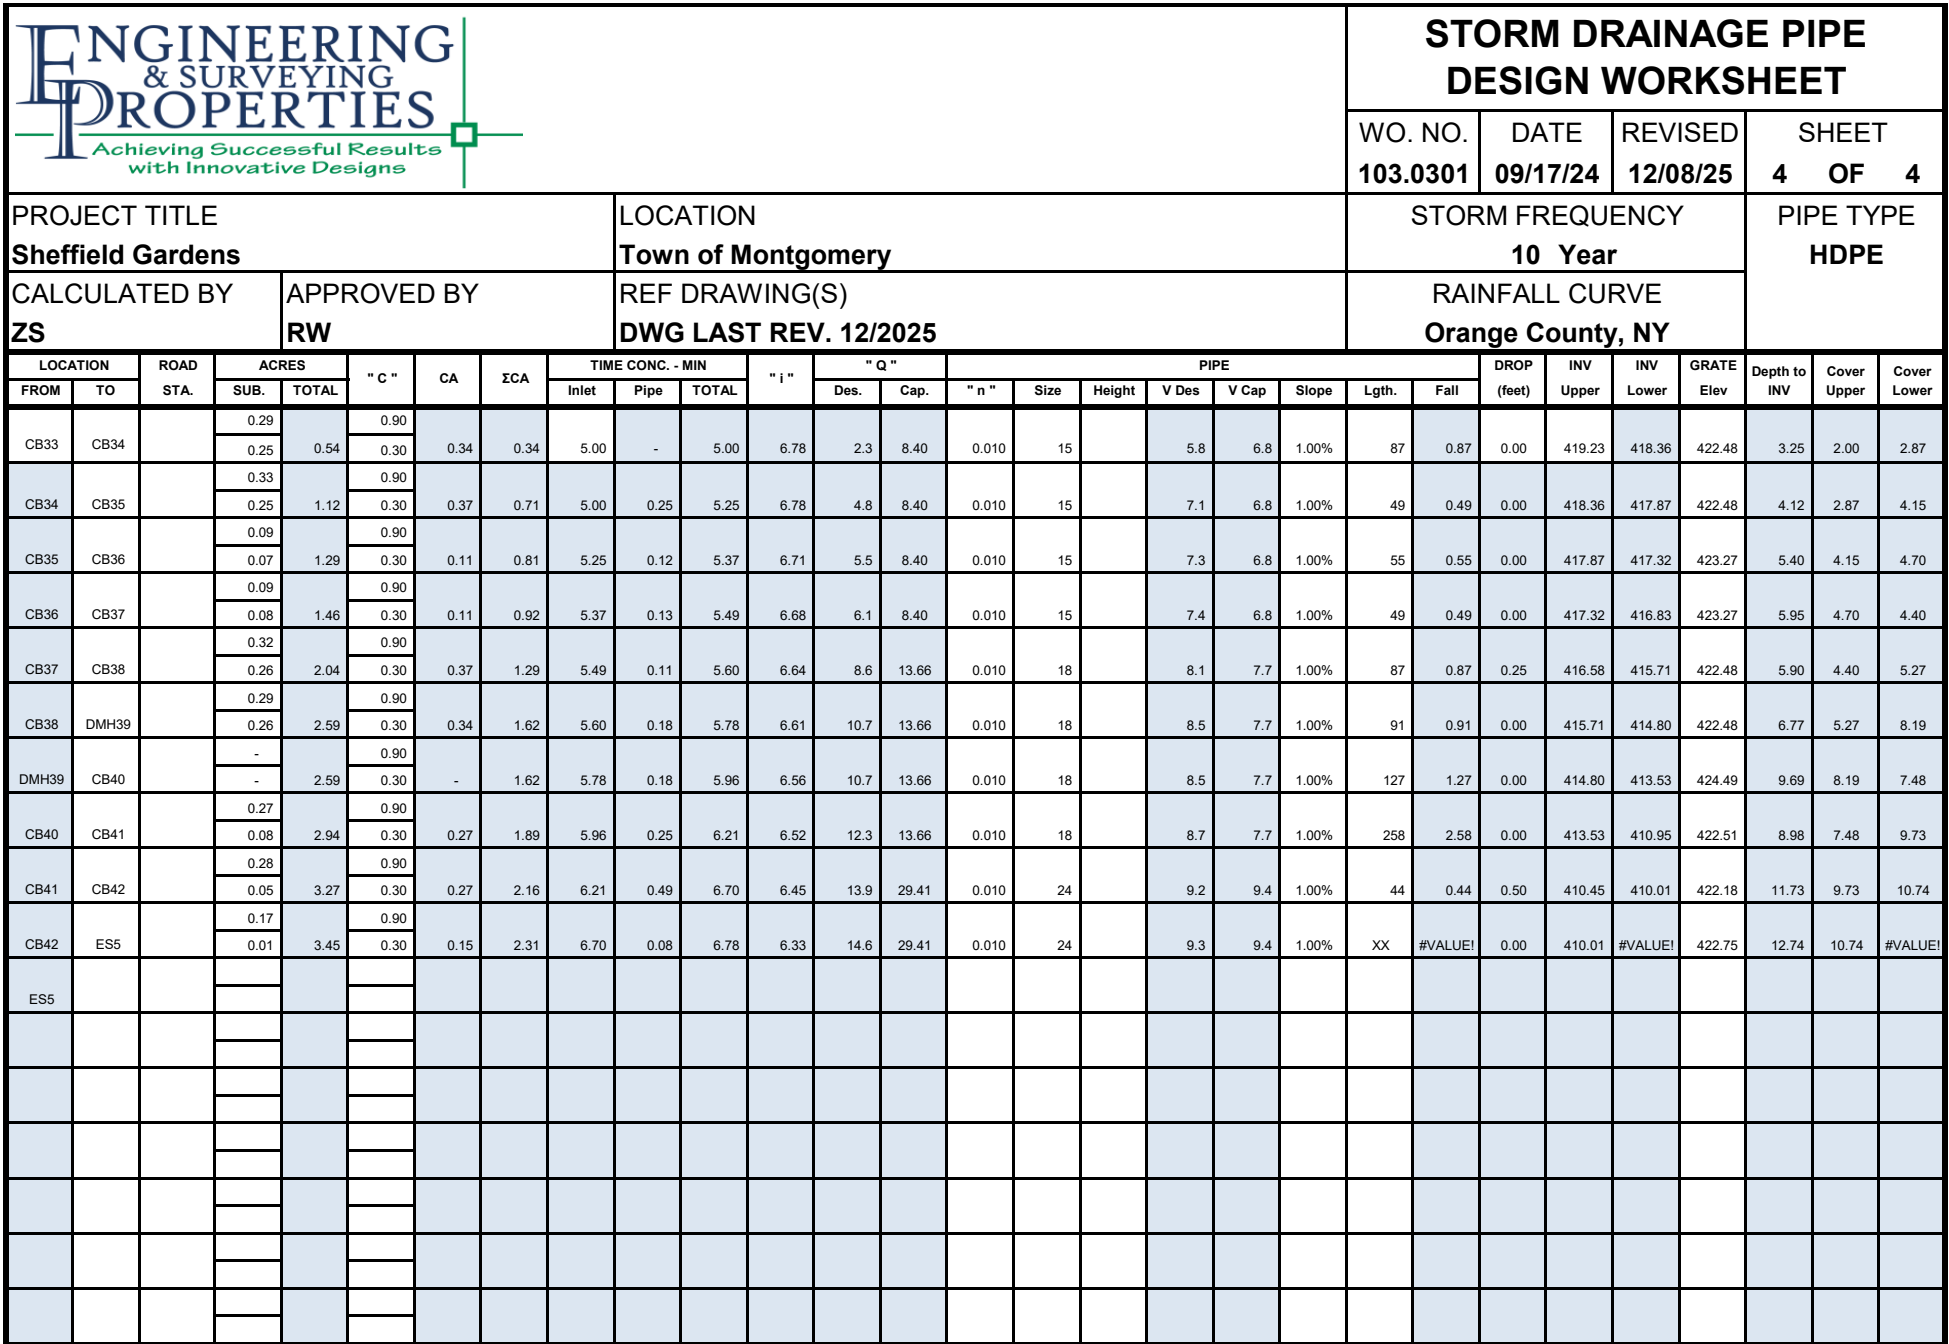

APPENDIX 15


CONSTRUCTION SITE

INSPECTION FORM, NOTICE

OF INTENT & MS4

ACCEPTANCE

SWPPP INSPECTION REPORT

 <p>ENGINEERING & SURVEYING PROPERTIES Achieving Successful Results with Innovative Designs</p>	W.O. No.:	Date:	Greater than 5 Ac. Of Disturbance? <input type="checkbox"/> Waiver? <input type="checkbox"/>	Page	Of
	Project Name:		Weather Conditions: <input type="checkbox"/> Dry <input type="checkbox"/> Rain <input type="checkbox"/> Snow		
			Soil Conditions: <input type="checkbox"/> Dry <input type="checkbox"/> Wet <input type="checkbox"/> Saturated		
	Location:		Arrival Time :	Photographs Taken? <input type="checkbox"/> Yes <input type="checkbox"/> No	
Departing Time:					
Owner:		Phone:	Documents on-site?	SWPPP:	
Contractor:		Phone:	Weekly Inspections:	NOI:	

1. Description of current activities onsite and phase of construction (attach sketch showing areas of stabilization, current work, and photo locations):

2. Description of the condition of the runoff at all points of discharge from the construction site (including onsite conveyance systems):

4. Identify all erosion and sediment control practices that require repair and/or maintenance:

6. Identify current status of construction for all post-construction stormwater management practices:

3. Description of the condition of all natural surface water bodies located within, or immediately adjacent to the construction site:

5. Identify all erosion and sediment control practices that were not installed properly or are not functioning as designed:

7. Corrective action(s) required to erosion and sediment control measures and post-construction stormwater management practices:

Was the owner and contractor(s) notified of the deficiencies and repairs needed within one (1) business day? ☐ Yes ☐ No

Qualified Inspector

Signature

Notice: ☐ GP-02-01 ☐ GP-08-001 ☐ GP-10-001

This inspection was performed solely for the purpose of determining compliance with NYSDEC SPDES General Permit:

Name and Title

Signature

Division of Water

NYR						
-----	--	--	--	--	--	--

(for DEC use only)

All sections must be completed unless otherwise noted. Failure to complete all items may result in this form being returned to you, thereby delaying your coverage under this General Permit. Applicants must read and understand the conditions of the permit and prepare a Stormwater Pollution Prevention Plan prior to submitting this NOI. Applicants are responsible for identifying and obtaining other DEC permits that may be required.

OWNER/OPERATOR MUST SIGN FORM

[illegible][illegible][illegible][illegible][illegible]

--	--

					-					
--	--	--	--	--	---	--	--	--	--	--

			-				-			
--	--	--	---	--	--	--	---	--	--	--

--	--	--	--

[illegible][illegible]

--	--

--	--	--	--	--	--	--

Page 1 of 14

Project Site Information

Project/Site Name

[illegible]

Street Address (NOT P.O. BOX)

[illegible]

Side of Street

☐ North ☐ South ☐ East ☐ West

City/Town/Village (THAT ISSUES BUILDING PERMIT)

[illegible]

State

Zip

County

DEC Region

N	Y
---	---

--	--	--	--	--

—

--	--	--	--

[illegible]

--	--

Name of Nearest Cross Street

[illegible]

Distance to Nearest Cross Street (Feet)

--	--	--	--	--

Project In Relation to Cross Street

☐ North ☐ South ☐ East ☐ West

Tax Map Numbers
Section-Block-Parcel

[illegible]

Tax Map Numbers

[illegible]

1. Provide the Geographic Coordinates for the project site. To do this, go to the NYSDEC Stormwater Interactive Map on the DEC website at:

<https://giservices.dec.ny.gov/gis/stormwater/>

Zoom into your Project Location such that you can accurately click on the centroid of your site. Once you have located the centroid of your project site, go to the bottom right hand corner of the map for the X, Y coordinates. Enter the coordinates into the boxes below. For problems with the interactive map use the help function.

X Coordinates (Easting)

-7

--	--	--	--	--	--

Ex. -73.749

Y Coordinates (Northing)

4

--	--	--	--	--	--

Ex. 42.652

2. What is the nature of this construction project?

- New Construction

- Redevelopment with increase in impervious area

- Redevelopment with no increase in impervious area

3. Select the predominant land use for both pre and post development conditions.

SELECT ONLY ONE CHOICE FOR EACH

**Pre-Development
Existing Land Use**

- ☐ FOREST
☐ PASTURE/OPEN LAND
☐ CULTIVATED LAND
☐ SINGLE FAMILY HOME
☐ SINGLE FAMILY SUBDIVISION
☐ TOWN HOME RESIDENTIAL
☐ MULTIFAMILY RESIDENTIAL
☐ INSTITUTIONAL/SCHOOL
☐ INDUSTRIAL
☐ COMMERCIAL
☐ ROAD/HIGHWAY
☐ RECREATIONAL/SPORTS FIELD
☐ BIKE PATH/TRAIL
☐ LINEAR UTILITY
☐ PARKING LOT
☐ OTHER

--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--

**Post-Development
Future Land Use**

- ☐ SINGLE FAMILY HOME
☐ SINGLE FAMILY SUBDIVISION
☐ TOWN HOME RESIDENTIAL
☐ MULTIFAMILY RESIDENTIAL
☐ INSTITUTIONAL/SCHOOL
☐ INDUSTRIAL
☐ COMMERCIAL
☐ MUNICIPAL
☐ ROAD/HIGHWAY
☐ RECREATIONAL/SPORTS FIELD
☐ BIKE PATH/TRAIL
☐ LINEAR UTILITY (water, sewer, gas, etc.)
☐ PARKING LOT
☐ CLEARING/GRADING ONLY
☐ DEMOLITION, NO REDEVELOPMENT
☐ WELL DRILLING ACTIVITY *(Oil, Gas, etc.)
☐ OTHER

Number of Lots

--	--	--	--

--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--

***Note:** for gas well drilling, non-high volume hydraulic fractured wells only

4. In accordance with the larger common plan of development or sale, enter the total project site area; the total area to be disturbed; existing impervious area to be disturbed (for redevelopment activities); and the future impervious area constructed within the disturbed area. (Round to the nearest tenth of an acre.)

Total Site Area	Total Area To Be Disturbed	Existing Impervious Area To Be Disturbed	Future Impervious Area Within Disturbed Area
<div> <div></div><div></div><div></div><div></div> </div> <div> <div></div><div></div><div></div><div></div> </div> <div> <div></div><div></div><div></div><div></div> </div>	<div> <div></div><div></div><div></div><div></div> </div> <div> <div></div><div></div><div></div><div></div> </div> <div> <div></div><div></div><div></div><div></div> </div>	<div> <div></div><div></div><div></div><div></div> </div> <div> <div></div><div></div><div></div><div></div> </div> <div> <div></div><div></div><div></div><div></div> </div>	<div> <div></div><div></div><div></div><div></div> </div> <div> <div></div><div></div><div></div><div></div> </div> <div> <div></div><div></div><div></div><div></div> </div>

5. Do you plan to disturb more than 5 acres of soil at any one time? ☐ Yes ☐ No

6. Indicate the percentage of each Hydrologic Soil Group(HSG) at the site.

A	B	C	D
<div> <div></div><div></div><div></div> </div> <div> <div></div><div></div><div></div> </div> <div> <div></div><div></div><div></div> </div>	<div> <div></div><div></div><div></div> </div> <div> <div></div><div></div><div></div> </div> <div> <div></div><div></div><div></div> </div>	<div> <div></div><div></div><div></div> </div> <div> <div></div><div></div><div></div> </div> <div> <div></div><div></div><div></div> </div>	<div> <div></div><div></div><div></div> </div> <div> <div></div><div></div><div></div> </div> <div> <div></div><div></div><div></div> </div>

7. Is this a phased project? ☐ Yes ☐ No

8. Enter the planned start and end dates of the disturbance activities.

Start Date	End Date
<div> <div></div><div></div><div></div> </div> <div> <div></div><div></div><div></div> </div> <div> <div></div><div></div><div></div> </div>	<div> <div></div><div></div><div></div> </div> <div> <div></div><div></div><div></div> </div> <div> <div></div><div></div><div></div> </div>

[illegible]

☐ Wetland / State Jurisdiction On Site (Answer 9b)
☐ Wetland / State Jurisdiction Off Site
☐ Wetland / Federal Jurisdiction On Site (Answer 9b)
☐ Wetland / Federal Jurisdiction Off Site
☐ Stream / Creek On Site
☐ Stream / Creek Off Site
☐ River On Site
☐ River Off Site
☐ Lake On Site
☐ Lake Off Site
☐ Other Type On Site
☐ Other Type Off Site

- ☐ Regulatory Map
- ☐ Delineated by Consultant
- ☐ Delineated by Army Corps of Engineers
- ☐ Other (identify)

[illegible][illegible]

11. Is this project located in one of the Watersheds identified in Appendix C of GP-0-20-001? ☐ **Yes** ☐ **No**

13. Does this construction activity disturb land with no existing impervious cover and where the Soil Slope Phase is identified as an E or F on the USDA Soil Survey? ☐ Yes ☐ No

If Yes, what is the acreage to be disturbed?

--	--	--	--	--	--

Page 4 of 14

15. Does the site runoff enter a separate storm sewer system (including roadside drains, swales, ditches, culverts, etc)? ☐ **Yes** ☐ **No** ☐ **Unknown**

- [illegible]

17. Does any runoff from the site enter a sewer classified as a Combined Sewer? ☐ **Yes** ☐ **No** ☐ **Unknown**

18. Will future use of this site be an agricultural property as defined by the NYS Agriculture and Markets Law? ☐ Yes ☐ No

19. Is this property owned by a state authority, state agency, federal government or local government? ☐ Yes ☐ No

20. Is this a remediation project being done under a Department approved work plan? (i.e. CERCLA, RCRA, Voluntary Cleanup Agreement, etc.) ☐ **Yes** ☐ **No**

21. Has the required Erosion and Sediment Control component of the SWPPP been developed in conformance with the current NYS Standards and Specifications for Erosion and Sediment Control (aka Blue Book)? ☐ Yes ☐ No

22. Does this construction activity require the development of a SWPPP that includes the post-construction stormwater management practice component (i.e. Runoff Reduction, Water Quality and Quantity Control practices/techniques)? ☐ Yes ☐ No
- If No, skip questions 23 and 27-39.**

23. Has the post-construction stormwater management practice component of the SWPPP been developed in conformance with the current NYS Stormwater Management Design Manual? ☐ Yes ☐ No

24. The Stormwater Pollution Prevention Plan (SWPPP) was prepared by:

- ☐ Professional Engineer (P.E.)
- ☐ Soil and Water Conservation District (SWCD)
- ☐ Registered Landscape Architect (R.L.A.)
- ☐ Certified Professional in Erosion and Sediment Control (CPESC)
- ☐ Owner/Operator
- ☐ Other

[illegible]

SWPPP Preparer

[illegible]

Contact Name (Last, Space, First)

[illegible]

Mailing Address

[illegible]

City

[illegible]

State Zip

								-				
--	--	--	--	--	--	--	--	---	--	--	--	--

Phone

--	--	--	--

Fax

--	--	--	--	--	--	--

Email

[illegible][illegible]

SWPPP Preparer Certification

I hereby certify that the Stormwater Pollution Prevention Plan (SWPPP) for this project has been prepared in accordance with the terms and conditions of the GP-0-20-001. Furthermore, I understand that certifying false, incorrect or inaccurate information is a violation of this permit and the laws of the State of New York and could subject me to criminal, civil and/or administrative proceedings.

First Name

[illegible]

MI

7

Last Name

[illegible]

Signature

--

Date _____

--	--

/

--	--

/

--	--	--	--

25. Has a construction sequence schedule for the planned management practices been prepared? ☐ Yes ☐ No

☐ Yes ☐ No

26. Select **all** of the erosion and sediment control practices that will be employed on the project site:

Temporary Structural

- ☐ Check Dams
- ☐ Construction Road Stabilization
- ☐ Dust Control
- ☐ Earth Dike
- ☐ Level Spreader
- ☐ Perimeter Dike/Swale
- ☐ Pipe Slope Drain
- ☐ Portable Sediment Tank
- ☐ Rock Dam
- ☐ Sediment Basin
- ☐ Sediment Traps
- ☐ Silt Fence
- ☐ Stabilized Construction Entrance
- ☐ Storm Drain Inlet Protection
- ☐ Straw/Hay Bale Dike
- ☐ Temporary Access Waterway Crossing
- ☐ Temporary Stormdrain Diversion
- ☐ Temporary Swale
- ☐ Turbidity Curtain
- ☐ Water bars

Biotechnical

- Brush Matting
- Wattling

Other

[illegible]

Vegetative Measures

- Brush Matting
- Dune Stabilization
- Grassed Waterway
- Mulching
- Protecting Vegetation
- Recreation Area Improvement
- Seeding
- Sodding
- Straw/Hay Bale Dike
- Streambank Protection
- Temporary Swale
- Topsoiling
- Vegetating Waterways

Permanent Structural

- ☐ Debris Basin
- ☐ Diversion
- ☐ Grade Stabilization Structure
- ☐ Land Grading
- ☐ Lined Waterway (Rock)
- ☐ Paved Channel (Concrete)
- ☐ Paved Flume
- ☐ Retaining Wall
- ☐ Riprap Slope Protection
- ☐ Rock Outlet Protection
- ☐ Streambank Protection

Post-construction Stormwater Management Practice (SMP) Requirements

**Important: Completion of Questions 27-39 is not required
if response to Question 22 is No.**

27. Identify all site planning practices that were used to prepare the final site plan/layout for the project.

- ☐ Preservation of Undisturbed Areas
- ☐ Preservation of Buffers
- ☐ Reduction of Clearing and Grading
- ☐ Locating Development in Less Sensitive Areas
- ☐ Roadway Reduction
- ☐ Sidewalk Reduction
- ☐ Driveway Reduction
- ☐ Cul-de-sac Reduction
- ☐ Building Footprint Reduction
- ☐ Parking Reduction

27a. Indicate which of the following soil restoration criteria was used to address the requirements in Section 5.1.6("Soil Restoration") of the Design Manual (2010 version).

- ☐ All disturbed areas will be restored in accordance with the Soil Restoration requirements in Table 5.3 of the Design Manual (see page 5-22).
- ☐ Compacted areas were considered as impervious cover when calculating the **WQv Required**, and the compacted areas were assigned a post-construction Hydrologic Soil Group (HSG) designation that is one level less permeable than existing conditions for the hydrology analysis.

28. Provide the total Water Quality Volume (WQv) required for this project (based on final site plan/layout).

Total WQv Required

. acre-feet

29. Identify the RR techniques (Area Reduction), RR techniques (Volume Reduction) and Standard SMPs with RRv Capacity in Table 1 (See Page 9) that were used to reduce the Total WQv Required (#28).

Also, provide in Table 1 the total impervious area that contributes runoff to each technique/practice selected. For the Area Reduction Techniques, provide the total contributing area (includes pervious area) and, if applicable, the total impervious area that contributes runoff to the technique/practice.

Note: Redevelopment projects shall use Tables 1 and 2 to identify the SMPs used to treat and/or reduce the WQv required. If runoff reduction techniques will not be used to reduce the required WQv, skip to question 33a after identifying the SMPs.

Table 1 - Runoff Reduction (RR) Techniques
and Standard Stormwater Management
Practices (SMPs)

RR Techniques (Area Reduction)	Total Contributing Area (acres)	Total Contributing Impervious Area(acres)
○ Conservation of Natural Areas (RR-1) ...	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>	and/or <input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>
○ Sheetflow to Riparian Buffers/Filters Strips (RR-2)	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>	and/or <input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>
○ Tree Planting/Tree Pit (RR-3)	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>	and/or <input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>
○ Disconnection of Rooftop Runoff (RR-4) ..	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>	and/or <input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>
RR Techniques (Volume Reduction)		
○ Vegetated Swale (RR-5)	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>
○ Rain Garden (RR-6)	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>
○ Stormwater Planter (RR-7)	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>
○ Rain Barrel/Cistern (RR-8)	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>
○ Porous Pavement (RR-9)	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>
○ Green Roof (RR-10)	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>
Standard SMPs with RRv Capacity		
○ Infiltration Trench (I-1)	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>
○ Infiltration Basin (I-2)	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>
○ Dry Well (I-3)	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>
○ Underground Infiltration System (I-4)	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>
○ Bioretention (F-5)	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>
○ Dry Swale (O-1)	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>
Standard SMPs		
○ Micropool Extended Detention (P-1)	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>
○ Wet Pond (P-2)	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>
○ Wet Extended Detention (P-3)	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>
○ Multiple Pond System (P-4)	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>
○ Pocket Pond (P-5)	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>
○ Surface Sand Filter (F-1)	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>
○ Underground Sand Filter (F-2)	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>
○ Perimeter Sand Filter (F-3)	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>
○ Organic Filter (F-4)	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>
○ Shallow Wetland (W-1)	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>
○ Extended Detention Wetland (W-2)	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>
○ Pond/Wetland System (W-3)	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>
○ Pocket Wetland (W-4)	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>
○ Wet Swale (O-2)	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>	<input type="text"/> <input type="text"/> <input type="text"/> . <input type="text"/> <input type="text"/> <input type="text"/>

Table 2 - Alternative SMPs (DO NOT INCLUDE PRACTICES BEING USED FOR PRETREATMENT ONLY)																																	
<u>Alternative SMP</u>	<u>Total Contributing Impervious Area(acres)</u>																																
<input type="radio"/> Hydrodynamic	<table border="1" style="display: inline-table; vertical-align: middle;"><tr><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td></tr></table> = <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td></tr></table>																																
<input type="radio"/> Wet Vault	<table border="1" style="display: inline-table; vertical-align: middle;"><tr><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td></tr></table> = <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td></tr></table>																																
<input type="radio"/> Media Filter	<table border="1" style="display: inline-table; vertical-align: middle;"><tr><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td></tr></table> = <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td></tr></table>																																
<input type="radio"/> Other <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr></table>																					<table border="1" style="display: inline-table; vertical-align: middle;"><tr><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td></tr></table> = <table border="1" style="display: inline-table; vertical-align: middle;"><tr><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td></tr></table>												

Provide the name and manufacturer of the Alternative SMPs (i.e. proprietary practice(s)) being used for WQv treatment.

Name	<table border="1" style="width: 100%; height: 20px;"></table>
Manufacturer	<table border="1" style="width: 100%; height: 20px;"></table>

Note: Redevelopment projects which do not use RR techniques, shall use questions 28, 29, 33 and 33a to provide SMPs used, total WQv required and total WQv provided for the project.

[illegible]

--	--	--

 ·

--	--	--

 acre-feet

--	--	--

.

--	--	--

acre-feet

Page 10 of 14

33. Identify the Standard SMPs in Table 1 and, if applicable, the Alternative SMPs in Table 2 that were used to treat the remaining total WQv(=Total WQv Required in 28 - Total RRv Provided in 30).

Also, provide in Table 1 and 2 the total impervious area that contributes runoff to each practice selected.

Note: Use Tables 1 and 2 to identify the SMPs used on Redevelopment projects.

- 33a. Indicate the Total WQv provided (i.e. WQv treated) by the SMPs identified in question #33 and Standard SMPs with RRv Capacity identified in question 29.

WQv Provided

. acre-feet

Note: For the standard SMPs with RRv capacity, the WQv provided by each practice = the WQv calculated using the contributing drainage area to the practice - RRv provided by the practice. (See Table 3.5 in Design Manual)

34. Provide the sum of the Total RRv provided (#30) and the WQv provided (#33a).

.

35. Is the sum of the RRv provided (#30) and the WQv provided (#33a) greater than or equal to the total WQv required (#28)? ☐ Yes ☐ No

If Yes, go to question 36.

If No, sizing criteria has not been met, so NOI can not be processed. SWPPP preparer must modify design to meet sizing criteria.

36. Provide the total Channel Protection Storage Volume (CPv) required and provided or select waiver (36a), if applicable.

CPv Required

. acre-feet

CPv Provided

. acre-feet

- 36a. The need to provide channel protection has been waived because:

- ☐ Site discharges directly to tidal waters or a fifth order or larger stream.
- ☐ Reduction of the total CPv is achieved on site through runoff reduction techniques or infiltration systems.

37. Provide the Overbank Flood (Qp) and Extreme Flood (Qf) control criteria or select waiver (37a), if applicable.

Total Overbank Flood Control Criteria (Qp)

Pre-Development

. CFS

Post-development

. CFS

Total Extreme Flood Control Criteria (Qf)

Pre-Development

. CFS

Post-development

. CFS

37a. The need to meet the Qp and Qf criteria has been waived because:

- ☐ Site discharges directly to tidal waters or a fifth order or larger stream.
- ☐ Downstream analysis reveals that the Qp and Qf controls are not required

- [illegible]

39. Use this space to summarize the specific site limitations and justification for not reducing 100% of WQv required(#28). (See question 32a)
This space can also be used for other pertinent project information.

40. Identify other DEC permits, existing and new, that are required for this project/facility.

○ Air Pollution Control

○ Coastal Erosion

☐ Hazardous Waste

○ Long Island Wells

○ Mined Land Reclamation

○ Solid Waste

○ Navigable Waters Protection / Article 15

○ Water Quality Certificate

○ Dam Safety

○ Water Supply

○ Freshwater Wetlands/Article 24

○ Tidal Wetlands

○ Wild, Scenic and Recreational Rivers

○ Stream Bed or Bank Protection / Article 15

○ Endangered or Threatened Species(Incidental Take Permit)

- Individual SPDES

○ SPDES Multi-Sector GP	N	Y	R						
-------------------------	---	---	---	--	--	--	--	--	--

[illegible]

☐ None

41. Does this project require a US Army Corps of Engineers Wetland Permit? ☐ ☐ ☐ ☐ ☐ ☐

☐ Yes ☐ No

If Yes, Indicate Size of Impact.				
.				

42. Is this project subject to the requirements of a regulated, traditional land use control MS4?
(If No, skip question 43)

☐ Yes ☐ No

43. Has the "MS4 SWPPP Acceptance" form been signed by the principal executive officer or ranking elected official and submitted along with this NOI?

☐ Yes ☐ No

44. If this NOI is being submitted for the purpose of continuing or transferring coverage under a general permit for stormwater runoff from construction activities, please indicate the former SPDES number assigned.

N	N	D				
---	---	---	--	--	--	--

N	Y	R						
---	---	---	--	--	--	--	--	--

Owner/Operator Certification	
<p>I have read or been advised of the permit conditions and believe that I understand them. I also understand that, under the terms of the permit, there may be reporting requirements. I hereby certify that this document and the corresponding documents were prepared under my direction or supervision. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations. I further understand that coverage under the general permit will be identified in the acknowledgment that I will receive as a result of submitting this NOI and can be as long as sixty (60) business days as provided for in the general permit. I also understand that, by submitting this NOI, I am acknowledging that the SWPPP has been developed and will be implemented as the first element of construction, and agreeing to comply with all the terms and conditions of the general permit for which this NOI is being submitted.</p>	
Print First Name <div style="border: 1px solid black; height: 30px; width: 100%; position: relative;"> <div style="position: absolute; top: 0; left: 0; right: 0; bottom: 0; border: 1px solid black; display: flex; flex-wrap: wrap;"> <!-- 20 empty boxes for first name --> </div> </div>	MI <div style="border: 1px solid black; height: 30px; width: 100%; position: relative;"> <div style="position: absolute; top: 0; left: 0; right: 0; bottom: 0; border: 1px solid black; display: flex; flex-wrap: wrap;"> <!-- 2 empty boxes for MI --> </div> </div>
Print Last Name <div style="border: 1px solid black; height: 30px; width: 100%; position: relative;"> <div style="position: absolute; top: 0; left: 0; right: 0; bottom: 0; border: 1px solid black; display: flex; flex-wrap: wrap;"> <!-- 20 empty boxes for last name --> </div> </div>	
Owner/Operator Signature <div style="border: 1px solid black; height: 60px; width: 100%;"></div>	
<div style="display: flex; justify-content: space-between; align-items: flex-end;"> <div style="width: 60%;"> <div style="border: 1px solid black; height: 60px; width: 100%;"></div> </div> <div style="width: 35%; text-align: center;"> Date <div style="display: flex; justify-content: space-around; align-items: center;"> <div style="border: 1px solid black; padding: 2px 5px;"> </div> <div style="font-size: 24px;">/</div> <div style="border: 1px solid black; padding: 2px 5px;"> </div> <div style="font-size: 24px;">/</div> <div style="border: 1px solid black; padding: 2px 5px;"> </div> <div style="border: 1px solid black; padding: 2px 5px;"> </div> <div style="border: 1px solid black; padding: 2px 5px;"> </div> </div> </div> </div>	



Department of
Environmental
Conservation

NYS Department of Environmental Conservation
Division of Water
625 Broadway, 4th Floor
Albany, New York 12233-3505

MS4 Stormwater Pollution Prevention Plan (SWPPP) Acceptance Form

for

Construction Activities Seeking Authorization Under SPDES General Permit

*(NOTE: Attach Completed Form to Notice Of Intent and Submit to Address Above)

I. Project Owner/Operator Information

1. Owner/Operator Name:

2. Contact Person:

3. Street Address:

4. City/State/Zip:

II. Project Site Information

5. Project/Site Name:

6. Street Address:

7. City/State/Zip:

III. Stormwater Pollution Prevention Plan (SWPPP) Review and Acceptance Information

8. SWPPP Reviewed by:

9. Title/Position:

10. Date Final SWPPP Reviewed and Accepted:

IV. Regulated MS4 Information

11. Name of MS4:

12. MS4 SPDES Permit Identification Number: NYR20A _____

13. Contact Person:

14. Street Address:

15. City/State/Zip:

16. Telephone Number:

MS4 SWPPP Acceptance Form - continued

V. Certification Statement - MS4 Official (principal executive officer or ranking elected official) or Duly Authorized Representative

I hereby certify that the final Stormwater Pollution Prevention Plan (SWPPP) for the construction project identified in question 5 has been reviewed and meets the substantive requirements in the SPDES General Permit For Stormwater Discharges from Municipal Separate Storm Sewer Systems (MS4s).
Note: The MS4, through the acceptance of the SWPPP, assumes no responsibility for the accuracy and adequacy of the design included in the SWPPP. In addition, review and acceptance of the SWPPP by the MS4 does not relieve the owner/operator or their SWPPP preparer of responsibility or liability for errors or omissions in the plan.

Printed Name:

Title/Position:

Signature:

Date:

VI. Additional Information

APPENDIX 16

CONSTRUCTION WASTE

MANAGEMENT & SPILL

PREVENTION PLANS

CONSTRUCTION WASTE MANAGEMENT & SPILL PREVENTION PLAN

Early in the construction activities, land clearing materials will be collected and recycled either off site or re-used on site as erosion control materials. During early phase construction activities, cardboard, concrete, metal, wood and general trash collection dumpsters will be on site for collection and processing. As the project progresses, concrete dumpsters will be changed over to drywall collection, site clearing dumpsters will be changed over to finish material containers, etc. Typically, (4) open top containers will be on site for the duration of the project. General waste and cardboard/paper containers will be on site for the duration of the project. The contractor will be responsible for organizing and placing containers on site and timely removal/replacement when containers are filled to capacity. As necessary, the contractor will provide areas of collection or hoppers for subcontractors to utilize for intermediate storage of construction and demolition (CD) materials. All containers will be clearly identified with signage indicating stored materials.

Those CD materials generated on this project will be salvaged and re-processed as listed. The contractor will research available processing sources specific to the job site and make all trades aware of project qualifying CD recyclable materials as follows:

Brick: Materials will be stored on site and palletized by processor who will resell as product.

Cardboard: Materials will be separated on the jobsite and stored within dedicated on-site dumpster and delivered loose to processor. Processor will bale materials and deliver/resell to end market users.

Concrete: Scrap and loose materials will either be crushed on site and used for aggregate or stored within dedicated on-site dumpster and delivered to processor. Processor will reuse or resell materials as clean fill back or crush and use for aggregate.

Metals: Materials will be sorted and stored within dedicated on-site dumpster and delivered to processor. Processor will sell materials to metal recyclers (steel, aluminum, brass, copper, lead, stainless).

Stone and Granite: Materials will be collected on site in piles or containers and processor will palletize and haul materials. Processor will re-sell as product or crushed and use as aggregate.

Plastic, paper goods, and aluminum cans: Materials will be collected on job site within construction trailers, cantina areas, etc. and stored in on-site trailers. Materials will be hauled/recycled by processor.

Drywall: Waste materials will be sorted and collected in dedicated on-site containers or materials will be ground on site and used as an erosion control product. Hauled materials to processor will be processed as a soil amendment or used in alternate fuel mixture.

Wood or Lumber: Materials will be sorted and stored on-site within dedicated on-site containers and either resold as retail lumber by processor or ground and mixed with commercial land

clearing and/or approved materials for erosion control applications. Lumber will need to be clean, no paint or other wood treatment.

Land Clearing Debris: Woody materials (stumps, large limbs) will be ground on-site and used for soil erosion control products or hauled to processor to be ground as re-sold as erosion control products.

Roofing Shingles: Materials will be stored on site and processed as temporary road base, mixed into hot asphalt mix or used as alternate fuel blend or hauled offsite via appropriate methods to an authorized disposal/recycling facility.

Fuel Tanks: On site storage of fuel chemicals shall be equipped with a spill kit. The contractor must provide secondary containment for storing any hazardous chemicals on site.

Equipment storage: All equipment stored on site shall be inspected daily by the contractor for any oil or lubricant spills or leaks. Any leaks shall be repaired immediately. In addition all equipment must be closely inspected prior to working in the Village R.O.W.

Spill Response: All petroleum spills that occur within New York State must be reported to the NYS Spill Hotline (1-800-457-7362) within 2 hours of discovery, except spills which meet **all of the following criteria:**

1. The quantity is known to be less than 5 gallons; and
2. The spill is contained and under the control of the spiller; and
3. The spill has not and will not reach the State's water or any land; and
4. The spill is cleaned up within 2 hours of discovery.

A spill is considered to have not impacted land if it occurs on a paved surface such as asphalt or concrete. A spill in a dirt or gravel parking lot is considered to have impacted land is reportable.

Hazardous Material Spills & Waste: Materials deemed to be hazardous (ie, antifreeze, fertilizers, paint, pesticides), as defined by State and Federal regulations, shall be stored in their approved containers, and maintained in good condition. All spills of hazardous materials shall be cleaned sufficiently, in accordance with all State and Federal regulations, and documented accordingly. All hazardous material waste shall be properly collected, handled and transported to an approved hazardous waste processing facility.

This Plan will be displayed in the construction jobsite trailer at all times.

APPENDIX 17

NEW YORK STATE

RECREATION AND HISTORIC

PRESERVATION

DETERMINATION



**New York State
Parks, Recreation and
Historic Preservation**

KATHY HOCHUL
Governor

ERIK KULLESEID
Commissioner

December 4, 2023

Jane Samuelson
Professional Engineer
Engineering & Surveying Properties
71 Clinton Street
Montgomery, NY 12549

Re: SEQRA
Sheffield Gardens: Subdivision and Multi-use Development
State Route 17K, Montgomery, NY 12549
23PR02059

Dear Jane Samuelson:

Thank you for requesting the comments of the Division for Historic Preservation of the Office of Parks, Recreation and Historic Preservation (OPRHP). We have reviewed the submitted materials in accordance with the New York State Historic Preservation Act of 1980 (section 14.09 of the New York Parks, Recreation and Historic Preservation Law). These comments are those of the Division for Historic Preservation and relate only to Historic/Cultural resources. They do not include potential environmental impacts to New York State Parkland that may be involved in or near your project.

OPRHP has reviewed the Phase IB Archaeological Survey report for the Sheffield Gardens: Subdivision and Multi-use Development project (23PR02059) prepared by TRACKER Archaeology, Inc., Consulting Archaeologists (August 2023; 23SR00607). OPRHP concurs with the report recommendation that no additional archaeological investigation is warranted.

Based upon this review, it is OPRHP's opinion that no properties, including archaeological and/or historic resources, listed in or eligible for the New York State and National Registers of Historic Places will be impacted by this project.

If you have any questions, I can be reached at Bradley.Russell@parks.ny.gov.

Sincerely,

Bradley W. Russell, Ph.D.
Historic Preservation Specialist - Archaeology